



University of Massachusetts Lowell Alternative Energy Master Plan

June 30, 2021

DRAFT

Contents

1	Executive Summary	4
	Plan Goals	5
	Roadmap to Carbon Neutral	6
	Implementation Timeline	7
2	Metering and Data Management	8
	Energy Metering Overview	9
	Data Management Overview	9
	Energy Metering Analysis	10
	Campus Energy and Emissions	12
	Campus-by-Campus Energy and Emissions	13
	Building Use Energy and Emissions	16
	Solar Photovoltaic Generation	18
	Building Rankings	19
	Data Omissions and Anomalies	23
	Data Management Analysis	24
	Metering Data Management	24
	BMS Trend Data Management	25
	Campus Living Lab Opportunities	25
	Summary	27
3	30-Year Forecast	28
	30-Year Energy and Emissions Analysis	30
	Overview	30
	EIA New England Assumptions	30
	UML-Specific Assumptions	31
	30-Year Energy and Emissions Forecast	35
	Data Omissions and Anomalies	36
	Summary	36
4	Default-Alternative Analysis	37
	Default Case Overview	38
	Alternative Case Overview	38
	Default Case	40
	Electrical Services Reliability Assessment	40
	Steam Reliability Assessment	41
	Current and Future Electricity Rates	41
	Alternative Case	44
	Energy Efficiency Measure Descriptions	44

Alternative Energy Measures Descriptions.....	62
Pilot Building Descriptions.....	69
North Campus Energy Efficiency Results.....	77
North Campus Plant Alternatives.....	91
North Campus Life-Cycle Cost Analysis.....	100
South Campus Energy Efficiency Results.....	103
South Campus Plant Alternatives.....	115
East Campus Energy Efficiency Results.....	117
East Campus Plant Alternatives.....	132
On-site Renewable Solar Analysis.....	134
Assessing Alternative Strategies.....	156
5 Investment Plan.....	158
Implementation Timeline.....	160
Financial Investment.....	163
Improved Resiliency.....	165
Energy, Emissions, EUI Results.....	166
Summary.....	173
6 Appendices.....	174
Appendix A – Work Plan.....	175
Appendix B – RFI Log.....	190
Appendix C – Space Types.....	206
Appendix D – Solar Photovoltaic Generation Supplemental Information.....	208
Appendix E – Building Scores.....	209
Appendix F – Metering Sources by Building.....	214
Appendix G – EIA New England Data.....	215
Appendix H – Building Cooling Equipment.....	217
Appendix I – UML Enrollment Data.....	219
Appendix J – UML Operating Revenue Data.....	220
Appendix K – Energy Forecast Data.....	221
Appendix L – Emissions Forecast Data.....	222
Appendix M – Site-by-site PV Modeling Results.....	223
Appendix N – Site-by-site BESS Requirements.....	228
Appendix O – Helioscope PV Production Models.....	231
Appendix P – Energy Toolbase Financial Analysis (Pilot Sites).....	348
Appendix Q – Building Timeline.....	407
Appendix R – Soft Cost Factors.....	408

DRAFT



1 Executive Summary

DRAFT

Executive Summary

The University of Massachusetts at Lowell (UML) has set an ambitious goal to achieve carbon neutrality by 2050. To progress toward this goal, UML collaborated with BR+A Consulting Engineers and Anser Advisory, building on previous success, to develop this Alternative Energy Master Plan (AEMP). The AEMP effort grew out of a multi-year strategic planning process and in support of campus sustainability objectives, legislative mandates, and university commitments. The AEMP will assist UML in achieving interim carbon reduction goals with the ultimate goal of carbon neutrality by 2050 while aligning multiple stakeholder groups across the campus. This report was developed through comprehensive engagement with many stakeholders, including the Office for Sustainability; Facilities Operations and Services; Planning, Design, and Construction; Business Development (E2i); Research and Innovation; DOER; DCAMM; National Grid; and representatives from UML Academics.

Plan Goals


The University of Massachusetts Lowell (UML) has six primary goals in developing a comprehensive campus Alternative Energy Master Plan:

1. Evaluate UML's existing energy and metering, data management systems, and data governance practices to establish accurate usage and demand baselines, and to analyze onsite electricity and steam production, building-level performance, and campus-level energy performance on an ongoing basis;
2. Forecast the primary campus' annual energy demands between 2020 and 2050;
3. Identify, scope and estimate specific energy sources and/or energy savings opportunities that can meet the campus' growth over the next 30 years in a resilient, cost effective, and sustainable manner;
4. Identify and design energy sources and energy savings opportunities that can enable UML to meet the sustainability targets mandated under Executive Order 484 and the campus' carbon neutrality goals under the American College & University President's Climate Commitment in a reliable, cost effective manner;
5. Identify physical infrastructure, operating systems (mechanical, administrative, etc.), advantages and constraints for each identified location, and costs in order for UML to implement or upgrade recommended energy strategies to meet the campus' resiliency, utility cost, and sustainability objectives; and
6. Propose mechanisms for stakeholder engagement (students, faculty, staff, and broader community) throughout the planning process that offers opportunities for students and faculty to engage in planning, hands-on projects, and activities associated with the renewable energy goals.


Roadmap to Carbon Neutral

This proven roadmap to carbon neutral builds on UML's successful Alternative Energy Project (AEP) load reduction, then applies electrification technologies to shift off of fossil fuels, and then offsets the remaining energy consumption with renewables:

1. **Energy efficiency.** The roadmap starts with developing a set of energy targets. Energy conservation measures (ECMs) are then applied to meet these targets prioritizing those buildings with the highest scores. Investment in energy efficiency reduces loads and thereby reducing the size and cost of plant and electrification infrastructure.
2. **Electrification.** After sufficient load reduction is achieved, then proven alternative energy measures (AEMs) are applied to further reduce energy consumption and reliance on fossil fuels for heating. The North Plant will be transitioned from a steam-based heating system to a low-temperature hot water heating system. The South and East campus buildings will rely on standalone, electrified plants.
3. **Renewables.** After all the energy is squeezed out of the campus, a carbon offset purchase would be required to meet carbon neutrality if the Massachusetts electricity grid is powered by anything less than 100% renewable energy. After review with UML, onsite solar PV can be deployed to reduce operating costs, but is not a critical strategy to reducing emissions given current regulation on renewable energy credit (REC) ownership and the critical role that the sale of RECs play in the economic feasibility of these types of projects.

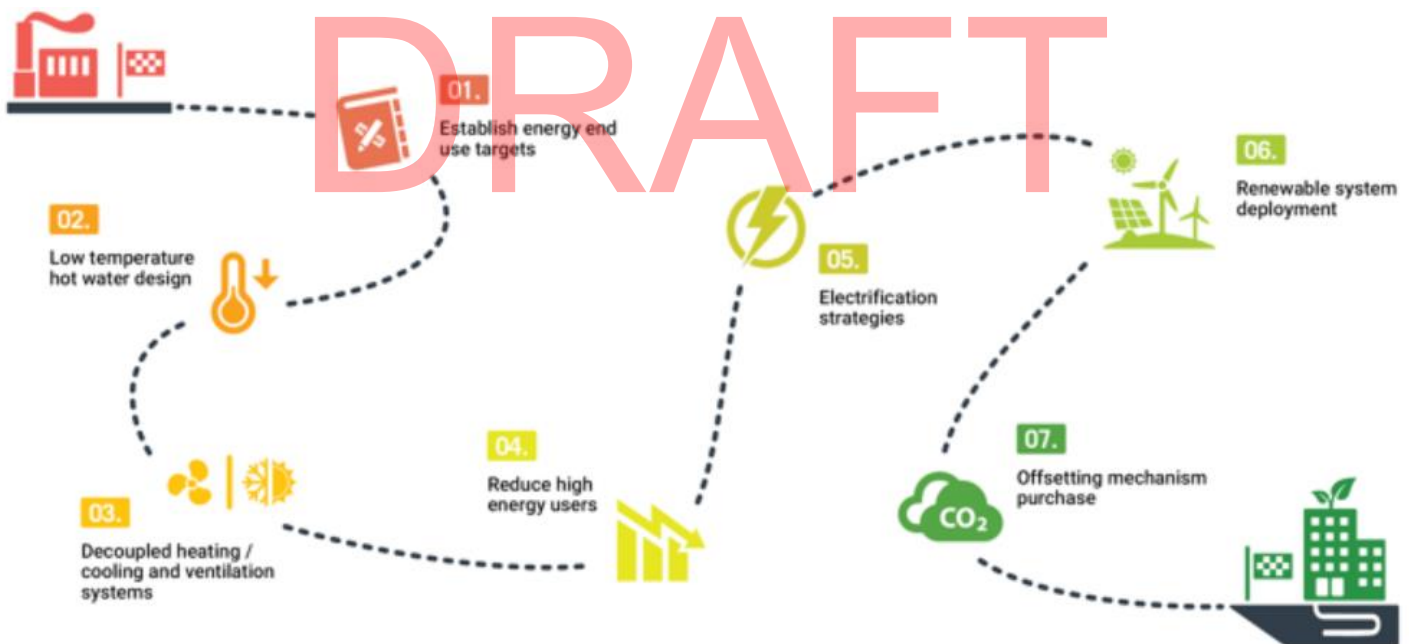


The Selected Scenario results in significant reductions in energy and emissions. This creates a pathway towards carbon neutrality by 2050 as well as achievement of Executive Order 594 and Executive Order 484 requirements. The Selected Scenario is estimated to reduce building emissions 85% compared to emissions in 2004. About half of this reduction is the result of grid emission reductions.

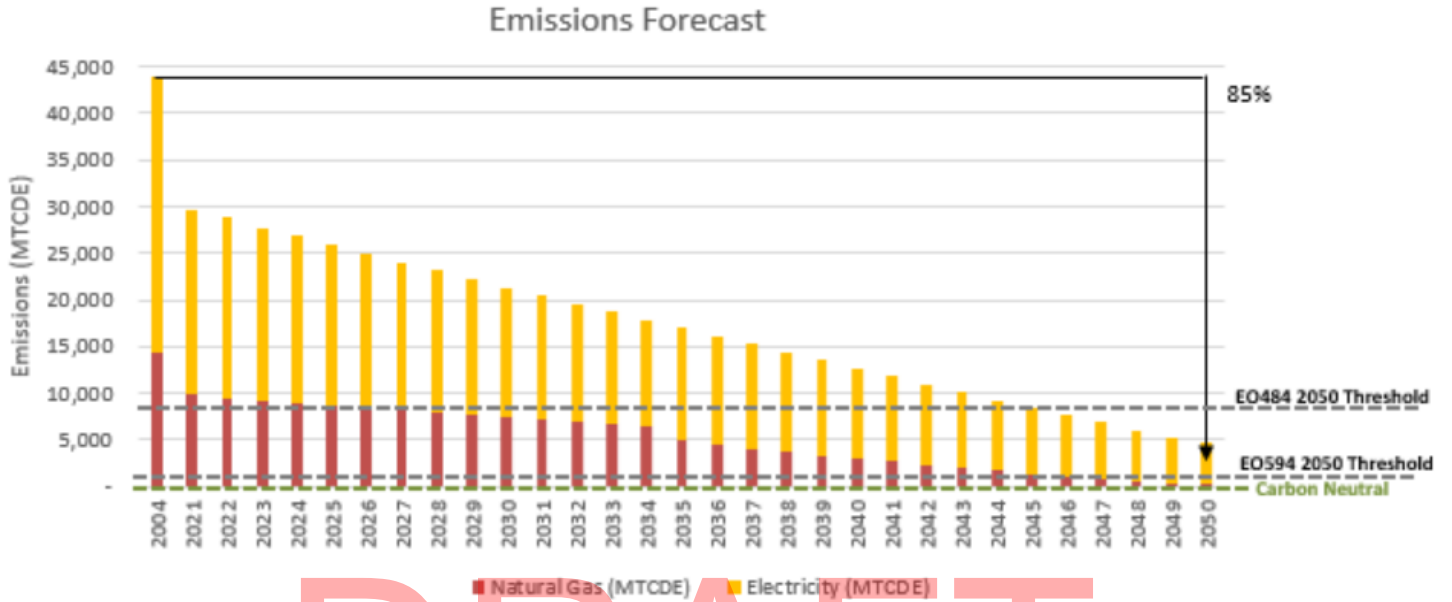

DRAFT

Implementation Timeline

The timing of energy efficiency and alternative energy projects are prioritized based on building score and expected central plant infrastructure useful life. Energy efficiency projects for buildings on the North Campus are prioritized in order to reduce loads ahead of new central plant upgrades. The South Campus building energy efficiency and alternative energy projects would be prioritized next ahead of retiring the South Plant central plant assets while maximizing their useful life. Buildings on the East Campus would also consist of standalone heat pump heating/cooling plants.

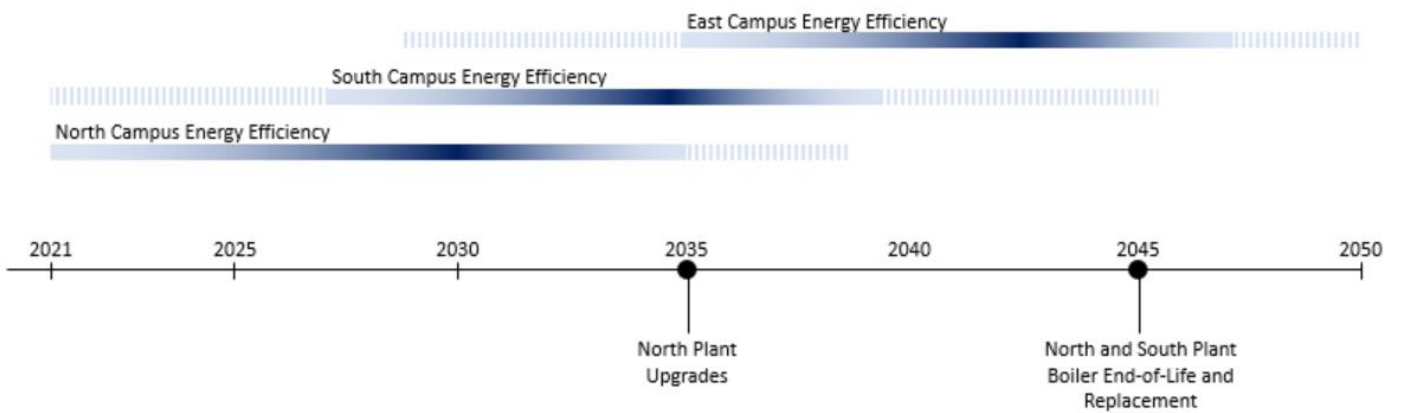



2 Metering and Data Management

DRAFT

Metering and Data Management

Energy Metering Overview

Metering is not only a means for billing energy consumption. It serves as a powerful tool to identify where UML should make alternative energy investments that offer the most cost effective solution. BR+A aggregated metering information from multiple sources in order to identify these opportunities. Buildings are prioritized based on key criteria: actual energy use intensity, energy consumption change over time, target energy use intensity (based on building type), combustion energy consumption, and facility condition. Buildings that rank highest in these criteria are assumed as ideal candidates to pilot alternative energy projects. A candidate from each of the core building use types (lab, office/classroom, residential) has been recommended for UML evaluation and sign-off. Olney Hall is the candidate for lab, Ball Hall is the candidate for office/classroom, and Sheehy Hall is the candidate for residential.

Data Management Overview

Adequate data management is critical for tracking carbon goals, identifying energy waste, and fostering a living lab campus. Metering data must be usable and easily accessible to track UML's 2050 carbon neutral goal and the impact of alternative energy projects. UML currently uses several metering platforms. BR+A recommends centralizing metering under a single platform to streamline carbon reporting efforts.

Building management system (BMS) trend data helps to identify systems not operating at their optimal efficiency. Current UML BMS trend data intervals and sampling storage practices are limited such that trend data cannot be used as a tool to troubleshoot issues. Near term changes to reduce trend intervals and increase the maximum number of samples for all building types can help UML Facilities better understand how their buildings are operating. Impacts to network traffic and storage requirements should be reviewed on a project-by-project basis with UML Information Technology. Cloud-based automated fault detection systems can help reduce BMS or on-site storage requirements, as well as support UML Facilities in identifying energy waste problems and solutions.

More granular metering and monitoring practices can also help foster a living lab campus. Implementation of alternative energy projects offer opportunities for faculty, students, and staff to confirm proper operation, verify energy savings, and, in some cases, improve system operation. As alternative energy projects are implemented, end-use energy submetering should be explored to better understand energy increases. In office/classroom buildings, a physical energy dashboard can empower occupants to change their behavior in the spaces they use. In residential buildings, web-based dashboards can help inform students on how their dorm building "stacks up" against one another. In lab spaces, deployment or future-proofing for circuit-level metering can unlock opportunities to conduct energy competitions at the individual lab level as well as expand research on lab consumption loads. These practices are intended to be cost-effective with more granular living lab deployment prioritizing high energy building types.

Energy Metering Analysis

BR+A reviewed and aggregated building-by-building, campus-by-campus, and whole campus energy metering information into an Excel-based tool in order to understand how energy and carbon are used on campus. Building information such as use type, built/renovation date, energy meter data, and facility condition information was obtained from UML. With this information, energy use intensity, energy consumption change over time, total combustion energy, and a facility condition rating were calculated. Buildings were scored/ranked based on usage and aging systems. Buildings that rank highest in these criteria are assumed as the ideal candidates to pilot alternative energy projects.

In the absence of building end-use submetering, typical energy end-use profiles were applied to each building based on use type and system type. This helped the team understand how each building may use energy for heating, cooling, pump, fan, domestic hot water, interior lighting, and plug loads. This information can then be used as part of the Alternative Analysis phase to prioritize projects that target the highest end-uses. Also, this information was organized by campus – North, South, and East – to better understand energy loads and, therefore, potential opportunities for energy recovery and centralized plant solutions.



Whole campus energy data was reviewed for change over time and utility energy breakdowns. Patterns in energy change over time data will help inform the 30 Year Forecast phase of the project. Breakdowns of total campus energy into electricity and natural gas will help inform the 30 Year Forecast and the Alternatives Analysis. Grid electricity from renewable sources is anticipated to increase based on the Massachusetts (MA) Clean Energy Standard (CES). This will help reduce emissions on campus. This will be reflected in the 30 Year Forecast. A discussion is required between UML, BR+A, and Anser to understand how the MA CES may influence project prioritization as part of the Alternatives Analysis phase.

Building Use Types

Buildings of similar space type are anticipated to have similar energy and carbon emissions. Therefore, it's important to define each building's use type to enable an apples-to-apples comparison and identify the highest consumers. First, buildings were defined by their use type: office, classroom, high-use lab, engineering lab, residential, fitness center, performance, garage, plant, library, greenhouse, maintenance, ice rink, recreation, and conference center. The use type with the greatest square footage is classroom. High-use labs are anticipated to be exhaust driven and have high outside air requirements resulting in higher energy consumption than engineering labs where air may be recirculate recirculated. Residential and office were further defined if they contained commercial cooking, as their energy consumption/carbon emissions are anticipated be higher than a building without. These space types were rolled up into three core use types based on anticipated energy end-use breakdown and anticipated alternative energy projects: lab, office/classroom, and residential. The core use type with the greatest square footage is office/classroom.

Buildings with unique energy end-use breakdowns and/or low energy consumers are organized into an "Other" category. Use types organized into "Other" include garage, greenhouse, maintenance, and ice rink. High consumers will require specialized alternative energy project approaches. Buildings defined as "plant" (North Power Plant and South Power Plant) were omitted from this list as to not duplicate steam energy consumption metered at the building level.


Appendix C contains a list of how each building was defined.

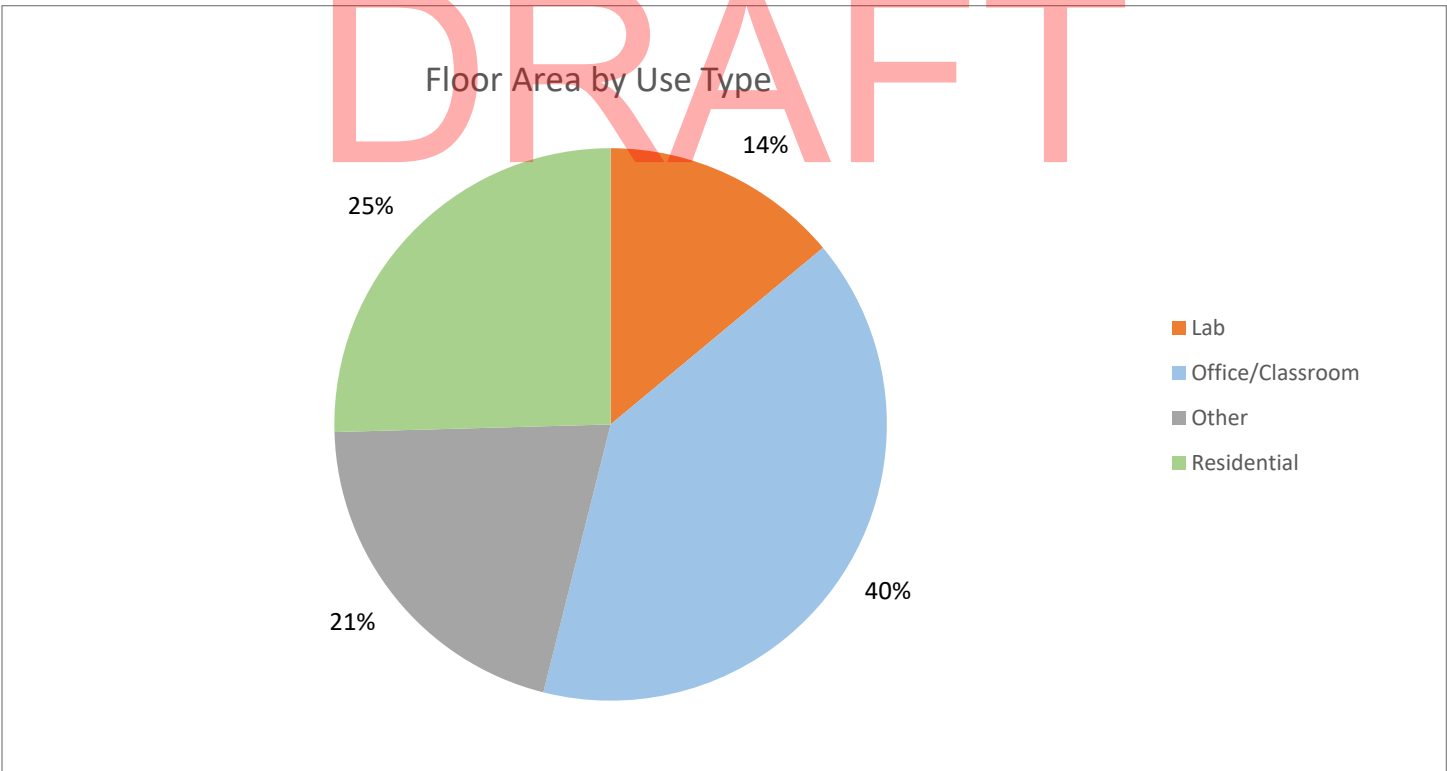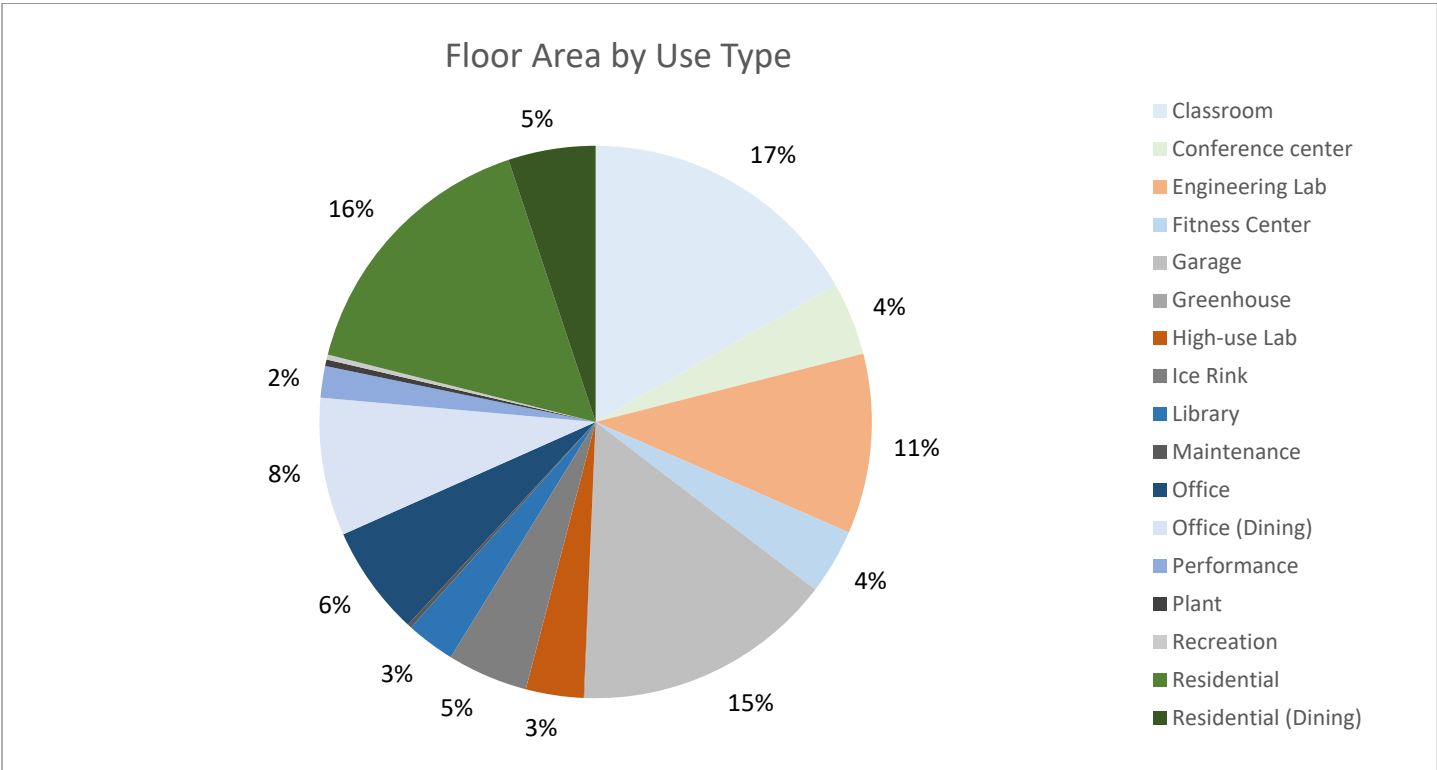


Campus Energy and Emissions

The intent of analyzing total campus metered energy data is to develop a baseline for the “30-Year Forecast” phase. The charts below compare total energy and total emissions year-over-year. The raw data used to develop this analysis was provided by UML via Competitive Energy Solutions’ reports. Reports were limited to only providing total campus energy from 2017 (partial), 2018, 2019, and 2020 (partial). For the purposes of this analysis, 2020 data was omitted given assumed non-normal operation as a result of COVID-19.


Total campus energy and emissions are relatively consistent between 2018 and 2019. Energy was converted to carbon emissions using the following factors: 682 lbs/MWh electricity and 117 lbs/MMBtu natural gas. Natural gas energy is the largest utility end use. Grid electricity is the largest utility emission end use. However, a more detailed end use breakdown is required in order to better anticipate how alternative energy projects should be prioritized. This can be found under the “Building-by-building Energy and Emissions” section.

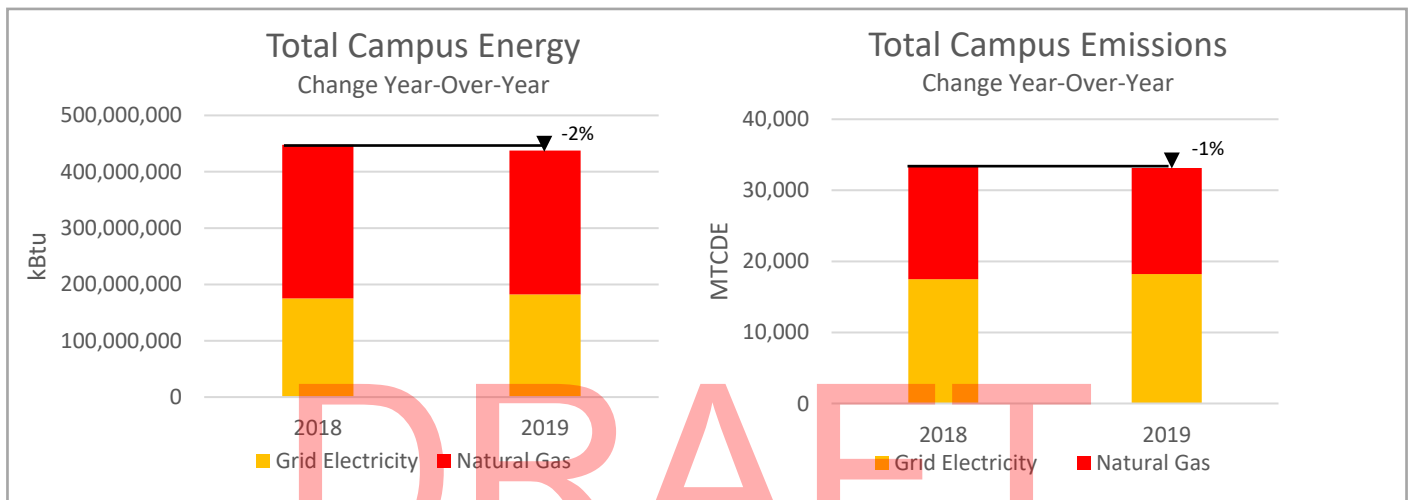

The charts below compare grid electricity energy and natural gas consumption year-over-year as it relates to cooling and heating degree days. Degree days are the number of hours during the year when heating or cooling is expected. The hypothesis is that grid electricity is correlated by cooling degree days (CDD) and natural gas is correlated to heating degree days (HDD). However, the data shows an inverse relationship. Grid electricity energy consumption increased even though CDD decreased 36%, and natural gas energy consumption decreased even though heating degree days increased 11%. This conclusion will have to be further reviewed with UML to better understand the relationship between campus energy consumption and weather.

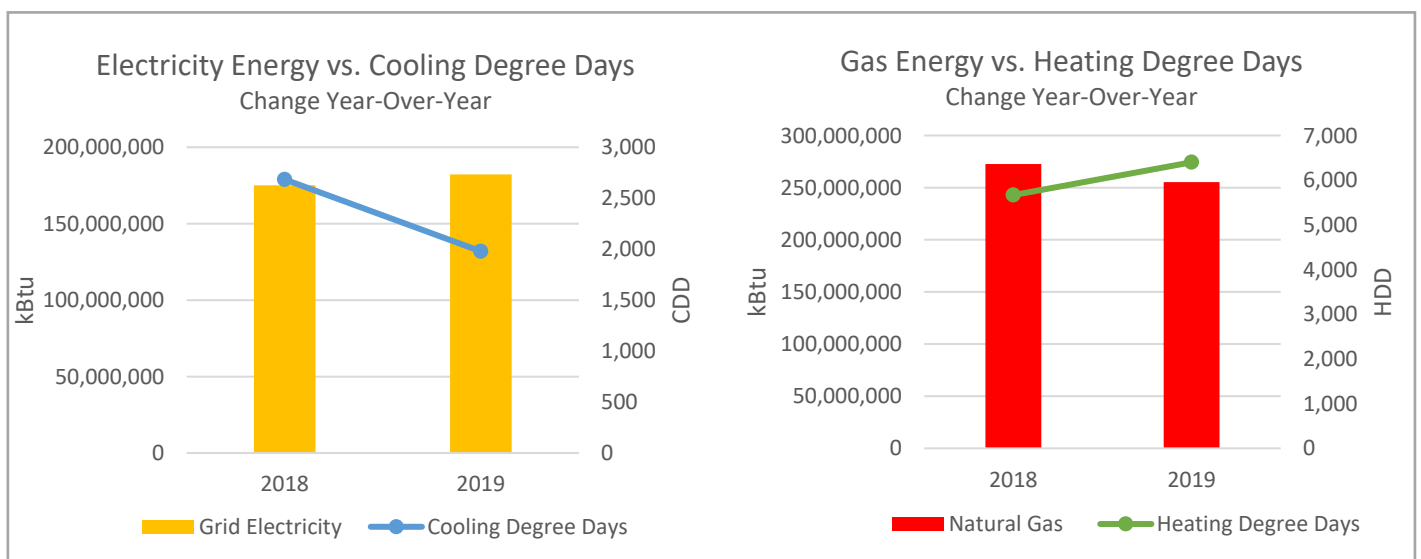

The chart below shows the hourly electricity demand of the entire Lowell Campus in 2019. The coincidental peak electricity demand of the campus is approximately 8 MW. The peak demand occurred on September 23rd and is approximately 1MW. This is likely driven by student move-in and weather (near design cooling day: 88°F max). Note that some high intensity buildings (i.e. Perry Hall, Pinanski Hall, and 110 Canal) do not have electricity demand information. Additional research will have to be conducted in order to estimate peak electricity demand in these buildings.

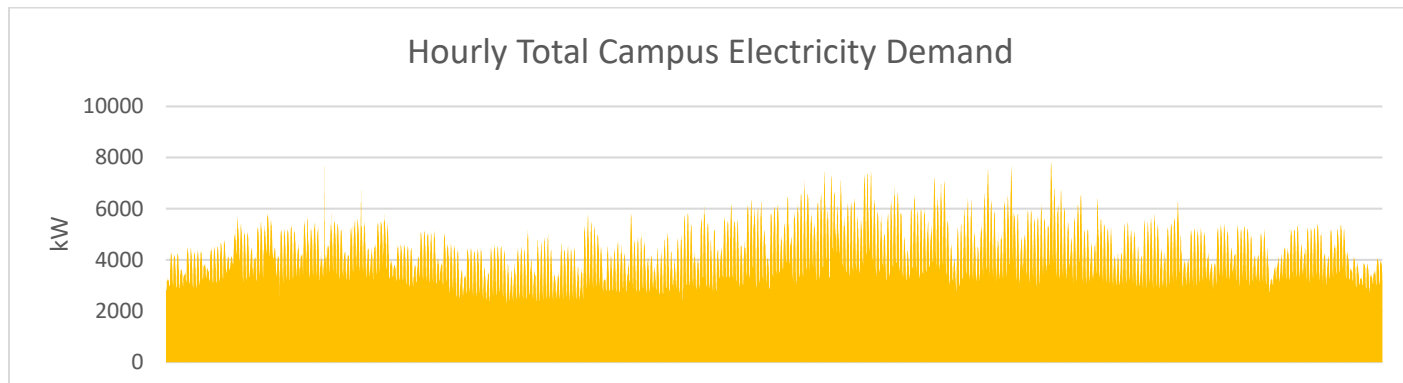


The UML 2012 Climate Action Plan established target goals for Scope 1 and 2 emissions by 2020 and 2030. The table below compares these targets to CY19 emissions for stationary and purchased electricity only. For the purposes of this comparison, it's assumed that the target goals used the same stationary (33.8%) and purchased electricity (27.1%) emission end use breakdown factors. A more detailed analysis showing this breakdown as well as emission factor assumptions would be needed to verify these findings. This delta between CY19 and FY2030 will help the team better understand how projects can be prioritized in order to meet the interim 2030 goal.




Time Frame	FY2011 (actual)	CY19 (actual)	FY2020 (target)	FY2030 (target)
Scope 1+2 Emissions	34,567 MTCDE	33,146 MTCDE	36,884 MTCDE	28,684 MTCDE

Campus-by-Campus Energy and Emissions

The Lowell Campus has three distinct campuses: North Campus, South Campus, and East Campus. The North Campus is primarily office/classroom, but has the largest presence of lab space on campus. The South Campus is primarily office and classroom, and the East Campus is primarily residential. The charts below do not include "satellite buildings" that are relatively near any of the three campuses. The charts below show the core use type breakdown of each campus.


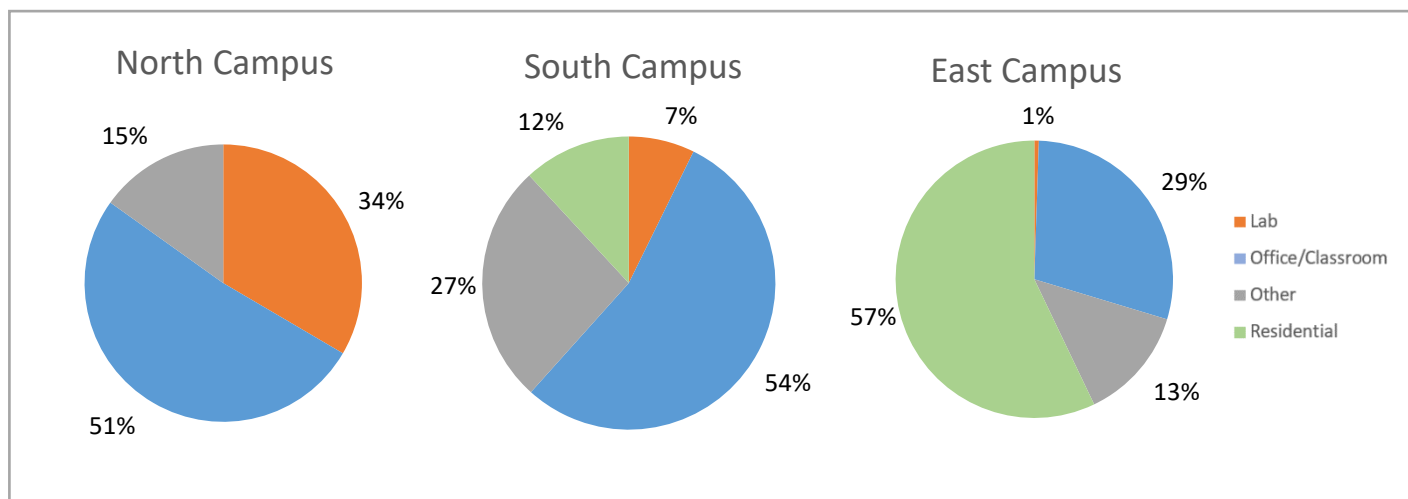


The charts below show the hourly electricity demand of each campus in 2019 broken down by core use type. The raw data used to develop this analysis was provided by UML via Hatch Data. The North Campus has the highest electricity demand of the three campuses, primarily driven by labs. The coincidental peak demand of the North Campus occurred on July 31st and is approximately 3.3MW. This is likely driven by coincidental loads in labs and weather (near design cooling day: 88°F max). The demand of the South Campus is driven by office/classroom. The coincidental peak demand occurred on September 21st and is approximately 1.5MW. This is likely driven by student presence on campus and weather (near design cooling day: 88°F max). The demand of the East Campus is driven by residential. The peak demand occurred on September 23rd and is approximately 1MW. This is likely driven by student presence on campus and weather (near design cooling day: 85°F max).

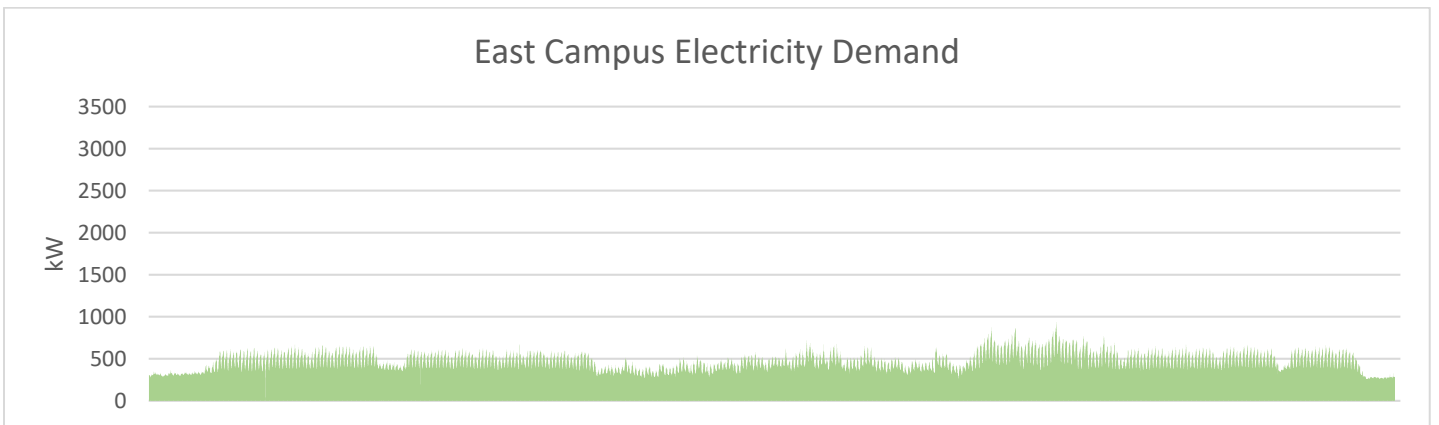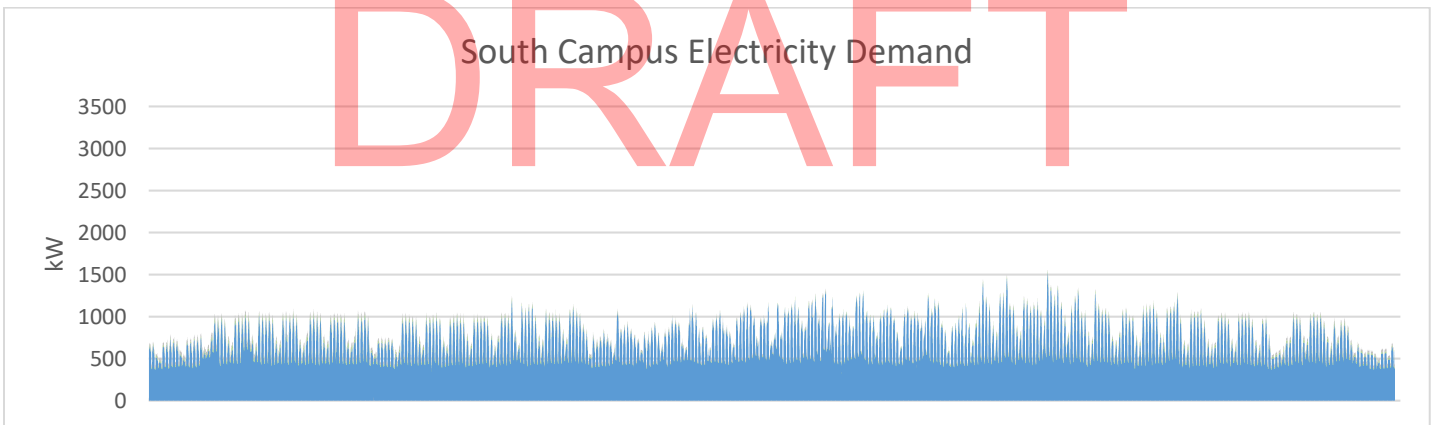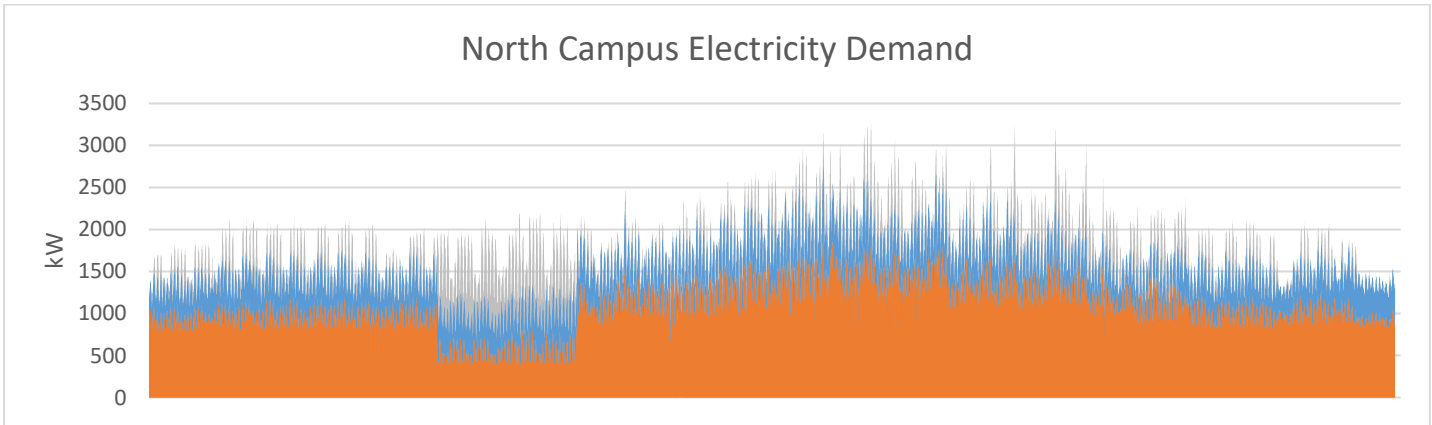


■ Lab
 ■ Office/Classroom
 ■ Other
 ■ Residential

The charts below show the hourly gas consumption for the North Plant and South Plant in 2019. The raw data used to develop this analysis was provided by UML via Hatch Data. The data for the North Plant's first half of the year is not available. Similar data gaps exist in the 2018 data. However, it is still assumed that the North Campus has a higher gas demand than the south campus, primarily driven by labs and increased, treated outside air. The peak hourly consumption of the North Campus occurred on December 20th and is approximately 1,045 boiler HP. The peak hourly consumption of the South Campus occurred on January 9th and is approximately 806 boiler HP. Both instances are expected to be weather dependent. The peak hourly consumption is significantly less than the estimated maximum plant capacity at both the North Plant and South Plant.

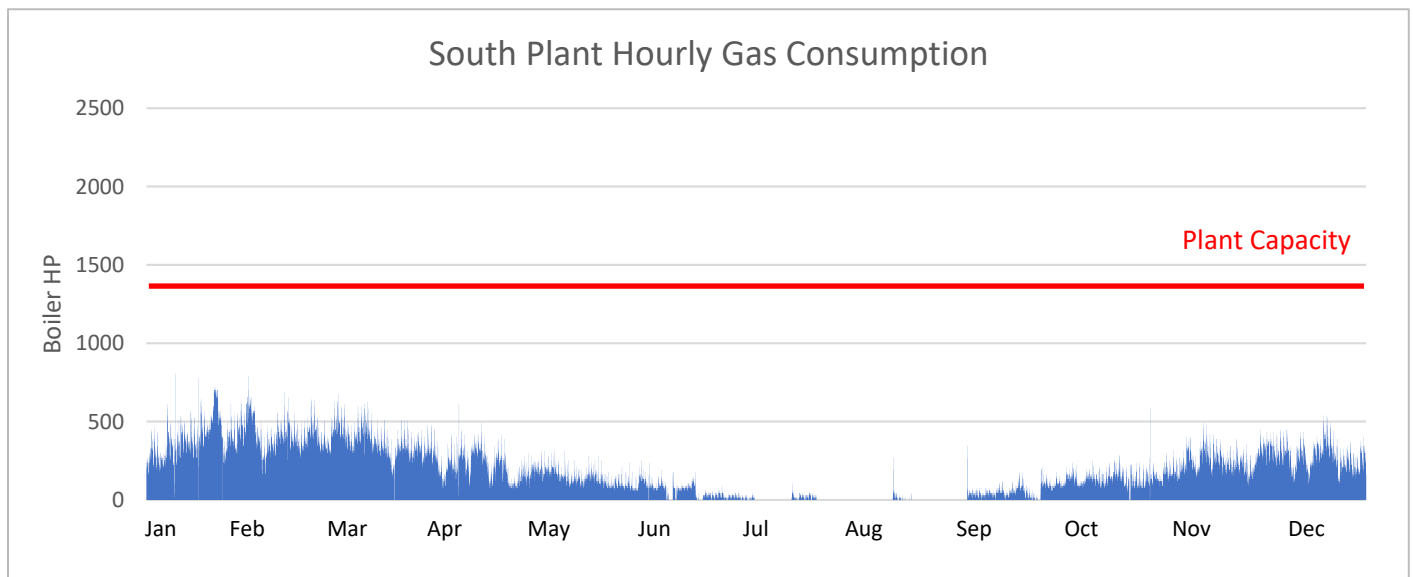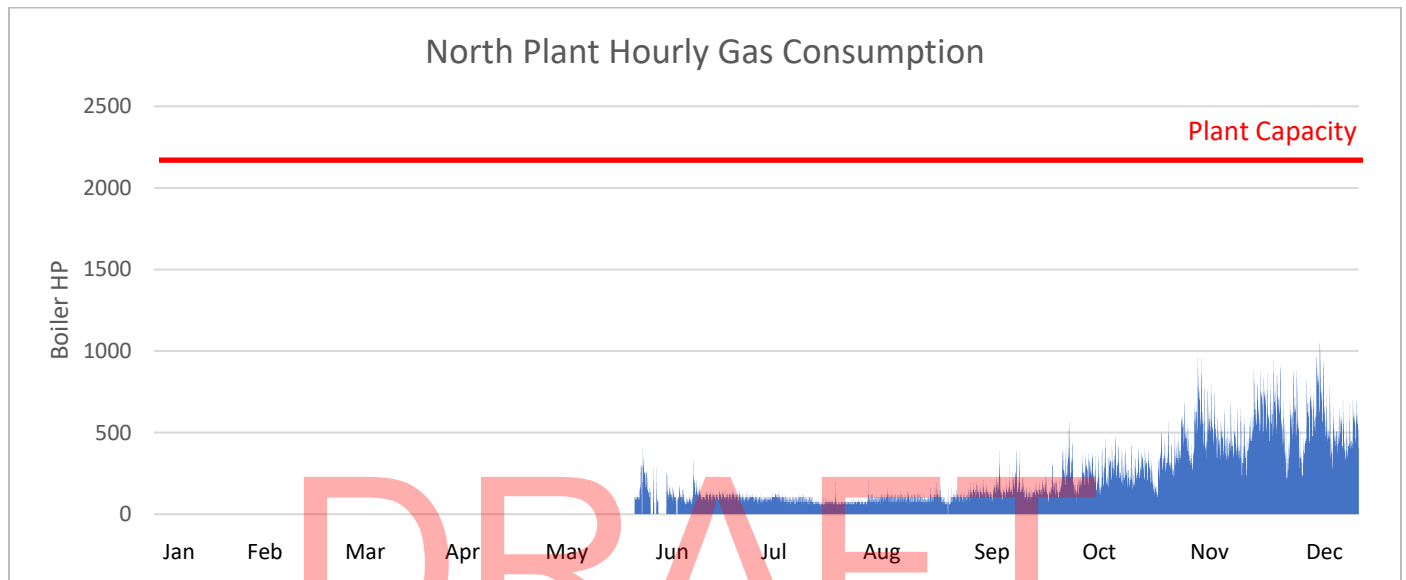


Building Use Energy and Emissions


The charts below compare core use type floor area as a percentage of total campus floor area and core use type emissions as a percentage of total campus emissions. Steam energy consumption has been adjusted to apply an 80% average boiler efficiency. This efficiency should be confirmed by UML. As noted above, the core use type with the greatest square footage is office/classroom. Office/classroom also contributes to the greatest number of emissions. However, lab emissions constitute almost a third of emissions even though labs makes up 14% of floor area. This data suggests that alternative energy projects should initially prioritize lab core use types as part of the Alternatives Analysis.

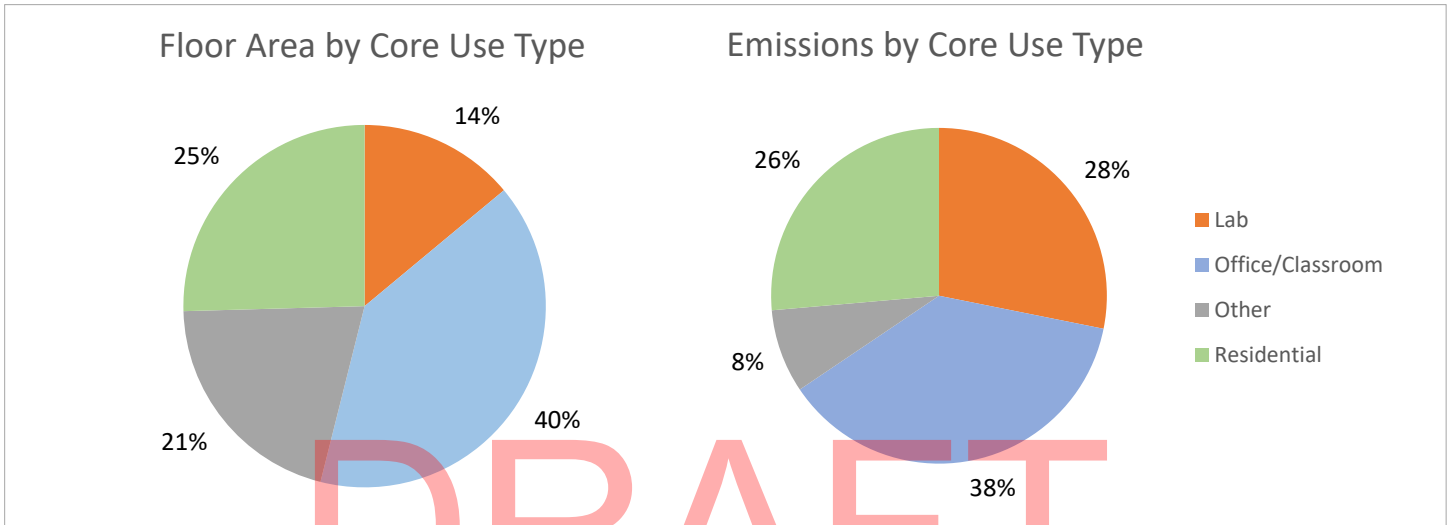


The charts below compare the ranges of energy use intensity (EUI) as a function of core use type. In general, lab spaces are the most dense energy consumers followed by office/classroom. Lab EUI ranges from 115 to 316 kBtu/sf. Office/classroom EUI ranges from 41 to 254 kBtu/sf. Residential EUI ranges from 58 to 120 kBtu/sf. Higher EUI residential buildings contain dining facilities. Outliers have been removed from this part of the analysis. See “Data Omissions and Anomalies” for more details.

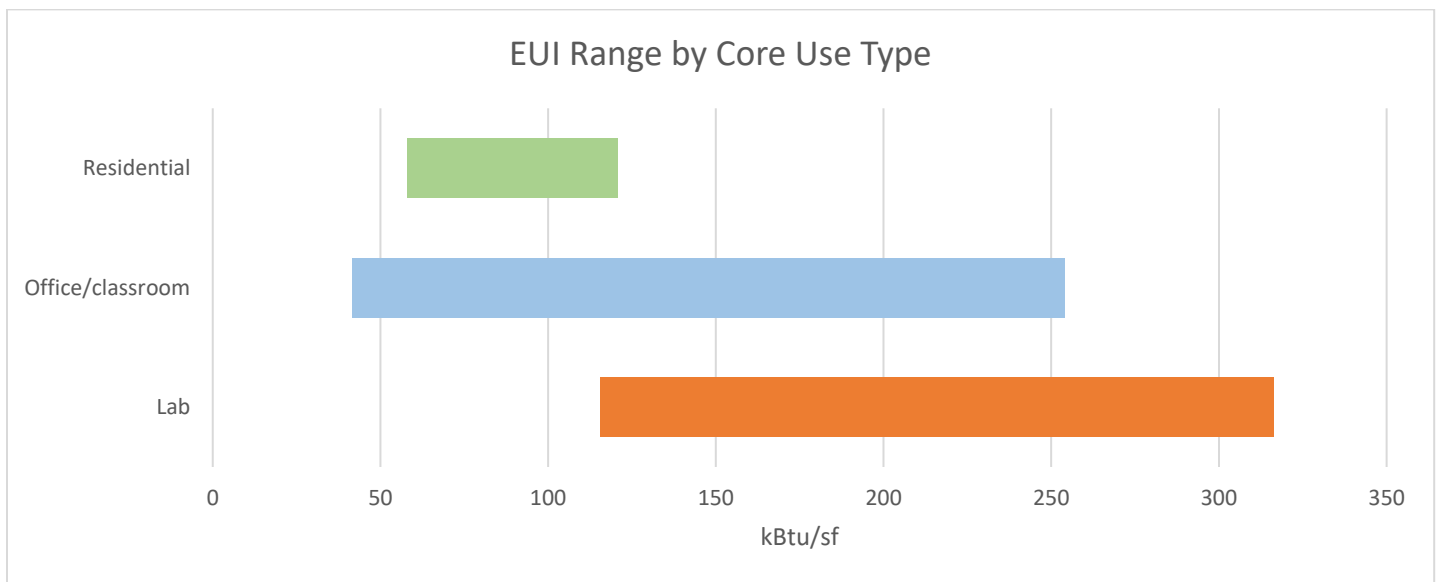

The chart below compares core use type fuel mix breakdown. The raw data used to develop this analysis was provided by UML via Hatch Data and the cumulative spreadsheet. Energy consumption by fuel type was aggregated for each building of each core use type in order to develop these profiles. The highest fuel type use in residential buildings is natural gas. The highest fuel type use for office is steam. This suggests that alternative energy projects should initially target natural gas reduction in residential and steam reduction in office/classroom. A closer look at estimated end-use breakdowns is required to understand more specifically what projects should be targeted in labs.

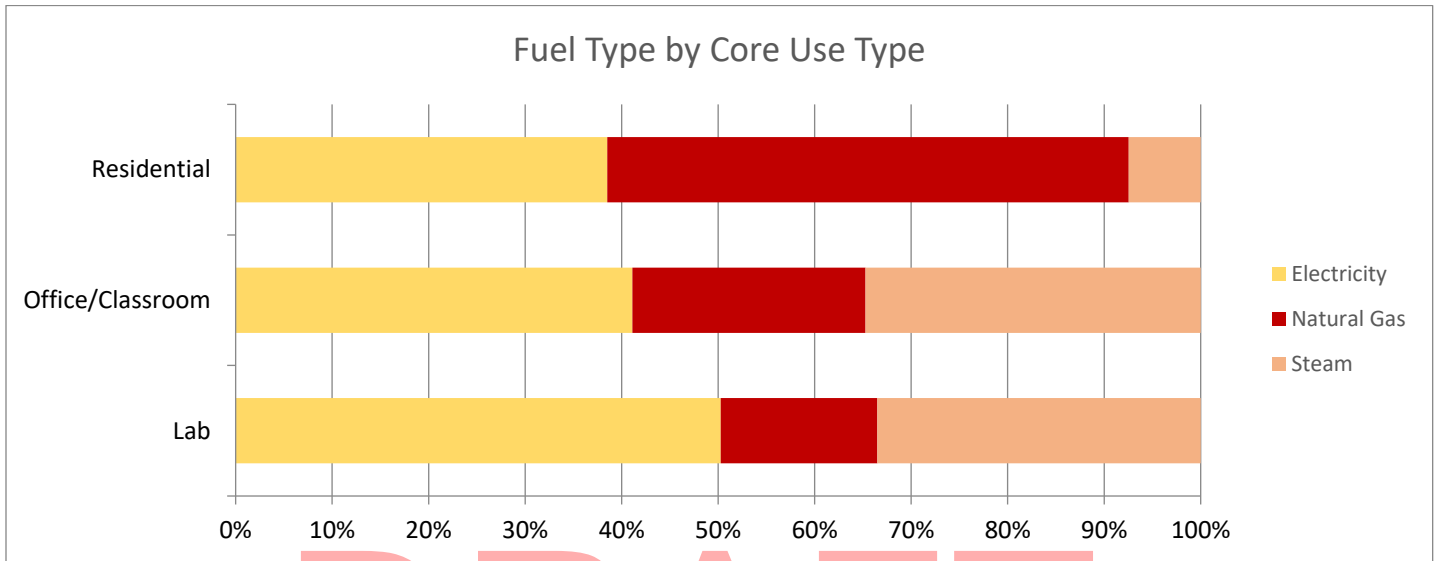

The chart below compares core use type end use emissions. The raw data used to develop this analysis was provided by UML via Hatch Data and the cumulative spreadsheet. End use breakdowns were estimated using typical end use breakdowns for core use type adjusted for UML building specific electricity-natural gas fuel mix. The highest energy end use for every core use type is space heating. This is to be expected given UML's climate. This data suggests that alternative energy projects should initially prioritize space heating reduction.


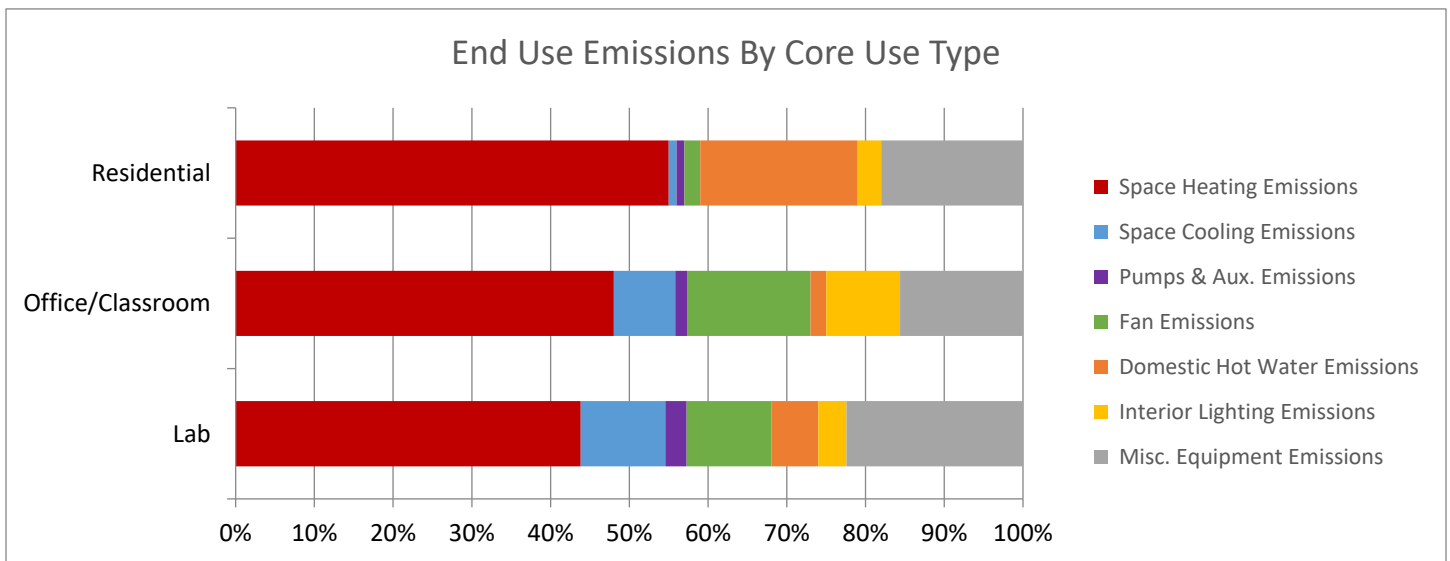


Solar Photovoltaic Generation

Solar photovoltaic (PV) electricity generation offset approximately 1% of campus electricity consumption in 2019. There are five solar PV arrays on campus: Bourgeois Hall (51kW), Costello Athletic Center (61kW), Dugan Hall (82kW), Leitch Hall (49kW), and South Parking Garage (154kW). The table below details these buildings' electricity consumption and generation. South Parking Garage energy consumption is not available. See "Data Omissions and Anomalies" for more details.

Building/Area	Electricity Consumption (kBtu)	Electricity Generation (kBtu)	Percentage Generation
Bourgeois Hall	1,096,613	147,808	12%
Costello Athletic Center	927,728	250,714	21%
Dugan Hall	2,519,844	280,569	10%
Leitch Hall	283,957	163,230	37%
South Parking Garage	n/A	784,521	n/A
Total Campus	137,511,835	1,626,842	1%



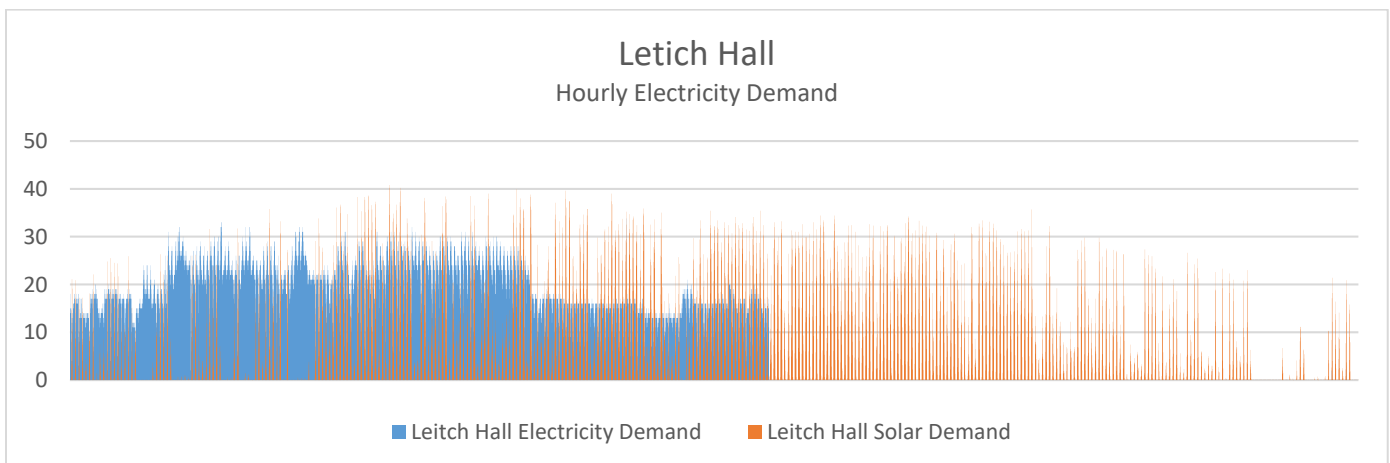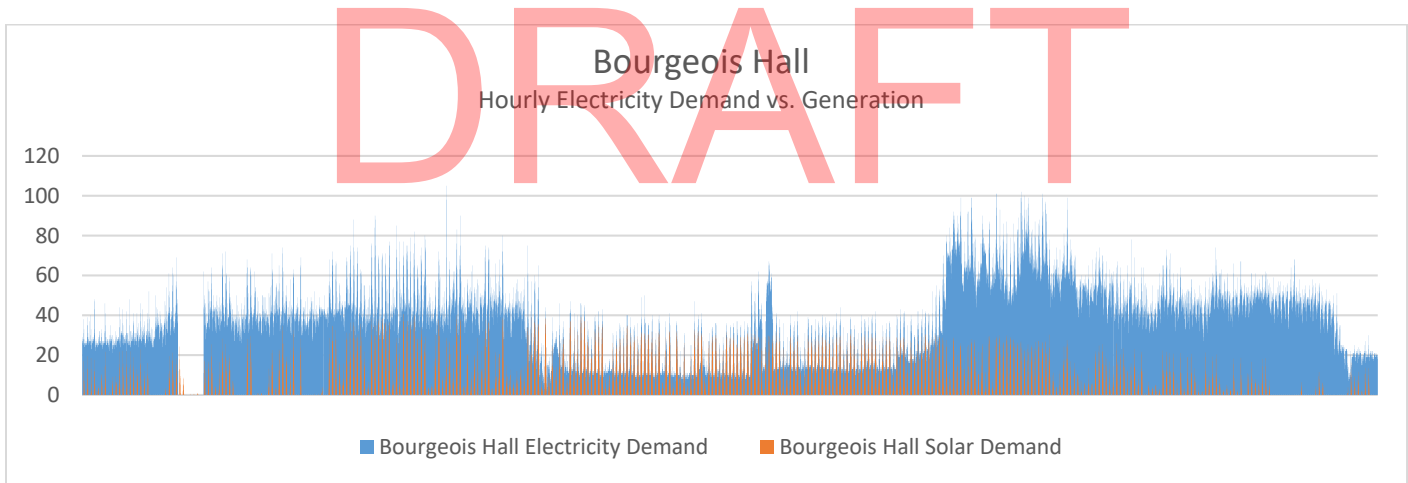





















The table graphs below compare hourly 2019 building electricity demand to solar PV generation. These analyses help to better understand microgrid and battery storage opportunities. For example, Bourgeois Hall solar generation rarely exceeds building demand. Inversely, Leitch Hall's solar generation often exceeds its building demand in the summer. This may be a higher priority candidate for microgrid and/or battery storage particularly given its variable building use. Similar profiles can be found in Appendix D for Costello Athletic Center and Dugan Hall.







Building Rankings
























Prioritizing the highest energy consumers for projects is the more cost effective strategy to achieving load reductions on campus. These buildings are ideal for pilots. The pilot project approach helps align multi-stakeholder decision-making and build momentum such that similar strategies can be applied across all core end uses. In order to help prioritize buildings that would be ideal candidates for pilot projects, buildings have been ranked across a set of key criteria: energy use intensity, energy change over time, energy use intensity target, combustion emissions, and facility conditions. The analysis below breaks down how buildings rank in each key criteria.





Energy Use Intensity (EUI) – Energy use intensity is a measurement of energy density – unit of energy per square foot. This helps conduct an apples-to-apples comparison of buildings of different sizes. Buildings with a higher EUI are ranked higher. Below is a summary of the highest ranked buildings in this key criteria. These rankings should be revisited once data omissions and anomalies are resolved, particularly those involving Pinanski Hall and UMASS Lowell Research Institute.

Building	Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Ames Building 	100 	0 	96 	60 	46 	100 	72 
Saab ETIC 	98 	0 	36 	88 	0 	100 	58 
McGauvran Center 	96 	0 	94 	79 	12 	100 	68 


 High priority
  Medium priority
  Low priority
  Incomplete/anomaly

Energy Change Over Time – Energy change over time can be an indicator that system operation may be becoming less efficient and/or that operational “band-aids” are leading to energy waste. Buildings with an energy increase between 2018 and 2019 are ranked higher. If a building decreased its energy use between 2018 and 2019, then a score of “0” was assigned under this key criteria. Below is a summary of the highest ranked buildings in this key criteria.

Building	Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Wannalancit Business Center 	54 	100 	64 	62 	22 	100	55 
Concordia Hall 	62 	96 	76 	54 	98 	0 	74 
East Parking Garage 	12 	94 	2 	0 	22 	0 	13 

 High priority
  Medium priority
  Low priority
  Incomplete/anomaly



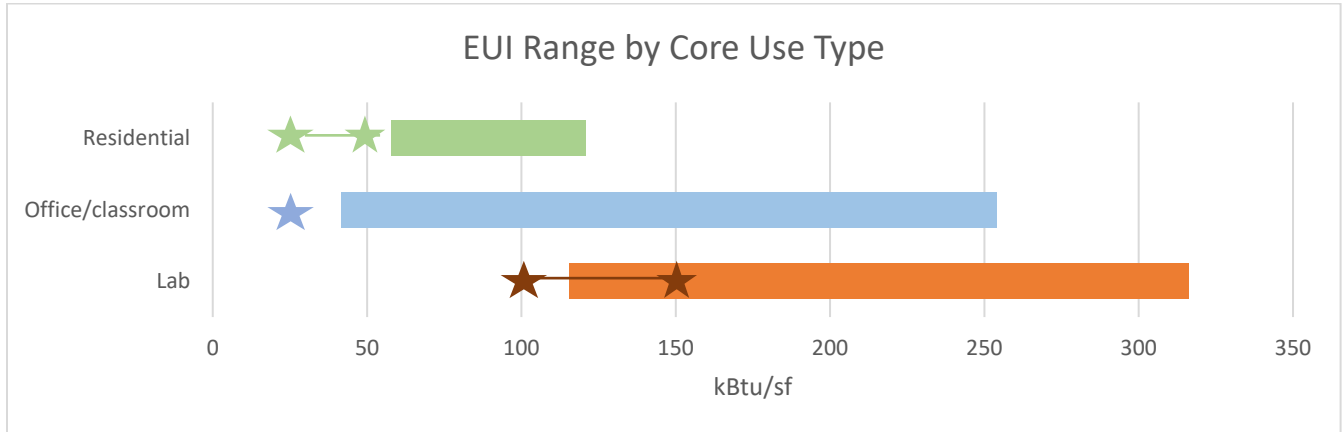





















Energy Use Intensity Target – Load reduction strategies are the first step toward a carbon neutral future. Load reduction strategies significantly reduce EUI. Based on building end use, BR+A has established a target EUI for load reduction strategies based on our experience and The U.S. Department of Energy’s Energy Information Administration’s (EIA) Commercial Building Energy Consumption Survey (CBECS) data. The higher a building’s 2019 EUI is from the target, the higher it is ranked. Below is a summary of the EUI ranges across core end uses relative to their associated EUI targets as well as highest ranked buildings in this key criteria. More information is required to better understand how maintenance facilities are used on campus. This will be reviewed during BR+A’s site visits.



Building	Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Ames Building	100	0	96	60	46	100	72
McGauvran Center	96	0	94	79	12	100	68
Ball Hall	75	0	92	81	94	100	85

























^ High priority
 — Medium priority
 v Low priority
 ? Incomplete/anomaly

Combustion Emissions – The goal of this project is to reduce emissions on campus as the campus works towards its goal of carbon neutral by 2050. Electricity can be generated by renewable sources. It’s expected that 80% of grid electricity in Massachusetts will be generated by renewable sources by 2050. Therefore, it’s more important to prioritize electrification strategies. Buildings with the highest carbon emissions from natural gas and/or steam rank higher. Below is a summary of the highest ranked buildings in this key criteria.

Building		Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Olney Hall		92 	0 	42 	96 	74 	100 	73 
Fox Hall		79 	0 	60 	94 	22 	100 	62 
University Crossing		63 	0 	48 	92 	22 	0 	50 

 High priority  Medium priority  Low priority  Incomplete/anomaly

























Facility Condition – Deferred maintenance may make decision-making easier when it comes to implement load reduction strategies. Buildings were reviewed for recent renovations, AEP projects, and Sightlines. Using this information, a “facility condition” score was established. Buildings were subjectively scored on a scale from 0-4 if exterior improvements appeared to be needed, 0-3 if building system improvements appear to be needed, and a 0-1 score if the building appeared to be architectural importance. Buildings with a higher score suggest a greater need for improvements. A total score was calculated for each building. Buildings with a greater total score are ranked higher. Below is a summary of the highest ranked buildings in this key criteria. Building facility scores will be revisited during BR+A’s upcoming site visits.


Building		Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Sheehy Hall		54 	46 	74 	65 	98 	0 	67 
Concordia Hall		67 	96 	84 	62 	98 	0 	74 
Ball Hall		85 	0 	92 	87 	94 	100 	85 

 High priority  Medium priority  Low priority  Incomplete/anomaly

Precinct Priority – Centralizing heating and cooling operations improves efficiency, resiliency, and reliability. Buildings that are best suited for central plants given relative location to other buildings, critical operations, anticipated alternative energy strategies based on core end use, and/or coincidental loads rank higher in this category. Buildings that met this criteria were ranked with a score of 100 in this key criteria. See Appendix E for a list of building scores.

In summary, buildings with the highest average score are anticipated to be the best candidates for pilot alternative energy projects. Weight factors were applied to each key criteria in order to establish an overall score for each building. Weight factors for energy change over time and precinct priority are lower given data omissions and to prevent skewing of data. Weight factors should be reviewed by UML at this stage to align with goal priority. Below is a summary of the office/classroom, residential, and lab building with the highest average score in each core use building type. Sheehy has replaced Concordia as a pilot building after review with UML. See Appendix E for a list of all building scores.

Building		Energy Consumption	Energy Change	EUI Target	Combustion Total	Facility Condition	Precinct Plant	Overall Score
Ball Hall		85 	0 	92 	87 	94 	100 	85 
Concordia Hall		67 	96 	84 	62 	98 	0 	74 
Olney Hall		92 	0 	42 	96 	74 	100 	73 

 High priority  Medium priority  Low priority  Incomplete/anomaly

DRAFT

Data Omissions and Anomalies

Energy metering data was reviewed for omissions and anomalies. Metering issues include data not available, data incomplete, and suspect data. Below is a chart summarizing the buildings affected, issues, and next steps to ensure a complete data set. Buildings have been omitted from the analysis until issues are resolved (unless otherwise noted). Issues resolved will be included as part of the Final Report.

Affected Building	Issue	Next Steps
110 Canal	Missing natural gas meter data.	UML to follow up. Natural gas may be included as part of lease. If so, UML to provide proxy building. Not 100% UML occupancy. Not in scope of project.
175 Cabot	EUI flag. Calculated EUI is unrealistic based on building use (<2 kBtu/sf).	UML to confirm gas data is not available. Leased. Not in scope of project.
Allen House	No meter information available (electricity nor steam)	After review with UML, BR+A to develop energy profile based buildings of similar type from benchmarking database.
Ames Textile	EUI flag. Calculated EUI is high even though cleanroom (1036 kBtu/sf).	Review with UML as part of next phase. Allocated 20% to Ames of Ames/ Wannalancit meters.
Alumni Hall	No meter information available (electricity nor natural gas)	Assumed to be metered as part of Lydon Library
Coburn Hall	Building underwent major renovation such that one complete year of data is not available.	Energy model data recommended for use as proxy.
Costello Athletic Center	One complete year of data is not available.	Available 2018 and 2019 is relatively consistent month-over-month. 2018 and 2019 data stitched together to create complete profile. EUI still lower than expected (~16 kBtu/sf). BR+A to develop energy profile based buildings of similar type from benchmarking database.
Cumnock Hall	Missing steam meter data. Missing 2018 electricity data.	Use Mahoney Hall as proxy per UML for steam. Review with UML as part of next phase for electricity.
Dandeneau Hall	Missing steam meter data	Interim solution is to use Southwick as proxy. UML to follow up on omission.
Durgin Hall	Negative steam meter values	UML to review steam meter calibration. Values (-288) have been zeroed out for the purposes of this analysis.
Falmouth Hall	EUI flag. Calculated EUI is unrealistic based on building use (11 kBtu/sf).	Use Kitson as proxy.
Graduate and Professional Studies Center	EUI flag. Calculated EUI is unrealistic based on building use (25 kBtu/sf).	BR+A to develop energy profile based on proxy building.
O'Leary Library	Negative steam meter values. Significant steam spikes in energy consumption during summer months.	UML to review steam meter calibration and setup. Values (-288) have been zeroed out for the purposes of this analysis
Perry Hall	One complete year of data is not available.	Energy model data used as proxy (DMI, 11/9/17).
Pinanski Hall	No meter information available (electricity nor steam)	BR+A to develop energy profile based on proxy building.
Rist Urban Agriculture Farm	No meter information available (electricity only anticipated)	Building omitted based on anticipated low energy impact and limited alternative energy projects
Sheeney Hall	One complete year of data is not available.	Use Concordia as proxy.
UMass Lowell Research Institute	No meter information available (electricity nor steam)	Leased. Not in scope of project.
Weed Hall	One complete year of steam data is not available. Missing 2018 electricity data.	BR+A to develop energy profile based buildings of similar type from benchmarking database.

¹ Boston Building Energy Reporting and Disclosure Ordinance. <https://www.boston.gov/departments/environment/building-energy-reporting-and-disclosure-ordinance>

Data Management Analysis

BR+A reviewed data management practices related to metering and building management system (BMS) trend data. UML currently uses several sources to manage and store energy metering data. Each source was examined for capability of current and potential future needs. Also, reports from the BMS were generated for all buildings to understand trend data intervals and sampling, as well as trended system parameters. Below are recommendations to improve current practices to support tracking carbon goals, identifying energy waste, and fostering a living lab campus.

Metering Data Management

UML currently uses several sources to manage and store energy metering data: Hatch Data, ALSOENERGY PV Platform for solar photovoltaic generation, Automated Logic Controls (ALC) for select building metering, and an Excel spreadsheet for select building metering (“Cumulative Report” spreadsheet).

Hatch Data compiles the majority of large building energy metering data. It stores building electricity consumption and demand data as well as condensate and natural gas data. Data can be tracked at 15 minute intervals and has data for most buildings dating back to 2017. The platform also offers diagnostic tools to identify and offer solutions to energy anomalies. The software does not appear to integrate with UML work order management (CAMIS-Tririga) in order to centralize work order related tasks.

ALSOENERGY PV Platform is used to store solar photovoltaic generation data. Data for all five solar PV arrays is centralized in this platform. Data can be tracked at 15 minute intervals and has data for most buildings dating back to 2017. Actual generation is compared to an estimated generation target. The software does not integrate with sources of building energy consumption or demand data.

Automated Logic Controls (ALC) is UML’s building management system. Electricity demand metering is provided for most buildings. This appears to be redundant with Hatch Data efforts. In general, newer buildings have expanded end use metering capabilities such as BTU meters for heating hot water, chilled water, condenser water, and domestic hot water as well as electricity consumption for cooling tower fans, ventilation fans, and pumps through VFD integration. In general, the software does not “push” this BTU meter information to Hatch Data or another software for automated analytics.

An Excel-based spreadsheet manual (referenced as the “Cumulative Report”) is used to log energy metering data for select buildings. This spreadsheet is manually populated with electricity, natural gas, and water data. Data is available in monthly intervals dating back to 2012.

Centralizing metering records under a single platform will streamline carbon tracking and reporting efforts. Centralization under an energy tracking and analysis system (like Hatch) and linking BMS submeters from the building management system can help shift required meter data storage to the cloud, enable automated energy analysis/fault detection in order to reduce the need for manual analysis, and automate carbon accounting. In the near term, submeter trending, whether through the BMS or a centralized platform, is recommended given that, in general, newer buildings have this capability. Moving forward, development of a building management system standard, inclusive of metering requirements for construction projects, can help ensure that sufficient end use metering is comprehensive and trended appropriately to better support facilities and carbon tracking. As alternative energy projects are pursued, this standard will help support measurement and verification of these efforts.

See Appendix F for list of buildings and their associated metering capabilities.

BMS Trend Data Management


Automated Logic Controls (ALC) is UML’s building management system (BMS). BMS trend data is available for most HVAC systems: boilers, chillers, air handling units, pumps, and fans. However, points are typically trended at 15-minute intervals with maximum sampling storage of 1-4 days. In general, these practices are not sufficient to properly review system operation, identify wasted energy/carbon instances, and support troubleshooting. In the near term, storage retainage is recommended to be increased to at least 36 months as recommended as part of ASHRAE 90.1-2016. Moving forward, development of a building management system standard inclusive of trend parameters, intervals, and storage will help to better support facilities, streamline efforts as part of UMASS’ Turnkey Existing Building Commissioning Services, and enable the necessary information to maximize automated fault detection and diagnostics (AFDD). As alternative energy projects are pursued, this standard will help monitor technologies to ensure proper operation.

An automated fault detection and diagnostics (AFDD) system can help facilities proactively identify and troubleshoot energy/carbon waste issues. This may include equipment on during unoccupied hours, systems not tracking temperature setpoints, and simultaneous heating and cooling. AFDD not only helps identify issues, but also identifies potential solutions – a piece of equipment left in manual override/“hand,” a broken valve actuator, or a programming error. AFDD is a critical component to ensuring proper system operation and minimizing energy/carbon waste, but it is only possible if the proper information is available within the building management system.

Campus Living Lab Opportunities

Acquiring, storing, and managing meter and trend data is the first step towards enabling a living lab campus. A living lab campus may consist of enabling research, behavior change strategies, and energy competitions. Access to metering and trend data can equip faculty, students, and staff with hands-on, real-world research into smart buildings, big data, and the impact of alternative energy projects. Organization of this data can also unlock opportunities to change occupants’ behavior around how they use building energy. Below are recommended approaches to the three core building use categories:

Office/classroom Buildings – Office/classroom buildings create most of UML’s Scope 1 and Scope 2 emissions. However, a large number of occupants use these buildings as transient spaces. This begs the question: How do you empower occupants – whether office workers are there for eight hours a day or students just stopping in for an hour class – and hold them accountable for the energy that they use while working or studying in the building? A centrally located energy dashboard can help serve this purpose. Energy use intensity targets can be set for existing buildings based on historic data and for new buildings based on energy model estimates. The dashboard would be a clear indicator of how much of an “energy budget” the building has used. To the right is a stock graphic offered by ALC which could be used for this purpose. This effort can also help facilities automate energy management efforts.

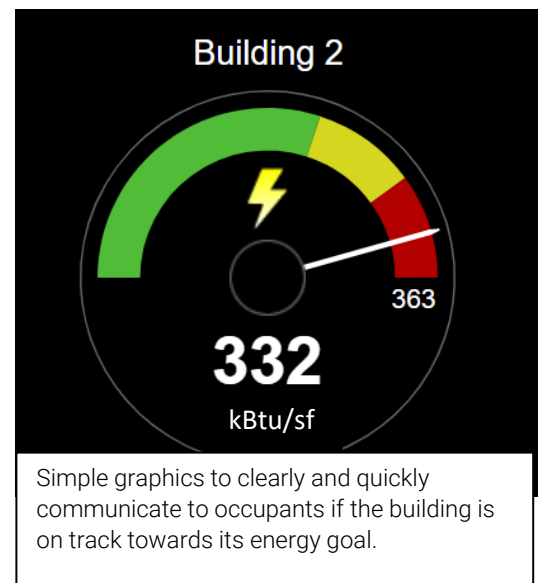

Residential Buildings – Residential buildings are generally occupied 24/7. The second highest end use in these buildings is plug loads (see “Building Energy Use and Emissions” section for more information). This end use type is more difficult to manage than other end use loads given that the solution is typically not as simple as switching to, for example, LED lighting or a more efficient boiler. Instead, this end use is typically based on what devices students bring with them and how often they use them. Our recommendation to manage this is through friendly, behavior change energy competitions. Centralizing metering to one platform and making this information accessible to students will unlock the ability to conduct competitions. These competitions could be run by the Office for Sustainability. Identifying and empowering student champions can help increase participation and help manage competitions. Low cost rewards like a pizza party or an annual trophy can help big impact energy savings. These competitions can be rolled up into a more comprehensive housing program, based on the student body’s strengths and interests, to ensure students are educated, create habits, and are aware of their impact on their residential building and overall campus. This will in turn help to change their behavior and interaction with other campus buildings. As a near term strategy, data can be organized to enable these types of competitions as much of this data is already available through Hatch Data.

Lab Buildings - Lab buildings are also 24/7 buildings but much more energy dense than residential buildings. As the University seeks to increase research on campus, lab energy and its associated plug use is also expected to increase. Plug loads are typically the second highest end use in lab type buildings (see “Building Energy Use and Emissions” section for more information). Programs like “shut the sash” can be deployed using existing information from the building management system with simple directions outside of labs. The goal for a shut the sash program is, if students are leaving their labs for the day, then it will prompt them to look to see if they perhaps left a fume hood open. As lab are renovated, fume hoods with auto sash closers can also support this same goal. Also, circuit-level metering can help enable energy competitions between individual labs. Traditional submetering may quantify the energy consumed by a panelboard with a mix of end use loads. Circuit level metering enable metering of the individual circuits. This can enable easy allocation of loads by labs and future proof competitions as labs are renovated. Low cost rewards like a pizza party or an annual trophy can help big cost energy savings. As a short term strategy, “shut the sash” displays can be deployed where fume hood exhaust airflow (cfm) is available through the building management system. Displays are recommended to be deployed as part of any future lab renovation. Furthermore, it is recommended that circuit-level metering should be deployed as part of lab fitouts and major renovations to enable future competitions. At a minimum, space in electrical rooms should be allotted for circuit-level metering modules during renovations as these devices can be deployed aftermarket.



Simple displays and directions to show exhaust air flow rates and users’ impact in fume hood driven spaces. The graphic above is from Harvard University’s Jacobsen Lab.

Summary

This data will provide the foundation for future project phases. Improvements to current data management practices including more granular interval trending and increased sampling storage can better support tracking carbon goals, identifying energy waste, and fostering a living lab campus. The data shows that Olney Hall, Ball Hall, and Sheehy Hall are the best buildings to conduct pilot alternative energy projects given that they score highest compared to other buildings of the same core use type. These buildings will be prioritized as part of the Alternatives Analysis. This preliminary report will be incorporated into the Final Report based on any comments and feedback from UML.

DRAFT



3 30-Year Forecast

DRAFT

30-Year Forecast

It is expected that factors affecting UML's historical energy and emissions data will change. The primary factor that has driven a reduction in energy consumption in the last 5-10 years was the Accelerated Energy Program (AEP). On-campus population growth and campus area growth were the primary factors resulting in an increase in energy consumption. It is expected that these factors will have less influence on energy consumption given that the Accelerated Energy program has ended, on-campus population has slowed, and campus growth is expected to slow given UML's debt ceiling. Therefore, anticipated energy consumption to be relatively flat over the next five years given these factors. The expansion of online learning, COVID's effects on student interest and COVID's impacts on building operations will also be factors. Going forward, it is expected that these changes in operating revenue and on-campus population will continue to play a role. However, it is expected that capital planning's focus will shift from new construction and acquisitions to renovation of existing assets. These renovations are expected to shift less energy intensive office/classroom program to more energy intensive lab program. Renovations are also likely to add cooling in spaces that currently do not have this function. As for emissions, Massachusetts's Clean Energy Standard ('CES') and the states' requirements will lead to a continuously improved electrical grid over time. This will result in reduced emissions from electric consumption. Considering all of these factors and adjusted forecasts from the U.S. Energy Information Administration's ('EIA') Commercial New England data sets, BR+A-Anser anticipate that energy consumption will slowly increase 7% and emissions will decrease 39% over the next 30 years.

Energy forecasts are subject change due to future developments in technologies, demographics, and resources. These factors cannot be accounted for with absolute certainty. Therefore, it is recommended that forecasting is updated on a regular basis to ensure project implementation decisions are made with the most up-to-date information.

DRAFT

30-Year Energy and Emissions Analysis

Overview

BR+A utilized data sets from the U.S. Energy Information Administration's (EIA) Annual Energy Outlook (AEO) in order to understand the key factors affecting energy in the region. The AEO is published annually in accordance with the Department of Energy Organization Act of 1977. Reports detail trends and projections for energy use and supply in the United States. Regional and building sector-specific data sets are available for estimating future electricity and natural gas consumption. This information was used as a baseline, then UML-specific factors were applied as adjustments.

BR+A reviewed changes over the last ten years in UML's gross area, on-campus population, and operating revenue in order to establish a correlation with changes in energy consumption. Initial findings were reviewed with members of UML's Office for Planning, Design and Construction; and Office of Strategic Analysis and Data Management. Results were inconclusive. Assumptions regarding how these factors will affect future energy consumption were adjusted based on the available data. In addition, members of these offices suggested that additional factors such as increased lab program and expanded cooling operations would play a role in energy changes on campus.

EIA New England Assumptions

The EIA data set that most closely resembles UML's climate and operations is the New England Commercial building sector. Economic growth is the primary driver of energy demand and related CO₂ emissions. Data sets show relatively steady economic growth as indicated by an average 1.9% annual increase in gross domestic product over the next 30 years. Gross square footage and population grow steadily at an annual average of 1% and 0.5%, respectively. This correlates with similar trends in electricity and natural gas consumption.


The electricity and natural gas data sets account for continued energy improvements leading up until 2026 as part of the AEP and consistent with EIA's assumption. At that point, economic growth increase is expected to outweigh energy conservation decreases. BR+A estimates that the UML will not experience this same degree of decline due the completion of the Accelerated Energy Program. See "UML-Specific Assumptions" for more details. In addition, electricity consumption/cooling is expected increase as cooling degree days increase, and natural gas consumption/heating is expected to decrease as heating degree days decrease.

In summary, New England Commercial total energy is expected to increase. Electricity consumption is expected to increase 11% between 2020-2050 with an average annual increase of 0.3%. Natural gas consumption is expected to increase 6% between 2020-2050 with an average annual increase of 0.1%. High economic growth and low economic growth scenarios are also available to demonstrate a range of how energy consumption could change. The high economic growth scenario accounts for a 2.4% annual GDP growth, and the low economic growth scenario accounts for a 1.4% annual GDP growth. Energy consumption could range 1.5% higher or lower depending on economic growth. Raw data sets can be found in Appendix G.




UML-Specific Assumptions

The cumulative spreadsheet was used to aggregate energy data for the last seven (7) years. Year-over-year aggregates are inconsistent with CES reporting. CES reporting is believed to be accurate based on prior reviews with UML. For example, the cumulative spreadsheet shows an increase in energy consumption whereas the CES reporting shows a decrease in energy consumption between FY2018 to FY2019. Note that CES reporting is only available for FY2018 through FY2020. FY2020 has been omitted from the analysis due to skewed data as a result of COVID-related reduced operations.

The graph below shows the inconsistent energy trends between FY2012 and FY2019 per the cumulative spreadsheet. The cumulative spreadsheet data shows a downward trend between FY2012 and FY2015. This appears to generally align with BR+A-Anser’s understanding of Alternative Energy Project (AEP) implementation and associated energy reduction (except for FY2014). However, the steady and subsequent increase in energy consumption between FY2015 and FY2019 does not align with Alternative Energy Project (AEP) implementation nor BR+A trends of other factors. Therefore, it’s expected that this is a data error. See “Data Omissions and Anomalies” for more information and next steps.

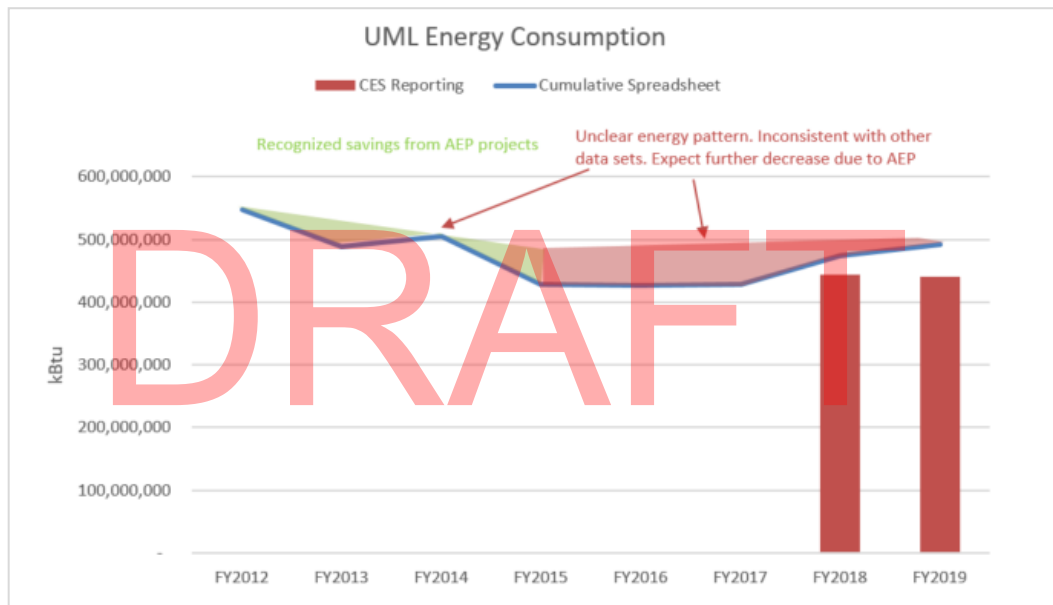



Campus area growth is a key factor expected to influence energy consumption. Energy consumption is expected to increase as the campus grows in size. Data provided by the Office for Planning, Design and Construction was used to review changes in gross area over the last twenty (20) years. Over the last ten years, the campus has experienced a surge in area growth; 55% increase with an average annual increase of 5%. Only 2% of this square footage is leased space. This is not included in the UML greenhouse gas inventory and, therefore, is not included in the scope of this project. The majority of the added area falls under the core end use “Other”, which is primarily “Parking.” See graphs below for more details.

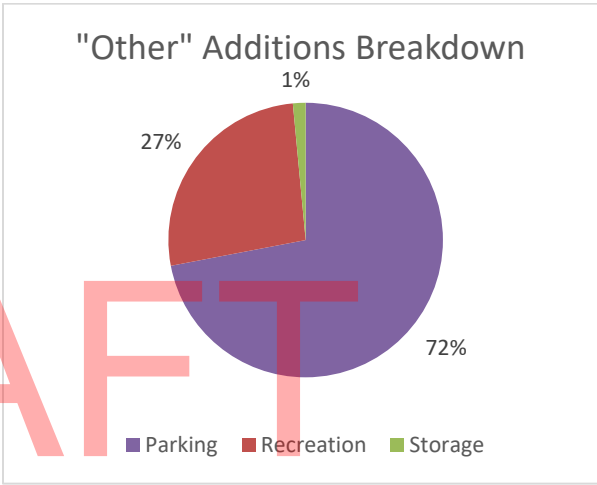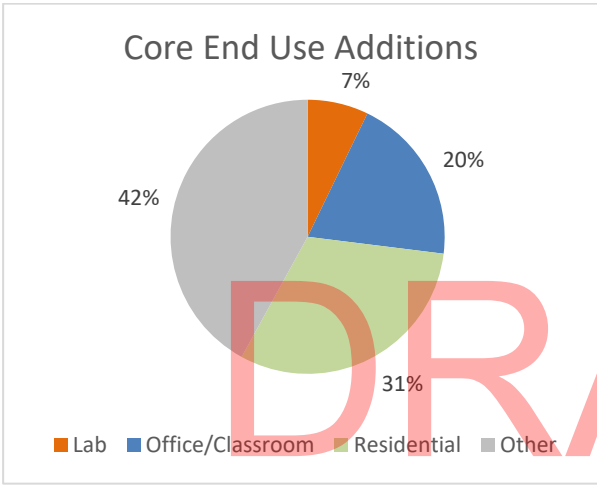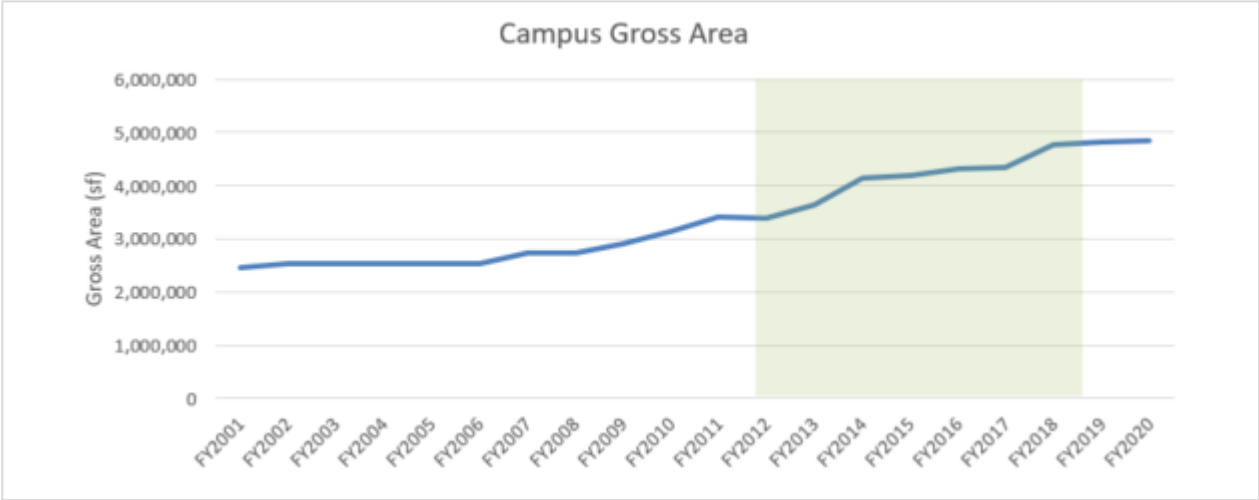

DRAFT


After review with the Office for Planning, Design and Construction, it is not expected that this gross area increase will continue at the same rate as experienced over the last ten (10) years. Instead, it's expected that capital planning's focus will shift from new construction and acquisitions to renovation of existing assets. These renovations are expected to shift less energy intensive office/classroom program to more energy intensive lab program. The energy forecast under "UML 30-Year Forecast" represents a 10% conversion of office space to lab space from FY2025 to FY2050 (~6K sf per year). This represents approximately 6-7% increase in energy consumption due to increased equipment loads and ventilation air changes (fan, heating, and cooling energy). In general, it's expected that energy will increase 3.5% for every 5% conversion of office/classroom to lab.

Also, the Office for Planning, Design and Construction noted that added mechanical cooling is expected to be a key factor on campus. Energy consumption is expected to increase in areas where mechanical cooling is added and it did not previously exist. BR+A-Anser reviewed the building management systems and building plans to gain a better understanding of how buildings on campus are cooled. Most of this square footage is in residential buildings. If all square footage currently not cooled is upgraded with mechanical cooling systems, it is expected to increase energy 1-2% from 2025-2050. See Appendix H for a breakdown of how buildings have been organized.

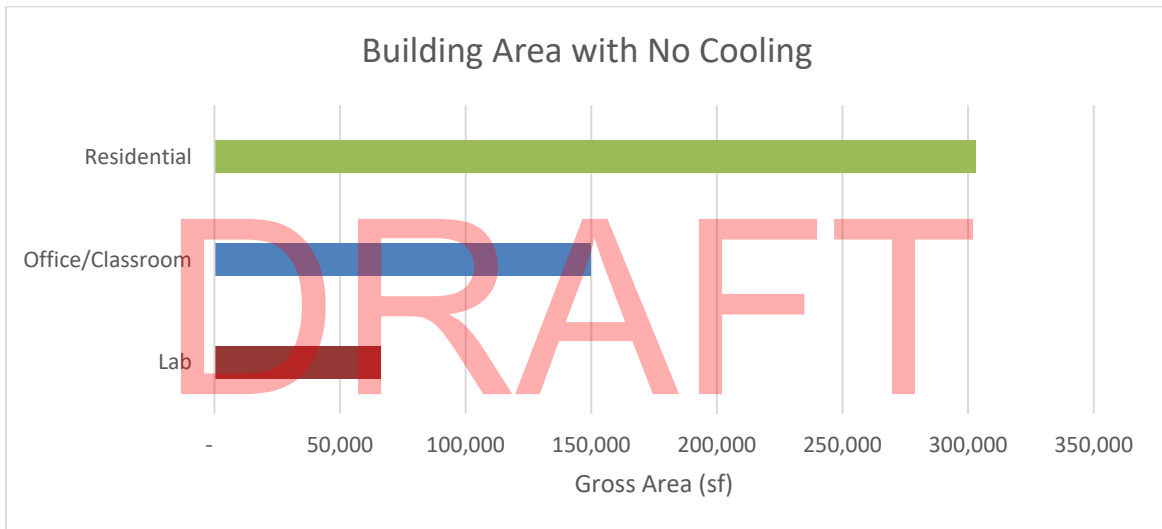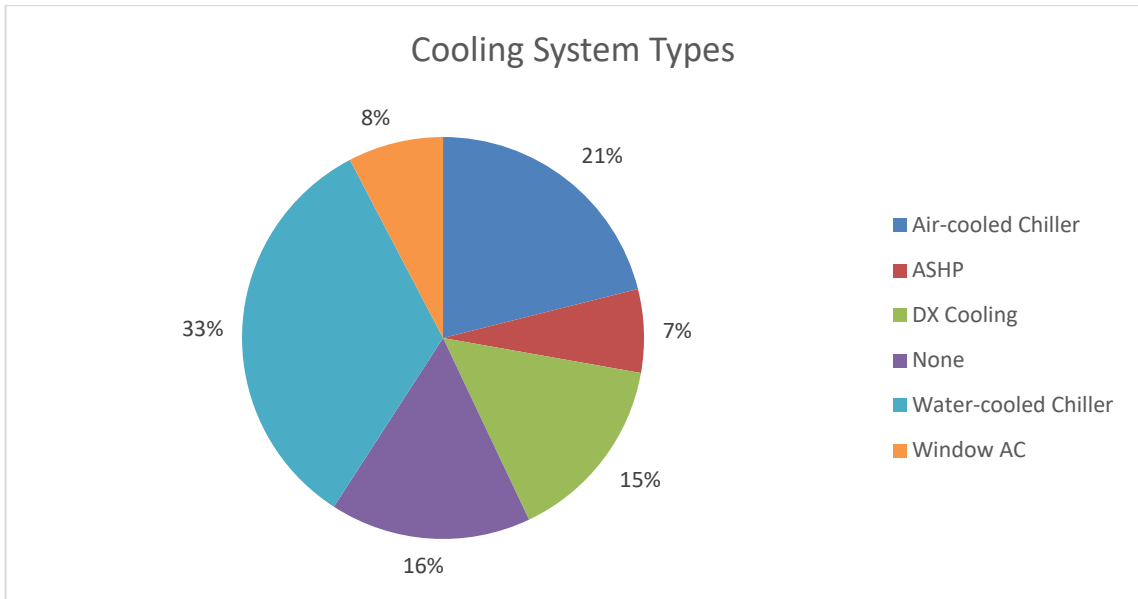


On-campus population growth is another key factor expected to influence energy consumption. Increases in on-campus population is expected to result in increases in energy consumption. The majority of graduate classes are expected to move online in future years. Also, in Fall 2018, graduate students accounted for ~1% of the on-campus student population. Therefore, undergraduate population was the focus of this study. Furthermore, the number of faculty staff is expected to increase to support the increasing student population. Therefore, specific patterns in faculty population are not explicitly detailed in this report. Lastly, the UML reporting data does not include data on support staff such as facilities. Similarly, support staff numbers are expected to increase to support student population

Undergraduate on-campus population growth has slowed in the past seven (7) years. This is represented by a pattern between Fall 2013 and Fall 2016 in which population increase compared to the previous year were 12%, 9% 5%, and 1%, respectively. See graph below for more details. See Appendix I for a table of the information below. After review with the Office of Strategic Analysis and Data Management, it's expected that student population will experience slower growth in the coming years. In the short term, this may be due to student interest may reduce given COVID. In the long term, this may be due to limited space on campus and in the city for expansion. This expected pattern is factored into the energy and emissions forecast by adjusting the EIA baseline to a slower rate of growth (50% adjustment factor). Note that data errors are expected in Fall 2017 and Fall 2018. See "Data Omissions and Anomalies" for more details.

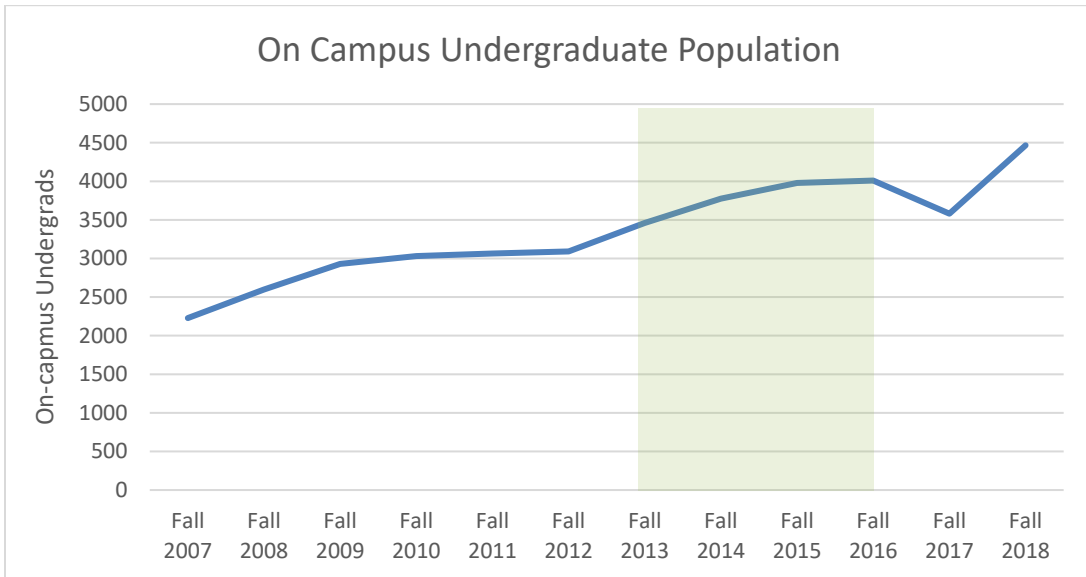


Operating revenue is another key factor expected to influence energy consumption. Increases in operating revenue may allow for building operations to expand resulting in an increase in energy consumption as well as allow for building upgrades that could reduce energy consumption. Operating revenue growth has slowed in the past ten (10) years. In FY2008-2009, growth was 15% and in FY2017-2018 growth was 5%. See graph below for more details. This expected pattern is factored into the energy and emissions forecast by adjusting the EIA baseline to a slower rate of growth (50% Adjustment). See Appendix J for a table of the information below.

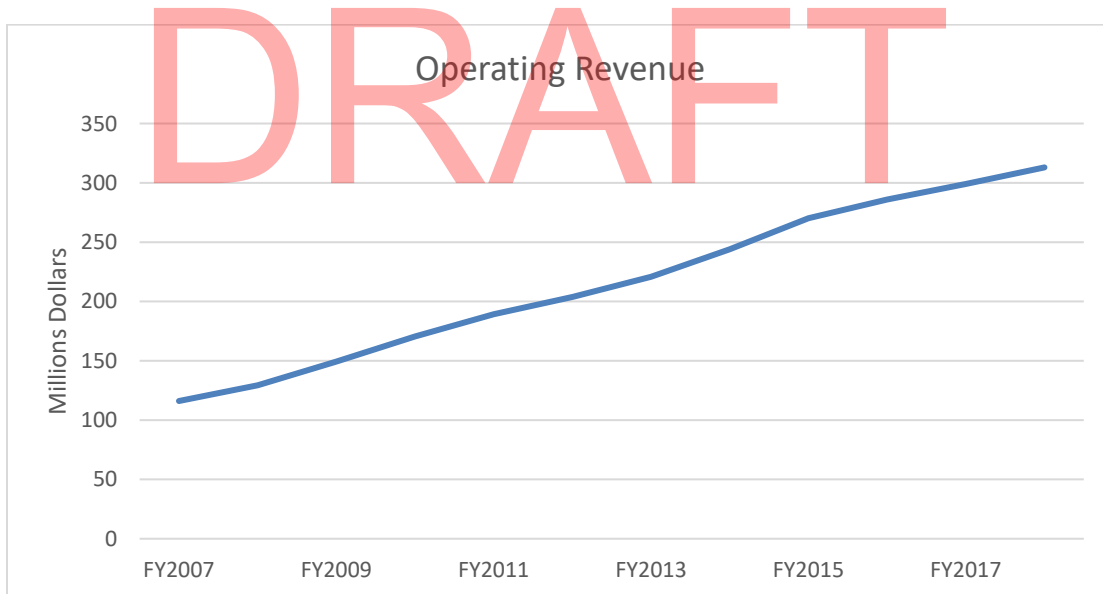


30-Year Energy and Emissions Forecast

Considering all key factors and adjusted forecasts from EIA’s Commercial New England energy consumption is estimated to increase 11% over the next thirty (30) years. The baseline year is based on CES reporting for calendar year 2019 normalized for weather. The graph below shows the year-over-year forecast broken down into electricity consumption and natural gas consumption. Electric energy consumption is expected to increase 14% and natural gas consumption is expected to increase 2%. See Appendix K for a table of the information below.

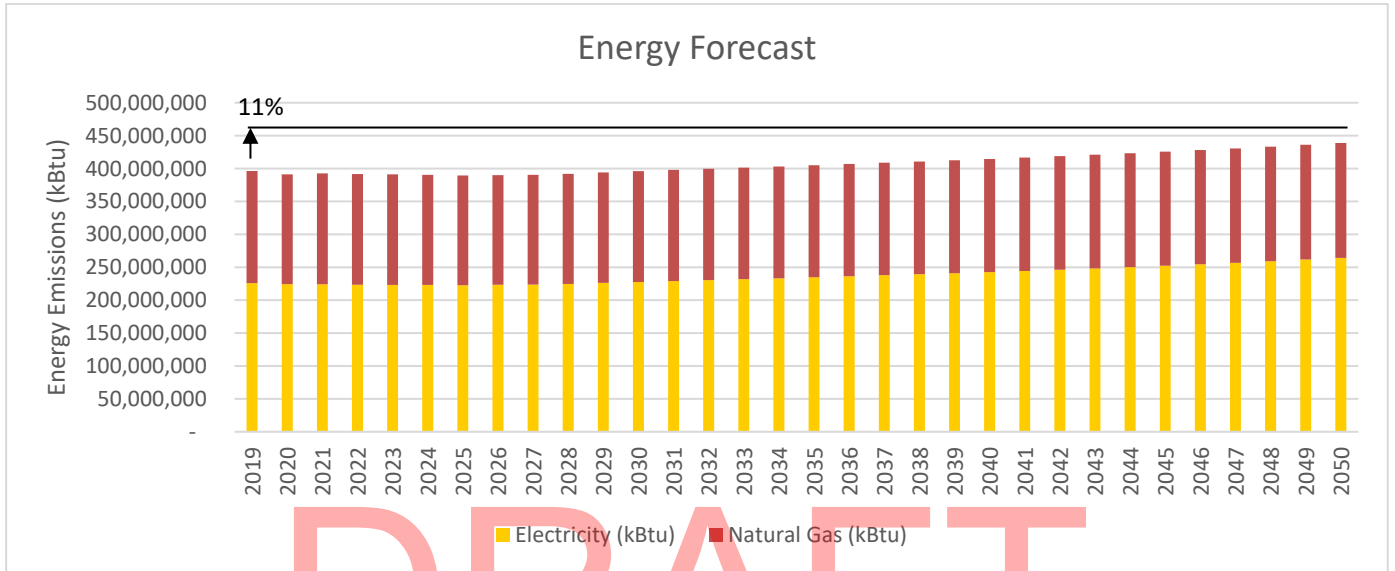

Considering all key factors and adjusted forecasts from EIA’s Commercial New England, BR+A-Anser anticipate that emissions will decrease by 47% over the next thirty (30) years. The graph below shows the year-over-year forecast broken down into electricity emissions and natural gas emissions. Electric emissions are expected to decrease 71% as a result of Massachusetts’ CES. Natural gas emissions are expected to decrease 2% consistent with energy reduction. At these rates, UML will not meet the EO484 2050 threshold. See Appendix L for a table of the information below and emissions factors.

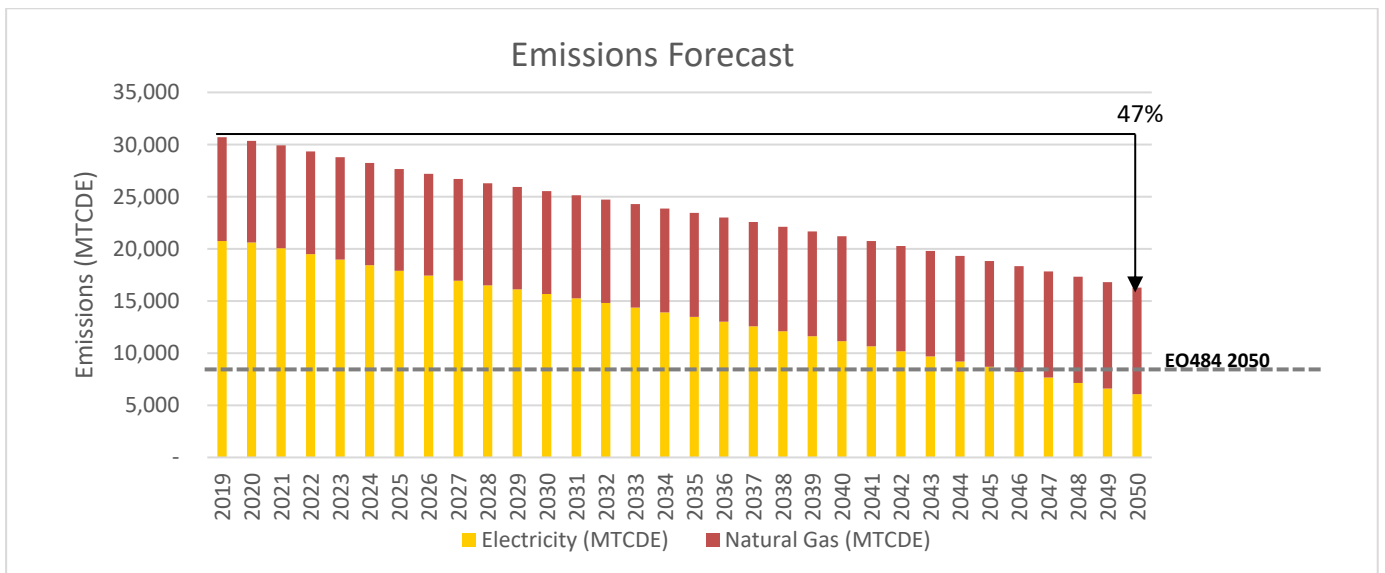

Data Omissions and Anomalies


Data was reviewed for omissions and anomalies. Below is a chart summarizing the issues and next steps to ensure an accurate data set. Resolved issues will be included as part of the Final Report to be issues at a later date.

Issue	Next Steps
<p>"Cumulative Report" total energy consumption data is higher than CES reporting and UMASS Sustainability Report. Sustainability Report estimates and CES reports are similar.</p>	<p>UML (D. Abrahamson) to follow up with CES to understand discrepancy.</p> <p>Constellation and 725 Merrimack accounts were identified by CES as the key contributors. Cumulative Report doesn't account for Constellation use (only cost). Discrepancy still exists.</p>
<p>"Enrollment At A Glance" reports on-campus undergraduate population unexpected drops in Fall 2017 followed by an unexpected degree of growth in Fall 2018 (even if Fall 2017 was normalized based on previous years' patterns). This suggests a data error.</p>	<p>UML (S. Barich) to review and follow up.</p> <p>Although our overall count of students enrolling year to year has mostly been on an increase, the growth rate has been on a decline. Raw numbers increasing, how much we increase by (the growth rate) is shrinking as time moves forward.</p> <p>A model of this nature would also assume infinite growth, at some point across the 30 years we would have to acquire new land and build new dorms to keep up with a 7% annual on-campus increase across a 30 year span. I am not sure if that is possible or not. Especially with bullet point number one above and available space in the city for expansion.</p> <p>Finally, I anticipate the impact of COVID to be felt for a few years to come. We might see flat to very little growth in the education sector as well as UML over the next couple of years.</p>

DRAFT

Summary

This forecast discussed above will provide the foundation of the Alternatives Analysis will be based. Considering all of these factors and adjusted forecasts from the U.S. Energy Information Administration's (EIA) Commercial New England, energy consumption is estimated to increase 11% and emissions will decrease 47% over the next thirty (30) years. The increase in energy consumption is expected to be driven by conversion of office/classroom to lab, added mechanical cooling, increased operating revenue and increased on-campus population. Emissions are expected to be impacted primarily by the Massachusetts's Clean Energy Standard. This preliminary report will be incorporated into the Final Report inclusive of any comments from UML.

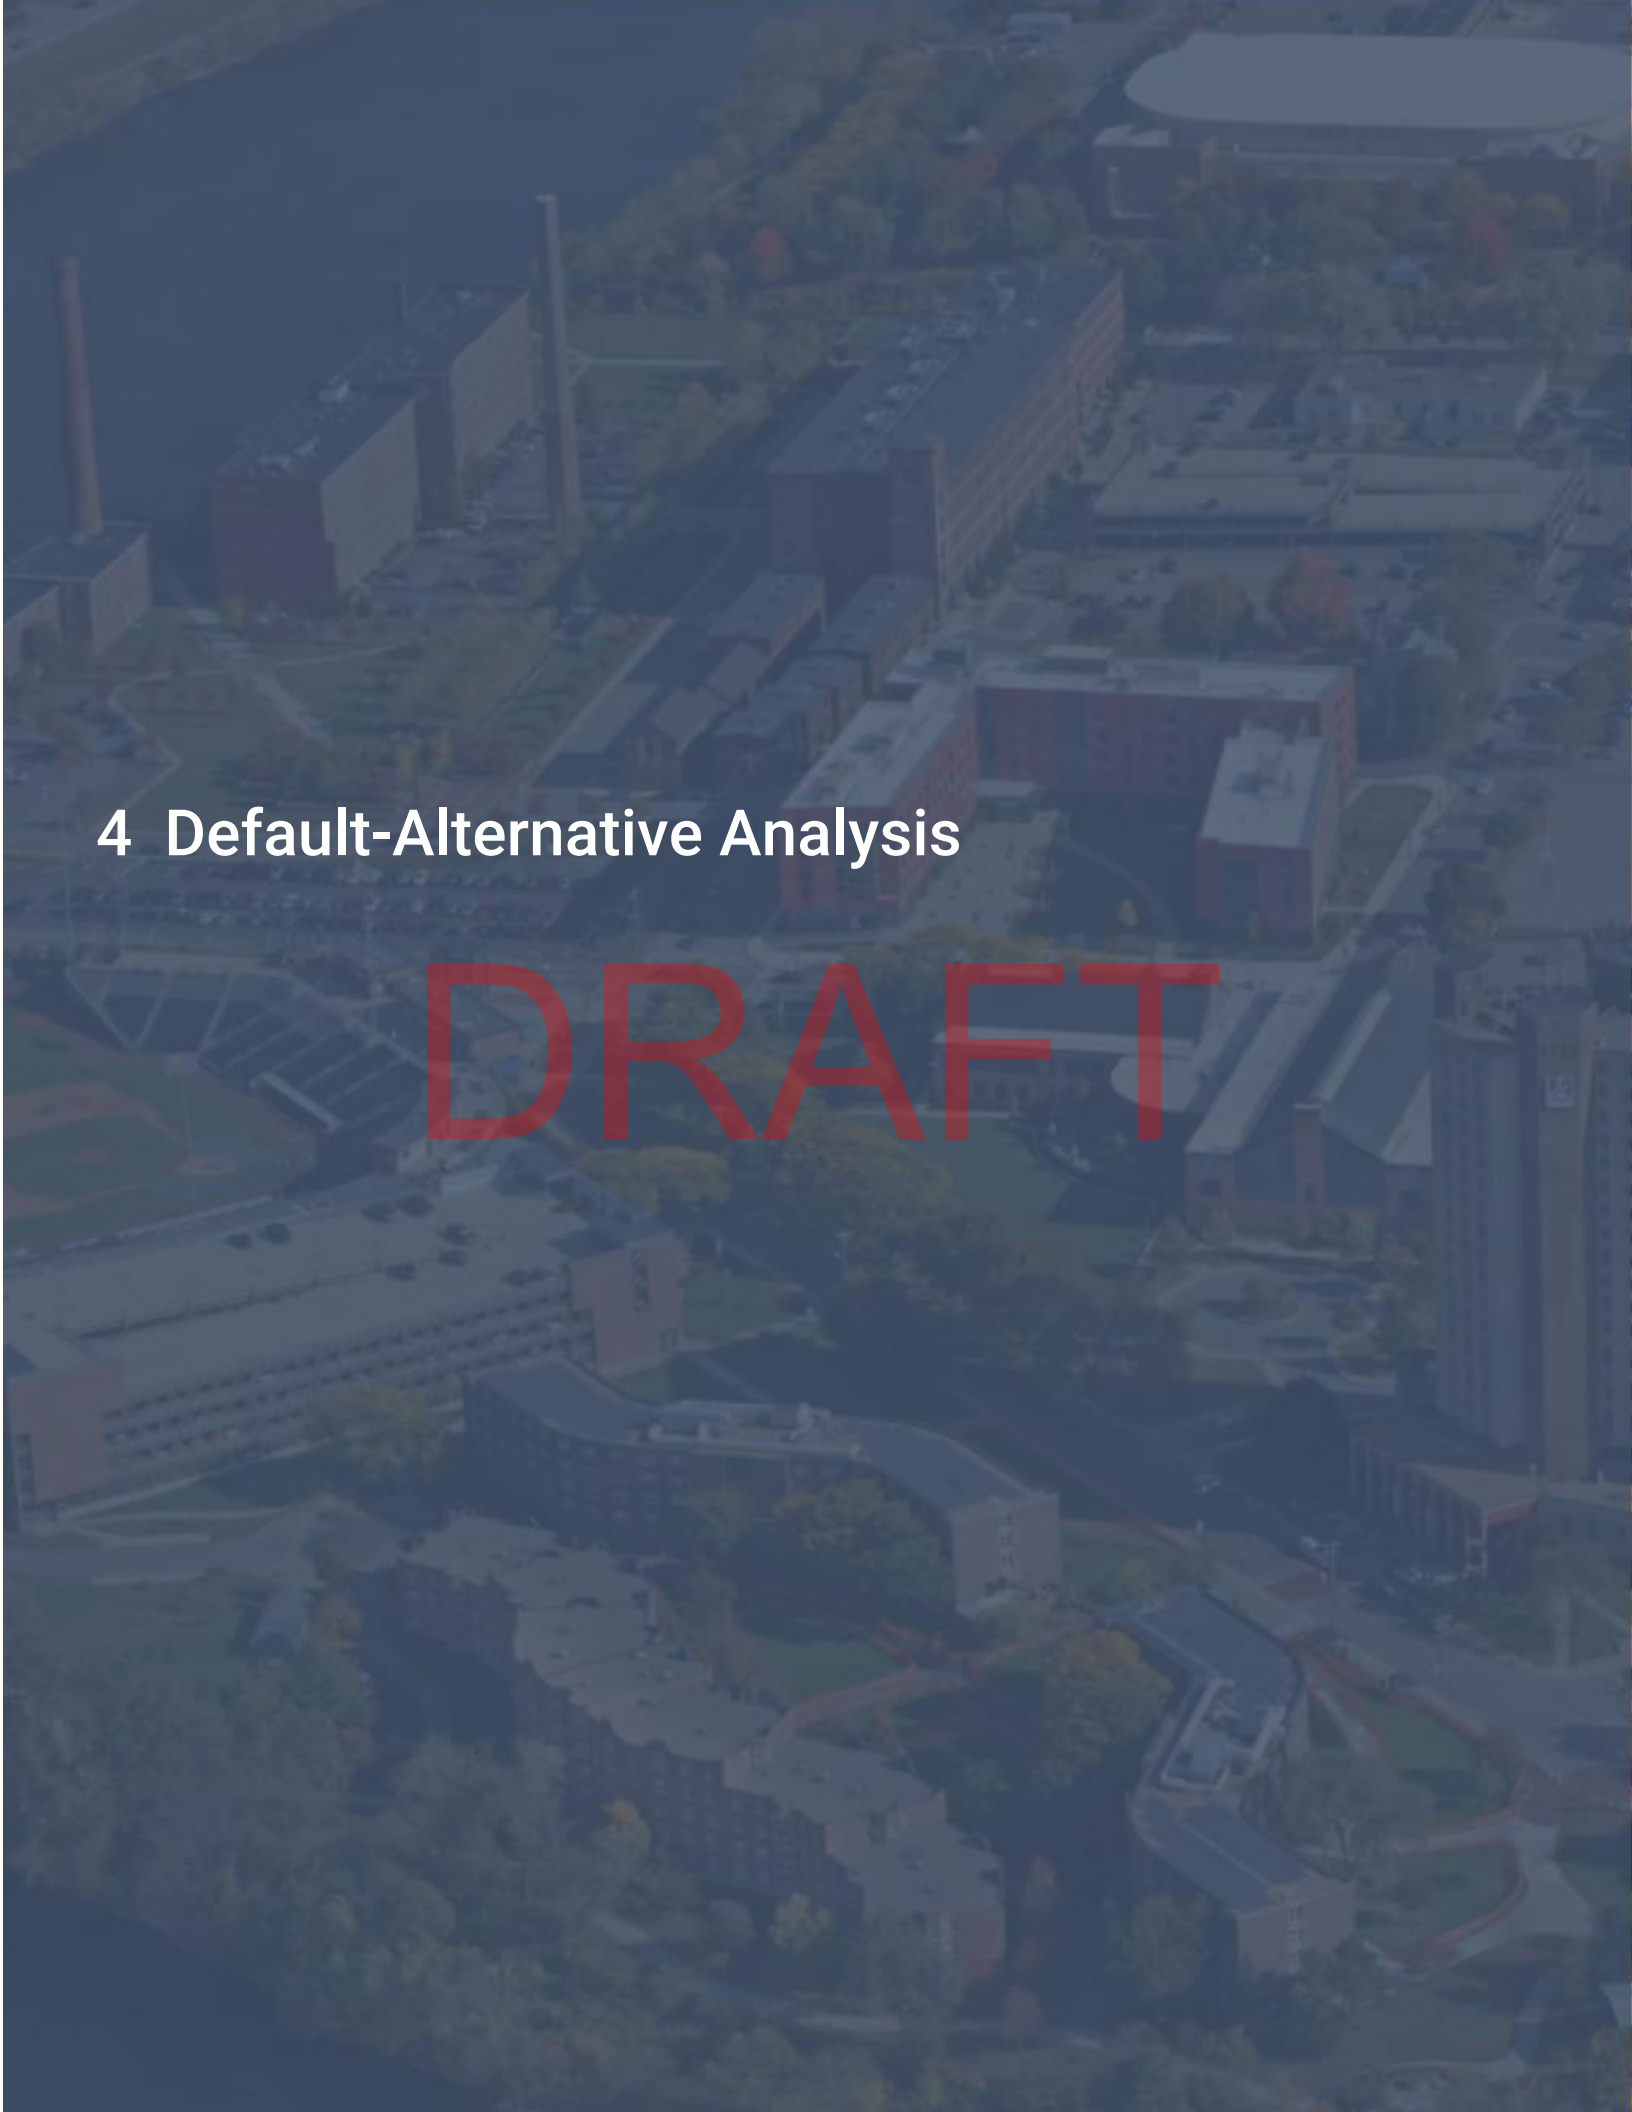

4 Default-Alternative Analysis

DRAFT

Default-Alternative Analysis

Default Case Overview

The Lowell Campus has three distinct campuses: North Campus, South Campus, and East Campus. The North Campus is primarily office/classroom, but has the largest presence of lab space on campus. The South Campus is primarily office and classroom, and the East Campus is primarily residential. The Default Case assumes that the steam boilers at the North and South plants as well as the main electrical infrastructure will be existing to remain given recent upgrades. The backlog of deferred maintenance will be replaced in kind.

Based on this historic energy information, there is spare electricity capacity at the North Campus and South Campus mains. There is anticipated on being approximately 0.3MW of available capacity on the North Campus. There is not enough spare capacity to add Saab Emerging Technologies & Innovation Center and Pulichino Tong Business Center are tied to the North Campus electrical distribution. It is not anticipated these or any other buildings will be tied in at this time. Furthermore, there is anticipated on being approximately 1.7MW of available capacity on the South Campus. For the East Campus, any upgrade projects will have to be evaluated on a building by building basis. Alternative Case projects that include the installation of all electric mechanical and plumbing systems in lieu of gas fired equipment, and large installations of electric vehicle-charging stations will likely need upgrades at individual buildings. This will be addressed as part of the Alternative Case. One potential resiliency measure in support of Executive Order No. 594 and the goals of this project is to provide a second utility circuit to each campus, fed from a different utility substation, and configure the incoming service in a main-tie-main configuration, with the tie breaker normally open.

Currently the North Campus peak steam demand is using 47% of the total plant capacity and the South Campus peak steam demand is using 57% of the total plant capacity. The capacity of the two main boilers on the North Campus can handle the full load of the campus, therefore the third, smaller boiler is not needed to be replaced at the end of its term. The age and required upgrades to the steam distribution systems on campus present further incentive to pursue and invest in electrification strategies campus wide and eliminate the use of fossil fuels.

UML contracts with energy suppliers for multi-year, fixed rate contracts. Inflation is expected to be the primary driver of UML electricity and natural gas rates given the smaller impact of renewable energy and retiring assets. Therefore, the average year-over-year change in electricity rates is 3% with a 2050 estimated rate of \$0.26/kWh. The average year-over-year change in gas rates is 4% with a 2050 estimated rate of \$23.50/Dth.

Alternative Case Overview

Energy efficiency, electrification, and renewable deployment are the key steps in working towards UML's 2050 carbon neutral goal and Executive Order No. 594 energy use intensity (EUI) and emissions goals. Implementation of energy conservation measures (ECMs) reduces energy, emissions, operating costs, and enables cost effective infrastructure by reducing heating and cooling loads. Measures were identified by using the ASHRAE Level I Audit procedure. Detailed scopes for the pilot buildings (as identified during the "Metering and Data Management" phase) – Ball Hall, Olney Hall, and Sheehy Hall – were developed in order to evaluate energy, emissions, and load impacts. Two scenarios - "Good" and "Best" – were detailed in order to outline the range of opportunities compared to a Default/Business-As-Usual ("BAU") Case. These options are expected to serve as standalone building options in order to provide a comparison to a centralized approach.

Compared to the Default/Business-As-Usual ("BAU") Case, the North Campus, "Good" case is expected to achieve a 47% energy reduction and 35% emissions reduction. Upgrades are expected to be all-electric systems. Based on future electricity emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is

expected to be closer to 71%. The North Campus, “Best” case is expected to achieve a 52% energy reduction and 42% emissions reduction. The emissions reduction is expected to be closer to 74% given the implemented electrification strategies and future grid emissions rates (as detailed in the “30-Year Forecast”). The remaining emissions can be offset with renewables sources.

The South Campus, “Good” case is expected to achieve a 47% energy reduction and 35% emissions reduction. Based on future emissions rate (as detailed in the “30-Year Forecast”), the emissions reduction is expected to be closer to 70%. The South Campus, “Best” case is expected to achieve a 53% energy reduction and 43% emissions reduction. Based on future emissions rate (as detailed in the “30-Year Forecast”), the emissions reduction is expected to be closer to 74%. The remaining emissions can be offset with renewables sources.

The East Campus, “Good” case is expected to achieve a 41% energy reduction and 26% emissions reduction. Based on future emissions rate (as detailed in the “30-Year Forecast”), the emissions reduction is expected to be closer to 68%. The East Campus, “Best” case is expected to achieve a 54% energy reduction and 43% emissions reduction. Based on future emissions rate (as detailed in the “30-Year Forecast”), the emissions reduction is expected to be closer to 75%. The remaining emissions can be offset with renewables sources.

The reductions outlined above are expected to greatly exceed the EUI and emissions goals of Executive Order No. 594. The Investment Phase will detail how these projects can be structured in order to meet these requirement timelines.

Alternative Energy Measures comprised of centralized heating/cooling strategies and on-site renewable energy deployment were reviewed. Alternative Energy Measures were screened for viability given UML’s unique campus conditions and key parameters including: construction cost, maintenance cost, energy cost, life cycle cost, system familiarity, emissions, resiliency, and space requirements. The North Campus provides the best opportunity for vetting alternative energy heating/cooling strategies given diversity of space types and associated heating and cooling load diversity. Eighteen (18) North Plant options were developed looking at a variety of technologies to help right-size the plant: ground-source heat pump, air-source heat pump, air-cooled chiller and water-cooled chiller capacities. If centralizing heating and cooling equipment on the North Plant is desired, the option that balances all factors including future flexibility, resiliency, construction cost, operating cost, maintenance is “Good B2 – Light Geo + Air-source + Gas Boilers”. The good option also allows flexibility in building retrofits. As buildings are added to the central plant, the required air-source heat pumps and boiler capacity can be added. The geothermal borefield can be completed in two phases, one for the parking lot to the south and one for the parking lot to the north. This option also offers familiarity of gas boilers with the potential of transitioning to biodiesel in the future. Based on decisions made by UML regarding the North Campus, the Team will evaluate the viability of centralized heating/cooling systems on the South Campus. The East Campus is not expected to be an appropriate site for centralized heating/cooling systems given the lack of space type and load diversity; limited space in the urban environment; and relative locations of buildings to one another.

UML’s site provides an opportunity for an additional 18,700 MWh/yr to be generated a year from solar PV. 85% of the total PV system capacity and annual production is proposed at parking sites. 84% of the total annual production for systems over 100 kW-DC. Sites under 100 kW are not expected to be cost effective. Given the current SMART program, solar PV can be used by UML as a tool to reduce operational costs but cannot be used to offset emissions given that the utility retains ownership of the renewable energy certificate (REC) under the SMART program. If this incentive program were to change such that owners could have ownership of the RECs, then the RECs could be retired in support of reducing emission and carbon neutrality. However, many owners may opt to sell the RECs as an additional cash flow. While battery energy storage system (BESS) resiliency may help harden UML buildings to the impacts of intermittent power disruptions, they are unlikely to supplant a liquid fuel generator and as such would have limited impact on long term energy and climate targets.

Default Case

Electrical Services Reliability Assessment

Several of the alternative options that are being considered rely on a transitioning from a fossil fuel-based energy source to electrification options, and the addition of electrical vehicle charging stations throughout the campus. Since these solutions will increase the electrical demand of the campus, it is important to identify the capacity of the primary electrical service feeder that is provided from National Grid to each campus.

The North Campus is fed from (2) two 1500KVA, 13.2 KV:4160V pad mounted transformers. These transformers in turn feed the South Campus loop distribution. There are select buildings that are fed with direct utility services from National Grid.

The South Campus is fed from a single National Grid 13.2KV circuit. This circuit serves a 3000/3750KVA, ONAN, 13.2KV: 4160V pad mounted transformer. There are (3) three buildings that are not fed off of the North Campus loop distribution, but rather fed with direct utility services from National Grid. The existing 3000/3750KVA transformer was sized to accommodate the load of these buildings in the future.

On the East Campus, each individual building is fed with an individual National Grid secondary service and there is no centralized electrical distribution infrastructure.

Based on this information the campus electrical capacities are as follows (assuming a power factor of 0.85):

Campus	Electrical Capacity	Peak Demand (Actual)	Peak Demand (All Buildings)
North	2.6 MW (main)	2.3 MW	3.3 MW
South	3.2 MW (main)	1.3 MW	1.5 MW
East	N/A (Decentralized)	N/A (Decentralized)	1 MW

Based on this information, there is not enough spare capacity to add Saab Emerging Technologies & Innovation Center and Pulichino Tong Business Center are tied to the North Campus electrical distribution. It is not anticipated these or any other buildings will be tied in at this time.

Depending on where equipment upgrades are occurring on campus, there could be downstream electrical infrastructure limitations at the building transformer and distribution feeder level. Projects that include the installation of all electric mechanical and plumbing systems in lieu of gas fired equipment, and large installations of electric vehicle-charging stations will likely need upgrades at individual buildings.

There are multiple on-going efforts on campus to increase the electrical resiliency of the electrical distribution system. On the North and South Campuses, the existing distribution network has been upgrade to consist of a loop primary system. This allow for isolating an individual building or cable segment in the event of a failure without affecting other buildings.

Efforts have been made to replace aging medium voltage cable and conduit infrastructure as areas of the campus are upgraded. In many cases, the new medium voltage cable has been rated for 15KV to provide better insulation, and allow for the future transition to campus electrical distribution at 13.2KV.

The existing North and South Campuses are each fed with an individual utility circuit. One potential resiliency measure is to provide a second utility circuit to each campus, fed from a different utility substation, and configure the incoming service in a main-tie-main configuration, with the tie breaker normally open. Should a utility outage occur on one of the incoming lines, the associated primary main breaker is opened and the tie breaker is closed (either manually or through an automatic means), and the campus then operates a single incoming line.

Steam Reliability Assessment

The campus is currently sub-divided into three campuses, North Campus, South Campus, and East Campus. North Campus and South Campus each are served by central plants that include gas fired boilers creating low pressure steam for heating. East campus is not served by a centralized system and relies on building specific systems to deliver heating and, in some instances, cooling. The proposed alternative heating options deviate from the reliance on fossil fuels and transition to electrification options.

Hourly gas consumption data for the North Campus and South Campus was provided by UML via Hatch Data. In 2019, the peak hourly gas consumption is approximately 1,045 boiler HP and 806 boiler HP for North Campus and South Campus, respectively. The plant capacity for the North Campus is approximately 2,200 boiler HP, and 1,400 boiler HP for the South Campus.

North Campus central plant consists of two main boilers which were replaced in 2015, and a third smaller boiler that is near the end of its useful life (expected replacement would be 1-3 years). An underground fuel oil tank on the North Campus will also need replaced within 1-3 years. The South Campus plant consists of three main boilers, all of which were replaced in 2015. Campus steam distribution piping for both North and South campuses are at the end of their life cycle and will need repaired or replaced.

Currently the North Campus peak steam demand is using 47% of the total plant capacity and the South Campus peak steam demand is using 57% of the total plant capacity. The capacity of the two main boilers on the North Campus can handle the full load of the campus, therefore the third, smaller boiler is not needed to be replaced at the end of its term. Additional buildings can utilize the North and South Campus plants without increasing current capacity in the short term as the campus moves towards electrification. Because the central plants are under-utilized currently (based on loads), they present a reliable source for heating as it relates to the equipment. Provided the current loads are not increased drastically in either campus, loss of a single boiler would not necessarily reflect a major campus wide shutdown.

The aging steam distribution system on both the North Campus and South Campus will need extensive maintenance and repair in the coming years if the system is to be kept in place. While the steam boilers currently operating were installed in 2015 and have an expected life of approximately 30 Years, it is the distribution piping that will require replacement. The steam tunnels and concrete trench systems are already in need of replacement within the coming 2-3 years, as well as the preinsulated steam piping. A failure or rupture in a steam distribution pipe will disrupt the large portions of the campus and potentially leaving many buildings unoccupiable in the heating season. Typically, these piping failures are not easy or quickly remedied, presenting a substantial risk to the university should this occur.

Ultimately, the age and required upgrades to the steam distribution systems on campus present further incentive to pursue and invest in electrification strategies campus wide and eliminate the use of fossil fuels.

Current and Future Electricity Rates

BR+A utilized data sets from the U.S. Energy Information Administration's (EIA) Annual Energy Outlook (AEO) in order to forecast energy costs. The EIA data set that most closely resembles UML's climate and operations is the New England Commercial building sector. Based on this data set, electricity rates are expected to slow +0.30%. This is primarily driven by an expected increase in renewable energy assets. Natural gas is expected to increase +0.50% (not including inflation). This is primarily driven by an expected retirement of nuclear and coal assets thereby focusing electricity generation on natural gas as well as electrification.

UML contracts with energy suppliers for multi-year, fixed rate contracts. The current electricity contract is with Constellation NewEnergy and is in effect until December 1, 2023. The rate is \$0.08230/kWh. The current gas contract is with Direct Energy and is in effect until December 1, 2022. The rate is \$2.53/Dth. Delivery and other associated costs were compiled from National Grid's publicly available rates. A G-3 and G-43 rate class was

used as the basis of this analysis given that is the rate class for UML’s larger accounts/accounts for a larger percentage of UML’s energy consumption. Below are lists of these assumptions.


Electricity Rate Assumptions


Charge	Rate (\$/kWh)
Supply Charge	0.08230
Distribution Charge (Peak Hours)	0.01357
Transmission Charge	0.02714
Transition Energy Charge	-0.00104
Energy Efficiency Charge	0.00967
Renewables Charge	0.00050

Natural Gas Rate Assumptions

Charge	Rate (\$/Dth)
Supply Charge	2.530
Gas Adjustment Factor (Peak Hours)	5.826
Local Distribution Adjustment Factor	1.007

Inflation is expected to be the primary driver of UML electricity and natural gas rates given the smaller impact of renewable energy and retiring assets. Therefore, the average year-over-year change in electricity rates is 3% with a 2050 estimated rate of \$0.26/kWh. The average year-over-year change in gas rates is 4% with a 2050 estimated rate of \$23.50/Dth. Below outlines how the 30-year electricity and natural gas rate rates are estimated to change over the next 30 years.

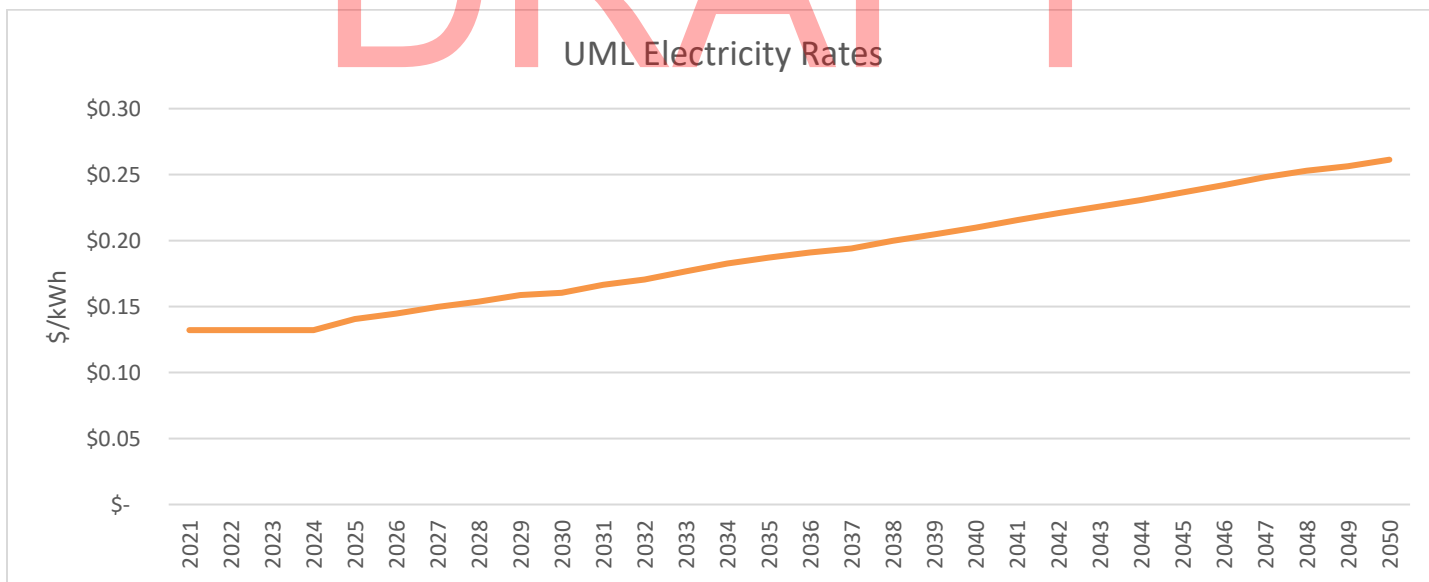

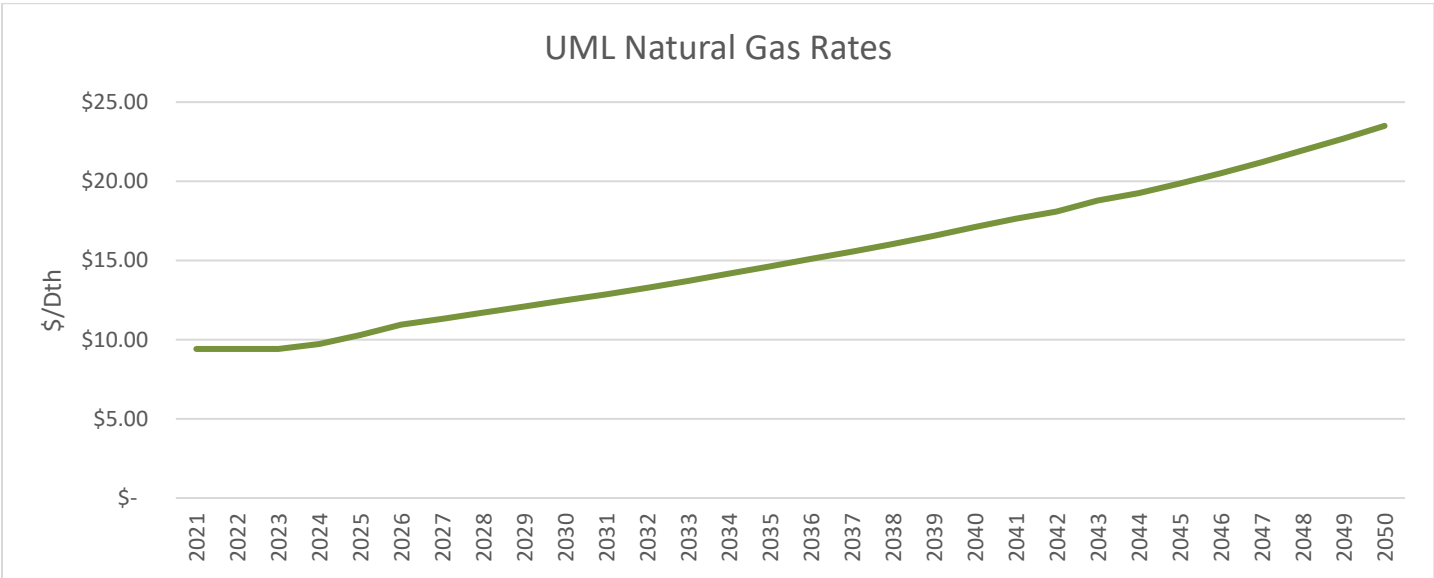

DRAFT

Alternative Case

Energy Efficiency Measure Descriptions

Energy efficiency is the first step in working towards UML's carbon neutral goal. ECMs, with the intent to reduce energy and move away from fossil fuels, have been identified through ASHRAE Level 1 audits. Along with reducing energy, ECMs also look to minimize building loads allowing building and campus plants and other mechanical systems to be right-sized and project equipment to be lower cost. A reduction in building load, especially on the heating side, also makes going all-electric even easier as smaller or less equipment means less mechanical space is required. Applying ECMs and transitioning towards building electrification reduces dependency on fossil fuels and moves reliance to the ever greener Massachusetts electric grid ultimately resulting in significant reductions of overall campus energy cost, energy consumption and greenhouse gas emissions.

ECM 1a - Wall Insulation - R-10 continuous insulation

Improve overall exterior wall R-value by R-10.

Measure description

There are two approaches for implementing this measure. The first strategy, over-cladding allows the work to occur while the building is in use, but does not preserve historic character. Over-cladding can be applied to any type of existing facade.

Any over-cladding approach will share common elements:

1. Wall preparation: Depending on the over-cladding system, the required preparation will vary. The labor costs of preparation should be factored into pricing comparisons between systems.
2. Air sealing with a spray on fluid applied air barrier, the permeability of which should be determined for optimal hygrothermal performance of the wall by an approved envelope consultant.
3. Exterior insulation: This can be in the form of a commercially available panelized system, however those tend to be more expensive. A panel system designed for the project that is fabricated offsite may be the most cost-effective in terms of materials and labor and will shorten construction duration. Lastly a site-built approach could also be taken which would entail more challenging quality assurance, higher labor costs and longer construction duration. Exterior insulation used could be moisture resistant wood fiber board as shown in this example (lowest embodied carbon), mineral wool, or even a foam based EIFS type system (highest embodied carbon).
4. Thermally broken clips with girts or rails – There are many different products available each with different thermal performance, structural properties, horizontal or vertical orientation, and range of available depth to accommodate varying insulation thicknesses
5. Lastly cladding – This should be lightweight to minimize the need for additional structural engineering and materials.
6. Optionally, if needed or desired, an interior wall can be furred out which can be insulated or not. Interior insulation options should be analyzed for hygrothermal performance to ensure long-term durability of the final assembly.

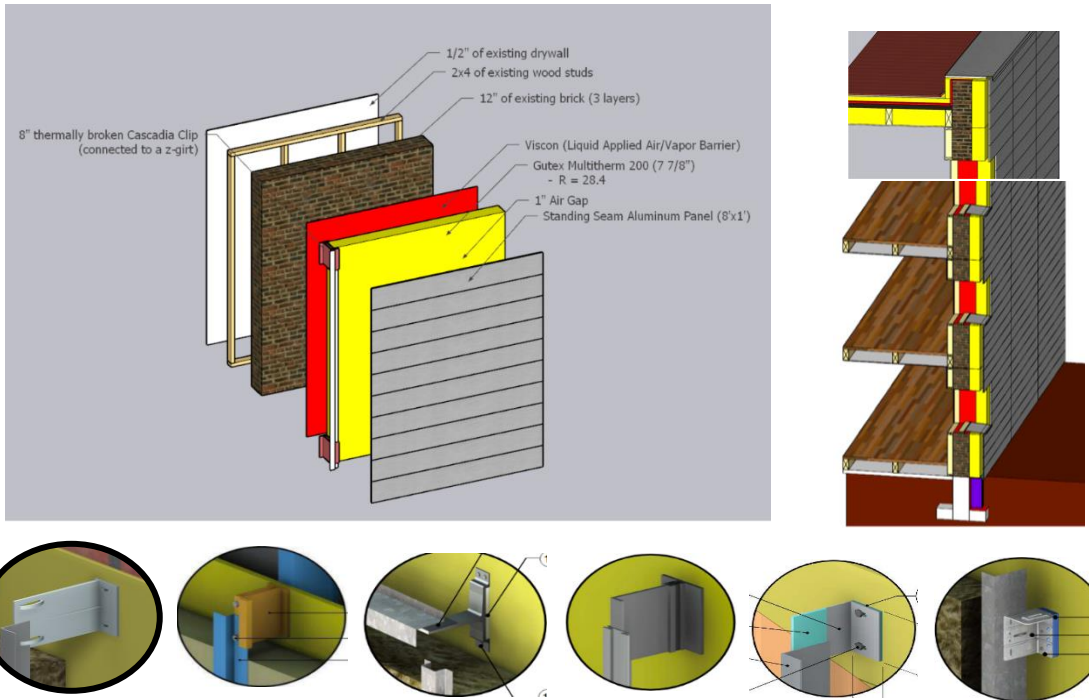



Figure ##: Over-cladding example with thermally broken clip system options

The alternative approach of insulating on the interior is appropriate for historic buildings where the original façade must be preserved.

The key here is to protect the existing masonry from water intrusion, while creating and insulated assembly that allows drying to the interior and the exterior in order to prevent moisture buildup in the brick which will now be colder in winter due to being cut off from interior heat by a layer of insulation, and prevent brick spalling, where trapped moisture inside the brick freezes, expanding and breaking off pieces.

The best strategy for insulating from the interior is shown below. Exterior treatment, air barrier and insulation options should be analyzed for hygrothermal performance to ensure long-term durability of the final assembly.

	<p>Prep the exterior concrete, stucco, stone or masonry wall and treat with silane or siloxane sealer. These sealers penetrate deep into the surface of the existing finish materials where they chemically react to form a hydrophobic barrier of cross-linked silicone resinous membranes within the pores, while remaining vapor permeable. Siloxane improves the ability of masonry to resist cracking, spalling, staining and other damage related to water intrusion. If the existing wall has been properly prepared these coatings can last for five to ten years.</p>
--	--

	<p>Air seal the interior with a permeable air barrier. Gypsum plaster works quite well combined with tapes and airtight paint, but other fluid applied vapor permeable air barriers will also do the job nicely. Air sealing must be done on both walls and the intersections of the intermediate floors to the exterior wall, across the ceiling and slab, at all rough openings and on all service penetrations.</p>
	<p>Windows can stay flush with exterior and be supported internally as we see above by a wood fiber/polyurethane board. This means the IGU is optimally aligned with the insulation layer in section view. The rough opening is treated with a permeable air barrier flashing, window positioned with nonconductive plastic shims, the shim gap filled with vapor open fibrous insulation, then the window is sealed with airtight to pre-primed gypsum prior to being fixed with steel brackets to inside face of wall.</p>
	<p>In the interior, a steel stud wall is furred out, but offset from the exterior brick wall by at least an inch to allow for fibrous vapor permeable insulation to fill the space between the steel stud and the masonry. The cavity is filled with insulation, then finished off with gypsum wallboard. Since the air barrier is outboard of the steel stud layers, electrical boxes do not need to be air sealed.</p>

DRAFT

In some instances, this approach may improve the overall appearance of the building or eliminate the need for existing façade maintenance. It must be noted that this measure will need further study by an approved envelope consultant to confirm appropriate application of the over-cladding system to prevent moisture issues. Prior to making any changes it will be required to investigate the presence of any toxic materials in the existing façade such as asbestos or PCBs and remediate as necessary.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Age and building type are primary drivers for recommending this measure. Older buildings are typically constructed with insulation only between framing members resulting in thermal bridging and reduced insulation performance or with no insulation at all.

[ECM 1b - Wall Insulation - R-30 continuous insulation](#)

Improve overall exterior wall R-value by R-30.

Measure description

See ECM 1a. It must be noted that this measure will need further study by an approved envelope consultant to confirm appropriate application of the over-cladding system to prevent moisture issues. Prior to making any

changes it will be required to investigate the presence of any toxic materials in the existing façade such as asbestos or PCBs and remediate as necessary.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Age and building type are primary drivers for recommending this measure. Older buildings are typically constructed with insulation only between framing members resulting in thermal bridging and reduced insulation performance or with no insulation at all.

[ECM 2a - Roof Insulation - R-30 continuous insulation](#)

Install additional insulation to improve overall roof R-value by R-30.

Measure description

Add insulation to the roof surface to improve thermal performance. The intent is to increase the existing roof insulation by adding continuous rigid roof insulation to achieve an overall R-value improvement. This measure requires the replacement of the weatherproof roofing membrane. To prevent thermal bridging and maintain anticipated thermal performance it is recommended to avoid mechanical fasteners and instead fully adhere the insulation and roof membrane.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Age, building type, existing roof insulation and condition. Older buildings that have not had a roof replacement are ideal candidates for a new roof with increased insulation levels.

[ECM 2b - Roof Insulation - R-50 continuous insulation](#)

Install additional insulation to improve overall roof R-value by R-50.

Measure description

Add insulation to the roof surface to improve thermal performance. The intent is to increase the existing roof insulation by adding continuous rigid roof insulation to achieve an overall R-value improvement. This measure requires the replacement of the weatherproof roofing membrane. To prevent thermal bridging and maintain anticipated thermal performance it is recommended to avoid mechanical fasteners and instead fully adhere the insulation and roof membrane.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Age, building type, existing roof insulation and condition. Older buildings that have not had a roof replacement are ideal candidates for a new roof with increased insulation levels.

ECM 3a - Glazing U-value/SHGC - Double-pane, U-0.30/ SGHC 0.25

Replace existing window assemblies with new utilizing double pane glass achieving an assembly U-value of U-0.30 with thermally-broken metal framing. The window assembly shall aim for a Solar Heat Gain Coefficient value of SHGC-0.25.

Measure description

Replace existing windows with new double pane glazing and thermally-broken metal framing to improve thermal performance by increasing overall thermal resistance. The intent is to remove existing window assemblies and replace with new efficient double-glazed units. Buildings with single pane glazing or older double pane systems have reduced thermal performance and higher solar gain. Replacing them with new high performance assemblies reduces heating and cooling loads. Prior to making any changes it will be required to investigate the presence of any toxic materials in the existing window assemblies such as asbestos or PCBs and remediate as necessary.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Based on building type, age and existing window assembly type/ condition.

ECM 3b - Glazing U-value/SHGC - Triple-pane, U-0.20/SGHC 0.25

Replace existing window assemblies with new utilizing triple pane glass achieving an assembly U-value of U-0.20 with thermally-broken metal framing. The window assembly shall aim for a Solar Heat Gain Coefficient value of SHGC-0.25.

Measure description

Replace existing windows with new triple pane glazing and thermally-broken metal framing to improve thermal performance by increasing overall thermal resistance. The intent is to remove existing window assemblies and replace with new efficient triple-glazed units. Buildings with single pane glazing or older double pane systems have reduced thermal performance and higher solar gain. Replacing them with new high performance assemblies reduces heating and cooling loads. Prior to making any changes it will be required to investigate the presence of any toxic materials in the existing window assemblies such as asbestos or PCBs and remediate as necessary.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Based on building type, age and existing window assembly type/ condition.

ECM 4a - Infiltration - 0.25 cfm/sf

Perform building analysis to identify points of infiltration through the building envelope and repair issues such that infiltration rates do not exceed 0.25 cfm/ sf of envelope area at 0.3 inches w.c. (75 Pa).

Measure description

Reduce existing amounts of air leakage through building envelope by remediating cracks, leaks and other means of unintended ambient air infiltration. The intent is to test the building for air leakage and to seal or repair problems. This requires a blower door test which lowers the inside pressure using temporary fans that pull air out of the building. This process identifies areas of the building that are not sufficiently sealed and require repair. After repair the blower door test can be re-performed to ensure the infiltration criteria set forth has been achieved.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Based on building type, age and existing façade condition.

ECM 4b - Infiltration - 0.10 cfm/sf

Perform building analysis to identify points of infiltration through the building envelope and repair issues such that infiltration rates do not exceed 0.10 cfm/ sf of envelope area at 0.3 inches w.c. (75 Pa).

Measure description

Reduce existing amounts of air leakage through building envelope by remediating cracks, leaks and other means of unintended ambient air infiltration. The intent is to test the building for air leakage and to seal or repair problems. This requires a blower door test which lowers the inside pressure using temporary fans that pull air out of the building. This process identifies areas of the building that are not sufficiently sealed and require repair. After repair the blower door test can be re-performed to ensure the infiltration criteria set forth has been achieved.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, reduced peak heating and cooling and improved overall occupant comfort.

Why is this measure being recommended for this building

Based on building type, age and existing façade condition.

ECM 5a - Air-side Systems - Decoupled systems (low)

Reconfigure or replace existing air handling units such ventilation air is conditioned separately from other building loads.

Measure description

Configure building air handling units such that ventilation load is decoupled from other building loads. Generally speaking a central 100% outdoor air unit with energy recovery shall be sized to only meet ventilation requirements while localized terminal units (fan coils) meet all other heating and cooling loads. The intent is to

modify or replace existing air handling units such that they include energy recovery and provide 100% outdoor air for ventilation only and be tied to zonal 4-pipe fan coil units.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, and reduced peak heating and cooling by reducing the amount of outdoor air.

Why is this measure being recommended for this building

Based on building type (residential/office-classroom), age and existing air handling configuration.

ECM 5b - Air-side Systems - Decoupled systems (high)

Reconfigure or replace existing air handling units such ventilation air is conditioned separately from other building loads.

Measure description

Configure building air handling units such that ventilation load is decoupled from other building loads. Generally speaking a central 100% outdoor air unit with energy recovery shall be sized to only meet ventilation and lab make-up air requirements while localized terminal units (fan coils) meet all other heating and cooling loads. The intent is to modify or replace existing air handling units such that they include energy recovery and provide 100% outdoor air for ventilation only and be tied to zonal 4-pipe fan coil units.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption, and reduced peak heating and cooling by reducing the amount of outdoor air.

Why is this measure being recommended for this building

Based on building type (lab), age and existing air handling configuration.

ECM 5c - Air-side Systems - Constant to variable volume (low)

Reconfigure or replace existing air handling units to operate as variable volume. This measure focuses on buildings with lower airflow capacity (low cfm/ ft²).

Measure description


Upgrade or replace constant volume existing air-handling units with a variable volume air distribution system. This involves providing variable volume airflow via variable frequency drive control and variable flow terminal units. The intent is to upgrade the air distribution system such that it can modulate airflow to meet varying building loads. Reducing air-flow results in lower fan use and less reheating, along with decreased cooling and pump use.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption.

Why is this measure being recommended for this building

Based on building type (non-lab) and existing air handling configuration.

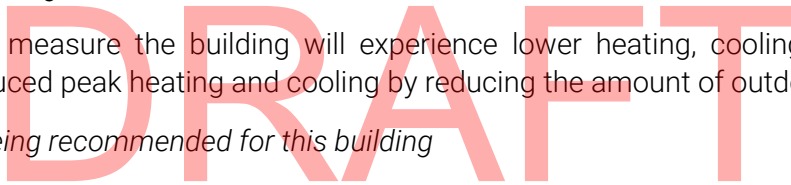

ECM 5d - Air-side Systems - Constant to variable volume (high)

Reconfigure or replace existing air handling units such that they can operate as variable volume. This measure focuses on buildings with higher airflow capacity (high cfm/ ft²).

Measure description

Upgrade or replace constant volume existing air-handling units with a variable volume air distribution system. This involves providing variable volume airflow via variable frequency drive control and variable flow terminal units. The intent is to upgrade the air distribution system such that it can modulate airflow to meet varying building loads. Reducing air-flow results in lower fan use and less reheating, along with decreased cooling and pump use.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption.

Why is this measure being recommended for this building

Based on building type (lab) and existing air handling configuration.

ECM 5e - Air-side Systems - Airflow setbacks

Provide controls to reduce unoccupied minimum airflows.

Measure description

Provide controls that allow room airflow minimums to reset lower when a space is unoccupied. The intent is to reduce unnecessary airflow in spaces when loads are satisfied and the space is unoccupied. When a space is occupied there is a minimum airflow required to meet ventilation and comfort requirements. When a space is unoccupied as indicated via an occupancy sensor there is no longer a need to meet these requirements. The room will go into an 'unoccupied' setting allowing the airflow minimum to reset to a lower value as long as the loads are satisfied. This is recommended for spaces that are non-critical in nature such as offices, classrooms and conference rooms. This measure also falls under ECMs 10a & 10c but is intended as a standalone measure.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption.

Why is this measure being recommended for this building

Based on building type, space type, and existing controls.

ECM 5f - Air-side Systems - Air quality (Aircuity, particle counters)

Provide controls to reduce unoccupied minimum airflows.

Measure description

Provide controls that allow space airflow design minimums to reset lower when conditions meet air quality monitoring (lab) or particle counter monitoring (cleanroom) setpoints. The intent is to reduce unnecessary airflow in spaces when loads are satisfied and the space meets minimum air quality or particle count set-points. This is recommended for chemical laboratory or cleanroom type spaces.

What metrics are improving

By implementing this measure the building will experience lower heating, cooling, fan and pump energy consumption due to reduced outdoor air and fan operation.

Why is this measure being recommended for this building

Based on building type, space type, age and existing air handlers this approach is recommended.

ECM 6a - Air-side Energy Recovery - 70% (Single Wheel Recovery)

Improve or provide means of recovering energy from building exhaust with a minimum recovery effectiveness of 70%.

Measure description

Install or upgrade to a total enthalpy energy recovery wheel. The intent is to increase the amount of energy recovered from the exhaust air stream to in turn reduce the amount of heating and cooling required. This is recommended only for non-lab type spaces. Enthalpy energy recovery wheels use rotating desiccant wheels to transfer sensible and latent energy from the exhaust air stream to the supply air stream.

What metrics are improving

By implementing this measure the building will experience reduced heating and cooling loads due to the recovery of energy that would otherwise be wasted through the exhaust.

Why is this measure being recommended for this building

Based on building type and space type this approach is recommended.

ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)

Improve or provide means of recovering energy from building exhaust with a minimum recovery effectiveness of 90%.

Measure description

Install or upgrade to an exhaust heat regen system. This system is similar in technology to heat wheel heat recovery using desiccant media but instead uses two alternating cores in lieu of a wheel. This advancement allows one core to recovery exhaust heat while the second preheats the outdoor air. When the second core can no longer preheat, the cores switch. This increases effectiveness of the system by preventing frost on the heat recovery media and eliminating the frost cycle heating that would otherwise be required.

The intent is to increase the amount of energy recovered from the exhaust air stream to in turn reduce the amount of heating and cooling required. This is recommended only for non-lab type spaces.

What metrics are improving

By implementing this measure the building will experience reduced heating and cooling loads due to the recovery of energy that would otherwise be wasted through the exhaust.

Why is this measure being recommended for this building

Based on building type and space type this approach is recommended.

ECM 6c - Air-side Energy Recovery - 50% (Runaround Coil)

Improve or provide means of recovering energy from building exhaust with a minimum recovery effectiveness of 50%.

Measure description

Install or upgrade to a conventional glycol runaround heat recovery system. The intent is to increase the amount of energy recovered from the exhaust air stream to in turn reduce the amount of heating and cooling required. Glycol runaround heat recovery uses a closed loop system with hydronic coils located in the exhaust and supply airstreams. Pumps move the glycol between the coils to transfer sensible heat between the exhaust and supply as needed. This is recommended only for laboratory type spaces where supply and exhaust air streams cannot be mixed.

What metrics are improving

By implementing this measure the building will experience reduced heating and cooling loads due to the recovery of energy that would otherwise be wasted through the exhaust.

Why is this measure being recommended for this building

Based on building type and space type this approach is recommended.

ECM 6d - Air-side Energy Recovery - 70% (DOAS Konvekta + Heat Pump)

Improve or provide means of recovering energy from building exhaust with a minimum recovery effectiveness of 70%.

Measure description

Install or upgrade to a high performance glycol runaround heat recovery system in combination with exhaust source heat-pump chiller. The intent is to increase the amount of energy recovered from the exhaust air to in-turn reduce the amount of heating and cooling required. This technology combines high performance runaround heat recovery coils with an air-source heat pump chiller to maximize system heat recovery effectiveness. Konvekta heat recovery uses specially designed coils along with advance control algorithms to maximize heat transfer between the supply and exhaust airstreams. The heat pump is designed such that it can remove more heat from or reject more heat to the building exhaust air stream and transfer it to where it can pretreat outdoor air more efficiently than the heat recovery coils alone. This is recommended only for laboratory type spaces where supply and exhaust air streams cannot be mixed.

What metrics are improving

By implementing this measure the building will experience lower heating and cooling energy.

Why is this measure being recommended for this building

Based on building type and space type this approach is recommended.

ECM 7a - Water-side Systems - Standalone VRF

Increase cooling energy efficiency by installing advanced VRF systems to provide cooling in lieu of a traditional cooling system.

Measure description

Install or upgrade to efficient Variable Refrigerant Flow (VRF) systems for comfort cooling. The intent is to provide cooling in spaces where the ventilation can be decoupled from cooling loads such as in office and

classroom type space. VRF differs from other types of cooling in that it moves refrigerant throughout the building to indoor units located directly in the conditioned space. As the space loads change, VRF has the ability to modulate the refrigerant flow to each indoor unit so that it only consumes enough energy to meet the load. There is also an option that allows for heat recovery for buildings that regularly have simultaneous heating and cooling further enhancing efficiency.

What metrics are improving

By implementing this measure the building will benefit from reduced cooling energy when compared to most alternatives.

Why is this measure being recommended for this building

Based on building type, space type and ease of retrofit this approach is recommended.

ECM 7b - Water-side Systems - Standalone AWHP

Add Air to Water Heat Pump (AWHP) heating system to increase heating efficiency over other electric heating alternatives.

Measure description

Install or upgrade to efficient heat pump heating. The intent is to provide heating using air to water heat pumps in lieu of using electric boilers or electric resistance. AWHP technology uses the refrigerant cycle to remove heat from the ambient air and transfer it to the hot water loop similar in place of a boiler. This process is significantly more energy efficient than using standard electric resistance heating. It also eliminates site carbon emissions in comparison to natural gas heating.

What metrics are improving

By implementing this measure the building will benefit from reduced heating energy when compared to other electric heating alternatives.

Why is this measure being recommended for this building

Based on building type, existing heating source and available outdoor space to locate the AWHP units.

ECM 7c - Water-side Systems - Pump VFDs

Increase pumping energy efficiency by installing variable speed drives on pumps.

Measure description

Install variable speed drives on pumps that currently operate at constant volume to allow pumps to modulate flow based on load. Differential pressure sensors shall also be installed to monitor the pressure across the loop supply and return. Additionally, all 3-way valves on the system shall be converted to 2-way.

What metrics are improving

By implementing this measure the building will benefit from reduced pumping energy.

Why is this measure being recommended for this building

Based on building current pump control, operation and motor horsepower.

ECM 8a - Lighting - LED Conversion

Increase lighting efficiency and appearance by replacing existing inefficient lighting with new LED fixtures.

Measure description

Upgrade all existing lighting to LED lighting fixtures. The intent is to convert any interior lighting fixtures to energy efficient LED where they have not been already. LED lighting is more efficient and has a longer life reducing the need for replacement.

What metrics are improving

By implementing this measure the building will benefit from reduced lighting and cooling energy.

Why is this measure being recommended for this building

Based on existing lighting fixtures.

[ECM 8b - Lighting - Occupancy Sensors](#)

Install occupancy sensors to turn off lighting when spaces have been unoccupied after a period of time.

Measure description

Install lighting occupancy sensors. The intent is to add occupancy sensors where not currently installed to control lighting in areas not required to be lit 24 hour a day. These lighting controls automatically turn lighting on when occupancy is detected and turn off lighting after a set time when no longer occupied.

What metrics are improving

By implementing this measure the building will benefit from reduced lighting and cooling energy.

Why is this measure being recommended for this building

Based on existing lighting controls.

[ECM 8c - Lighting - Daylight Sensors](#)

Install photocell sensors to limit amount of artificial lighting based on the availability of natural lighting from exterior windows.

Measure description

Install daylighting sensors. The intent is to add daylighting sensors to modulate lighting based on available natural light. Photocells are installed to sense space lighting levels, as natural light through windows and skylights varies the artificial lighting is adjusted to maintain desired lighting levels. This is recommended in spaces where non-critical activities occur.

What metrics are improving

By implementing this measure the building will benefit from reduced lighting and cooling energy.

Why is this measure being recommended for this building

Based on existing lighting controls.

[ECM 9a - Plumbing - Low Flow Fixtures](#)

Install new low-flow lavatory, kitchenette sink and shower head units to reduce domestic water consumption and hot water heater energy.

Measure description

Replace existing domestic water fixtures with low-flow units. The intent is to reduce water consumption by using low-flow fixtures. It is suggested that existing fixtures in lavatory sinks, showerheads and kitchenette sinks be examined for rated flow and new low-flow units be installed where appropriate.

What metrics are improving

By implementing this measure the building will benefit from reduced domestic water consumption and reduced hot water heater energy.

Why is this measure being recommended for this building

Based on existing domestic water fixtures, this building offers a good opportunity to reduce water consumption.

ECM 9b - Plumbing - Instantaneous Water Heater

Install new instantaneous domestic hot water heaters in place of existing hot water heaters.

Measure description

Replace existing domestic hot water heater with instantaneous hot water heater. The intent is to eliminate energy consumption during stand-by periods associated with storage tank type hot water heaters. Instantaneous hot water heaters make hot water only when it is called for, otherwise these units do not consume any energy.

What metrics are improving

By implementing this measure the building will benefit from a reduction in hot water heating energy.

Why is this measure being recommended for this building

Based on existing domestic water heater configuration, there is a good opportunity to reduce energy associated with heating domestic hot water.

ECM 9c - Plumbing - Electric Water Heater

Install new electric domestic hot water heaters in place of existing steam fired hot water heaters.

Measure description

Replace existing domestic steam fired hot water heaters with electric hot water heaters. The intent is to reduce emissions associated with using fossil fuels to generate domestic hot water.

What metrics are improving

By implementing this measure the building will benefit from a reduction in fossil fuel emissions.

Why is this measure being recommended for this building

Based on existing domestic water heater configuration, this building offers a good opportunity to reduce fossil fuel emissions associated with heating domestic hot water, this approach is recommended.

ECM 9d - Plumbing - Electric Water Heater with Storage

Install new electric domestic hot water heaters in place of existing hot water heaters.

Measure description

Replace existing domestic hot water heater with electric hot water heater with storage. The intent is to reduce emissions associated with using fossil fuels to generate domestic hot water.

What metrics are improving

By implementing this measure the building will benefit from a reduction in fossil fuel emissions.

Why is this measure being recommended for this building

Based on existing domestic water heater configuration, this building offers a good opportunity to reduce fossil fuel emissions associated with heating domestic hot water, this approach is recommended.

ECM 9e - Plumbing - ASHP Water Heater with Storage

Install new electric ASHP domestic hot water heaters with storage in place of existing electric hot water heaters with storage.

Measure description

Replace existing electric domestic hot water heater with electric Air Source Heat Pump (ASHP) hot water heater with storage. The intent is to reduce electric energy consumption associated with generating domestic hot water. ASHP technology uses the refrigerant cycle to remove heat from the surrounding air and transfer it to the domestic water to raise its temperature. This process is significantly more energy efficient than using a standard electric resistance domestic water heater.

What metrics are improving

By implementing this measure the building will benefit from a reduction hot water heating electric energy.

Why is this measure being recommended for this building

Based on existing domestic water heater configuration, this building offers a good opportunity to reduce energy associated with heating domestic hot water.

ECM 10a - Controls – DDC

Install new DDC controls to maximize automated building control.

Measure description

Install Direct Digital Controls (DDC) to allow for greater controllability of building systems and eliminate the need for manual control. The intent is to reduce energy consumption by monitoring HVAC and other building components and automatically controlling them as required to satisfy building set points. There are many control sequences that can be implemented through the installation of DDC controls, a partial list follows:

- Space temperature scheduling and automatic unoccupied temperature set-back.
- Unoccupied space airflow set-back.
- Air handler:
 - Static pressure reset.
 - Supply air temperature reset.
 - Outdoor air economizer.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Based on existing building having limited to no automated building controllability.

ECM 10b - Controls - Retrocommissioning

Perform retro-commissioning to ensure building is operating as originally designed.

Measure description

Perform Retro-commissioning to improve building performance such that the building operates as originally designed. The intent is to reduce energy consumption by reviewing the original design documents and ensuring the building is operating as intended. Over time building operations can be overridden or adjusted from the original design intent causing excessive energy consumption. The Retro-commissioning procedure will evaluate current building operation to define where it deviates from the original design and restore it. This may also expose issues the building was experiencing requiring the deviations.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Due to the age, energy consumption and apparent operation of the building this measure is recommend for implementation.

ECM 10c - Controls - DDC Sequence Upgrades

New DDC control sequences to maximize automated building control.

Measure description

Provide new sequence of operations for various control points such as temperature setbacks and resets, air-side economizer, water-side economizer and static pressure reset. The intent is to reduce energy consumption by enhancing automated controllability of various building components.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Based on existing building having limited to no automated building control, this approach is recommended.

ECM 11a - Process Loads - Behavior Change

Educate building users on ways to reduce their energy usage.

Measure description

Apply simple behavioral changes to reduce energy without requiring modification to the building or controls. The intent is to promote energy awareness and encourage building users to be conscientious about their energy consumption. This can be accomplished by providing signage around equipment regularly left on (shut the sash, turn off lights/monitors/ lab equipment), requiring occupants to set back thermostat and close windows when leaving for extended periods, having IT support program computers to enter sleep mode automatically and by hosting competitions against others to reduce energy.

What metrics are improving

This approach can reduce heating, cooling, fan, pump, receptacle and lighting energy.

Why is this measure being recommended for this building

Any building can benefit from users practicing smart energy behavior.

[ECM 11b - Process Loads - Filtered Fume Hoods](#)

Provide new filtered fume hoods.

Measure description: Provide new filtered fume hoods in lieu of exhausted fume hoods to reduce energy associated with conditioning make-up air. The intent is to reduce energy consumption by reducing the required amount of fume hood exhaust make-up air. Filtered fume hood technology allows for fume hood exhaust to be filtered and safely returned to the lab space rather than being exhausted from the building. Traditional exhausted fume hoods exhaust 100% of fume hood from the building which requires conditioned make-up air. Filtered fume hoods have limitations regarding the type of chemicals that can be used within, it is necessary to confirm what chemicals are used in the lab before selecting a filtered hood.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Based on existing building having labs with standard fume hoods or for proposed new fume hoods.

[ECM 11c - Process Loads - Low Flow Fume Hoods](#)

Provide new low flow fume hoods.

Measure description

Provide new low-flow fume hoods in lieu of standard flow fume hoods to reduce energy associated with conditioning make-up air. The intent is to reduce energy consumption by reducing the required amount of fume hood exhaust make-up air. Standard flow fume hoods are typically designed to operate with a face velocity of 100 FPM or greater. Low flow fume hoods are designed to operate at 80 FPM or less while safely containing fume hood contents. The face velocity reduction equates to less fume hood exhaust and conditioned make-up air requirements.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Based on existing building having labs with standard fume hoods or for proposed new fume hoods.

[ECM 11d - Process Loads - Fume Hood Sash Vacancy Sensors](#)

Provide fume hood sash vacancy sensors.

Measure description

Install fume hood sash vacancy sensors on existing fume hoods to reduce air-flow through the fume hood when hood operator is not present. The intent is to reduce energy consumption by reducing the required amount of fume hood exhaust and make-up air when appropriate. This technology retrofits existing fume hoods with automatically closing sashes to safely reduce fume hood flow when the operator has been away from the front of the hood for a set period of time.

What metrics are improving

By implementing this measure the building will benefit from a reduction in heating, cooling, fan and pump energy.

Why is this measure being recommended for this building

Based on existing building being a lab building with standard flow fume hoods that do not have the ability to automatically reduce the fume hood flow.

ECM 11e - Process Loads - Plug Load Management

Provide controls to reduce plug loads when equipment is not in use.

Measure description

Provide controls which have the ability to turn off non-critical equipment when user is not present. The intent is to reduce energy consumed when receptacle equipment is idle due to occupant inactivity. This measure connects an occupancy sensor with a portion of local receptacles to automatically turn off plugged in equipment when identified as unoccupied. It is important to note that certain equipment such as computers and other components which need a regular power supply not be powered by this system.

What metrics are improving

By implementing this measure the building will benefit from a reduction in receptacle equipment and cooling energy.

Why is this measure being recommended for this building

Based on the existing building having office, conference, breakrooms, classrooms printing/ copying rooms and individual workstations.

ECM 11f - Process Loads - Energy Star Office Equipment

Select Energy Star rated office equipment when purchasing new equipment.

Measure description

When purchasing new office equipment purchase Energy Star rated equipment such as computers, monitors, printers, copiers and appliances. The intent is to reduce receptacle energy consumed during normal operation and when on standby mode. An Energy Star rating means equipment has been independently certified that it meets energy performance in a given product category.

What metrics are improving

By implementing this measure the building will benefit from a reduction in receptacle equipment and cooling energy.

Why is this measure being recommended for this building

Based on the existing building having office, conference, breakrooms, classrooms printing/ copying rooms and individual workstations.

ECM 11g - Process Loads - Energy Star Kitchen Equipment

Select Energy Star rated kitchen equipment when purchasing new equipment.

Measure description

When purchasing new equipment purchase Energy Star rated kitchen equipment such as refrigerators, freezers, dishwashers, griddles and ice makers. The intent is to reduce receptacle energy consumed during normal operation and when on standby mode. An Energy Star rating means equipment has been independently certified that it meets energy performance in a given product category.

What metrics are improving

By implementing this measure the building will benefit from a reduction in receptacle equipment and cooling energy.

Why is this measure being recommended for this building

Based on the existing building having a kitchen or kitchenette.

ECM 12 – Natatorium – High Efficiency Heating and Cooling

Provide new packaged DX air handling unit with condenser heat recovery.

Measure description

Install new air handling unit with packaged DX cooling and condenser heat recovery to serve the Costello pool. The intent of this measure is to provide the natatorium with a new air handling unit which has the capability to control temperature and humidity set-points while recovering waste heat from the condenser. The waste heat is then in turn used to reheat supply air and heat pool water. Outdoor air heat recovery should also be considered when selecting the air-handling unit. A number of manufacturers (Desert Aire, PoolPak, Seresco for example) make units designed specifically for natatorium duties.

What metrics are improving

By implementing this measure the building will experience lower heating consumption due to the recovery and re-use of waste heat.

Why is this measure being recommended for this building

Based on building type, space type, age and existing air handlers this approach is recommended.

Alternative Energy Measures Descriptions

Overview

There are many technologies and fuels that can be considered when developing a carbon neutral master plan. It is important to focus the primary effort on proven solutions, namely: energy efficiency, electrification via heat pumps, solar photovoltaic (PV) for on-site renewable energy and procurement of additional off-site renewable energy to offset the remaining energy. But, other technologies and fuels may be considered; some may be valuable as a supplement to the primary strategies, others are not recommended.

This section provides a synopsis of a wider range of technologies and fuels, including a high-level assessment of the emissions, feasibility, cost, and potential resiliency advantages. A recommendation is made for each, listing them as a primary, supplemental or rejected option. The table below provides a quick visual reference, followed by more detailed narratives of the supplemental and rejected options. The primary recommended options are addressed in other sections of the report.

AEM #	Alternative Energy Measure	Low Construction Cost	Low Maintenance	Reduced Energy Cost	Low Life Cycle Cost	Familiar to Facilities Staff	Carbon Emissions Reduction	Resiliency Benefits	Space Requirements	Primary Solution Pass / Fail	Peaking + Back-up System Pass / Fail
1	Biodiesel generator	-	-	X	X	-	XXX	✓✓	✓	Fail	Pass
2	Biodiesel boiler	✓	✓	X	X	-	XXX	✓	✓	Fail	Pass
3	Biomass boiler (wood chips)	-	-	✓	X	X	XXX	✓	X	Fail	Fail
4	Electric boiler	✓	✓✓	XXX	XXX	-	XXX	X	✓	Fail	Fail
5	Heat-recovery electric chiller	✓	✓	✓	✓	-	✓✓✓	✓	✓✓	Pass	n/a
6	HP (air-to-water) - large scale	✓	-	X	✓	-	✓✓	X	✓✓✓	Pass	n/a
7	HP (air-to-water) - small scale	✓	-	X	✓	-	✓✓	X	✓✓✓	Pass	n/a
8	GSHP closed loop, horizontal	X	✓✓	✓	-	-	✓✓	X	XXX	Fail	n/a
9	GSHP closed loop, vertical	X	✓✓	✓✓	✓	-	✓✓✓	X	✓	Pass	n/a
10	GSHP open loop	-	XX	✓✓	-	X	✓✓✓	X	✓	Fail	n/a
11	TTES (Tank Thermal Energy Storage)	-	✓✓✓	-	-	-	X	✓	X	Fail	n/a
12	Solar Thermal	X	X	✓	XX	X	✓	-	X	Fail	n/a
13	Photovoltaics	✓	✓✓✓	✓✓✓	✓✓	✓	-	✓	✓	Pass	n/a
14	Battery storage	X	✓✓	✓	✓	X	✓✓	✓✓	✓	Pass	n/a
15	Wind turbine	XX	✓	✓	XX	X	✓	✓	XXX	Fail	n/a

AEM 1, 2 - Biodiesel Generators + Boilers

Biodiesel generators combust biodiesel to generate electricity. Biodiesel boilers combust biodiesel to generate heat.

Emissions

Biodiesel may result in lower carbon emissions than conventional fossil fuel diesel and natural gas. But, biodiesel is not life-cycle carbon neutral. There are emissions associated with growing the feedstock and processing and transporting the biodiesel. In addition, increased farming for biodiesel feedstock can result in land use changes that further increase the life cycle emissions of biodiesel. Biodiesel also results in lower particulate emissions than conventional fossil fuel diesel. But, biodiesel results in higher particulate emissions than natural gas. Particulates negatively impact air quality and human health.

Feasibility, Cost and Operations

Biodiesel generators, boilers, fuel storage and associated systems is more expensive to procure and higher cost to operate (due to higher maintenance and energy costs) than conventional fossil fuel diesel and natural gas. Therefore, there is no life cycle cost advantage to biodiesel generators. Biodiesel is also less stable than conventional fossil fuel diesel and needs to be consumed and replenished periodically; therefore, biodiesel should not be used solely as a back-up fuel source.

Resiliency

Biodiesel generators offer similar resiliency benefits as conventional fossil fuel diesel generators. They offer greater resilience than natural gas generators for short-term electric power failures, because the fuel is stored on-site. But, they offer lesser resilience than natural gas generators for long-term electric power failures, because they do not have a limitless source of fuel (which natural gas can offer).

Recommendation

Biodiesel generators (in combination with biodiesel boilers) are offered as a peaking and back-up system for UML consideration. The intent would be to operate the biodiesel generators as a source for back-up power, during periods of electric grid failure. The intent would be to operate the biodiesel boilers as a source of heating for peak winter conditions and as a back-up heating source, during periods of electric grid failure (when the electric heat pump systems would not operate).

AEM 3 - Biomass Boilers

Biomass boilers combust wood chips or wood pellets to generate heat.

Emissions

Biomass may result in lower carbon emissions than conventional fossil fuel diesel and natural gas. But, biomass is not life-cycle carbon neutral. There are emissions associated with growing some types of feedstock and processing and transporting the biomass. In addition, increased farming for some types of biomass feedstock can result in land use changes that further increase the life cycle emissions of biomass. Combustion of biomass results in higher particulate emissions than natural gas. Particulates negatively impact air quality and human health.

Feasibility, Cost and Operations

Biomass boiler plants, including boilers, fuel storage areas, truck access, and conveying systems requires a large area and is not compatible with urban campuses, such as UMass Lowell.

Resiliency

Biomass boilers offer similar resiliency benefits as conventional fossil fuel oil boilers. They offer greater resilience than natural gas generators for short-term electric power failures, because the fuel is stored on-site.

But, they offer lesser resilience than natural gas generators for long-term electric power failures, because they do not have a limitless source of fuel (which natural gas can offer).

Recommendation

Biomass boilers are not recommended for UMass Lowell. This is due to the lack of emissions savings and the large area required for a biomass boiler plant.

[AEM 4 - Electric Boilers](#)

Electric boilers use electric resistance to generate heat.

Emissions

Electric resistance results in higher emissions than on-site combustion of natural gas for heating. In the future, as grid emissions become lower, electric resistance will be lower emissions than on-site combustion of natural gas for heating. But, electric resistance heating results in high peak electrical demands, which currently results in operation of the high emissions “peaker” plants on the grid.. High peak demands also makes it more difficult (and more expensive) for the grid to shift toward reliance entirely on renewable energy systems, because the energy storage capacity must be increased.

Feasibility, Cost and Operations

Electric resistance boilers require large electric infrastructure and result in high energy costs. Therefore, they are not life cycle cost effective. Operation of electric resistance boilers is relatively simple and low maintenance.

Resiliency

Electric resistance boilers are not a resilient system, because they rely on electricity to operate, and would require large generators, in case of electric grid failure. It is far more efficient and cost effective to rely on combustion boilers as a resilient heating source, than it would be to rely on electric boilers and generators.

Recommendation

Electric resistance boilers could be considered as a small part of a central heating plant, but they provide limited advantages. Therefore, they are not recommended as part of this study.

[AEM 5, 6, 7 - Heat-Recovery Electric Chiller and Air-Source Heat Pumps](#)

Heat-recovery electric chillers and air source heat pumps are proven solutions and are recommended as primary systems for UMass Lowell. Therefore, heat recovery electric chillers and air source heat pumps are addressed in detail elsewhere in this report.

[AEM 8, 9, 10 - Ground-Source Heat Pumps](#)

Ground-source heat pump systems rely on electric heat pumps, coupled with a ground heat-exchanger to provide heating and cooling. The ground heat-exchanger can be one of three types: vertical closed loop, horizontal closed loop, and open loop.

Emissions

All types of ground-source heat pump systems result in high-efficiency electric sources of heating and cooling. This results in significantly lower emissions than any combustion or electric resistance-based system.

Feasibility, Cost and Operations

Vertical closed-loop is the most common type of ground-source heat exchanger in this region. This is due to the fact that it requires less area than horizontal ground-source systems and avoids the problems associated with open-loop systems.

Horizontal closed-loop requires approximately 10x the area required for vertical ground-source systems.

Open-loop systems can result in fouling and/or corrosion of pumps and heat exchangers. Contrary to popular belief, open loop systems (assuming no bleed water) do not provide significantly greater capacity than vertical closed-loop systems of similar depth and therefore offer little advantage.

Resiliency

Ground-source heat pumps are not typically considered to be a resilient system, because they rely on electricity to operate, and would require larger generators, in case of electric grid failure. It is less expensive to rely on combustion boilers as a resilient heating source, rather than rely on ground-source heat pump systems and have to increase the capacity of the generators.

Recommendation

Vertical closed loop ground-source heat pump systems are likely a valuable component of the carbon neutral solutions for UMass Lowell. This is a highly efficient and all electric heating and cooling source. Horizontal closed loop is not recommended, due to unreasonable space requirements. Open loop is not recommended, due to maintenance risks.

[AEM 11 - Tank Thermal Energy Storage](#)

Tank thermal energy storage is typically large tanks that store chilled water or hot water, allowing heat pumps to operate more consistently, charging up the tanks during periods of low thermal load, and then simultaneously discharging from the tanks and running the heat pumps during periods of high thermal load. This reduces the required heat pump capacity and reduces peak electric demand on the grid.

Emissions

Thermal energy storage can result in reduced operating emissions, when thermal energy is generated and stored during periods of low grid emissions and discharged during periods of high grid emissions.

Feasibility, Cost and Operations

Thermal energy storage is most advantageous when loads are highly variable. The thermal loads for the UMass Lowell campus are anticipated to be less variable in the future, as energy retrofit projects are implemented. In addition, to be effective, the volume of thermal storage is very large, requiring a significant amount of space.

Resiliency

Thermal energy storage systems can offer some resiliency advantages by reducing the peak thermal load on back-up heating systems.

Recommendation

Thermal energy storage systems should be considered as a component of the alternative energy systems for UMass Lowell. But, they are not a primary element of the systems being considered and therefore should be evaluated in the future, when the system is being fully designed, in preparation for construction.

[AEM 12 - Solar Thermal](#)

Solar thermal is a renewable energy system that relies on solar radiation to provide heating.

Emissions

Solar thermal systems result in zero operating emissions.

Feasibility, Cost and Operations

Solar thermal systems are highly efficient at converting solar energy into a useful energy source. But, the thermal varies from very high values on clear days to zero output at night. It is difficult to align the thermal energy production with the heating demand of a building or campus. Therefore, solar thermal systems are typically paired with large thermal storage tanks. Solar thermal produces more energy between April and August than between September and March, because of the shorter days and lower sun-angle in the Fall and

Winter. This does not align well with the heating demand profile of buildings or campuses, particularly when heat recovery systems are in place. Solar thermal systems are also relatively complex and high cost. Therefore, solar thermal systems offer little value, when compared with solar photovoltaic systems and heat pumps.

Resiliency

Solar thermal systems offer little resiliency benefit, due to their reliance on clear skies for optimal output.

Recommendation

Solar thermal systems are not recommended as a primary component of the alternative energy systems for UMass Lowell. This is largely due to the fact that solar photovoltaic systems and heat pumps systems can perform a similar role and are lower cost to install, are more life cycle cost effective and offer greater flexibility and emissions reduction.

[AEM 13, 14 - Solar Photovoltaic + Battery Storage](#)

Solar photovoltaic (PV) is a renewable energy system that relies on solar radiation to produce electricity. Batteries allow storage of electricity and offer peak-shaving opportunities.

Emissions

Solar PV systems result in zero operating emissions. Batteries can result in reduced operating emissions, when electricity is stored during periods of low grid emissions and discharged during periods of high grid emissions.

Feasibility, Cost and Operations

Solar PV systems are feasible, cost effective and low maintenance. Battery systems vary in terms of cost-effectiveness, based on the building demand profile and the SMART incentive program.

Resiliency

Solar PV systems and batteries can offer some resiliency advantages by reducing the electric load on generators.

Recommendation

Solar PV is recommended and in some instances batteries are recommended for UMass Lowell. The evaluation of solar PV and batteries is addressed in detail in a separate section of this report.

[AEM 15 - Wind Turbines](#)

Wind turbines are a renewable energy system that relies on wind to generate electricity.

Emissions

Wind turbines result in zero operating emissions.

Feasibility, Cost and Operations

Small-scale wind turbines are not cost effective and are typically used only as a visual indication that renewable energy is being generated on a site. This is not a local reason to install a renewable energy system. Large-scale wind turbines are marginally cost-effective in sub-optimal sites, such as the UMass Lowell campus. In addition, they result in a “strobe” effect, due to the moving shadows of the blades. Urban sites are not an appropriate application and are typically met with stiff opposition from nearby residents.

Resiliency

When paired with batteries and solar PV systems, wind turbines can offer some resiliency advantages by reducing the electric load on generators.

Recommendation

Wind turbines are not recommended for UMass Lowell. This is largely due to the fact that solar PV systems can perform a similar role and are lower cost to install, are more life cycle cost effective and are less likely to raise opposition from neighbors.

Other Considerations

In addition to the technologies outlined above, there are also two fuel sources that are not recommended, but may be considered in the future for UMass Lowell. These are renewable gas and hydrogen and are outlined below.

Renewable Gas

Renewable gas is a term that is used to describe methane from renewable or waste sources. This includes methane collected from landfill sites and anaerobic digesters. In rural settings or sites adjacent to landfills, the methane can be piped directly to combustion equipment such as generators and boilers. In some cases, the methane is injected into the natural gas utility distribution network. When methane from renewable or waste sources is injected into the natural gas utility distribution network, a renewable gas certificate may be generated, which can then be purchased by natural gas consumers to offset the carbon footprint of the gas that they consume (assuming that the renewable gas credits meet additionality standards).

For buildings and campuses in urban settings, the only reasonable means of relying on renewable gas is to purchase renewable gas credits. The process of procuring renewable gas credits is similar to the process commonly used to procure renewable electricity credits for electricity.

Emissions

Renewable gas may be considered carbon neutral. But, renewable gas represents a very small percentage of natural gas production and is not typically considered a significant opportunity to decarbonize the majority of building thermal energy needs.

Feasibility, Cost and Operations

When renewable gas credits are purchased, it has no direct impact on the fuel source for buildings and campuses; natural gas would still be combusted on-site. Therefore, conventional natural gas generators and boilers would continue to be used and natural gas would still be consumed. Procuring the renewable gas credits would simply be an additional operating cost. Therefore, there is no life cycle cost advantage to renewable gas.

Resiliency

Renewable gas offers no resiliency advantages beyond conventional natural gas-based systems.

Recommendation

If UMass Lowell continues to consume natural gas, renewable gas credits may be worth considering, if the credits meet additionality standards. This should be considered only after the natural gas consumption has been reduced to a very small value.

Hydrogen

Hydrogen is a combustion fuel that can be generated from renewable electricity, through the process of electrolysis. In this case, it is essentially a means of storing renewable energy. Hydrogen can be stored and distributed as a liquid fuel, most often used as a fuel for transportation. Hydrogen can also be injected into the natural gas utility distribution network, but typically only at low concentrations.

Emissions

Hydrogen, when generated from renewable energy, may be considered a carbon neutral fuel. But, it is far more energy efficient to use the renewable energy directly, particularly when heat pumps are used for heating.

Feasibility, Cost and Operations

Hydrogen is primarily a means of energy storage, similar to batteries. But, other battery technologies are currently more cost effective and common in campus settings. Therefore, there is no life cycle cost advantage to hydrogen.

Resiliency

Hydrogen offers no resiliency advantages, compared to other energy storage technologies.

Recommendation

The hydrogen industry has not been extensively developed for building energy needs and is more commonly used to fuel transportation. Direct utilization of renewable energy to operate heat pumps for emission-free heating and other battery technologies for energy storage have largely overtaken hydrogen technology. Therefore, hydrogen technology is not recommended for UMass Lowell.

DRAFT

Pilot Building Descriptions

Prioritizing the highest energy consumers for projects is the more cost effective strategy to achieving load reductions on campus. These buildings are ideal for pilots. The pilot project approach helps align multi-stakeholder decision-making and build momentum such that similar strategies can be applied across all core end uses. In order to help prioritize buildings that would be ideal candidates for pilot projects, buildings were ranked across a set of key criteria: energy use intensity, energy change over time, energy use intensity target, combustion emissions, and facility conditions. The data shows that Olney Hall, Ball Hall, and Sheehy Hall are the best buildings to conduct pilot alternative energy projects given that they score highest compared to other buildings of the same core use type. See the “Metering and Data Management Preliminary Report” for more details.

Project profiles and detailed scope descriptions for each pilot building are developed in order to evaluate and quantify energy, emissions, and heating/cooling load impacts. Measures were identified by using the ASHRAE Level I Audit procedure. Two scenarios - “Good” and “Best” – were detailed in order to outline the range of opportunities compared to a Default/Business-As-Usual (“BAU”) Case. The BAU case was defined as the 2019 energy use profiles adjusted for key factor including expanded lab operations, added cooling, and centralized ventilation. Energy end use breakdowns were estimated based building core end use given the lack of campus submetering. Current and future 2050 carbon emissions were quantified using values from the “30-year Forecast Preliminary Report.” Heating and cooling loads were quantified in order to enable evaluation of central vs. decentralized scenarios. Air-side energy recovery and envelope are the key strategies outlined to reduce heating and cooling loads.

DRAFT


Ball Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	92396
Last Major Renovation	1958


Building Summary

Ball Hall is an office/classroom building with some dry labs on the North Campus. It has the highest building score of any building on campus (73) making it an ideal candidate for energy efficiency upgrades as a pilot project particularly given direct steam systems. The business as usual case assume dry lab and cooling operations will be expanded. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

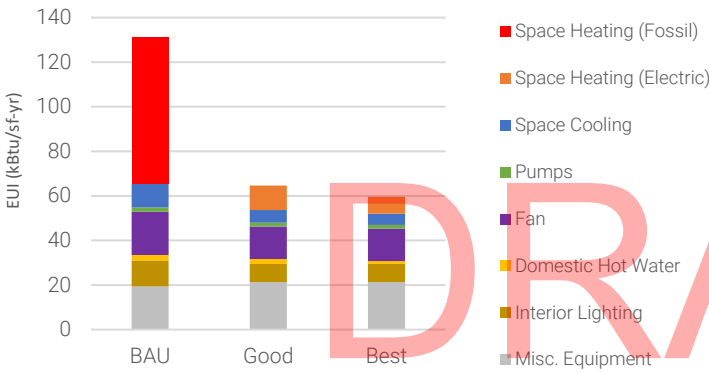


Carbon Emissions

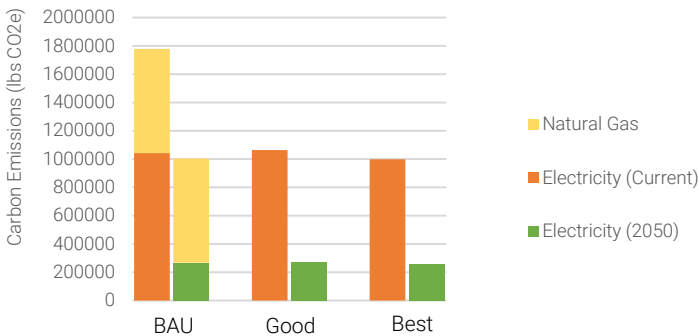

Heating Load



Cooling Load

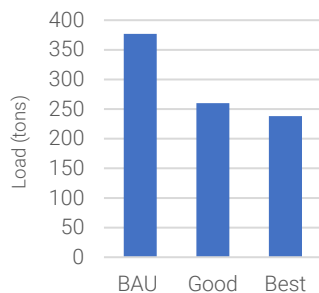

Current
Direct Steam
Air-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

Ball Hall Detailed Options Matrix

Description	BAU	Good	Best
Target EUI (kBtu/sf-yr)	131	65	60
Architectural			
Wall Performance	Brick (uninsulated exterior) (1950s)	R-10 continuous insulation	R-30 continuous insulation
Roof Performance	Tar/gravel 1" insulation ~R-4	R-30 continuous insulation, white	R-50 continuous insulation, white
Glazing Performance	Single pane window wall	Double glazing curtain wall and punched assembly u-value: 0.3, SHGC: 0.26	Triple glazing curtain wall and punched assembly u-value: 0.20, SHGC: 0.26
	Double pane punched	Insulate spandrel to wall performance.	
HVAC			
Heating/cooling system	Steam-to-hot water (7000 MBH)	(6) 30 ton modules air-to-water heat pumps (2) 100 ton air cooled chiller (peak and 50% redundancy) (3) chilled water pumps @ 3 HP (includes 1 on standby) (4) hot water pumps @ 3 HP (includes 2 on standby)	(3) 30 ton air-to-water heat pumps (2) 150 ton air cooled chiller (peak and 50% redundancy) (3) chilled water pumps @ 5.0 HP (includes 1 on standby) (4) hot water pumps @ 2 HP (includes 2 on standby)
	60 Ton Air-cooled chiller (new - 3rd and 4th floors only)		
	Window AC		
	Rooftop heat pumps		
Air distribution	AIR HANDLING UNIT - INDOOR (5-1.25 HP) - univents (DX cooling) - don't always provide fresh air during occupied times	DOAS Single Wheel (70% EF) - Qty. 2 - 20,000 CFM @ 45 MHP each	DOAS Regen (90% EF) - Qty. 2 - 20,000 CFM @ 45 MHP each
	Exhaust fans (constant volume)	Qty. 2 - 20,000 CFM @ 30 MHP each	Qty. 2 - 20,000 CFM @ 30 MHP each
Zone systems	Heat Pumps (1368 MBH cooling/1531 MBH cooling), FCU 2-pipe, FCU 4-pipe	4-pipe FCUs	4-pipe FCUs
Controls	95% DDC Resets in place	Complete DDC Chilled water reset Classroom 326 bypass damper issue Classroom 322 damper misrepresentation (100% OAD, 0% RAD, heat coil 0% OAT 23F, DAT 75F)	Complete DDC Chilled water reset Classroom 326 bypass damper issue Classroom 322 damper misrepresentation (100% OAD, 0% RAD, heat coil 0% OAT 23F, DAT 75F)
Plumbing			
Domestic Hot Water	Gas storage	Electric boiler with recirc	Instantaneous electric DHW
	Steam-to-hot water		
Fixture Flow Rates	0.5 gpm lavatory 1.5 gpm kitchen sink	0.35 gpm lavatory 1.0 gpm kitchen sink	0.35 gpm lavatory 1.0 gpm kitchen sink
Electrical			
Lighting	Fluorescent	LED	LED
EQUIPMENT, INTERNAL LOADS AND DESIGN TEMPERATURE SETPOINTS			
Process equipment	Fume hoods (4)	Filtered fume hoods	Filtered fume hoods
	Lab compressed air		


Olney Hall

Campus	North Campus
Core End Use	Lab
Square Footage	205550
Last Major Renovation	1974


Building Summary

Olney Hall is an lab building on the North Campus. It has a Building Score of 67. This makes it a higher priority for energy efficiency improvements as a pilot project particularly given direct steam systems. The business as usual case assume dry lab and cooling operations will be expanded. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

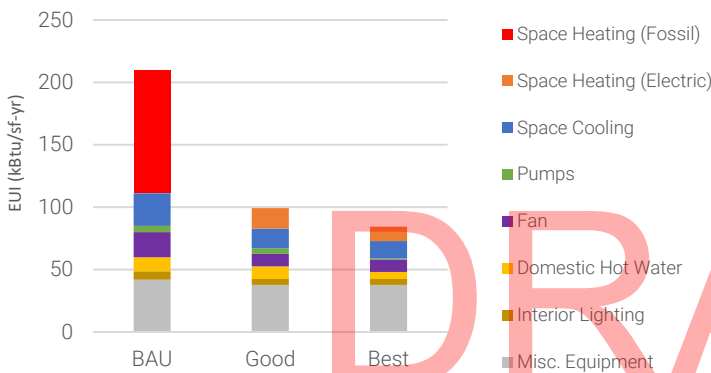


Carbon Emissions

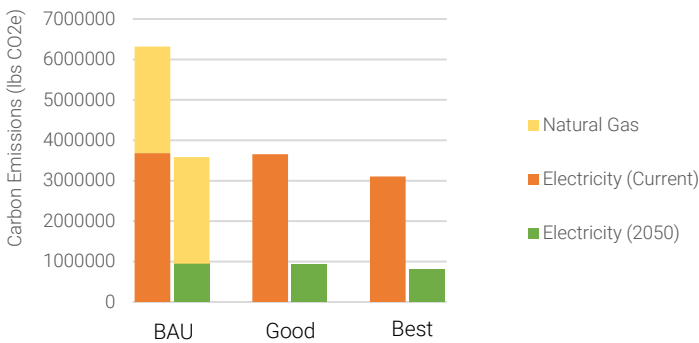

Heating Load



Cooling Load

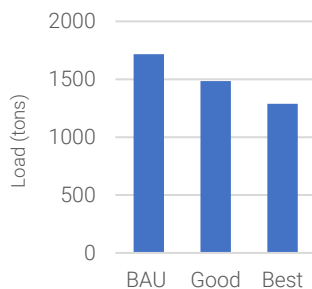

Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5b - Air-side Systems - Decoupled systems
ECM 5d - Air-side Systems - Constant to variable volume
ECM 5e - Air-side Systems - Airflow setbacks
ECM 6c - Air-side Energy Recovery - 50% (Runaround Coil)
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11c - Process Loads - Low Flow Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 5f - Air-side Systems - Aircurity, particle counters
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)
ECM 9b - Plumbing - Instantaneous Water Heater

Olney Hall Detailed Options Matrix

Description	BAU	Good	Best
Target EUI (kBtu/sf-yr)	210	99	84
Architectural			
Wall Performance	Mass and brick, 1 1/2" spray insulation, ~R-3 noncontinuous (1970s)	R-10 continuous insulation (exterior)	R-30 continuous insulation (exterior)
Roof Performance	Black TPO, 2" rigid R-8 (exterior) (1970s)	R-30 continuous insulation, white	R-50 continuous insulation, white
Glazing Performance	Single pane (fixed and operable)	Double glazing curtain wall and punched assembly u-value: 0.3, SHGC: 0.26	Triple glazing punched assembly u-value: 0.20, SHGC: 0.26
HVAC			
Heating/cooling system	Steam to hot water (original to building) Constant volume pumps	(40) 30 ton modular air-to-water heat pumps (2) 300 ton air cooled chiller (peak and 50% redundancy) (3) chilled water pumps @ 10 HP (includes 1 on standby) (3) hot water pumps @ 10 HP (includes 1 on standby) (6) hot water pumps @ 7.5 HP (includes 3 on standby)	(12) 30 ton modular air-to-water heat pumps (2) 900 ton air cooled chiller (peak and 50% redundancy) (4) chilled water pumps @ 20 HP (includes 1 on standby) (4) hot water pumps @ 7.5 HP (includes 2 on standby)
	Chiller Constant volume pumps		
	Cooling tower		
	Split AC		
	Split AC		
Air distribution	Individual AHUs (constant volume)	DOAS Runaround Coil - Qty. 4 - 66,000 CFM @ 120 MHP each	DOAS Konvekta + Heat Pump Qty. 3 - 70,000 CFM @ 140 MHP each Heat Pump - (7) 30 ton modules (multistack Heat Recovery) DOAS General exhaust through wheel Supply Qty. 1 - 54,000 CFM @ 100 MHP Exhaust Qty. 1 - 54,000 CFM @ 50 MHP
	Individual exhaust fans (constant volume)	Qty. 8 - 33,000 CFM @ 30 MHP each	Lab Exhaust Fans Qty. 6 - 35,000 CFM @ 30 MHP each
	Individual return fans		
Zone systems	Univent system (1-2 per lab)	4-pipe fan coil units	4-pipe fan coil units
Controls	DDC HHW and CHW resets included DAT reset included	Complete DDC Static pressure reset opportunity No effective reheat coil multiple spaces (Lab G2A, G4, G6) - Retro-commissioning opportunity	Complete DDC Static pressure reset opportunity No effective reheat coil multiple spaces (Lab G2A, G4, G6) - Retro-commissioning opportunity
Plumbing			
Domestic Hot Water	Steam to hot water	Electric boiler with recirc	Instantaneous electric DHW
	DHW Boiler		
Fixture Flow Rates	Bathroom renovation 2.2 gpm	0.35 gpm lavatory 1.0 gpm kitchen sink	0.35 gpm lavatory 1.0 gpm kitchen sink
Electrical			
Interior Lighting	Fluorescent	LED	LED

EQUIPMENT, INTERNAL LOADS AND DESIGN TEMPERATURE SETPOINTS			
Process equipment	Fume hoods (mostly constant)	Filter fume hoods	Filter fume hoods
	Fume hoods (mostly constant)	Low flow fume hoods	Low flow fume hoods
	Lab compressed air		
	Lab compressed air		
	Lab freezer condenser		
	Process chiller		

DRAFT


Sheehy Hall

Campus	South Campus
Core End Use	Residential
Square Footage	62219
Last Major Renovation	1989


Building Summary

Sheehy Hall is residential building on the South Campus. It has a Building Score of 62. This makes it a higher priority for energy efficiency improvements as a pilot project particularly given direct steam systems. The business as usual case assumes ventilation and cooling will be added. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

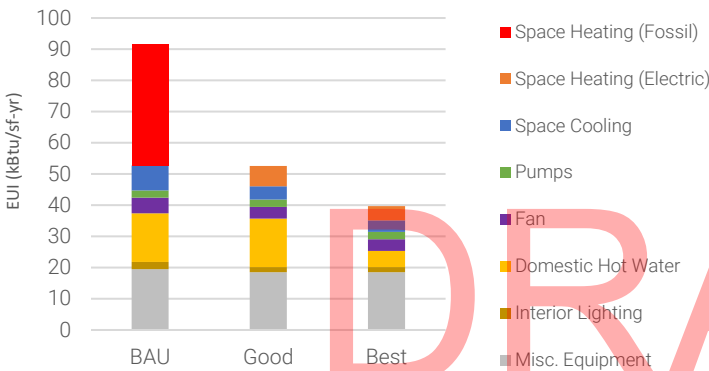


Carbon Emissions

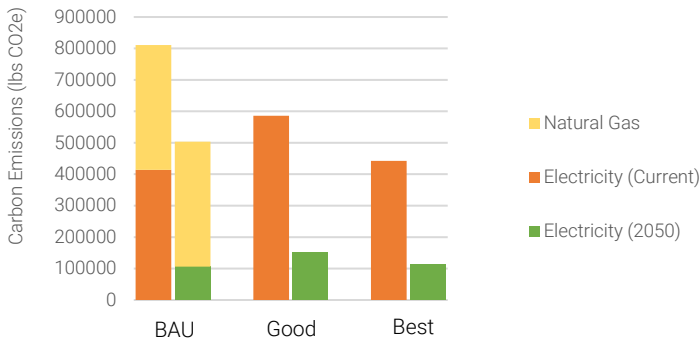

Heating Load



Cooling Load

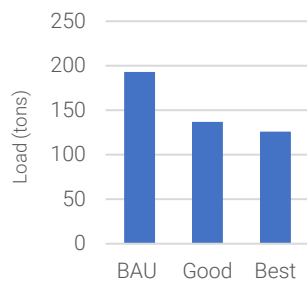

Current
Steam-to-HHW
No cooling
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7a - Water-side Systems - Standalone VRF
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9e - Plumbing - ASHP Water Heater with Storage

Description	BAU	Good	Best
Target EUI (kBtu/sf-yr)	92	53	40
Architectural			
Wall Performance	Brick, 4" blanket ~R-10 (1980s)	R-10 continuous insulation	R-30 continuous insulation
Roof Performance	Single-Ply/ EPDM 3" rigid insulation ~R-12 (1980s)	R-30 continuous insulation, white	R-50 continuous insulation, white
Glazing Performance	Single, operable, potentially leaking	Double glazing with Low e double hung (operable) assembly u-value: 0.35, SHGC: 0.26	Triple glazing double hung (operable) assembly u-value: 0.25, SHGC: 0.26
HVAC			
Heating/cooling system	Steam-to-hot water HX	VRF - (9) 16 ton Mitsubishi R2-Series Heat Recovery	VRF - (8) 16 ton Mitsubishi R2-Series Heat Recovery
Air distribution	No make-up air	DOAS Single Wheel (70% EF) w/ hot gas reheat - Qty. 1 - 16,000 CFM @ 30 MHP each	DOAS Regen (90% EF) w/ hot gas reheat - Qty. 1 - 16,000 CFM @ 30 MHP each
Exhaust	Bathroom exhaust	Qty. 1 - 16,000 CFM @ 20 MHP each	Qty. 1 - 16,000 CFM @ 20 MHP each
Zone systems	Perimeter radiation , Danfoss valve controlled	VRF	VRF
Controls	pneumatic	Complete DDC	Complete DDC
Plumbing			
Domestic Hot Water	Steam-to-hot water HX	Electrical water heater with storage	ASHP with storage
Fixture Flow Rates	Bathroom renovation	0.35 gpm lavatory 1.0 gpm kitchen sink 1.0 gpm shower	0.35 gpm lavatory 1.0 gpm kitchen sink 1.0 gpm shower
Electrical			
Lighting	CFL, LED, T12	LED	LED
Lighting Controls	None	Occupancy sensors	Occupancy sensors

North Campus Energy Efficiency Results

Project profiles were developed for each building on the North Campus pilot building are developed in order to evaluate and quantify energy, emissions, and heating/cooling load impacts. Measures were identified by using the ASHRAE Level I Audit procedure. Two scenarios - "Good" and "Best" – were detailed in order to outline the range of opportunities compared to a Default/Business-As-Usual ("BAU") Case. The BAU case was defined as the 2019 energy use profiles adjusted for key factor including expanded lab operations, added cooling, and centralized ventilation. Energy end use breakdowns were estimated based building core end use given the lack of campus submetering. Current and future 2050 carbon emissions were quantified using values from the "30-year Forecast Preliminary Report." Heating and cooling loads were quantified in order to enable evaluation of central vs. decentralized scenarios. Air-side energy recovery and envelope are the key strategies outlined to reduce heating and cooling loads.

Compared to the Default/Business-As-Usual ("BAU") Case, the North Campus, "Good" case is expected to achieve a 47% energy reduction and 35% emissions reduction. Based on future emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is expected to be closer to 71%. The North Campus, "Best" case is expected to achieve a 52% energy reduction and 42% emissions reduction. The emissions reduction is expected to be closer to 74% given the implemented electrification strategies and future grid emissions rates (as detailed in the "30-Year Forecast"). The reductions outlined above are expected to greatly exceed the EUI and emissions requirements of Executive Order No. 594. The Investment Phase will detail how these projects can be structured in order to meet these requirement timelines. The remaining emissions can be offset with renewables sources.

DRAFT


Kitson Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	46512
Last Major Renovation	1902


Building Summary

Kitson Hall is an office/classroom building with some dry labs on the North Campus. It has a Building Score of 71. This makes it a high priority for energy efficiency improvements. The business as usual case assume dry lab and cooling operations will be expanded. The EUI reduction in the Good and Best cases are a result of envelope upgrades, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

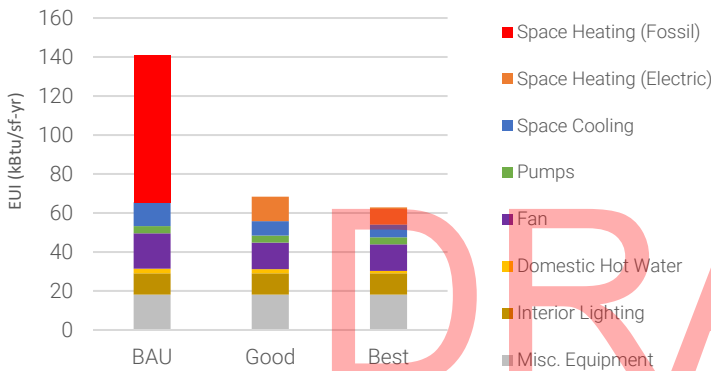


Carbon Emissions

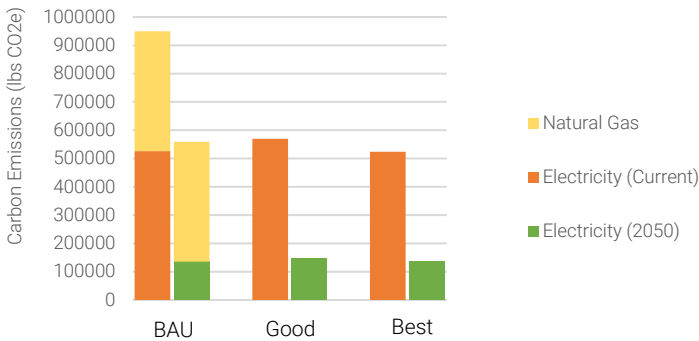

Heating Load



Cooling Load

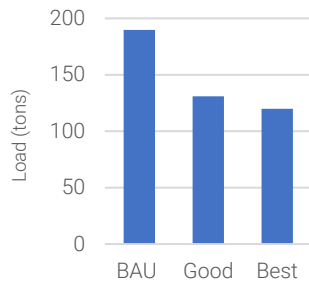

Current
Steam-to-HHW
Window AC
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10a - Controls - DDC
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


Pinanski Hall

Campus	North Campus
Core End Use	Lab
Square Footage	59696
Last Major Renovation	2019


Building Summary

Pinanski Hall is a lab building with on the North Campus. It has a Building Score of 69. This makes it a high priority for energy efficiency improvements. The business as usual case assumed added lab operations. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

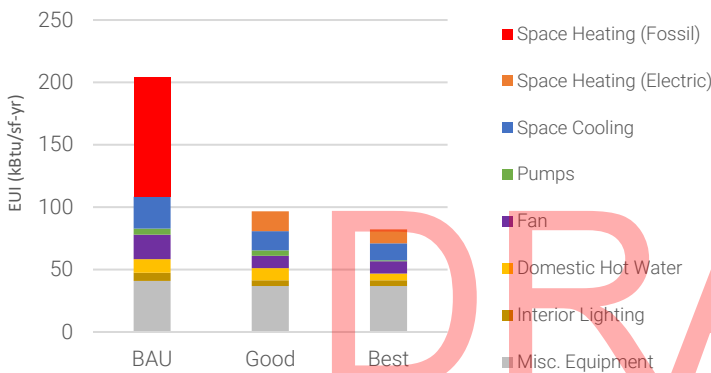


Carbon Emissions

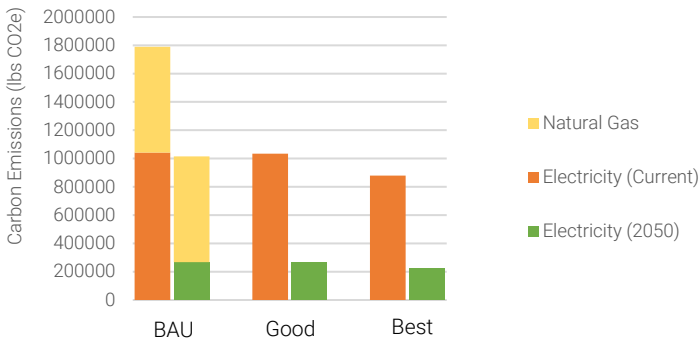

Heating Load



Cooling Load

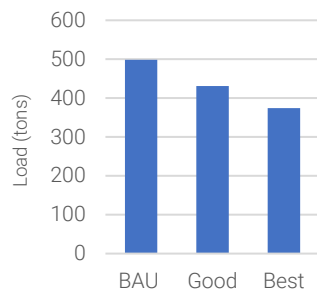

Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 6c - Air-side Energy Recovery - 50% (Runaround Coil)
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)
ECM 9b - Plumbing - Instantaneous Water Heater


Falmouth Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	49290
Last Major Renovation	1907


Building Summary

Falmouth Hall is an office/classroom building with some dry labs on the North Campus. It has a Building Score of 67. This makes it a high priority for energy efficiency improvements. The business as usual case assume dry lab and cooling operations will be expanded. The EUI reduction in the Good and Best cases are a result of envelope upgrades, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

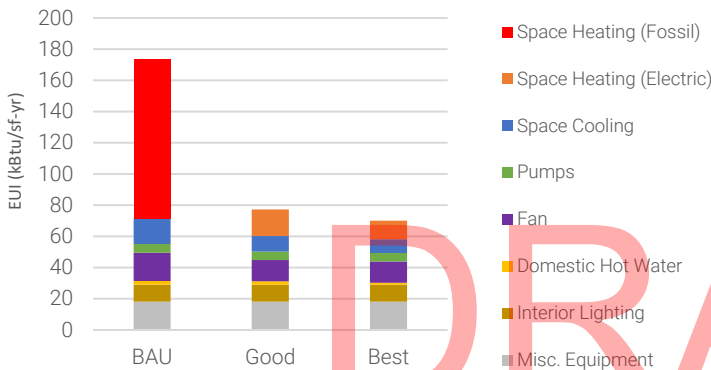


Carbon Emissions

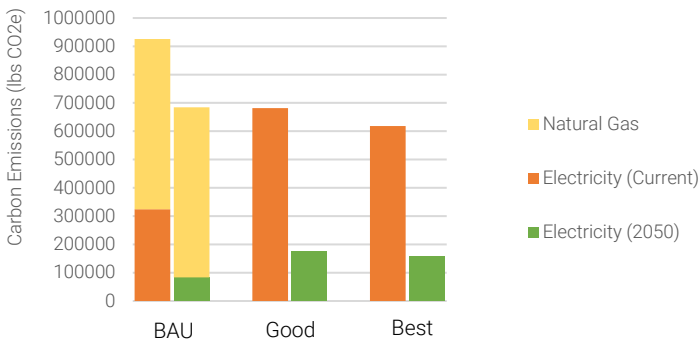

Heating Load

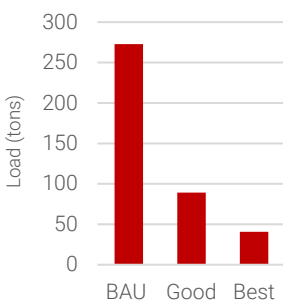

Cooling Load

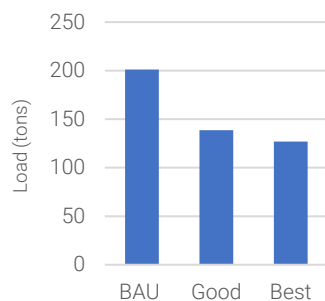

Current
Steam-to-HHW
DX Cooling
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10a - Controls - DDC
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11c - Process Loads - Low Flow Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


Southwick Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	62313
Last Major Renovation	1902


Building Summary

Southwick Hall is an office/classroom building with dining on the North Campus. It has a Building Score of 52. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, high efficiency heating/cooling systems, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

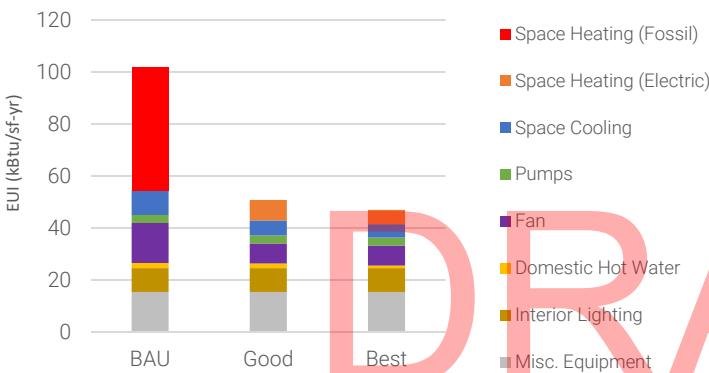


Carbon Emissions

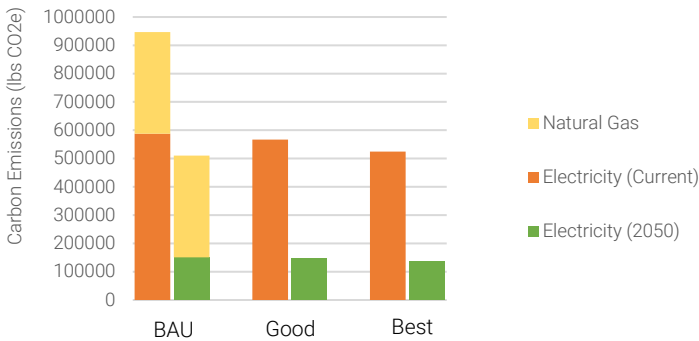

Heating Load



Cooling Load

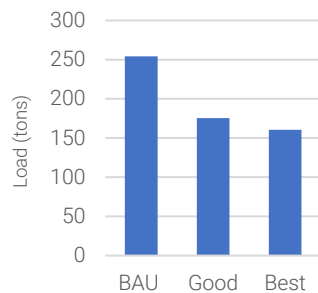

Current
Steam-to-HHW
DX Cooling
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment
ECM 11g - Process Loads - Energy Star Kitchen All-Electric Energy Star

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


Cumnock Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	34768
Last Major Renovation	1954


Building Summary

Cumnock Hall is an office building with a dining facility on the North Campus. It has a Building Score of 51. This makes it a medium priority for energy efficiency improvements particularly given direct steam systems. The business as usual case assumed added cooling. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

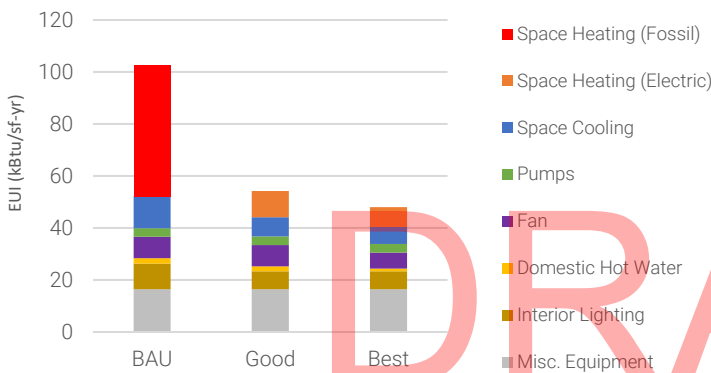


Carbon Emissions

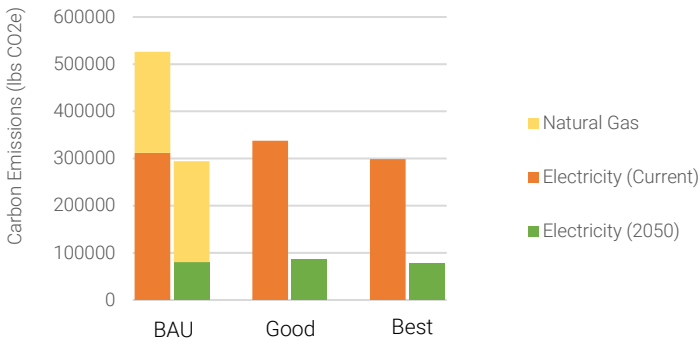

Heating Load



Cooling Load

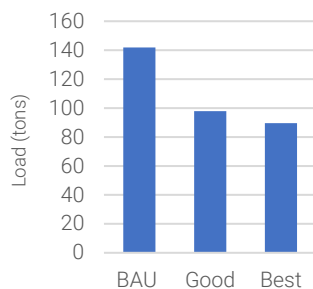

Current
Direct Steam
ASHP
Acceptable envelope; original components

Good
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment
ECM 11g - Process Loads - Energy Star Kitchen All-Electric Energy Star

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


Costello Athletic Center

Campus	North Campus
Core End Use	Fitness
Square Footage	84979
Last Major Renovation	1967


Building Summary

Costello Athletic Center is a fitness building on the North Campus. It has a Building Score of 65. This makes it a high priority for energy efficiency improvements particularly given direct steam systems. The business as usual case assumes cooling will be added. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

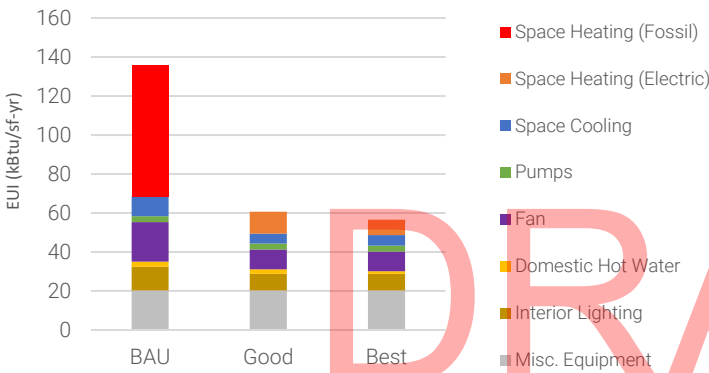


Carbon Emissions

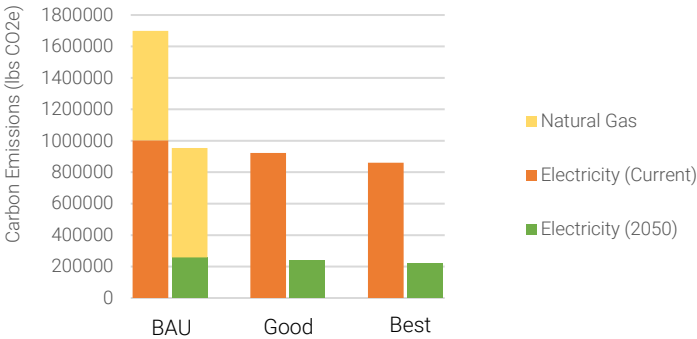

Heating Load



Cooling Load

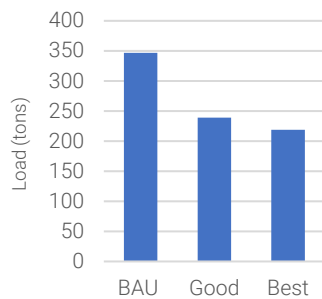

Current
Direct Steam
No cooling
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10c - Controls - DDC Sequence Upgrades

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 9e - Plumbing - ASHP Water Heater with Storage
ECM 12 - Natatorium - High Efficiency Heating and Cooling

Lydon Library

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	67329
Last Major Renovation	2017

Building Summary


Lydon Library building is an office/classroom building on the North Campus. It has a Building Score of 62. This makes it a higher priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.

Current
Steam-to-HHW
Air-cooled Chiller
Candidate for envelope improvements


Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

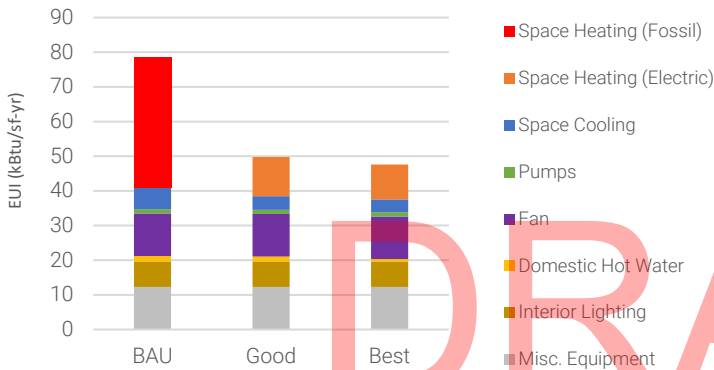


Carbon Emissions

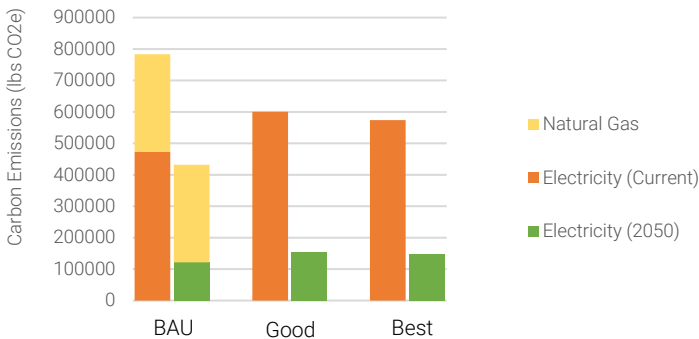

Heating Load



Cooling Load

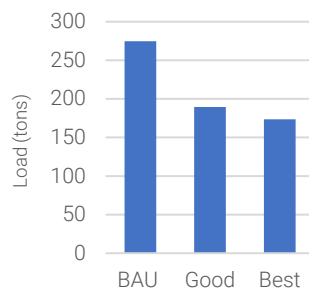


Dandeneau Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	44169
Last Major Renovation	2018


Building Summary

Dandeneau Hall is an office/classroom building with some dry labs on the North Campus. It has a Building Score of 61. This makes it a high priority for energy efficiency improvements. The business as usual case assumed added cooling. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


EUI Breakdown

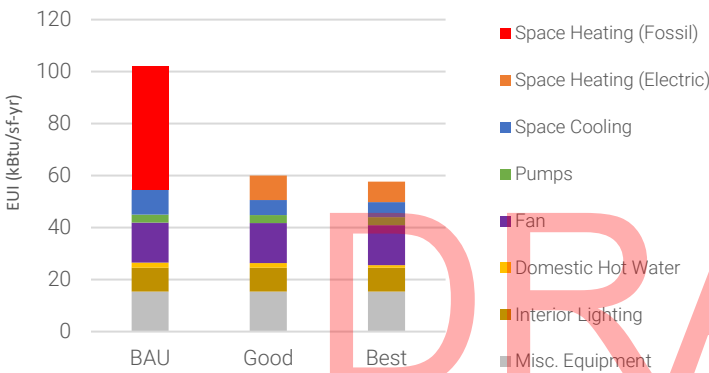

Carbon Emissions

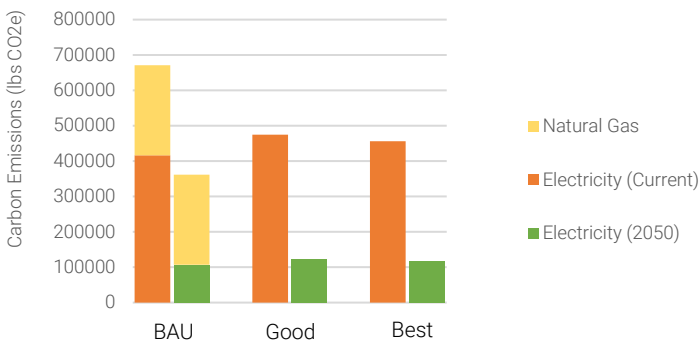

Heating Load



Cooling Load



Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

Pulichino Tong Business Center

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	51345
Last Major Renovation	2016

Building Summary


Pulichino Tong Business Center (PTB) is an office/classroom building on the North Campus. It has a Building Score of 44. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. Future carbon reduction is in result to electrified heating strategy. Minor envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
Water-cooled Chiller
High-quality; new insulation and new windows and doors


Good
ECM 7b - Water-side Systems - Standalone AWP
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

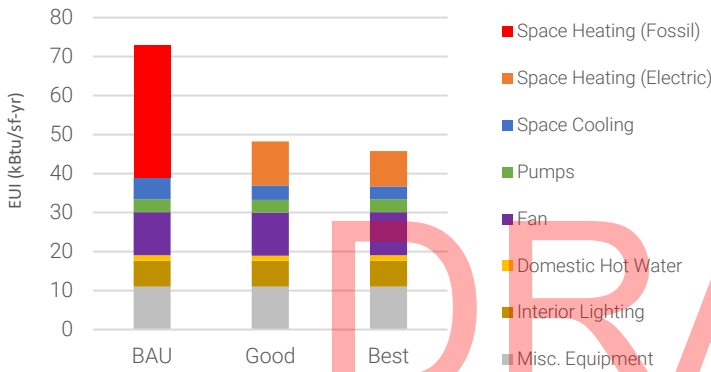


Carbon Emissions

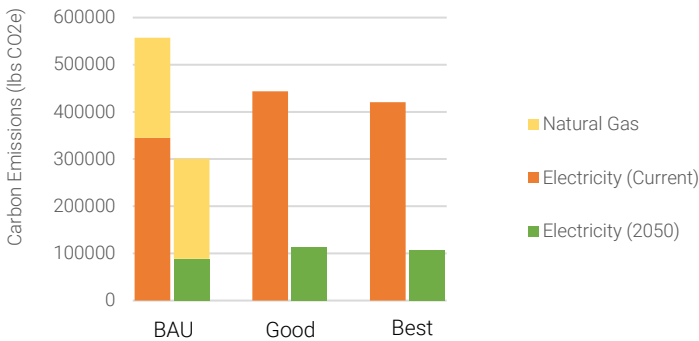

Heating Load



Cooling Load

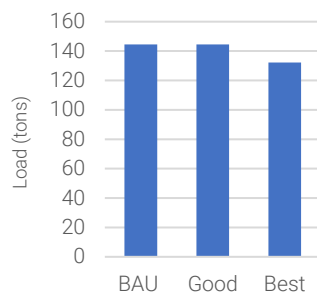

Saab Emerging Technologies & Innovation Center

Campus	North Campus
Core End Use	Lab
Square Footage	73637
Last Major Renovation	2012

Building Summary


Saab Emerging Technologies & Innovation Center is the most energy intensive lab building located on the North Campus. It has a Building Score of 44. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. Future carbon reduction is in result to electrified heating strategy. Minor envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
Water-cooled Chiller
High-quality, new insulation and new windows and doors


Good
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 5f - Air-side Systems - Aircurity, particle counters
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

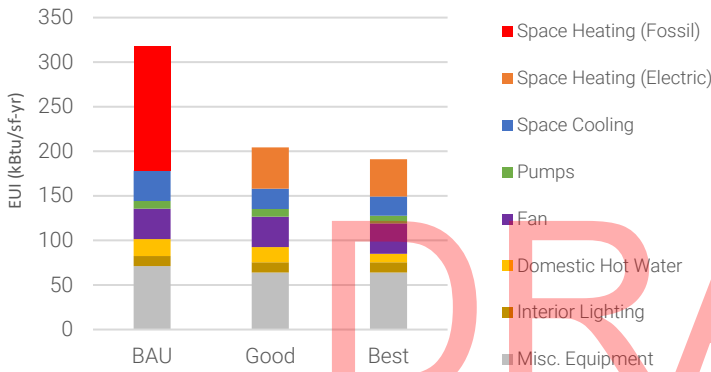


Carbon Emissions

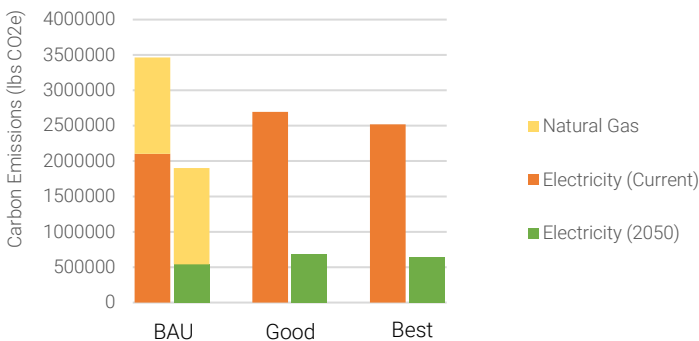

Heating Load



Cooling Load

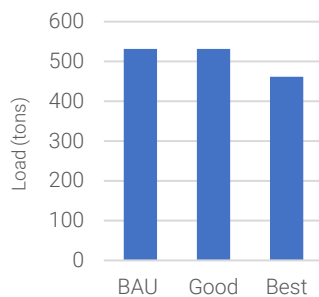

Perry Hall

Campus	North Campus
Core End Use	Lab
Square Footage	50158
Last Major Renovation	2019

Building Summary


Perry Hall is an office/classroom building with some dry labs on the North Campus. It has a Building Score of 42. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. A current carbon increase would be a result of minor energy efficiency upgrades and electrified heating strategy. Minor envelope upgrades reduce heating and cooling loads.

Current
Steam-to-HHW
Water-cooled Chiller
High-quality envelope; new insulation and new windows and doors


Good
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

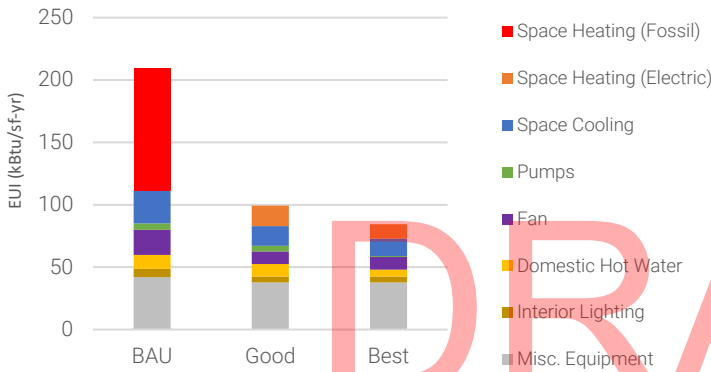


Carbon Emissions

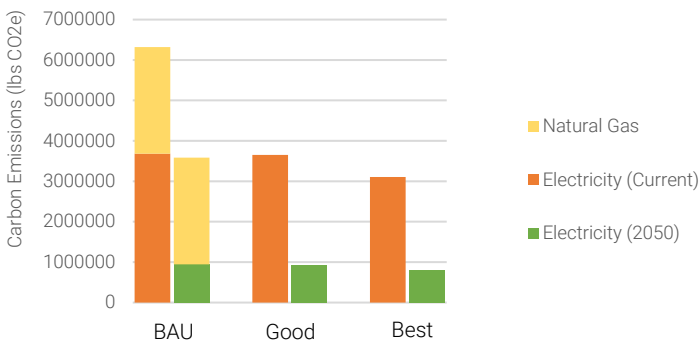

Heating Load

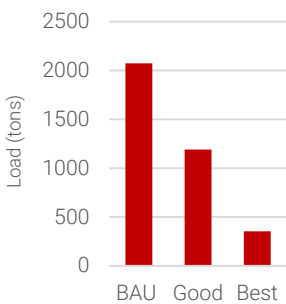

Cooling Load

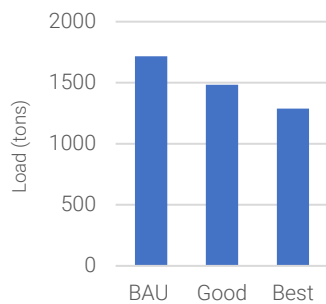


Olsen Hall

Campus	North Campus
Core End Use	Office/Classroom
Square Footage	116764
Last Major Renovation	2019


Building Summary

Olsen Hall is an office/classroom building with some wet labs on the North Campus. It has a Building Score of 29, although, the score is expected to be higher due to energy meter data anomalies. Therefore, this building is assumed to be a medium priority for energy efficiency improvements. The business as usual case assumes lab operations will be expanded. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

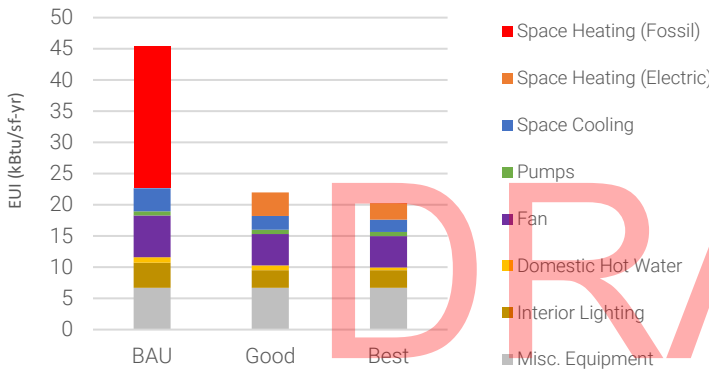


Carbon Emissions

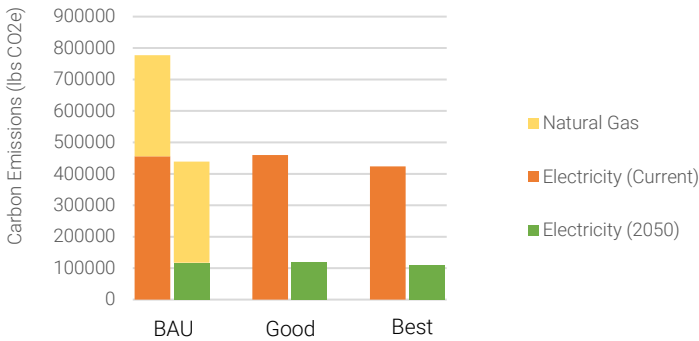

Heating Load



Cooling Load

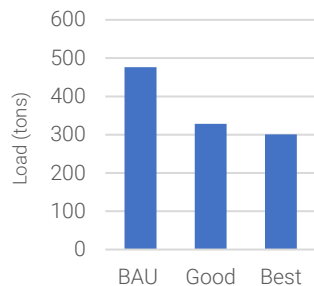

Current
Steam-to-HHW
Air-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11c - Process Loads - Low Flow Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

UMass Lowell Bellegarde Boathouse

Campus	North Campus (satellite)
Core End Use	Recreation
Square Footage	11272
Last Major Renovation	2009

Building Summary


UMass Lowell Bellegarde Boathouse is a recreation building on the North Campus. It has a Building Score of 16. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling systems and lighting. Future carbon reduction is in result to electrified heating strategy.

Current
HHW Boiler
Window AC
High-quality, new insulation and new windows and doors


Good
ECM 7a - Water-side Systems - Standalone VRF
ECM 8a - Lighting - LED Conversion
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater

Best
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 9b - Plumbing - Instantaneous Water Heater

EUI Breakdown

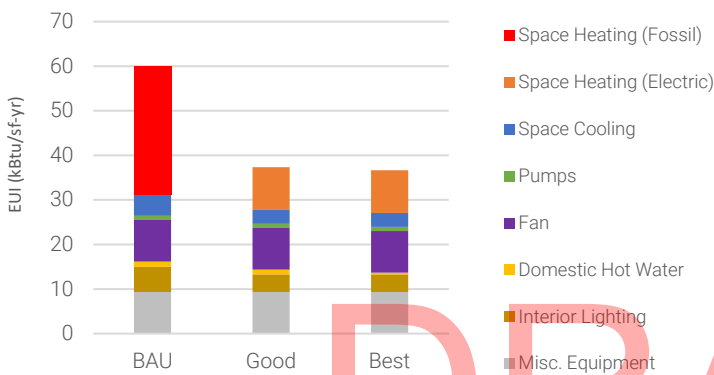

Carbon Emissions

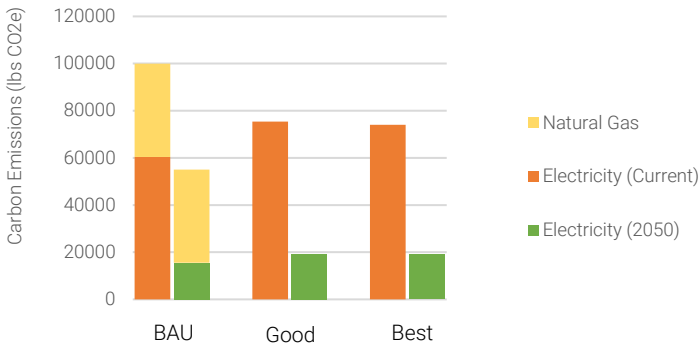

DRAFT

North Campus Plant Alternatives

Overview



The existing North Plant is a heating only central plant that serves the north campus except the Pulichino Tong Business Center and the Saab Emerging Technologies and Innovation Center. The north plant has three low pressure steam boilers for a total of 2,200 boiler HP of capacity. The aging steam infrastructure in the north campus presents an opportunity to convert to low temperature hot water and chilled water. Steam is a high grade heat source that requires either a fossil fuel or bio fuel to operate, locking the north campus into high grade heat through 2050. Therefore, it is recommended to pursue a low temperature hot water and chilled water distribution to take advantage of ground-source and air-source heat pump technologies, as well as integrate boilers for resiliency.

The proposed primary heating and cooling equipment for the central plant were selected based on emission impact, feasibility, resiliency and cost. This includes ground-source heat pumps, air-source heat pumps, biodiesel boilers and gas boilers (for low outdoor air temperatures only and backup). Refer to the alternative energy systems section for more information regarding these systems. This section outlines the peak heating and cooling loads for the “Business As Usual”, ‘Good’, and ‘Best’ load scenarios and central plant equipment sizing recommended for each option. Each load scenario has six options for consideration.

Plant Heating and Cooling Loads

The North Plant will serve all of the buildings currently served by the existing steam plant as well as the Pulichino Tong Business Center and the Saab Emerging Technologies and Innovation Center. The design heating and cooling loads for the ‘Business As Usual’, ‘Good’ and ‘Best’ cases are shown in the table and charts below. Note that as buildings improve the envelope and air-side energy recovery systems, the buildings require less and less heating and cooling.

	Business As Usual	Good	Best
Heating Load (MBH)	83,900	41,200	16,800
Cooling Load (MBH)	70,800	55,700	49,350

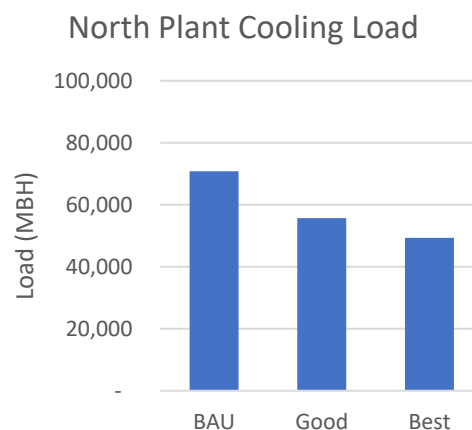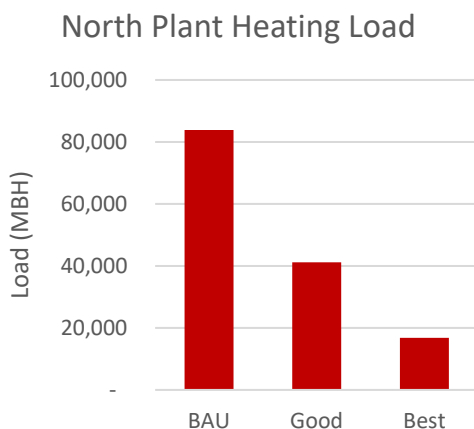

Options Description and Matrix

The team is proposing six options for the north plant consideration. Sizing of the plant depends on energy efficiency improvements made in the buildings the plant serves. These options are outlined in the following tables. The north plant is proposed to serve all of the building currently served by the north plant heating plant as well as the Pulichino Tong Business Center and the Saab Emerging Technologies and Innovation Center. When evaluating the plant options, consider the following:

1. Consider if the buildings should be stand-alone heating and cooling or expand the existing central plant.
2. Which peak load scenario the plant should be designed around.
3. Whether the peak/backup boilers will be biodiesel or gas.
4. Whether the plant will have geothermal or air-source heat pumps or a combination of both.

Best Option

The table below shows the main north plant equipment required if all buildings pursue “BEST” energy conservation measures. Options with “A” include a large geothermal field, “B” includes a medium size geothermal field and “C” includes no geothermal. Options with “1” include biodiesel boilers and options with “2” include natural gas condensing boilers.


	BEST A1 Heavy Geo + Biodiesel	BEST B1 Light Geo + Air- source + Biodiesel	BEST C1 Air-source + Biodiesel	BEST A2 Heavy Geo + Air- source + Gas	BEST B2 Light Geo + Air- source + Gas	BEST C2 Air-source + Gas
Heat Recovery Chillers	(12) 50 Ton modular heat recovery chillers with VFDs and ground connection	(6) 50 Ton modular heat recovery chillers with VFDs and ground connection	None	(12) 50 Ton modular heat recovery chillers with VFDs and ground connection	(6) 50 Ton modular heat recovery chillers with VFDs and ground connection	None
Geothermal Borefield	Closed Loop Vertical Borefield 200 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 100 Boreholes at 500 ft depth	None	Closed Loop Vertical Borefield 200 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 100 Boreholes at 500 ft depth	None
Air-to-Water Heat Pumps	None	(12) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(23) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(23) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(35) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(47) 30 Ton Air-to-Water heat pumps similar to Multistack ARA
Peak Heating Load + Backup System	(3) 150 Boiler HP Biodiesel Boilers	(3) 150 Boiler HP Biodiesel Boilers	(3) 150 Boiler HP Biodiesel Boilers	(4) 4,000 MBH Natural Gas Condensing Boilers	(4) 4,000 MBH Natural Gas Condensing Boilers	(4) 4,000 Natural Gas Condensing Boilers
Peak Cooling Load + Backup System	(4) 950 Ton Centrifugal Chillers with Cooling Towers	(4) 900 Ton Centrifugal Chillers with Cooling Towers	(4) 900 Ton Centrifugal Chillers with Cooling Towers	(4) 800 Ton Centrifugal Chillers with Cooling Towers	(4) 800 Ton Centrifugal Chillers with Cooling Towers	(4) 750 Ton Centrifugal Chillers with Cooling Towers
Hot water and Chilled Water Distribution	Chilled water and hot water supply and return through buildings and direct buried as required.					
Emergency Generators + Backup System	Emergency generators for life-safety and heating system. The cooling plant is not on optional standby.					
Fuel Storage	36-48 hours of backup fuel storage in the plant.					

Best Option Geothermal Borefield

The potential geothermal borefield site is parking lots and green space immediately surrounding the North Plant. The target percent of peak heating load is 15% to 30% of the peak heating load to maximize utilization of the geothermal borefield. For resiliency, the closed-loop vertical borefields will be piped in groups or 'circuits', with each circuit having supply and return piping directly to the building. The satellite images below show the approximate site area required for the 'Light and 'Heavy' geothermal options. The "Light" geothermal option would require the parking lot to the south of Pinanski Hall. The 'Heavy' geothermal option would require the parking lot to the south of Pinanski Hall, the parking lot to the north of Pinanski Hall and green space to the east of Olney Hall. The parking lots would need to be re-paved and the green-space would need to be landscaped.



Best Option A1 and A2 geothermal borefield

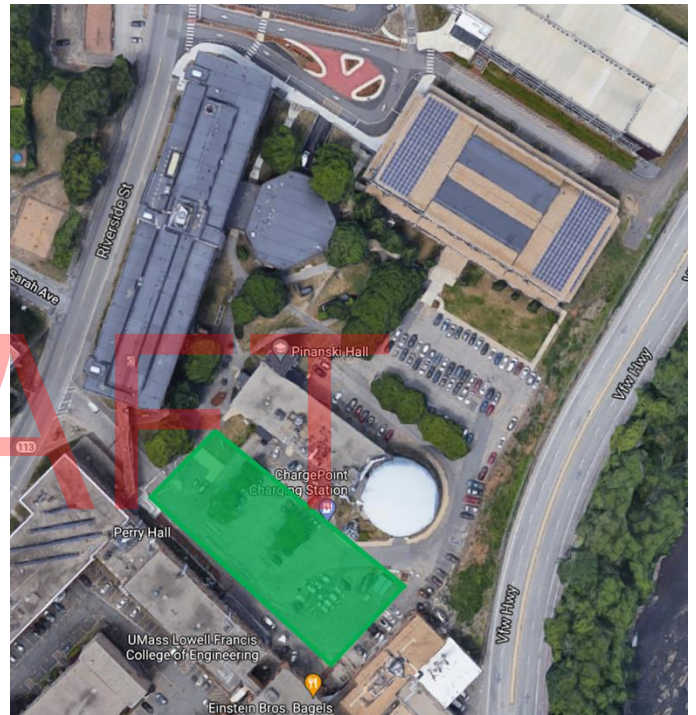

Best Option B1 and B2 geothermal borefield


Good Option

The table below shows the main north plant equipment required if all buildings pursue “GOOD” energy conservation measures. Options with “A” include a large geothermal field, “B” includes a medium size geothermal field and “C” includes no geothermal. Options with “1” include biodiesel boilers and options with “2” include natural gas condensing boilers.


	GOOD A1 Heavy Geo + Biodiesel	GOOD B1 Light Geo + Air- source + Biodiesel	GOOD C1 Air-source + Biodiesel	GOOD A2 Heavy Geo + Air- source + Gas	GOOD B2 Light Geo + Air- source + Gas	GOOD C2 Air-source + Gas
Heat Recovery Chillers	(22) 50 Ton modular heat recovery chillers with VFDs and ground connection	(12) 50 Ton modular heat recovery chillers with VFDs and ground connection	None	(22) 50 Ton modular heat recovery chillers with VFDs and ground connection	(12) 50 Ton modular heat recovery chillers with VFDs and ground connection	None
Geothermal Borefield	Closed Loop Vertical Borefield 350 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 175 Boreholes at 500 ft depth	None	Closed Loop Vertical Borefield 350 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 175 Boreholes at 500 ft depth	None
Air-to-Water Heat Pumps	None	(29) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(57) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(57) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(86) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(114) 30 Ton Air-to-Water heat pumps similar to Multistack ARA
Peak Heating Load + Backup System	(3) 350 Boiler HP Biodiesel Boilers	(3) 350 Boiler HP Biodiesel Boilers	(3) 350 Boiler HP Biodiesel Boilers	(6) 6,000 MBH Natural Gas Condensing Boilers	(6) 6,000 MBH Natural Gas Condensing Boilers	(6) 6,000 Natural Gas Condensing Boilers
Peak Cooling Load + Backup System	(4) 950 Ton Centrifugal Chillers with Cooling Towers	(4) 900 Ton Centrifugal Chillers with Cooling Towers	(4) 800 Ton Centrifugal Chillers with Cooling Towers	(3) 800 Ton Centrifugal Chillers with Cooling Towers	(3) 750 Ton Centrifugal Chillers with Cooling Towers	(3) 650 Ton Centrifugal Chillers with Cooling Towers
Hot water and Chilled Water Distribution	Chilled water and hot water supply and return through buildings and direct buried as required.					
Emergency Generators + Backup System	Emergency generators for life-safety and heating system. The cooling plant is not on optional standby.					
Fuel Storage	36-48 hours of backup fuel storage in the plant.					

Good Option Geothermal Borefield

The potential geothermal borefield site is parking lots and green space immediately surrounding the North Plant. The target percent of peak heating load is 15% to 30% of the peak heating load to maximize utilization of the geothermal borefield. For resiliency, the closed-loop vertical borefields will be piped in groups or 'circuits', with each circuit having supply and return piping directly to the building. The satellite images below show the approximate site area required for the 'Light' and 'Heavy' geothermal options. The "Light" option would require the parking lot to the south of Pinanski Hall, the parking lot to the north of Pinanski Hall and green space to the east of Olney Hall. The parking lots would need to be re-paved and the green-space would need to be landscaped. The 'Heavy' geothermal option would require that in addition to demolishing Pinanski Hall. Geothermal boreholes underneath buildings is possible before construction, but does take away valuable real estate which could be slated for new buildings. Maintaining space and future options is a paramount in an urban environment.

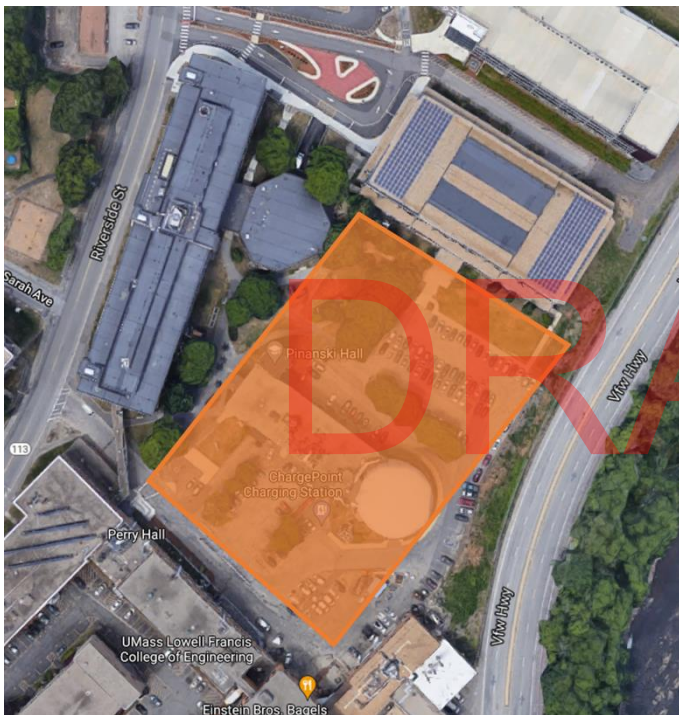

Good Option A1 and A2 geothermal borefield

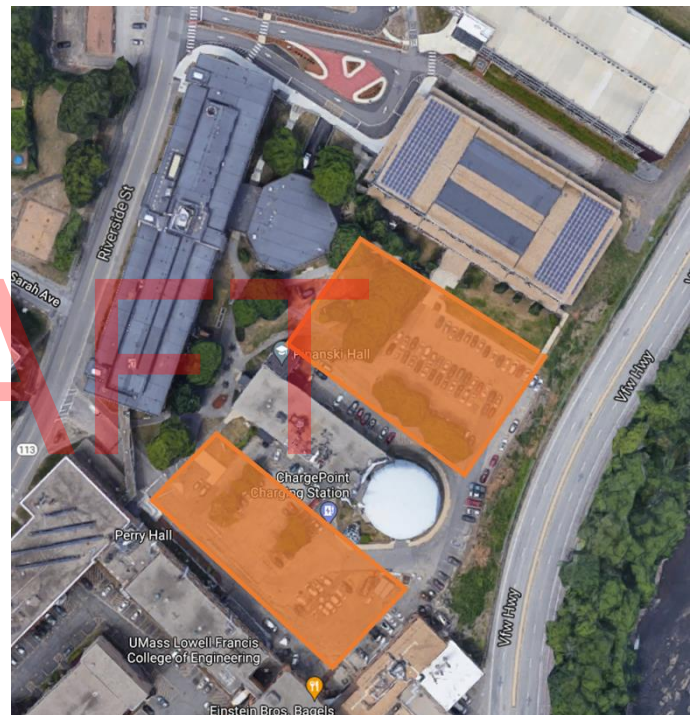

Good Option B1 and B2 geothermal borefield

Business As Usual (For Reference Only)

The table below shows the main north plant equipment required if all buildings replace in kind and pursue no energy conservation measures. Options with “A” include a large geothermal field, “B” includes a medium size geothermal field and “C” includes no geothermal. Options with “1” include biodiesel boilers and options with “2” include natural gas condensing boilers.

	BAU A1 Heavy Geo + Biodiesel	BAU B1 Light Geo + Air- source + Biodiesel	BAU C1 Air-source + Biodiesel	BAU A2 Heavy Geo + Air- source + Gas	BAU B2 Light Geo + Air- source + Gas	BAU C2 Air-source + Gas
Heat Recovery Chillers	(44) 50 Ton modular heat recovery chillers with VFDs and ground connection	(22) 50 Ton modular heat recovery chillers with VFDs and ground connection	None	(44) 50 Ton modular heat recovery chillers with VFDs and ground connection	(22) 50 Ton modular heat recovery chillers with VFDs and ground connection	None
Geothermal Borefield	Closed Loop Vertical Borefield 700 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 350 Boreholes at 500 ft depth	None	Closed Loop Vertical Borefield 700 Boreholes at 500 ft depth	Closed Loop Vertical Borefield 350 Boreholes at 500 ft depth	None
Air-to-Water Heat Pumps	None	(58) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(116) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(116) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(175) 30 Ton Air-to-Water heat pumps similar to Multistack ARA	(233) 30 Ton Air-to-Water heat pumps similar to Multistack ARA
Peak Heating Load + Backup System	(3) 700 Boiler HP Biodiesel Boilers	(3) 700 Boiler HP Biodiesel Boilers	(3) 700 Boiler HP Biodiesel Boilers	(12) 6,000 MBH Natural Gas Condensing Boilers	(12) 6,000 MBH Natural Gas Condensing Boilers	(12) 6,000 Natural Gas Condensing Boilers
Peak Cooling Load + Backup System	(4) 1,050 Ton water-cooled Centrifugal Chillers with Cooling Towers	(4) 950 Ton water-cooled Centrifugal Chillers with Cooling Towers	(4) 950 Ton water-cooled Centrifugal Chillers with Cooling Towers	(3) 500 Ton water-cooled Centrifugal Chillers with Cooling Towers	(2) 450 Ton air-cooled chillers	(1) 350 Ton air-cooled chiller
Hot water and Chilled Water Distribution	Chilled water and hot water supply and return through buildings and direct buried as required.					
Emergency Generators + Backup System	Emergency generators for life-safety and heating system. The cooling plant is not on optional standby.					
Fuel Storage	36-48 hours of backup fuel storage in the plant.					

Business As Usual Geothermal Borefield

The potential geothermal borefield site is parking lots and green space immediately surrounding the North Plant. The target percent of peak heating load is 15% to 30% of the peak heating load to maximize utilization of the geothermal borefield. For resiliency, the closed-loop vertical borefields will be piped in groups or 'circuits', with each circuit having supply and return piping directly to the building. The satellite images below show the approximate site area required for the 'Light' and 'Heavy' geothermal options. The "Light" option would require the parking lot to the south of Pinanski Hall, the parking lot to the north of Pinanski Hall, the green space to the east of Olney Hall and demolishing Pinanski Hall. The 'Heavy' geothermal option would require that in addition to demolishing the Olney Hall and take away valuable real estate which could be slated for new buildings. Geothermal boreholes underneath buildings is possible before construction, but does take away valuable real estate which could be slated for new buildings. Maintaining space and future options is a paramount in an urban environment.



Business As Usual Option A1 and A2 geothermal borefield




Business As Usual Option B1 and B2 geothermal borefield

Heating loads by Equipment

The primary heating equipment for the new North Campus plant will consist of ground-source heat pumps, air-source heat pumps, biodiesel boilers and gas boilers. The sizing of the geothermal is based on 30% of the peak heating load for the heavy geothermal options, 15% for the light geothermal options. For biodiesel options, the air-source heat pumps are sized based on having at least 30% heat pump capacity (either ground-source or air-source), while the gas options are sized to have at least 80% of the peak heating load to meet the energy goals of the campus. Biodiesel and gas boilers are sized for resiliency for 80% of the design capacity. The options with biodiesel are carbon neutral while the gas boilers options are >95% carbon neutral.


The chart below shows the 18 North Plant options and the associated ground-source heat pump, air-source heat pump, biodiesel boiler and gas boiler capacities.

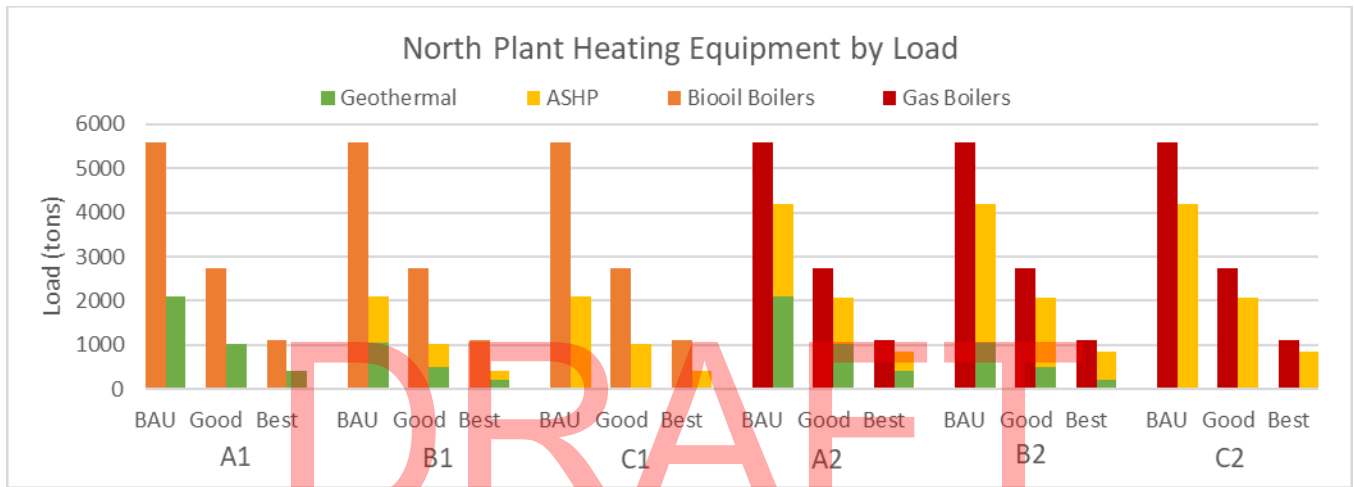

Cooling loads by Equipment

The primary cooling equipment for the new North Campus plant will consist of ground-source heat pumps, air-source heat pumps, air-cooled chillers and water-cooled chillers with cooling towers. The sizing of ground-source heat pumps and air-source heat pumps are based on the heating design loads. The sizing of the air-cooled chiller and water-cooled chiller plant options are based on the remaining load for the option. Air-cooled was used when the remaining cooling load was less than 1,000 tons.

The chart below shows the 18 North Plant options and the associated ground-source heat pump, air-source heat pump, air-cooled chiller and water-cooled chiller capacities.

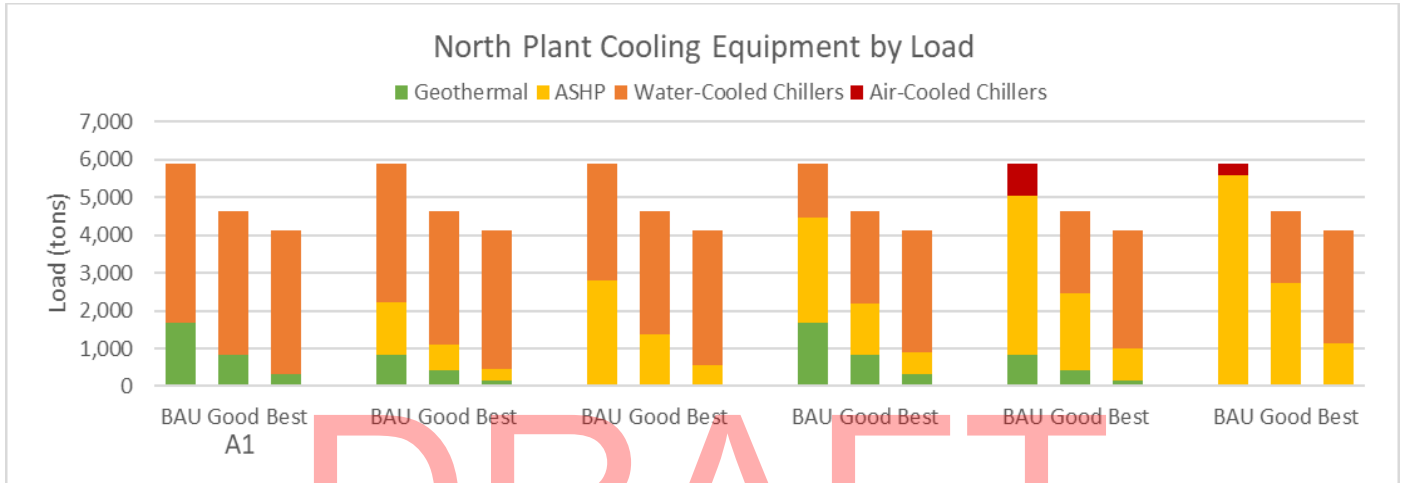

DRAFT

North Campus Life-Cycle Cost Analysis

A life-cycle cost analysis (LCCA) provides an estimate of the total net present cost of ownership including construction costs, maintenance costs, equipment replacement costs and energy costs over a given study period. The analysis assumes construction would start in 2025 and include costs through 2050.

The discount rate, escalation rates, equipment life, and study length are shown in the table below.

INPUT	VALUE
Discount Rate	5%
Maintenance Escalation Rate	3%
Utility Escalation Rate	3%
Escalation Rate of Future Costs	3%
Equipment Life	Pumps and heat pumps: 15 years Boilers and chillers: 25 years
Study Length	25 years


The utility rates used in the analysis have been provided by UMass Lowell. The electricity rate is 0.132 \$/kWh, the gas rate is 9.36 \$/MMBtu and the biodiesel rate is 3.50 \$/gallon. The maintenance costs include the costs associated with equipment as well as costs to staff the plant.

DRAFT

Construction Costs

The plant construction costs have been estimated based on costs in today's dollars to have a clear relative comparison of construction costs between the options, regardless of when plant equipment is installed. The options include an addition located to the northeast of the existing boiler plant to house the cooling plant equipment including centrifugal chillers, heat recovery chillers, pumps, etc with the cooling towers and some of the air-source heat pumps on the roof. The remainder of the air-source heat pumps will be located on the roof of the adjacent building.

The chart below shows the costs for the central plant for all options and all load scenarios. Each option shows the load scenario (Business as Usual, Good and Best), the boiler type (biodiesel and gas), and the percent of peak heating capacity is ground-source and air-source heat pumps.

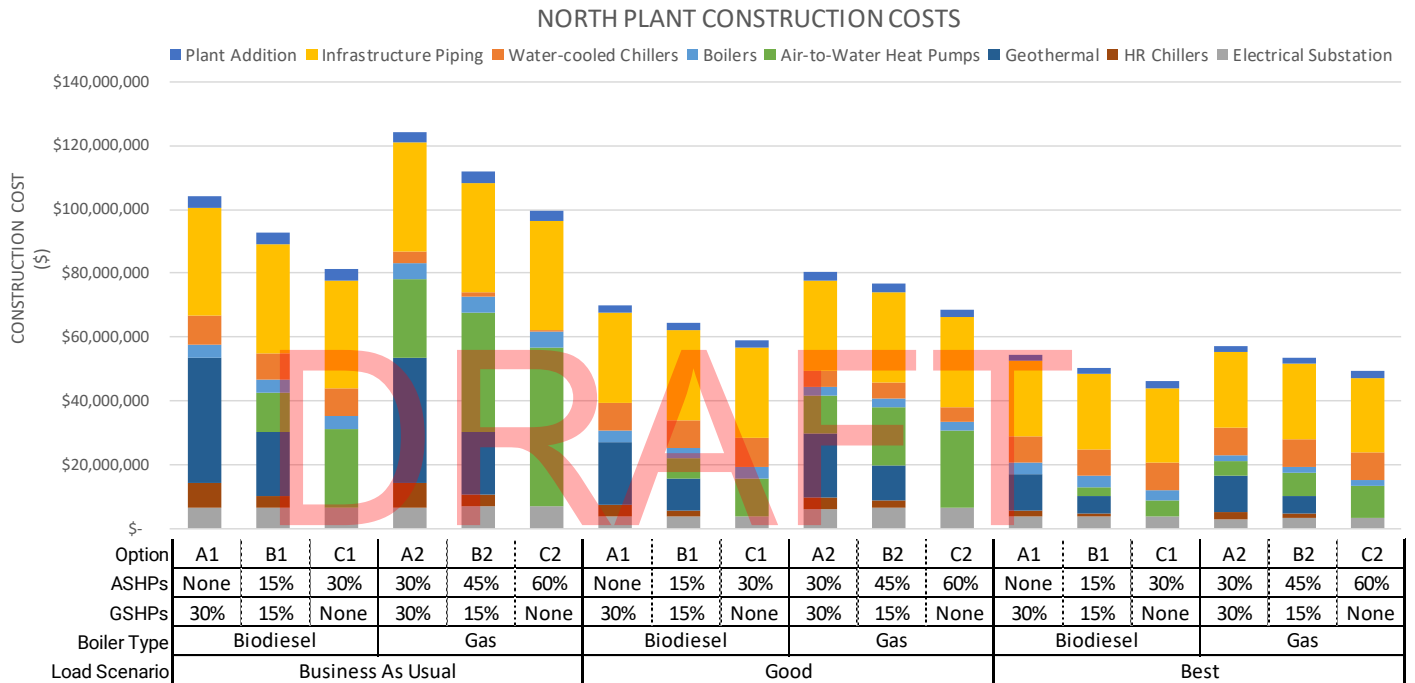


A few things stand out.

1. Reducing peak load at the buildings reduces the construction cost of the north campus plant because it reduces the amount of mechanical equipment required to heat and cool the buildings.
2. Increasing the air-source heat pumps to eliminate boiler use results in an increase in construction cost. The construction cost per btu of heat at design day is much higher for an air-source heat pump than a biodiesel boiler.
3. The cost of geothermal is relatively low when comparing to air-source heat pumps operating at low outdoor air conditions. Geothermal exchanges heat with the ground and therefore does not operate at a reduced capacity at low ambient. It is possible in the future for air-to-water heat pumps to maintain nominal capacity and hot water supply temperatures at low ambient, but currently most manufacturers do not.

Life-cycle Cost Analysis Results

The chart below shows the life-cycle cost for all options and all load scenarios compared to the building stand-alone (SA). Each option shows the load scenario (Business as Usual, Good and Best), the boiler type (biodiesel and gas), and the percent of peak heating capacity is ground-source and air-source heat pumps. Note that to meet the alternative energy goals, the gas boiler options are required to have more air-source heat pumps, with the gas boilers for only when the outdoor air temperature is below the 99% winter design temperature and emergency operation.

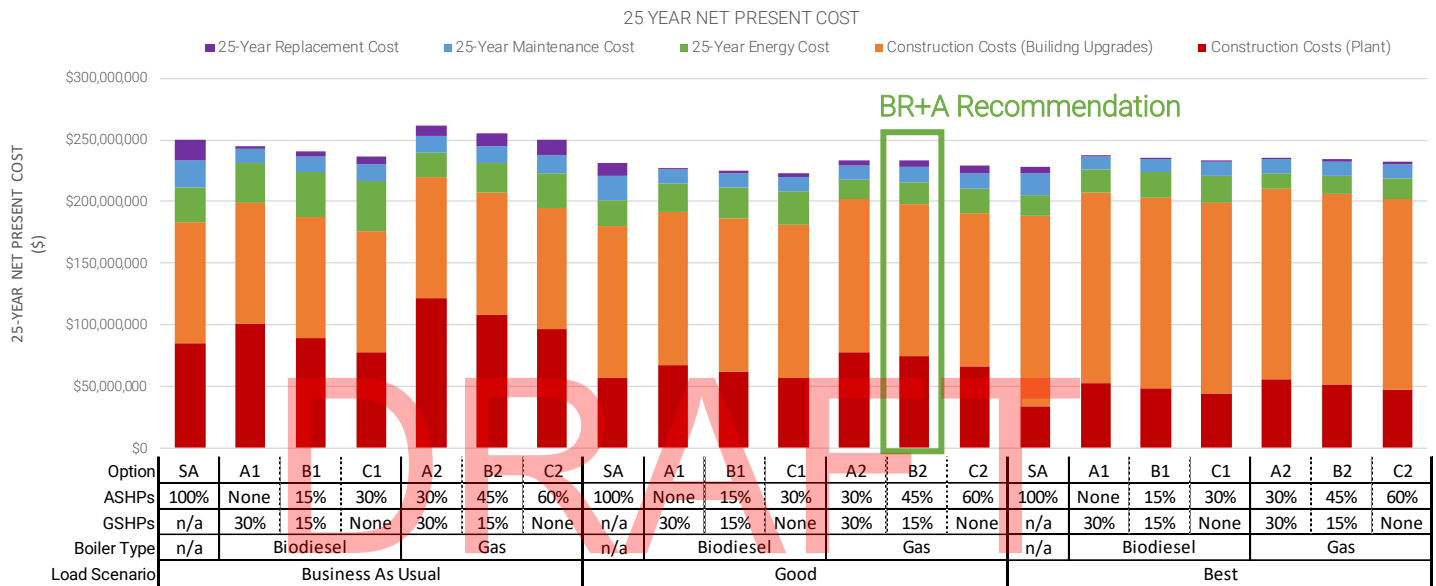

Recommendation

BR+A recommends the north campus select a central plant to centralize maintenance and provide more reliability. The “Good B2 – Light Geo + Air-source + Gas Boilers” offers the best balance of load reductions, energy efficiency and future flexibility. The “Good B2 – Light Geo + Air-source + Biodiesel Boilers” option offers similar benefits, with the one caveat being the use of biodiesel boilers for a portion of the heating load. Using the “Good” load scenario accounts for some buildings being designed to meet the “best scenario”, some only able to achieve “Good” and some remaining as “Business as Usual”. This is to account for unforeseen circumstances as the building upgrades are pursued.

The plant equipment installs a high efficiency geothermal closed-loop geothermal heat exchanger below the two parking lots to the north of the plant. Ground-source heat pumps are more efficient, have a longer expected life and are more reliable than air-source heat pumps. Since the site cannot accommodate the full heating load with geothermal, air-source heat pumps are used for a portion of the peak heating load. The option allows the plant to continue to use the gas steam boilers until the hot water and chilled water distribution is in place and the steam boilers can be taken offline. At that time, a final decision regarding gas vs biodiesel boilers can be made. Biodiesel may be more common and cost effective in the future and therefore use biodiesel in place of heat pumps may be more desirable to achieve the carbon neutral goals by 2050.

South Campus Energy Efficiency Results

Project profiles were developed for each building on the South Campus pilot building are developed in order to evaluate and quantify energy, emissions, and heating/cooling load impacts. Measures were identified by using the ASHRAE Level I Audit procedure. Two scenarios - "Good" and "Best" – were detailed in order to outline the range of opportunities compared to a Default/Business-As-Usual ("BAU") Case. The BAU case was defined as the 2019 energy use profiles adjusted for key factor including expanded lab operations, added cooling, and centralized ventilation. Energy end use breakdowns were estimated based building core end use given the lack of campus submetering. Current and future 2050 carbon emissions were quantified using values from the "30-year Forecast Preliminary Report." Heating and cooling loads were quantified in order to enable evaluation of central vs. decentralized scenarios. Air-side energy recovery and envelope are the key strategies outlined to reduce heating and cooling loads.

Compared to the Default/Business-As-Usual ("BAU") Case, the South Campus, "Good" case is expected to achieve a 47% energy reduction and 35% emissions reduction. Based on future emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is expected to be closer to 70%. The South Campus, "Best" case is expected to achieve a 53% energy reduction and 43% emissions reduction. Based on future emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is expected to be closer to 74%.

The reductions outlined above are expected to greatly exceed the EUI and emissions requirements of Executive Order No. 594. The remaining emissions can be offset with renewables sources.

Based on decisions made by UML regarding the North Campus, the Team will evaluate the viability of centralized heating/cooling systems on the South Campus.

DRAFT

Durgin Hall

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	70865
Last Major Renovation	2019

Building Summary


Durgin Hall is an office/classroom building with performance space on the South Campus. It has a Building Score of 67. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of envelope upgrades, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.

Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements


Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5c - Air-side Systems - Constant to variable volume
ECM 5e - Air-side Systems - Airflow setbacks
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

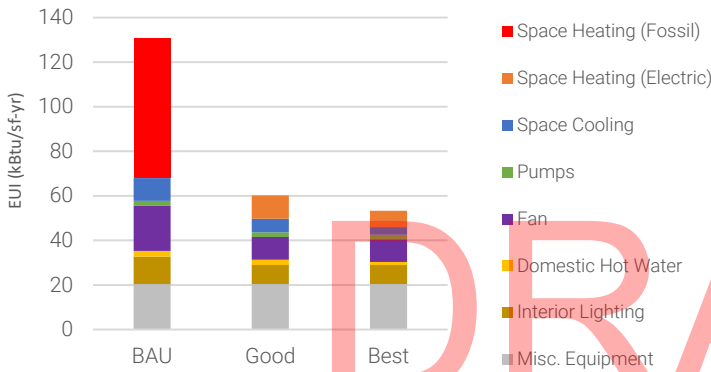


Carbon Emissions

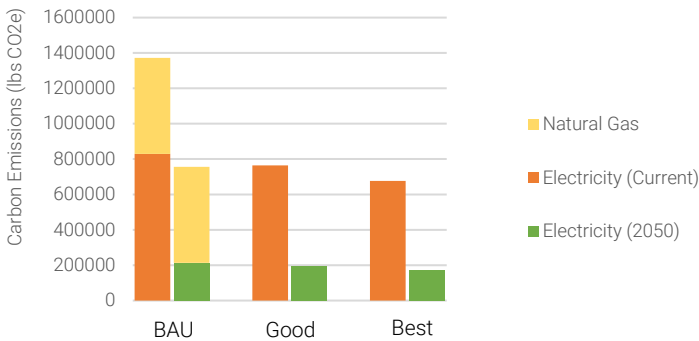

Heating Load



Cooling Load

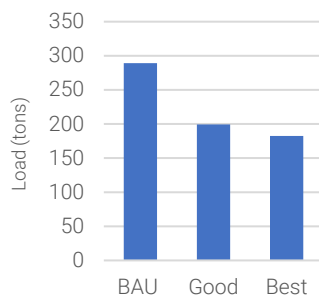


O'Leary Library

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	109788
Last Major Renovation	2019


Building Summary

O'Leary Library building is an office/classroom building on the South Campus. It has a Building Score of 68. This makes it a higher priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


EUI Breakdown

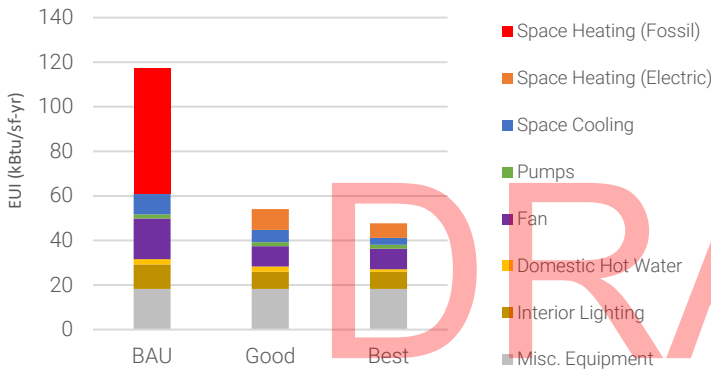


Carbon Emissions

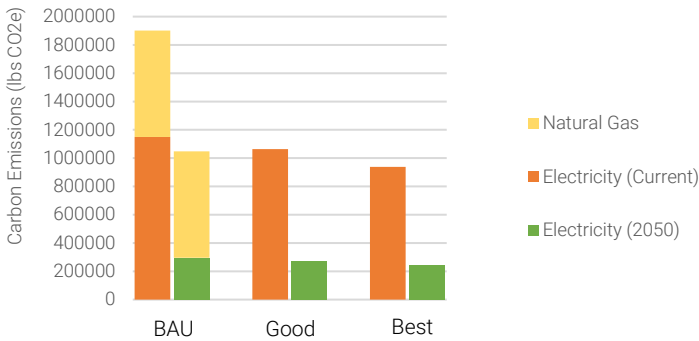

Heating Load



Cooling Load

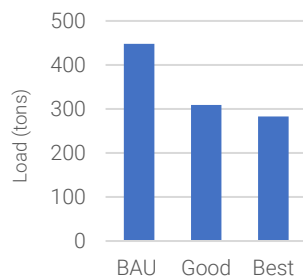

Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 5e - Air-side Systems - Airflow setbacks
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

McGauvran Center

Campus	South Campus
Core End Use	Lab
Square Footage	44756
Last Major Renovation	2015

Building Summary


McGauvran Center is an office/classroom building with dining on the South Campus. It has a Building Score of 62. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, and energy efficient heating and cooling systems. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
Air-cooled Chiller
High-quality envelope; new insulation and new windows and doors


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWP
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

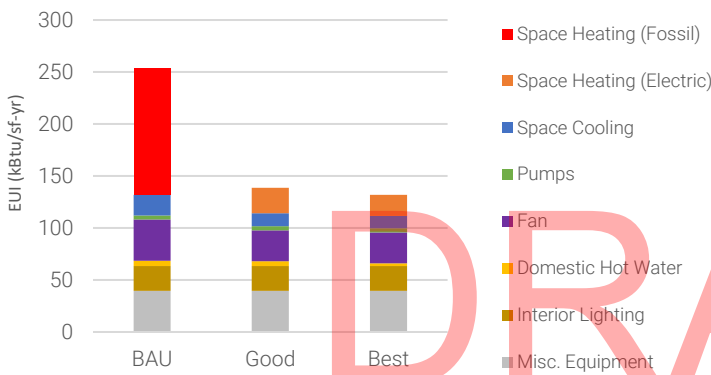


Carbon Emissions

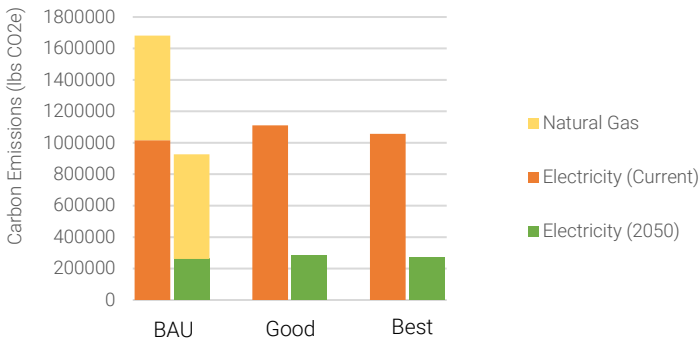

Heating Load



Cooling Load

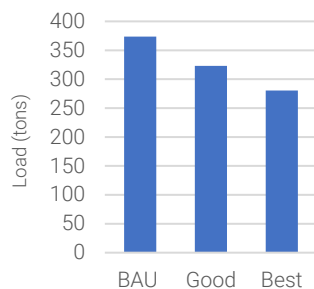

Mahoney Hall

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	50394
Last Major Renovation	1960


Building Summary

Mahoney Hall is an office/classroom building on the South Campus. It has a Building Score of 60. This makes it a high priority for energy efficiency improvements particularly given direct steam systems. The business as usual case assume added central ventilation and cooling. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


Current
Direct Steam
Window AC
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10a - Controls - DDC
ECM 11f - Process Loads - Energy Star Office Equipment

EUI Breakdown

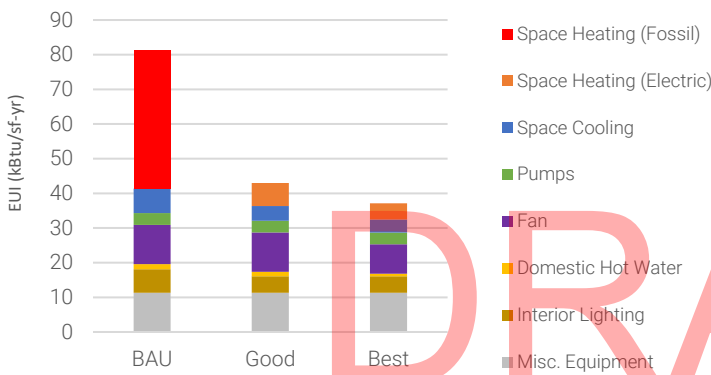


Carbon Emissions

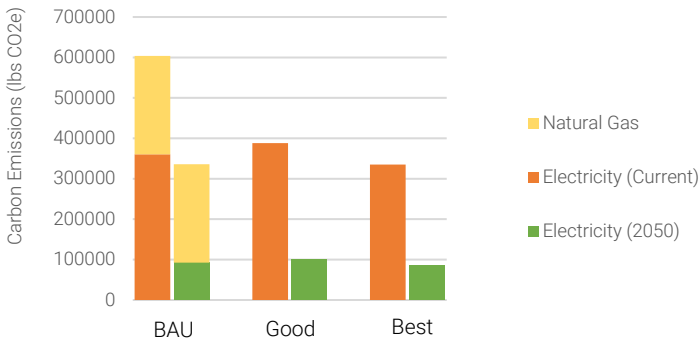


Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

Heating Load



Cooling Load

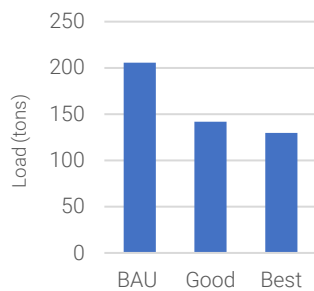


Dugan Hall

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	52643
Last Major Renovation	1962


Building Summary

Dugan Hall is an office/classroom building on the South Campus. It has a Building Score of 56. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of envelope upgrades, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


EUI Breakdown

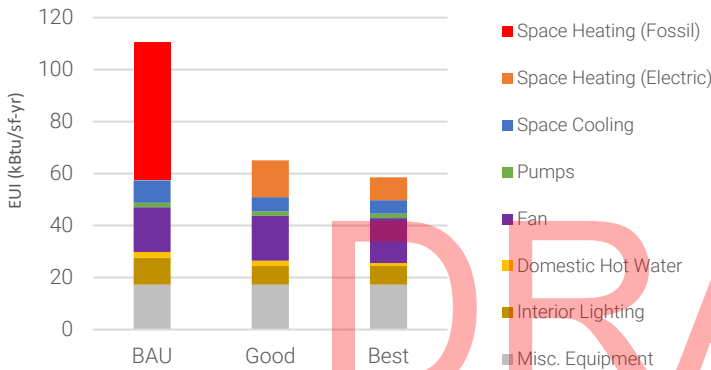


Carbon Emissions

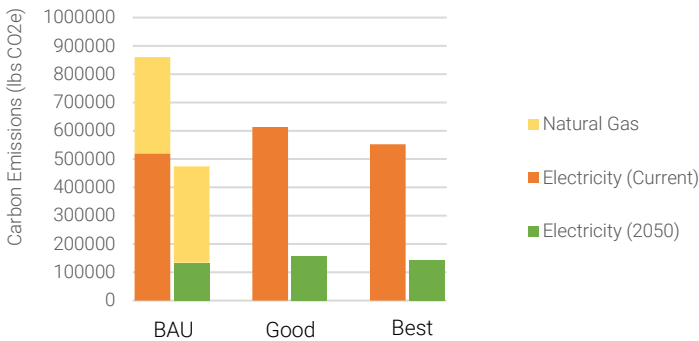

Heating Load



Cooling Load

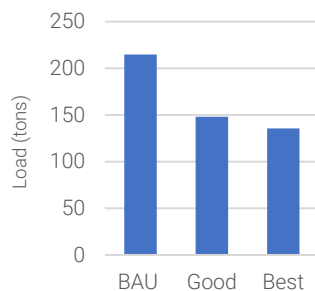

Current
Steam-to-HHW
DX Cooling
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 7b - Water-side Systems - Standalone AWP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

Concordia Hall

Campus	South Campus
Core End Use	Residential
Square Footage	41380
Last Major Renovation	1966


Building Summary

Concordia Hall is residential building on the South Campus. It has a Building Score of 72. This makes it a higher priority for energy efficiency improvements particularly given direct steam systems. The business as usual case assumes ventilation and cooling will be added. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.

Current
Steam-to-HHW
No cooling
Candidate for envelope improvements


Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7a - Water-side Systems - Standalone VRF
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 11a - Process Loads - Behavior Change

EUI Breakdown

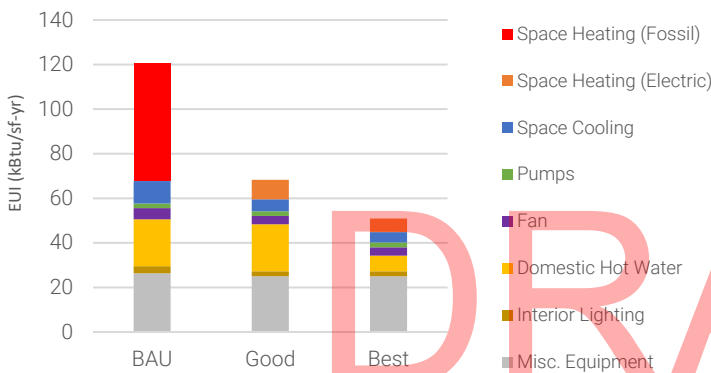


Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9e - Plumbing - ASHP Water Heater with Storage


Carbon Emissions

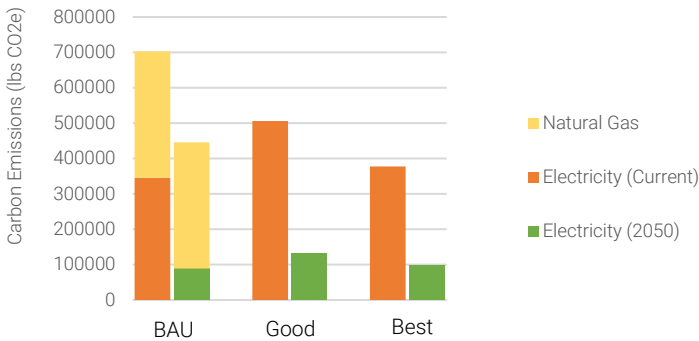

Heating Load



Cooling Load

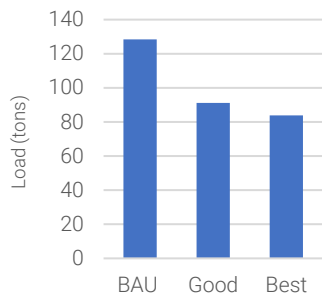


Weed Hall

Campus	South Campus
Core End Use	Lab
Square Footage	63469
Last Major Renovation	1966


Building Summary

Weed Hall is an lab building on the South Campus. It has a Building Score of 59. This makes it a higher priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.


EUI Breakdown

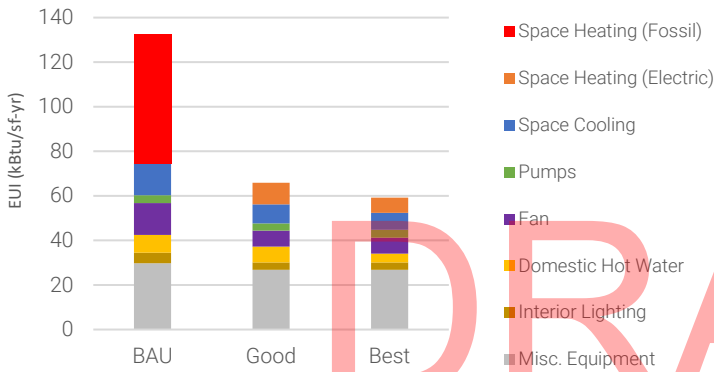


Carbon Emissions

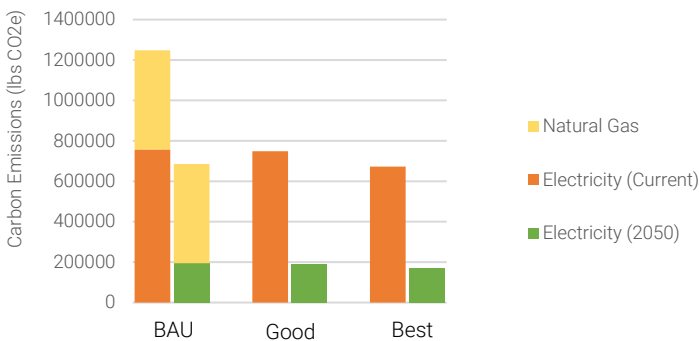

Heating Load

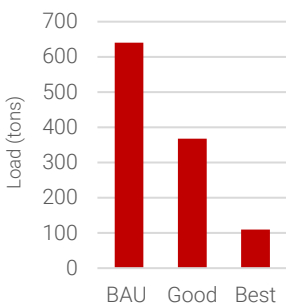

Cooling Load

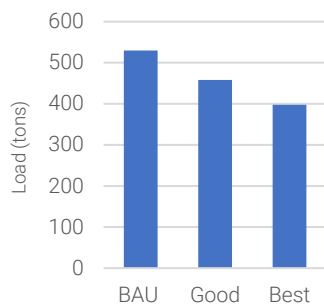

Current
Steam-to-HHW
Water-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5b - Air-side Systems - Decoupled systems
ECM 5d - Air-side Systems - Constant to variable volume
ECM 9c - Plumbing - Electric Water Heater
ECM 6c - Air-side Energy Recovery - 50% (Runaround Coil)
ECM 7c - Water-side Systems - Pump VFDs
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11b - Process Loads - Filtered Fume Hoods
ECM 11c - Process Loads - Low Flow Fume Hoods
ECM 11d - Process Loads - Fume Hood Vacancy Sensors
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 5f - Air-side Systems - Aircurity, particle counters
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)
ECM 9b - Plumbing - Instantaneous Water Heater

Health & Social Sciences Building

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	63237
Last Major Renovation	2013


Building Summary

The Health & Social Sciences Building is an office/classroom building with some dry labs on the South Campus. It has a Building Score of 46. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy efficient heating and cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


Current
Steam-to-HHW
Water-cooled Chiller
High-quality envelope; new insulation and new windows and doors

Good
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5e - Air-side Systems - Airflow setbacks
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

EUI Breakdown

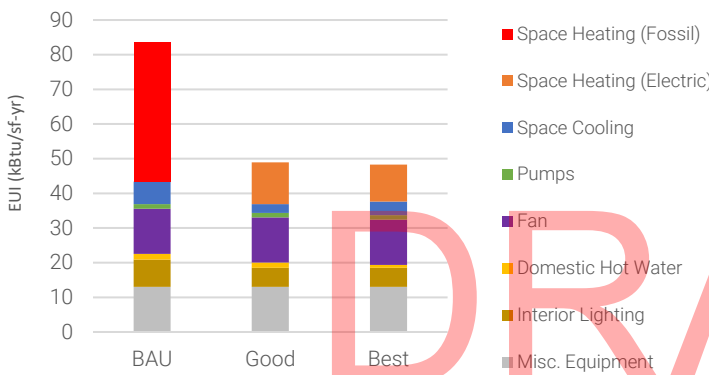


Carbon Emissions

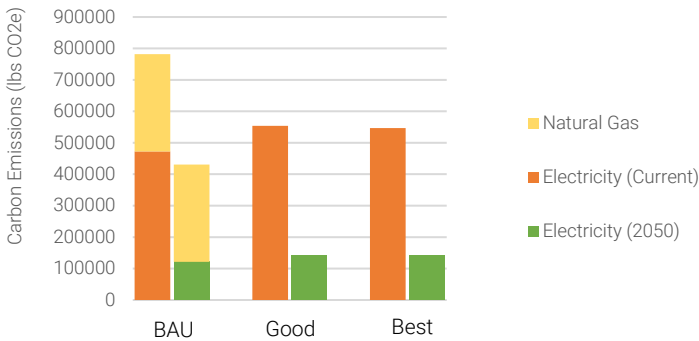


Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

Heating Load

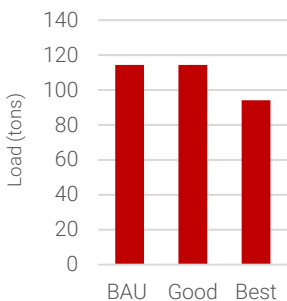

Cooling Load

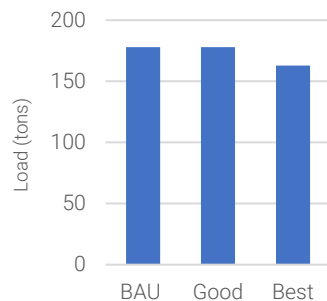

150 Wilder - Desmarais House

Campus	South Campus (satellite)
Core End Use	Office
Square Footage	5317
Last Major Renovation	1905


Building Summary

Desmarais House is a small office building on the South Campus. It has a Building Score of 33. This makes it a lower priority as it relates to energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Improved envelope reduce heating and cooling loads.

Current
Steam Boiler (local)
No Cooling
Candidate for envelope improvements


Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-paned
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10a - Controls - DDC
ECM 11f - Process Loads - Energy Star Office Equipment

EUI Breakdown

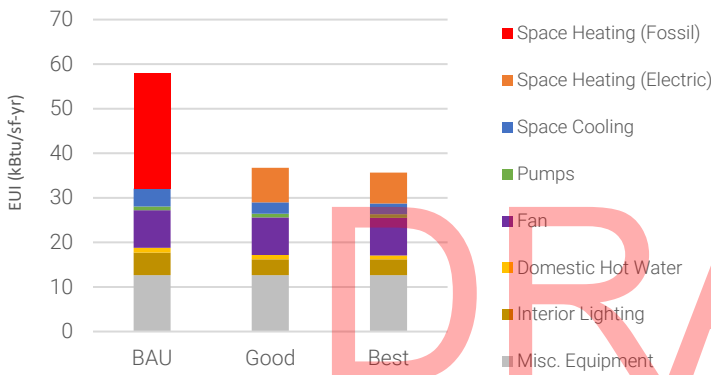


Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 7a - Water-side Systems - Standalone VRF
ECM 9b - Plumbing - Instantaneous Water Heater


Carbon Emissions

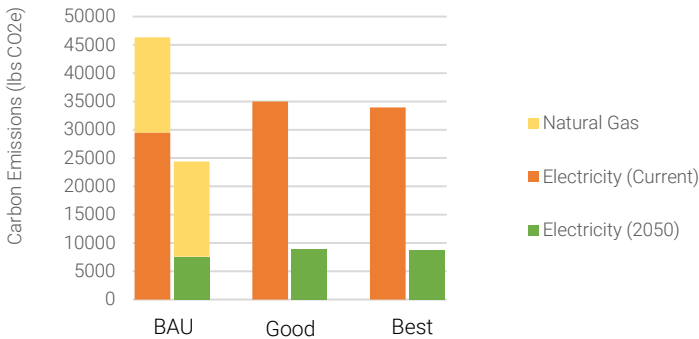

Heating Load

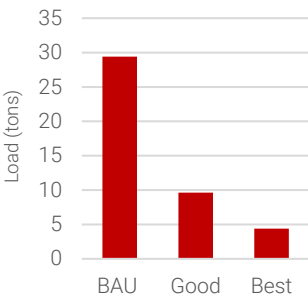

Cooling Load

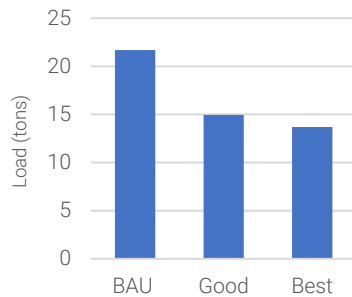

820 Broadway

Campus	South Campus (satellite)
Core End Use	Office
Square Footage	5583
Last Major Renovation	1890

Building Summary


820 Broadway is a small office building on the South Campus. It has a Building Score of 33. This makes it a lower priority as it relates to energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Improved envelope reduce heating and cooling loads.

Current
Steam Boiler (local)
No Cooling
Candidate for envelope improvements


Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-paned
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10a - Controls - DDC
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 7a - Water-side Systems - Standalone VRF
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

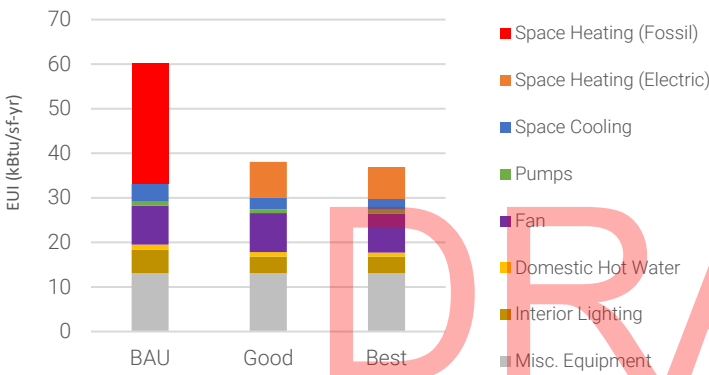


Carbon Emissions

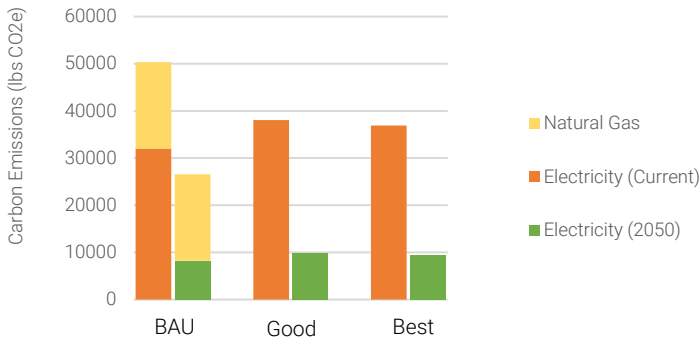

Heating Load



Cooling Load

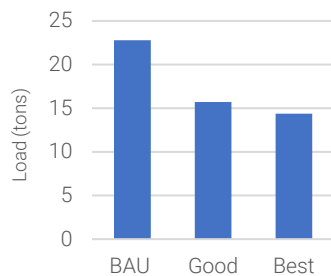

Coburn Hall

Campus	South Campus
Core End Use	Office/Classroom
Square Footage	67889
Last Major Renovation	2020

Building Summary


Coburn Hall is an office/classroom building on the South Campus. It has a Building Score of 18. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. Future carbon reduction is in result to electrified heating strategy. Minor envelope upgrades reduce heating and cooling loads.

Current
Steam-to-HHW
Air-cooled Chiller
High-quality envelope; new insulation and new windows and doors


Good
ECM 7b - Water-side Systems - Standalone AWWP
ECM 9a - Plumbing - Low Flow Fixtures
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

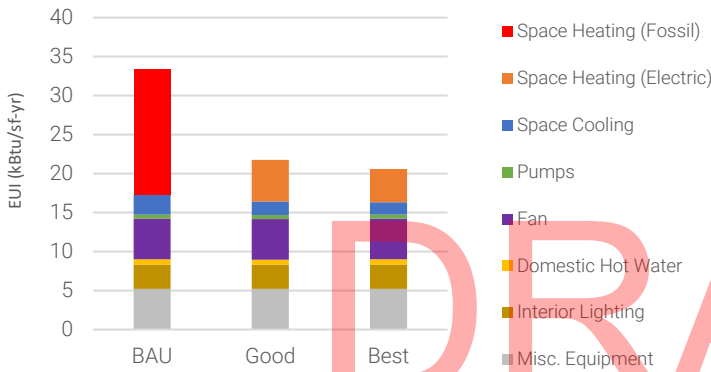


Carbon Emissions

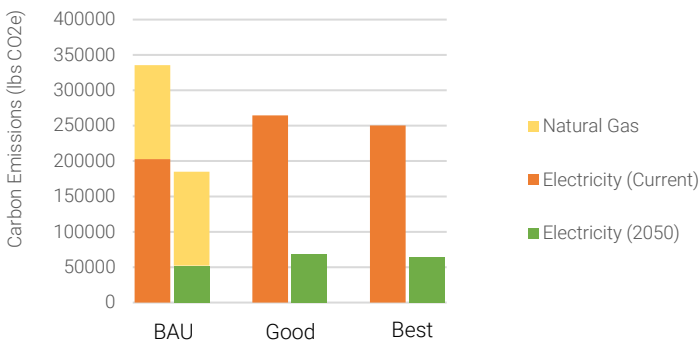

Heating Load



Cooling Load

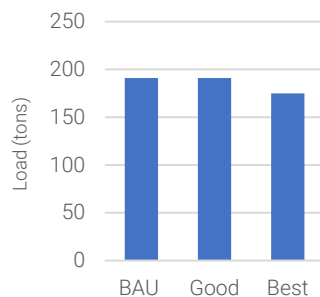


South Campus Plant Alternatives

The South Campus is currently served by three steam boilers that were replaced in 2015. The options for meeting the alternative energy requirements for the south campus buildings is to pursue stand-alone electrified heating and cooling plants or to install and expand the south campus central plant. These electrification options can be bundled with building upgrades under the “Good” or “Best” energy conservation bundles. These options are summarized below:

1. Stand-alone heating and cooling plants and code minimum building upgrades
2. Stand-alone with “Good” ECM package building upgrades
3. Stand-alone heating and cooling with “Best” ECM package building upgrades
4. Central Utility Plant using the North Campus “Good B2 – Light Geo + Air-source + Gas Boilers” Option for the south campus

The central plant options were vetted in the north central plant analysis and determined that the “Good B2 – Light Geo + Air-source + Gas Boilers” option was the best plant option. For the reasons described in the “Alternative Energy Measures Descriptions” of this report and the north plant analysis, converting to biodiesel is not be the best option from an emissions and operating cost perspective at this time. The chart below shows the 25-year life-cycle cost analysis for the South Campus Options for electrification.

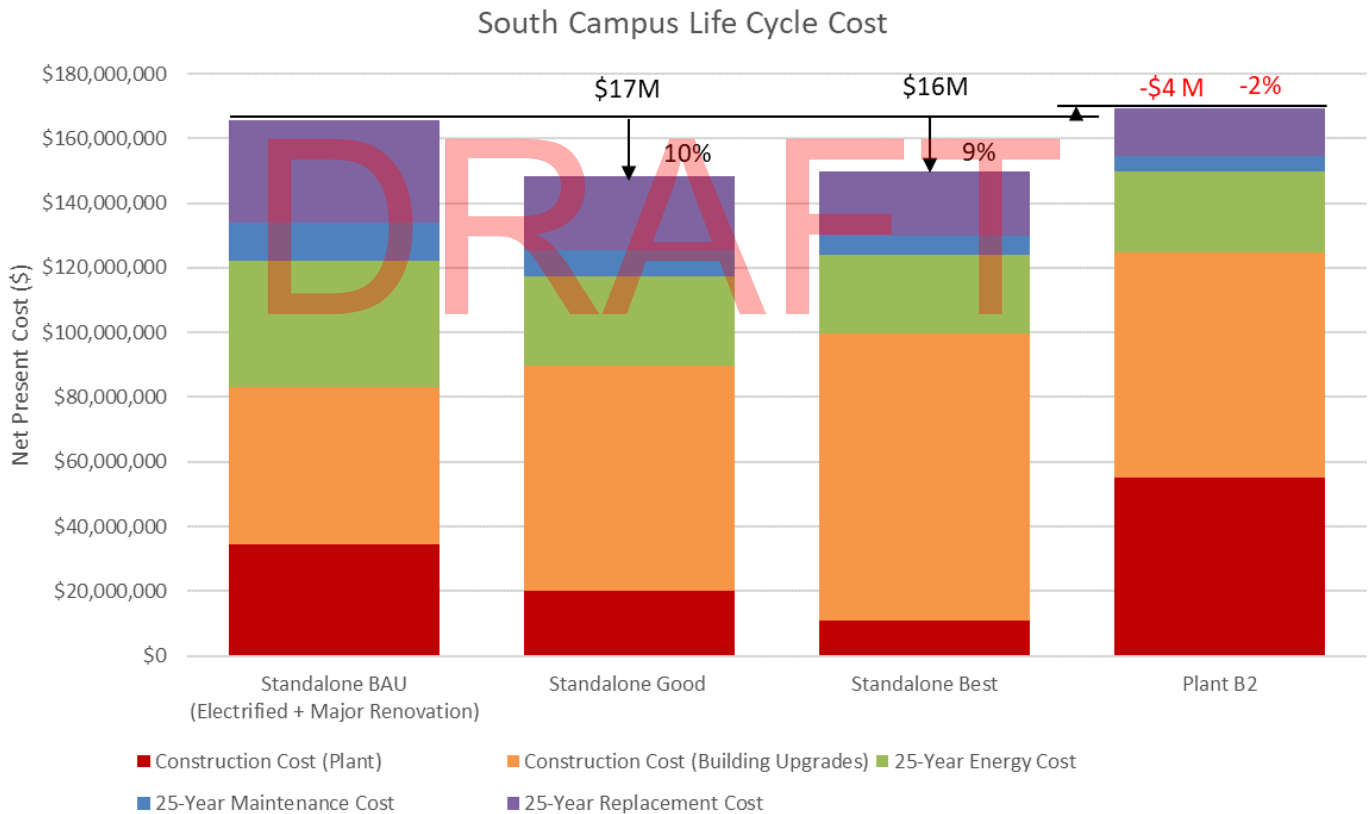

Recommendation

BR+A recommends decentralizing the heating and cooling equipment for the south campus (Stand-alone Good in the chart). The reason for this is because it provides the best balance between construction cost and operating cost, resulting in the lowest life-cycle cost. Implementing a central hybrid ground-source / air-source system based on the analysis of from the north campus analysis would also not be life-cycle cost effective. There are a number of factors that results in a negative life-cycle cost compared to building stand-alone heating and cooling including:

1. The design heating load is lower than the north campus for the “Good” and “Best” options.
2. The piping distribution is higher due to a more spread out.
3. The building types are primarily residence halls and education buildings, which have low heating and cooling loads when the envelope and mechanical systems are improved.

The analysis shows that doing some building upgrades during major renovations should be performed to reduce heating and cooling loads and thus reducing heating and cooling equipment cost. It is expected that some buildings may be renovated to the “Best” bundle, some will be renovated to the “Good” scenario and some will remain as existing, making the “Good” scenario the best representative option that incorporates unforeseen factors.

DRAFT

East Campus Energy Efficiency Results

Project profiles were developed for each building on the East Campus pilot building are developed in order to evaluate and quantify energy, emissions, and heating/cooling load impacts. Measures were identified by using the ASHRAE Level I Audit procedure. Two scenarios - "Good" and "Best" – were detailed in order to outline the range of opportunities compared to a Default/Business-As-Usual ("BAU") Case. The BAU case was defined as the 2019 energy use profiles adjusted for key factor including expanded lab operations, added cooling, and centralized ventilation. Energy end use breakdowns were estimated based building core end use given the lack of campus submetering. Current and future 2050 carbon emissions were quantified using values from the "30-year Forecast Preliminary Report." Heating and cooling loads were quantified in order to enable evaluation of central vs. decentralized scenarios. Air-side energy recovery and envelope are the key strategies outlined to reduce heating and cooling loads.

The East Campus, "Good" case is expected to achieve a 41% energy reduction and 26% emissions reduction. Based on future emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is expected to be closer to 68%. The East Campus, "Best" case is expected to achieve a 54% energy reduction and 43% emissions reduction. Based on future emissions rate (as detailed in the "30-Year Forecast"), the emissions reduction is expected to be closer to 75%. The remaining emissions can be offset with renewables sources.

The reductions outlined above are expected to greatly exceed the EUI and emissions requirements of Executive Order No. 594. The Investment Phase will detail how these projects can be structured in order to meet these requirement timelines.

The East Campus is not expected to be an appropriate site for centralized heating/cooling systems given the lack of space type and load diversity; limited space in the urban environment; and relative locations of buildings to one another.

DRAFT


Fox Hall

Campus	East Campus
Core End Use	Lab
Square Footage	196192
Last Major Renovation	2019


Building Summary

Fox Hall is a residential building with dining on the East Campus. It has a Building Score of 59. This makes it a high priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, high efficiency heating/cooling systems, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


EUI Breakdown

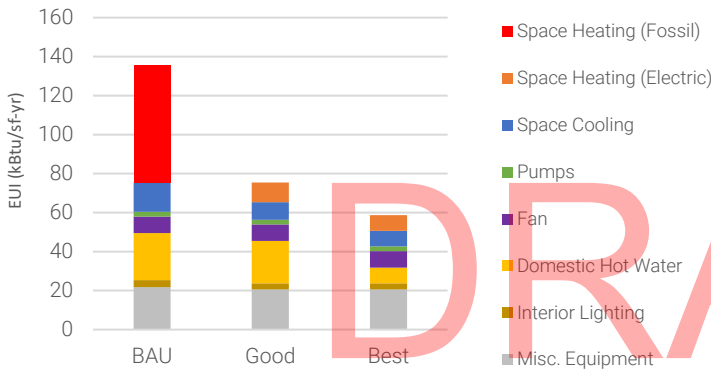


Carbon Emissions

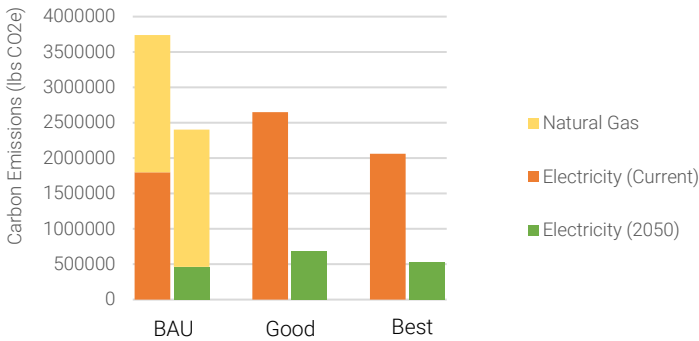

Heating Load

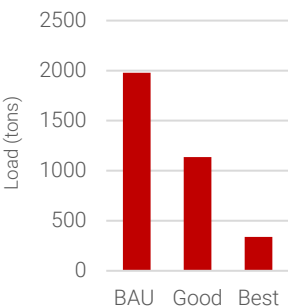

Cooling Load

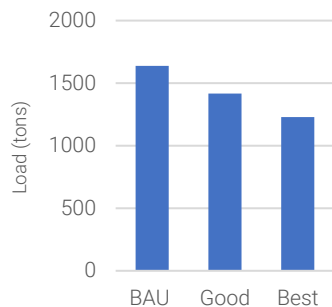

Current
HHW Boiler
Air-cooled Chiller
Candidate for envelope improvements

Good
ECM 1a - Wall Insulation - R-10 continuous insulation
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8b - Lighting - Daylight Sensors
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11g - Process Loads - Energy Star Kitchen All-Electric Energy Star

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9e - Plumbing - ASHP Water Heater with Storage

River Hawk Village

Campus	East Campus
Core End Use	Residential
Square Footage	197841
Last Major Renovation	2017

Building Summary


Riverhawk Village is a residential building on the East Campus. It has a Building Score of 56. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy recovery. Future carbon reduction is in result to electrified heating strategy. Energy recovery upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
WSHP
High-quality; new insulation and new windows and doors


Good
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9e - Plumbing - ASHP Water Heater with Storage


EUI Breakdown

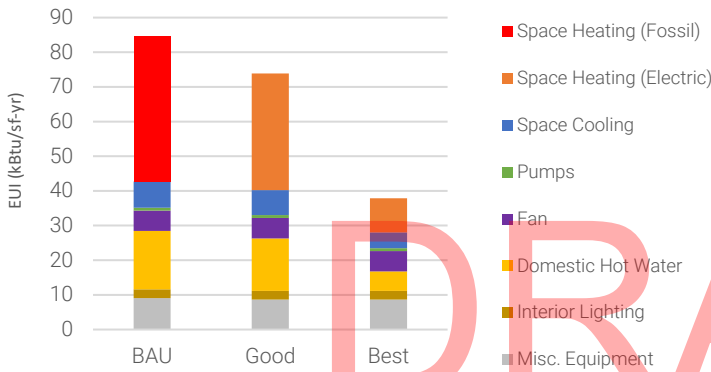


Carbon Emissions

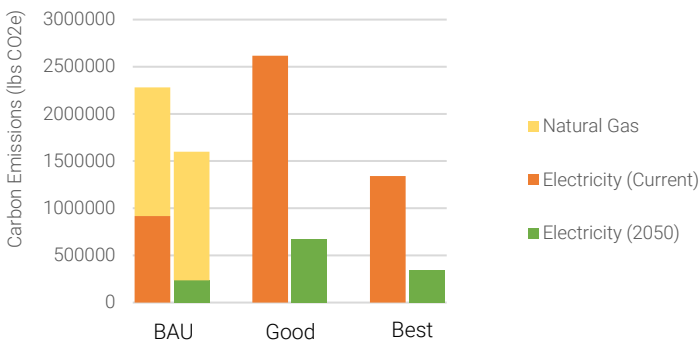

Heating Load



Cooling Load

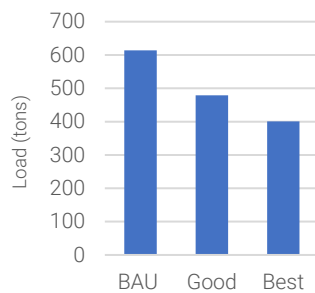

Leitch Hall

Campus	East Campus
Core End Use	Residential
Square Footage	52768
Last Major Renovation	2014

Building Summary


Leitch Hall is a residential building on the East Campus. It has a Building Score of 52. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
DX Cooling
Acceptable envelope; original components


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 7a - Water-side Systems - Standalone VRF
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9e - Plumbing - ASHP Water Heater with Storage


EUI Breakdown

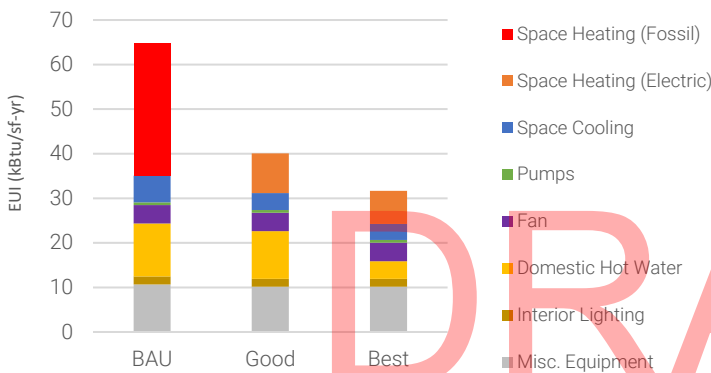


Carbon Emissions

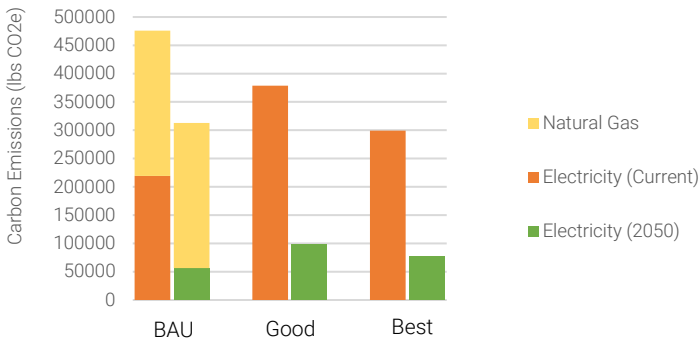

Heating Load



Cooling Load



Donahue Hall

Campus	East Campus
Core End Use	Residential
Square Footage	81593
Last Major Renovation	2019

Building Summary


Donahue Hall is a residential building on the East Campus. It has a Building Score of 51. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.

Current
HHW Boiler
Water-cooled Chiller
Acceptable envelope; original components


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7a - Water-side Systems - Standalone VRF
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9e - Plumbing - ASHP Water Heater with Storage


EUI Breakdown

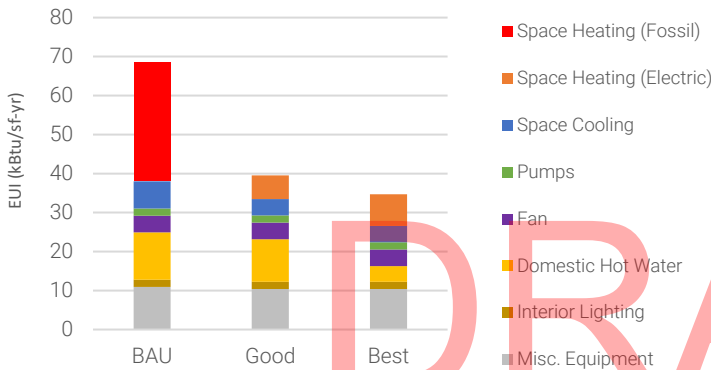


Carbon Emissions

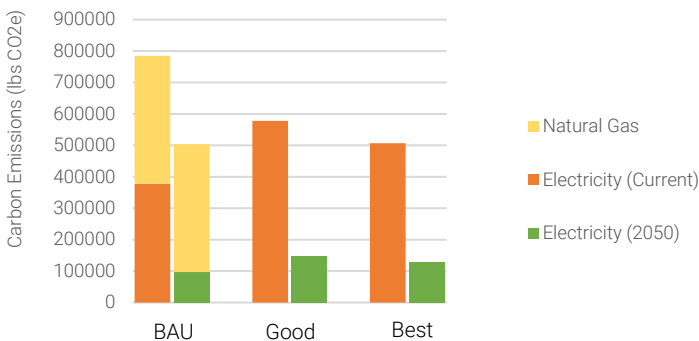

Heating Load



Cooling Load

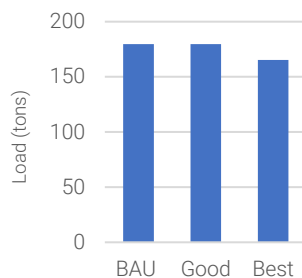


Tsongas Center at UMass Lowell

Campus	East Campus (satellite)
Core End Use	Other
Square Footage	181230
Last Major Renovation	2019


Building Summary

Tsongas Center is an ice rink with dining on the East Campus. It has a Building Score of 50. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

EUI Breakdown

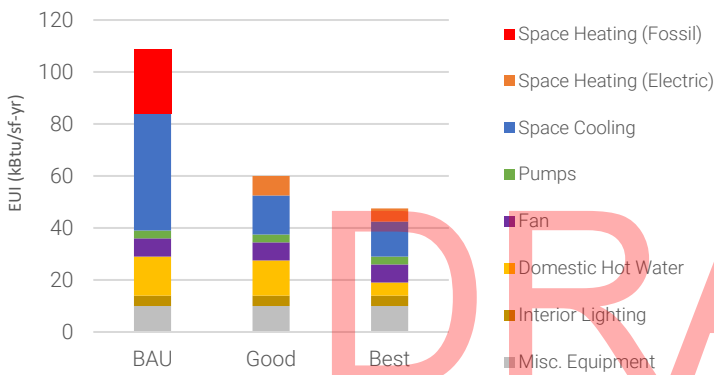

Carbon Emissions

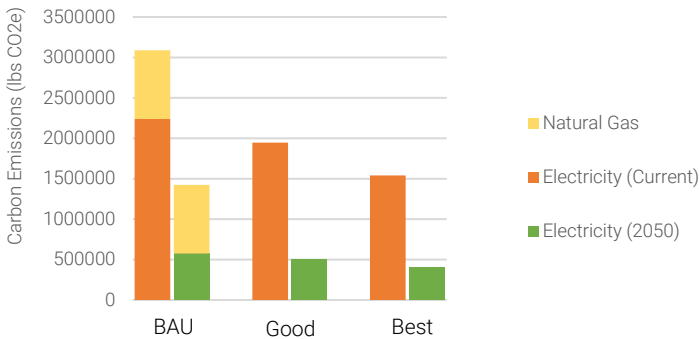

Current
Steam Boiler (local)
Air-cooled Chiller
Acceptable envelope; original components

Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone WSHP
ECM 8b - Lighting - Daylight Sensors
ECM 10b - Controls - Retro-commissioning
ECM 11g - Process Loads - Energy Star Kitchen All-Electric Energy Star

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9e - Plumbing - ASHP Water Heater with Storage

UMass Lowell Inn & Conference Center

Campus	East Campus (satellite)
Core End Use	Residential
Square Footage	163946
Last Major Renovation	2019

Building Summary


UMass Lowell Inn & Conference Center is a residential building on the East Campus. It has a Building Score of 49. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of air-side energy efficiency and high efficiency heating/cooling systems. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
Gas-Fired/Electric Heat
DX Cooling
Acceptable envelope; original components


Good
ECM 7a - Water-side Systems - Standalone VRF
ECM 8b - Lighting - Daylight Sensors
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11g - Process Loads - Energy Star Kitchen All-Electric Energy Star

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 7b - Water-side Systems - Standalone AWHP


EUI Breakdown

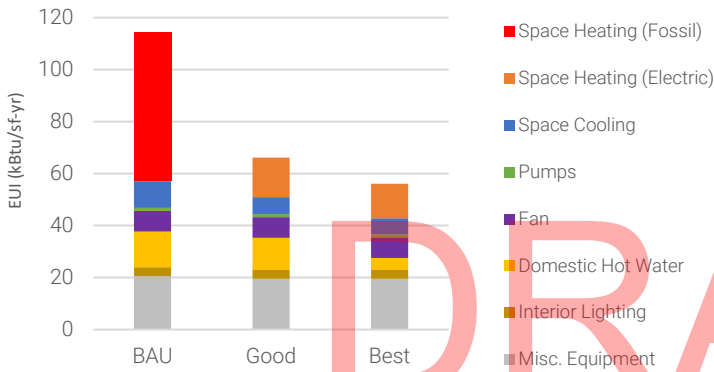


Carbon Emissions

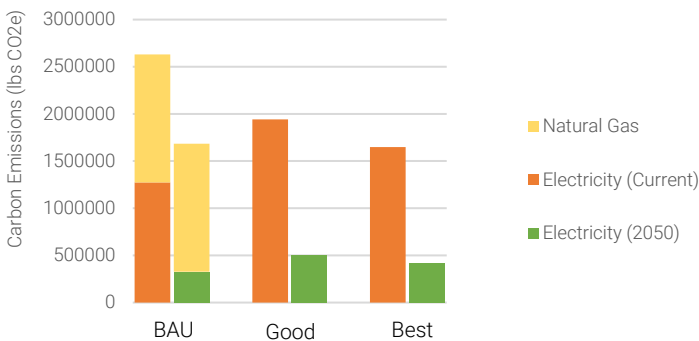

Heating Load



Cooling Load

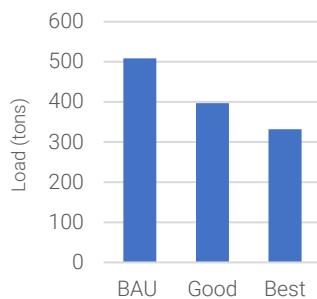

Campus Recreation Center

Campus	East Campus
Core End Use	Fitness
Square Footage	62185
Last Major Renovation	2019

Building Summary


Campus recreation center is a fitness building on the East Campus. It has a Building Score of 47. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of air-side energy recovery, high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
Water-cooled Chiller
High-quality envelope; new insulation and new windows and doors


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9e - Plumbing - ASHP Water Heater with Storage


EUI Breakdown

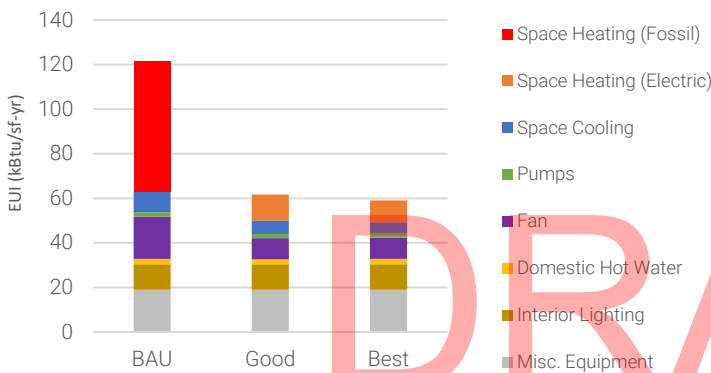


Carbon Emissions

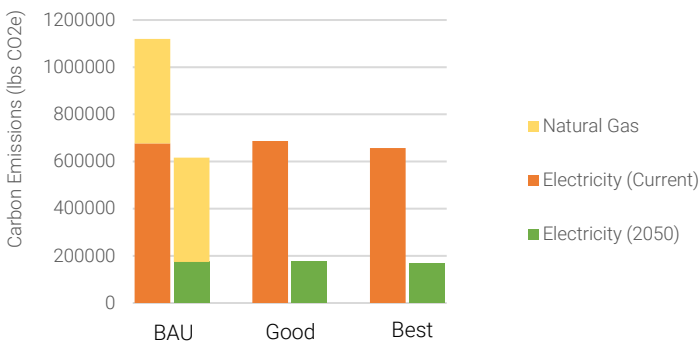

Heating Load



Cooling Load

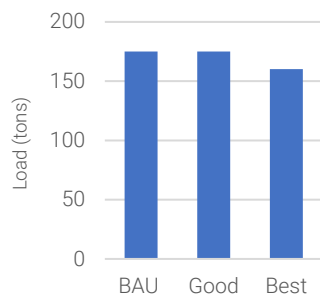

Bourgeois Hall

Campus	East Campus
Core End Use	Residential
Square Footage	52979
Last Major Renovation	2014

Building Summary


Bourgeois Hall is a residential building on the East Campus. It has a Building Score of 44. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
DX Cooling
Acceptable envelope; original components


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 7a - Water-side Systems - Standalone VRF
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 7b - Water-side Systems - Standalone AWHHP
ECM 9e - Plumbing - ASHP Water Heater with Storage


EUI Breakdown

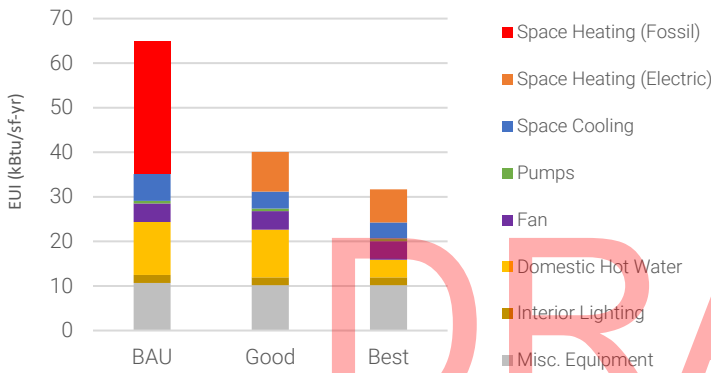


Carbon Emissions

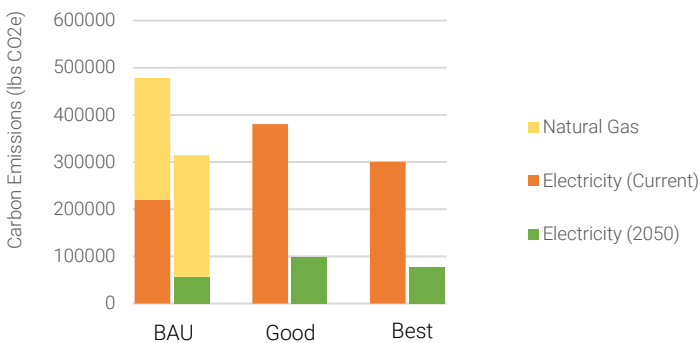

Heating Load

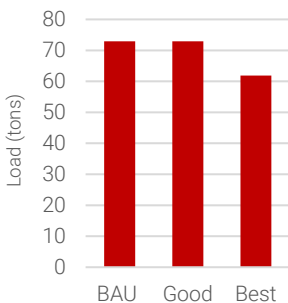

Cooling Load

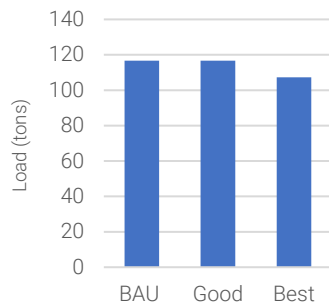

Ames Textile

Campus	East Campus
Core End Use	Lab
Square Footage	7985
Last Major Renovation	2006


Building Summary

Ames Textile is small lab building on the East Campus. It has a Building Score of 41. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, and lighting controls. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.


Current
HHW Boiler
DX Cooling
Acceptable envelope; original components

Good
ECM 2a - Roof Insulation - R-30 continuous insulation
ECM 3a - Glazing U-value/SHGC - Double-pane
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5b - Air-side Systems - Decoupled systems
ECM 5d - Air-side Systems - Constant to variable volume
ECM 6c - Air-side Energy Recovery - 50% (Runaround Coil)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 7c - Water-side Systems - Pump VFDs
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9b - Plumbing - Instantaneous Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change
ECM 11f - Process Loads - Energy Star Office Equipment

EUI Breakdown

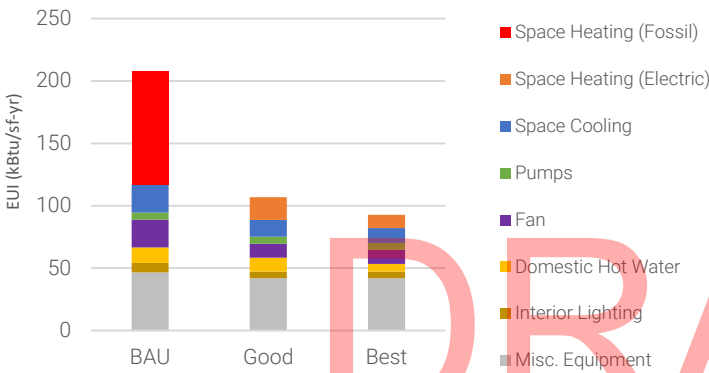


Carbon Emissions

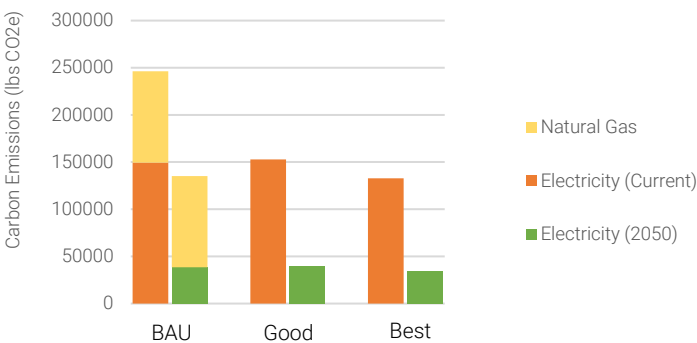


Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 5f - Air-side Systems - Aircurity, particle counters
ECM 6d - Air-side Energy Recovery - 70% (Konvekta/HP)

Heating Load

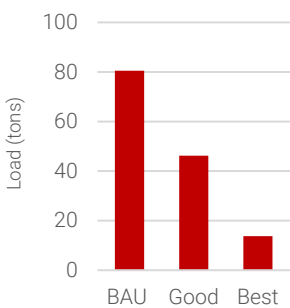

Cooling Load

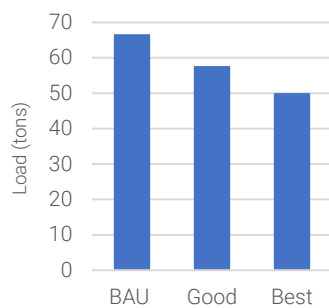


University Crossing

Campus	East Campus
Core End Use	Office/Classroom
Square Footage	202969
Last Major Renovation	2014


Building Summary

University Crossing is an office/classroom building with dining on the East Campus. It has a Building Score of 43. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. A current carbon increase would be a result of minor energy efficiency upgrades and electrified heating strategy. Minor envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper system operation.


EUI Breakdown

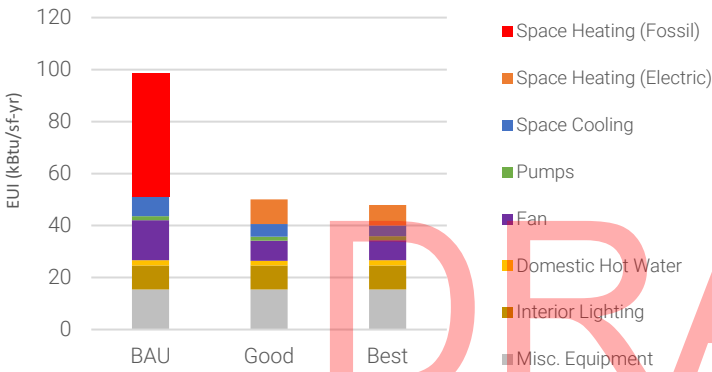

Carbon Emissions

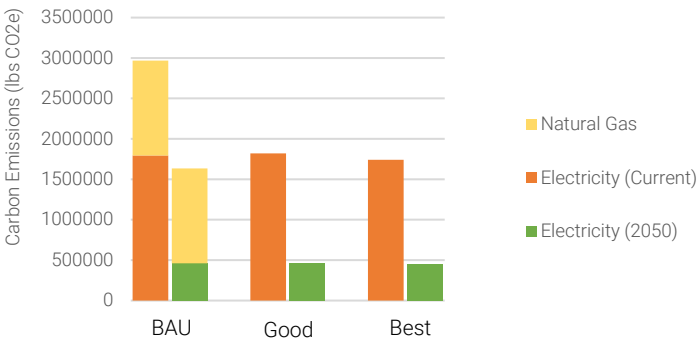

Heating Load



Cooling Load



Current
HHW Boiler
Water-cooled Chiller
High-quality envelope; new insulation and new windows and doors

Good
ECM 1a - Wall Insulation - R-10 continuous insulation*
ECM 3a - Glazing U-value/SHGC - Double-pane*
ECM 4a - Infiltration - 0.25 cfm/sf
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8b - Lighting - Daylight Sensors
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater

*Only applies to Salem Street

University Suites Residence Hall

Campus	East Campus
Core End Use	Residential
Square Footage	124323
Last Major Renovation	2013





Building Summary

University Suites Residence Hall is a residential building on the East Campus. It has a Building Score of 39. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of high efficiency heating/cooling system. Future carbon reduction is in result to electrified heating strategy. Energy recovery upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HHW Boiler
Water-cooled Chiller
High-quality envelope; new insulation and new windows and doors

Good
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9d - Plumbing - Electric Water Heater with Storage
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11a - Process Loads - Behavior Change

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9e - Plumbing - ASHP Water Heater with Storage

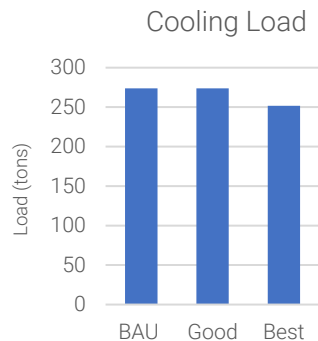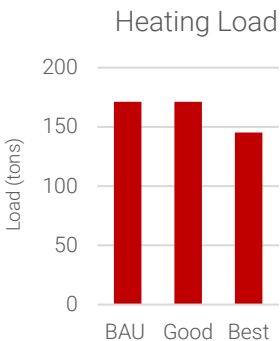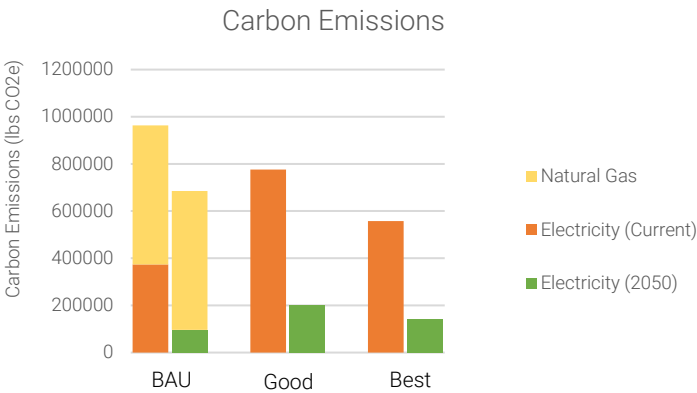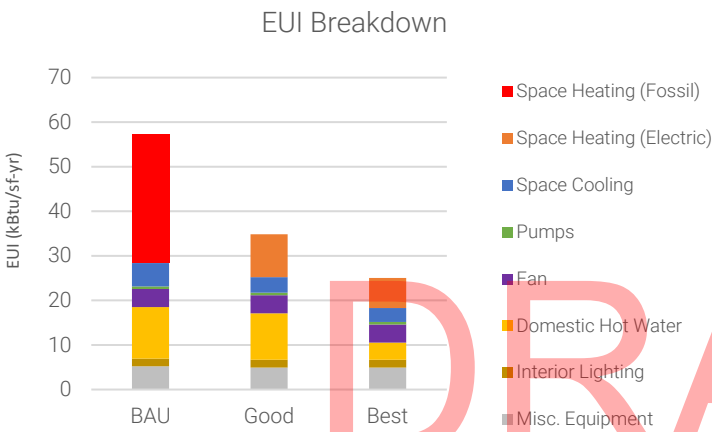

Charles Hoff Alumni Scholarship Center

Campus	East Campus
Core End Use	Office
Square Footage	5815
Last Major Renovation	2014

Building Summary


Charles Hoff Alumni Scholarship is an office building on the East Campus. It has a Building Score of 34. This makes it a medium priority for energy efficiency improvements. The EUI reduction in the Best case is a result of envelope upgrades. A current carbon increase would be a result of minor energy efficiency upgrades and electrified heating strategy. Natural ventilation is expected to be maintained.

Current
Furnace
DX Cooling
High-quality envelope; new insulation and new windows and doors


Good
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

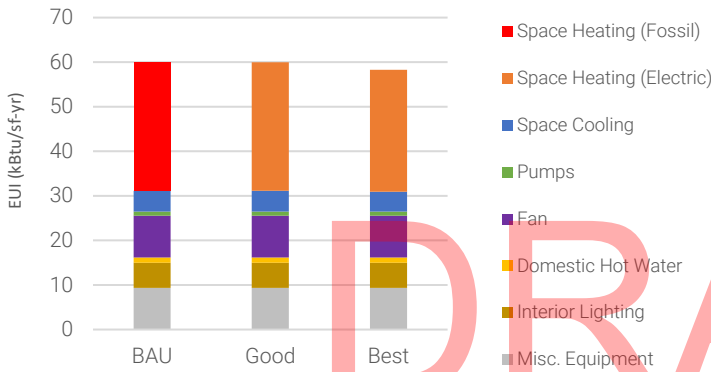


Carbon Emissions

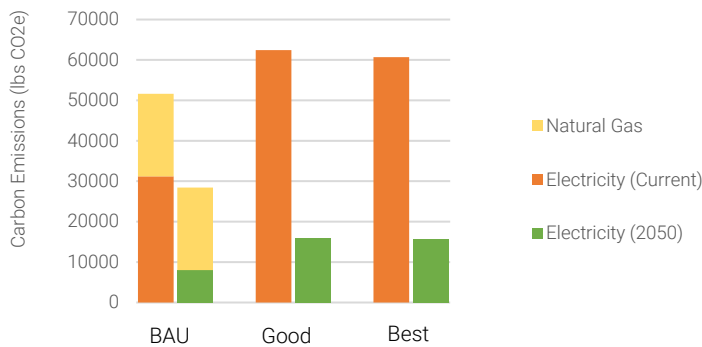

Heating Load



Cooling Load

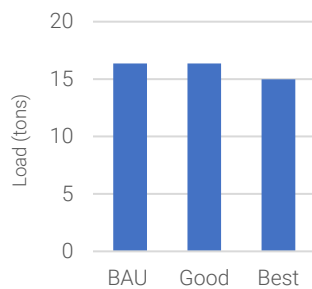

Campus	East Campus
Core End Use	Office/Classroom
Square Footage	50119
Last Major Renovation	2009

Building Summary


The Graduate and Professional Studies building is an office/classroom building on the East Campus. It has a Building Score of 34. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of improved envelope, energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads. Retro-commissioning can be a useful tool to ensure proper operation of recently renovated systems.

Current
HW Boiler
Air-cooled Chiller
Candidate for envelope improvements


Good
ECM 5a - Air-side Systems - Decoupled systems
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 7b - Water-side Systems - Standalone AWHP
ECM 9a - Plumbing - Low Flow Fixtures
ECM 9c - Plumbing - Electric Water Heater
ECM 10b - Controls - Retro-commissioning
ECM 10c - Controls - DDC Sequence Upgrades
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)


EUI Breakdown

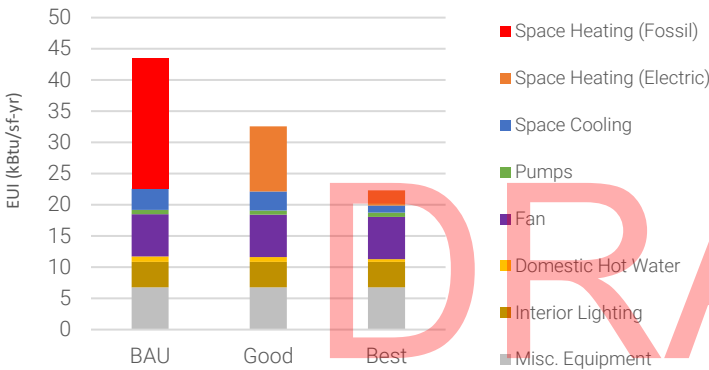


Carbon Emissions

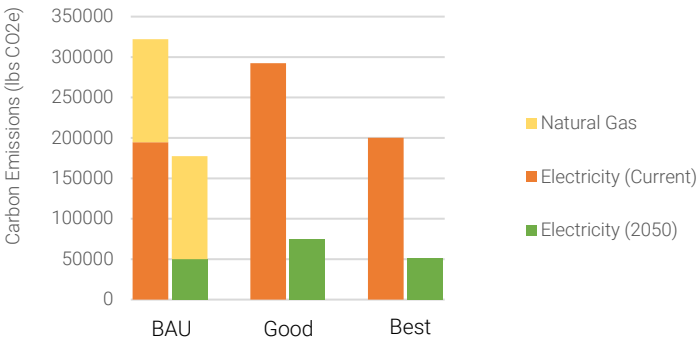

Heating Load



Cooling Load



Wannalancit Business Center

Campus	East Campus
Core End Use	Office/Classroom
Square Footage	122721
Last Major Renovation	2019

Building Summary


Wannalancit Business Center is an office building with some wet labs on the East Campus. It has a Building Score of 30. This makes it a lower priority for energy efficiency improvements. The EUI reduction in the Good and Best cases are a result of energy recovery, decoupled heating/cooling and ventilation systems, lighting, lighting controls, domestic hot water heater, and low flow fixtures. Future carbon reduction is in result to electrified heating strategy. Air-side energy recovery and envelope upgrades reduce heating and cooling loads.

Current
HHW Boiler
DX Cooling
Acceptable envelope; original components


Good
ECM 6a - Air-side Energy Recovery - 70% (Single Wheel)
ECM 9c - Plumbing - Electric Water Heater
ECM 5a - Air-side Systems - Decoupled systems
ECM 7b - Water-side Systems - Standalone AWHP
ECM 8a - Lighting - LED Conversion
ECM 8b - Lighting - Occupancy Sensors
ECM 8b - Lighting - Daylight Sensors
ECM 9a - Plumbing - Low Flow Fixtures
ECM 11f - Process Loads - Energy Star Office Equipment

Best
ECM 1b - Wall Insulation - R-30 continuous insulation
ECM 2b - Roof Insulation - R-50 continuous insulation
ECM 3b - Glazing U-value/SHGC - Triple-pane
ECM 4b - Infiltration - 0.1 cfm/sf @ 75 Pa
ECM 6b - Air-side Energy Recovery - 90% (Heat Regen)
ECM 9b - Plumbing - Instantaneous Water Heater


EUI Breakdown

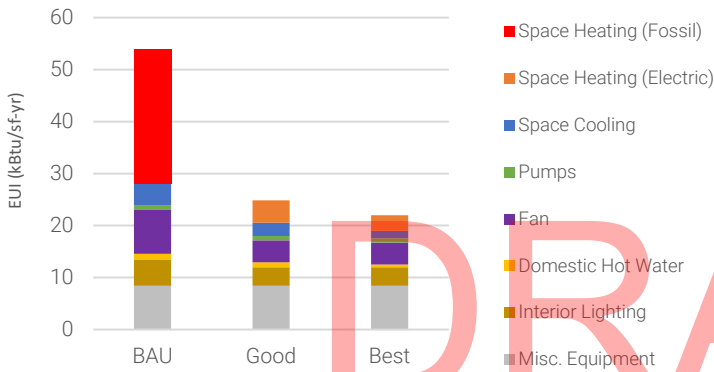


Carbon Emissions

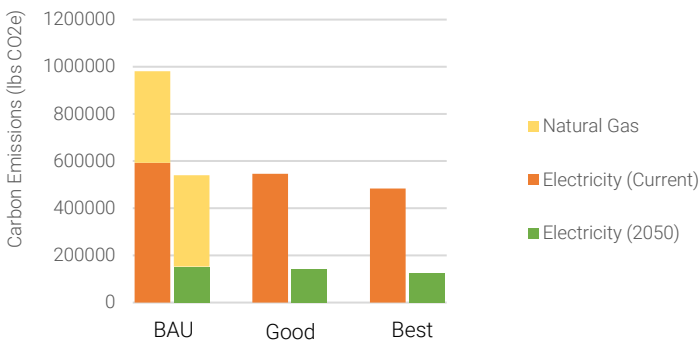

Heating Load



Cooling Load

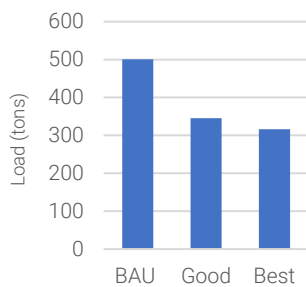


East Campus Plant Alternatives

The East Campus is currently served by three steam boilers that were replaced in 2015. The options for meeting the alternative energy requirements for the east campus buildings is to pursue stand-alone electrified heating and cooling plants or to install and expand the east campus central plant. These electrification options can be bundled with building upgrades under the “Good” or “Best” energy conservation bundles. These options are summarized below:

1. Stand-alone heating and cooling plants and code minimum building upgrades
2. Stand-alone with “Good” ECM package building upgrades
3. Stand-alone heating and cooling with “Best” ECM package building upgrades
4. Central Utility Plant using the North Campus “Good B2 – Light Geo + Air-source + Gas Boilers” Option for the east campus

The central plant options were vetted in the north central plant analysis and determined that the “Good B2 – Light Geo + Air-source + Gas Boilers” option was the best plant option. For the reasons described in the “Alternative Energy Measures Descriptions” of this report and the north plant analysis, converting to biodiesel is not be the best option from an emissions and operating cost perspective at this time. The chart below shows the 25-year life-cycle cost analysis for the East Campus Options for electrification.

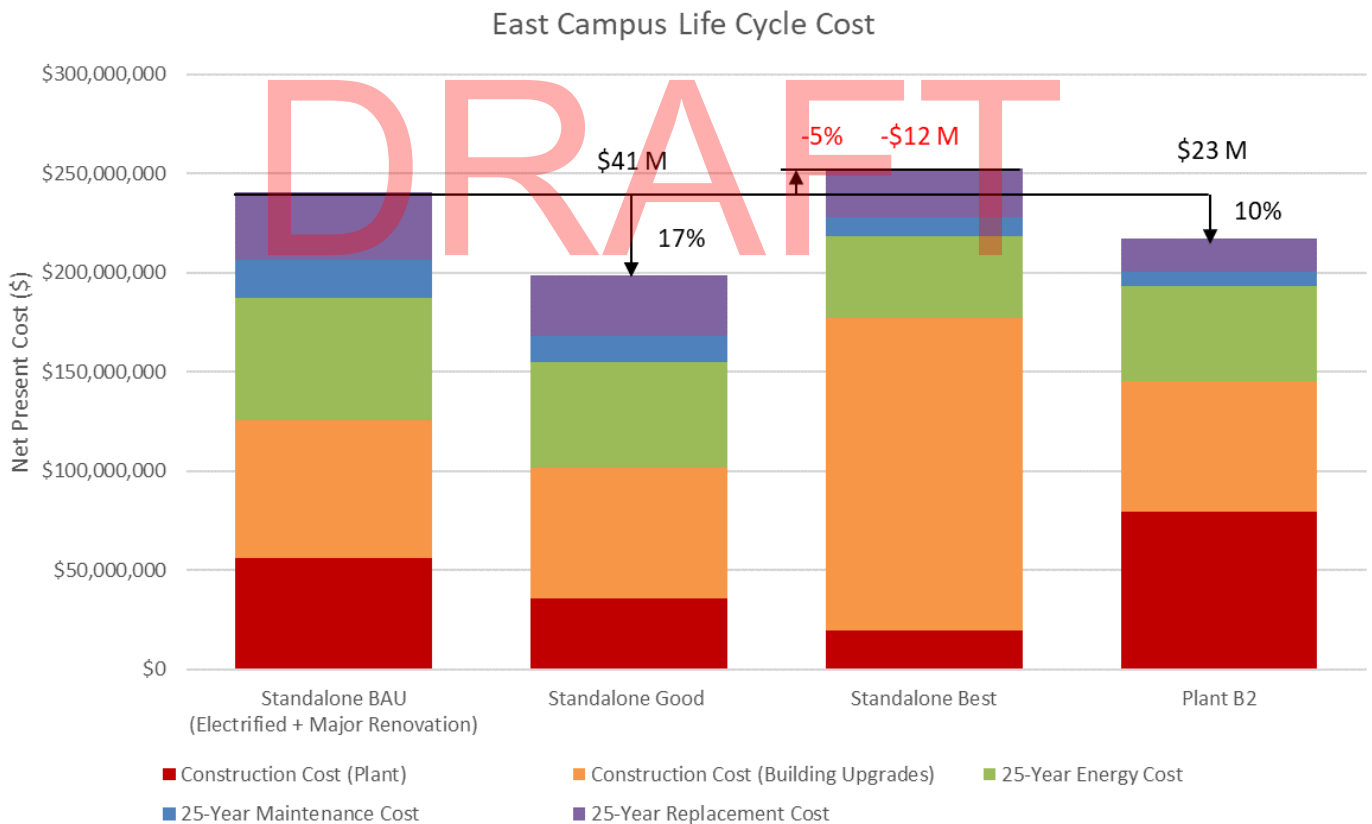

Recommendation

BR+A recommends decentralizing the heating and cooling equipment for the east campus (Stand-alone Good in the chart). The reason for this is because it provides the best balance between construction cost and operating cost, resulting in the lowest life-cycle cost. Implementing a central hybrid ground-source / air-source system based on the analysis of from the north campus analysis would also not be life-cycle cost effective. There are a number of factors that results in a negative life-cycle cost compared to building stand-alone heating and cooling including:

4. The design heating load is lower than the north campus for the “Good” and “Best” options.
5. The piping distribution is higher due to a more spread out.
6. The building types are primarily residence halls and education buildings, which have low heating and cooling loads when the envelope and mechanical systems are improved.

The analysis shows that doing some building upgrades during major renovations should be performed to reduce heating and cooling loads and thus reducing heating and cooling equipment cost. It is expected that some buildings may be renovated to the “Best” bundle, some will be renovated to the “Good” scenario and some will remain as existing, making the “Good” scenario the best representative option that incorporates unforeseen factors.

DRAFT

On-site Renewable Solar Analysis Overview

The project team was tasked by UML to conduct a solar photovoltaic (PV) assessment of various campus sites ("the sites") as part of the Alternatives Analysis. Sites are listed in

South Campus	
150 Wilder - Desmarais House	South Maintenance Facility
820 Broadway	South Power Plant
Allen House	Weed Hall
Coburn Hall	Riverview Suites Lot
Concordia Hall	Broadway/ Riverview Lot
Dugan Hall	Upper Mahoney Lot
Durgin Hall	Lower Mahoney Lot
Health & Social Sciences Building	South Parking Garage
Mahoney Hall	Solomont Way Lot
McGauvran Center	Coburn Lot
O'Leary Library	Wilder Faculty/ Staff/ Visitor Lot
Sheehy Hall	Durgin Lot

East Campus	
Ames Textile	Pawtucket Visitor. Metered Lot
Bourgeois Hall	Fr. Morrissette Blvd
Campus Recreation Center	Merrimack Lot
Charles Hoff Alumni Scholarship Center	Merrimack Street Lot
Donahue Hall	Fox Lot
Fox Hall	East Parking Garage
Graduate and Professional Studies Center	Campus Rec Lot
Leitch Hall	Wannalancit East Courtyard
River Hawk Village	Tremont Lot
Tsongas Center at UMass Lowell	Ames Lot
University Crossing	Lawrence Drive Lot
University Suites Residence Hall	Perkins Lot
Wannalancit Business Center	Tsongas Lot B
110 Canal	Canal Lot
Salem Street/ Admissions Lot	Lower Locks Garage
Fletcher Lot	Hall St. Garage

below:

North Campus	
Ball Hall	Pulichino Tong Business Center
Costello Athletic Center	Saab Emerging Technologies & Innovation Center
Cumnock Hall	Southwick Hall
Dandeneau Hall	UMass Lowell Bellegarde Boathouse
Falmouth Hall	Standish Visitor/ Metered Lot
Kitson Hall	Pinanski/ Costello Lot
Lydon Library	Olsen Lot
North Power Plant	North Parking Garage
Olney Hall	Riverside Lot B
Olsen Hall	Riverside Lot A
Perry Hall	Cumnock Lot
Pinanski Hall	Cross River Center Lot

South Campus	
150 Wilder - Desmarais House	South Maintenance Facility
820 Broadway	South Power Plant
Allen House	Weed Hall
Coburn Hall	Riverview Suites Lot

Concordia Hall	Broadway/ Riverview Lot
Dugan Hall	Upper Mahoney Lot
Durgin Hall	Lower Mahoney Lot
Health & Social Sciences Building	South Parking Garage
Mahoney Hall	Solomont Way Lot
McGauvran Center	Coburn Lot
O'Leary Library	Wilder Faculty/ Staff/ Visitor Lot
Sheehy Hall	Durgin Lot

East Campus	
Ames Textile	Pawtucket Visitor. Metered Lot
Bourgeois Hall	Fr. Morrissette Blvd
Campus Recreation Center	Merrimack Lot
Charles Hoff Alumni Scholarship Center	Merrimack Street Lot
Donahue Hall	Fox Lot
Fox Hall	East Parking Garage
Graduate and Professional Studies Center	Campus Rec Lot
Leitch Hall	Wannalancit East Courtyard
River Hawk Village	Tremont Lot
Tsongas Center at UMass Lowell	Ames Lot
University Crossing	Lawrence Drive Lot
University Suites Residence Hall	Perkins Lot
Wannalancit Business Center	Tsongas Lot B
110 Canal	Canal Lot
Salem Street/ Admissions Lot	Lower Locks Garage
Fletcher Lot	Hall St. Garage

DRAFT

After achieving load reduction through energy conservation measures and campus system electrification, UML is interested in offsetting electricity purchased from the utility with clean renewable energy. This intent aligns with Executive Order No. 569 which calls on government to “expand upon existing strategies for the Commonwealth to lead by example in making new, additional reductions in greenhouse gas emissions,” and specifically supports the following objectives:

- Increase the amount of renewable and clean energy on the grid by increasing onsite renewable energy generation, the procurement of renewable energy supply, and continued development of clean energy resources; and
- Expand the deployment and use of energy storage and other strategies to minimize peak demand.

The objective of this solar assessment was to determine the most successful options for installing campus-wide distribution solar PV by determining the most viable sites. Options considered include the different types of solar PV systems including ballasted roof mount, mechanically attached roof mount, and parking canopy structures. In addition, the assessment evaluates opportunities for integrating Battery Energy Storage Systems (BESS) into renewable energy projects to increase utility bill savings.

The assessment first investigates the site-specific viability based on building and parking dimensions and constraints, shading considerations, typical mounting structures and products, and minimum array size. Local weather data and system size are used to model solar electricity generation. PV production models, BESS operation characteristics, and industry-standard project costs are utilized to estimate the financial impact of integrating solar and storage into the project sites.

This solar assessment report covers the relevant utility programs, incentives, installation options, financing options, and feasibility evaluation. The feasibility evaluation consists of the following:

- An evaluation to determine suitability of rooftop solar and shade canopies on parking lot locations;
- PV system modeling to determine electricity output from sites;
- An investigation of utility rate programs and incentives that benefit a solar PV and BESS interconnection;
- Financing options to fund the solar PV and BESS projects including incentives;
- A deep dive on design and financial analysis for three pilot sites: Ball Hall, Olney Hall, and Sheehy Hall;
- A financial analysis of battery storage integration into two pilot sites: Ball Hall and Tsongas Center; and
- Technical appendices for backup documentation.

Programs and Initiatives

Utility, state, and federal incentives can support the adoption and deployment of solar PV projects by lowering the cost or facilitating the integration with the utility grid. Programs and incentives are as follows:

Net Metering

Customers of regulated utility companies in Massachusetts, such as National Grid, are permitted to generate electricity to offset electrical usage. Energy generated onsite from assets such as wind generators or solar photovoltaic systems are connected to a bi-directional meter to measure the net energy used. When energy is purchased from the utility company, the net meter spins forward and when more electricity is generated than needed, energy is exported to the grid and the net meter spins backwards.

Solar or wind net metering systems on public facilities are restricted to 10 MW or less per G.L. c. 164, §138. When electricity is exported to the grid, net metering credits (NMC) are created and assigned to the generating entity. “Banked” credits can offset charges associated with the delivery, supply, and customer portions of the generating entity’s electric bill. NMC’s can offset up to 100% of the utility bill and appear as dollars on the electric bill, not as kWh. Net metering credits are not always assigned on a 1:1 ratio to kilowatt-hours (kWh’s) exported due to non-bypassable customer fees and charges collected by the utility. The NMC calculation is based on the type and size of generating facility. Credits do not expire and rollover to the next billing cycle and can be assigned to other accounts within Independent System Operator New England (ISO).

Solar Massachusetts Renewable Target (SMART) Tariff

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff-based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1,600 MW declining block incentive program. Eligible projects must be interconnected by one of three investor-owned utility (IOU) companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. SMART incentive applications for PV systems greater than 500 kW-DC must be co-located with an Energy Storage System to qualify. Incentive payments are remitted to the system owner/ applicant, and in the case of third-party ownership, some portion of the incentive payment should be passed through to the buyer (UML) in the form of a reduced PPA rate.

Solar Massachusetts Renewable Target (SMART) – Energy Storage System Incentive

This performance-based incentive is determined on the ratio of total energy storage system max power discharge to total PV DC power rating, the full discharge duration, and the production of the system. There is a minimum efficiency requirement stating that the energy storage system paired with the solar photovoltaic generation unit must have at least a 65% round trip efficiency under normal operation. There are also operational requirements, such as the energy storage system must discharge at least 52 complete cycle equivalents per year and must remain functional and operational for the PV generation unit to continue to be eligible for the energy storage adder. Additionally, the nominal useful energy capacity of the energy storage system paired with the PV system must be at least two hours and incentivized for no more than six hours. The nominal rated power capacity of the storage system paired with a PV generation unit must be at least 25 per cent and shall be incentivized for no more than 100% of the rated capacity, as measured in direct current, of the PV generation unit. Incentive payments are remitted to the system owner/ applicant, and in the case of third-party ownership, some portion of the incentive payment should be passed through to the buyer (UML) in the form of a reduced PPA rate.

Solar Renewable Energy Certificate (SREC)

SRECs represent the renewable and/or environmental attributes associated with electricity that is produced by solar generators. One credit is created for each MWh of solar electricity generated. Massachusetts Renewable Portfolio Standard (RPS) mandates that distribution companies buy specified quantities of SRECs each year.

Federal Investment Tax Credit (ITC)

Businesses that install PV and Battery Energy Storage Systems (BESS) are eligible to receive an (ITC) investment tax credit, which can be used to directly offset federal tax liability on a dollar-for-dollar basis. If the tax credit exceeds the tax liability the credit can be rolled into future tax periods for 20 years. Commercial

projects that commence construction through the end of 2022 are eligible to receive a 26% tax credit of the total PV system cost. The ITC steps down thereafter: 2023 projects qualify for a 22% ITC, 2024 and later projects qualify for a 10% ITC. While this incentive is not available to the tax-exempt entities such as UML, it is anticipated that systems owned by a third-party will pass through a portion of the savings in the form of a reduced PPA rate.

Federal Modified Accelerated Cost-Recovery System (MACRS)

Under the federal MACRS, businesses may recover investments in PV and ESS property through depreciation deductions. MACRS establishes a lifespan for various types of property over which the property may be depreciated. For PV and energy storage systems, the taxable basis of the equipment must be reduced by 50% of any federal tax credits associated with the system. While this incentive is not available to the tax-exempt entities such as UML, it is anticipated that systems owned by a third-party will pass through a portion of the savings leveraged by MACRS in the form of a reduced PPA rate.

Modeling Approach

The project team collected site data from UML then applied typical design criteria and justifiable assumptions to establish viable locations for PV development and model representative system production. While all sites were screened by the project team and viable sites Modeled, only the three pilot project locations were elaborated in detail herein.

Data Sources

Site data was collected from a combination of UML-provided databases, satellite imagery, and site visit observations. Hatch Data was utilized for utility 15-minute interval data in kilowatt-hours (kWh's) for the pilot sites to build electricity usage profiles. Aerial/satellite imagery from Google Earth was utilized as an input for the PV system modeling tool (described below) and for shade/obstacle recognition. UML resources such as the web-based Campus Map and data from Sightlines reports were used for additional site detail and identification of parking lots.

Tools

Helioscope

The industry-leading tool, Helioscope, was used to develop site-specific PV production models and estimate site energy offset. Helioscope incorporates equipment specifications and efficiencies, array orientation(s) and tilt(s), user-identified obstacle shading, and local weather and temperature data to provide energy generation models.

Energy Toolbase

Another powerful solar PV modeling software, Energy Toolbase, was used to calculate important financial metrics for the pilot sites. The financial model was used to calculate a series of annual cash flows for the life expectancy of the equipment and incorporated two financing scenarios: direct purchase and power purchase agreement (PPA). The software was used to develop and model cashflows for net metering credits, operations and maintenance, and applicable incentives. Energy Toolbase reported the following metrics:

- Electricity costs with and without the PV system (\$)
- Electricity savings and annual cashflows (\$)
- Simple payback (years)

- PPA costs and cashflows (\$/kWh)
- Net present value (NPV in 2021\$)
- Internal rate of return (IRR in percent)
- Leveled cost of energy (LCOE in \$/W)

Equipment Assumptions

The table below presents PV and BESS equipment assumptions used for conceptual system design and production modeling.

Variable	Assumption Value	Warranty	Justification
Module type	LG Electronics, 410N2W-A5 (410W)	25 yr	Typical Tier 1 solar module
Inverter type (carport canopy)	Solectria, PVI-36TL, PVI-60TL	15 yr	Typical 36kW, 60kW grid-tied string inverters for carports
Inverter type (roof mount)	SolarEdge, SE 17.3KUS, SE33.3KUS, SE66.6KUS, SE100KUS	15 yr	Typical 33kW, 66kW, 100kW string inverter with rapid shut-down
PV optimizer (roof mount)	SolarEdge, P850	25 yr	Compatible 850W DC power optimizer (2 inputs) for use with SolarEdge Inverters
BESS	Chint, CPS-ESS 30/65-US, 60/130-US, 120/260-US, 240/520-US	10 yr	UL9540 turnkey 2-hour BESS (inverter, EMS, climate control, enclosure), LG Chem Li-Ion batteries. 65-520kWh.

DRAFT

Design Criteria

The table below presents the design guidance and justification for PV siting on the campus. While these criteria are typical of design best practices, exception may be taken in appropriate circumstances. For example, while ballasted roof mount racking is the design preference, there may be opportunities for monolithic tilt, mechanically attached rooftop arrays. Individual designs will note any exceptions taken.

Description	Design Guidance	Justification
Roof coverage	Minimum of 10% of roof area left undeveloped and available for other uses	Energy conservation measures such as new HVAC equipment may require roof space in the future
Roof mount racking	Ballasted non-penetrating racking where possible	Contingent on AHJ guidance and building exposure per ASCE 7-10. Reduces roof penetrations and impacts to roof warranties. Existing campus PV precedent.
Roof mount inverter location	Inverters to be mounted on roof unless otherwise noted	Reduction of DC wiring and service accessibility
Roof mount tilt & orientation	10° tilt with interspaced rows, oriented south, +/- 20°	Typical of low-profile roof mount systems to maximize use of available rooftop while minimizing interrow spacing/shading
Roof setbacks	Minimum 5' setback from roof edge/parapet and from major rooftop equipment	Typical of commercial rooftop installations to allow safe access
Carport clear height	10' clear height unless intended for heavy vehicle parking	Standard clear height for public parking lots, excludes fire lanes and heavy vehicle parking

Carport tilt and orientation	7° tilt south, east, or west	Typical of canopy parking structures
Carport structure	Double bay Tee structure or long span structure where possible	Reduces steel \$/Watt and maximizes Watts/SF
Carport lighting	Light standards in canopy area to be removed and under canopy lighting installed	Typical of carport canopy systems
Carport inverter location	Inverters to be mounted on canopy columns	Typical of carport canopy systems
Parking garage canopy	Post and beam structure with pitched arrays. Assumes structure can support added dead weight	Maximizes beam spans for vehicular movement. Structural review of garage beyond scope of assessment
DC/AC inverter loading ratio	Up to 1.25	Typical load ratio to maximize economy of inverter capacity without limiting instantaneous output. Systems with arrays in multiple orientations may have higher load ratio
BESS location	Exterior ground mount	Typical BESS installation requirements
BESS operating model	Charge from solar and/or grid	Most flexible operating model, determined by the greatest savings
BESS sizing	Nominal power rating of at least 25% of the nominal PV system size (kW-DC)	For compliance with SMART Energy Storage System incentive
BESS hour rating	BESS kWh/ BESS kW \geq 2	For compliance with SMART Energy Storage System incentive

Financial Models

Financial models were used to show lifecycle PV project economics using different financing vehicles such as direct purchase and power purchase agreement (PPA).

Direct Purchase (Build, Own, Operate, Maintain)

The university procures a contractor to design, build, and commission the solar PV project. UML is responsible for paying all upfront costs associated with the site including permitting, due diligence, drainage/hydrology assessments, geotechnical surveys, economic modeling, system design & engineering, procurement, construction, and commissioning. Once commissioned, UML purchases an O&M package so that the contractor can maintain the system and guarantee uptime. Equipment replacement beyond the warranty period is in addition to the O&M package and the cost is borne by the university. Electricity generated by the system is consumed by the facility and any excess electricity is sent to the utility grid as part of the NMC program. In this scenario UML retains all REC's generated by the PV system but be ineligible to receive the ITC as there is no tax liability to apply the credit.

Power Purchase Agreement

The university allows a solar project developer (seller) to build, own, and operate the solar PV project on site and signs a power purchase agreement to purchase all or part of the electricity generated by the system. A PPA is a contractual agreement whereby the project owner agrees to sell electricity to the university at a fixed price per kilowatt-hour over an extended contract term (typically 20 – 25 years). PPA's can include annual rate escalations where the price per kWh increases by a predetermined percentage every year. Because the project developer is responsible for delivering a predetermined quantity of energy annually, O&M is included in the base PPA rate

paid by UML. Shortfalls in annual production resulting in higher utility payments are compensated by the developer. Inversely, the university is liable for purchasing energy produced by the equipment, therefore system size and energy appetite are critical in managing risk. UML: does not own any REC's or the ITC under this scenario, but the system owner/financier leverages the ITC for tax equity and reduces the PPA rate that the university pays.

This option provides several financial advantages to public agencies including no upfront cost and passthrough of tax incentives that would otherwise not be available under other procurement methods. The disadvantage of a PPA is that the university would not own the environmental attributes of the green energy and therefore solar deployed through a PPA would not help UML achieve net zero targets.

Assumptions

The assumptions and the justification for each feasibility input are listed in the table below. Cost breakdown for rooftop PV was based on the National Renewable Energy Laboratory's Q1 2020 report, *U.S Solar Photovoltaic System and Energy Storage Cost Benchmark: Q1 2020*. Figure 1 provides a project cost breakdown in \$/Watt-DC drawn from national PV project data.

Variable	Assumption Value	Justification
PV degradation (%/year)	0.50%	Typical solar PV system degradation
Utility escalation (%/year)	3.00%	Historic
PPA rate – roof mount (\$/kWh)	\$0.12	Conservative PPA rate for systems over 100 kW-DC (ranges \$0.10-0.15/watt)
PPA rate – shade structure (\$/kWh)	\$0.14	Conservative PPA rate for systems over 100 kW-DC (ranges \$0.11-0.17/watt)
PPA rate – BESS adder (\$/kWh PV)	\$0.04 - \$0.12	Contingent on SMART incentive value and BESS rating
PPA escalation rate (%/year)	1.0%	Conservative PPA escalation rate. Current PPA's often have 0% escalation clause.
Roof mount cost (\$/Watt)	\$2.15 - \$2.75	<i>US Solar Photovoltaic System and Energy Storage Cost Benchmark: Q1 2020</i> (NREL). Increased 15% for MA educational institution.
Shade Structure (\$/Watt)	\$3.50 - \$4.00	Typical for systems over 100 kW
BESS cost (\$/kWh)	\$708 - \$1,000	<i>US Solar Photovoltaic System and Energy Storage Cost Benchmark: Q1 2020</i> (NREL).
Operation and Maintenance (\$/Watt)	\$0.02	Typical industry cost for O&M agreement
Operation & Maintenance Annual Escalation (%/year)	2%	Typical industry O&M escalator
Equipment Replacement (\$/Watt)	\$0.12	Inverter replacement after year 15
Nominal Discount Rate including inflation and real discount rate (%)	5%	Typical for public institution

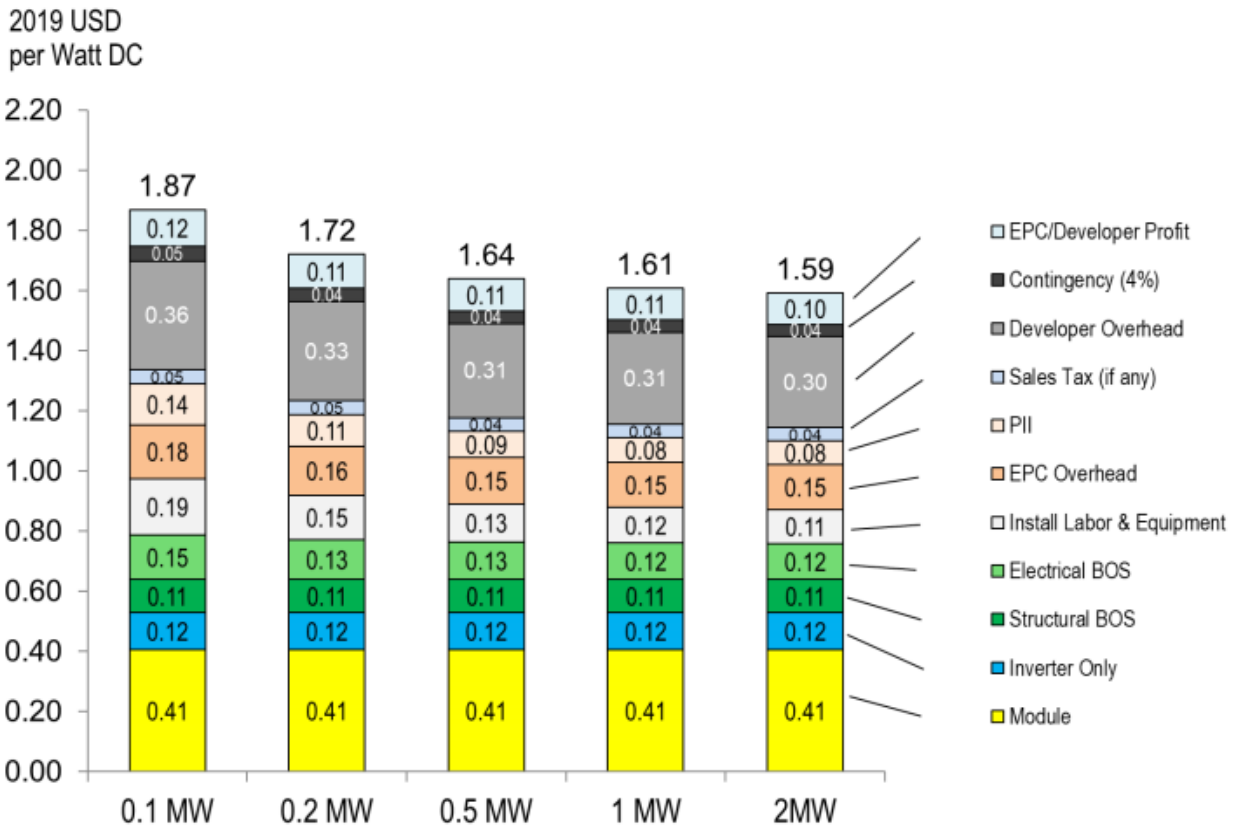


Figure 1 - NREL 2020 U.S. Benchmark: Commercial Rooftop PV System Costs (2019 USD/W-DC)

Minimum System Size

While solar PV systems can be designed to any size, soft costs for design and engineering, permitting, mobilization, and project management make up a greater percentage of total cost for small projects thus reducing cost effectiveness. Conversely, larger systems achieve economies of scale that often translate into better pricing and higher quality/more competitive bidders. While it is understood that the intent of campus-wide PV development is not exclusively financial in nature, the project team recognizes that efficient use of capital is critical to achieving aggressive clean energy targets. As such, sites were prioritized to maximize solar production and favorable economics. **To leverage economies of scale, installations less than 100 kW-DC should generally be avoided.**

RESULTS

Electrical Utility Information

Utility rate and tariff option depends on the electric utility provider, use type of facility, customer election, service size, and peak demand. It is often required and/or advantageous to change rate option after deploying PV and BESS. Mandatory rate change and opportunities for rate optimization were evaluated to determine the most favorable combination of solar, storage, and utility power. The table below presents site utility information and data reviewed.

#	Bldg. Name	Utility Tariff	Elec. Consumption (MWh/yr)	15-min
1	Ball Hall	G3	906	✓
2	Olney Hall	G3	4,167	✓
3	Sheehy Hall	G3	334	✓ ¹

Pilot Project Solar Production Models

Pilot sites were modeled using Helioscope to show representative PV designs and simulate resulting electricity generation for each. Summary results are shown in the table below with detailed designs in subsequent sections.

#	Site	PV System Type	System Size (kW-DC)	Year-1 Total Site Load (MWh)	Year-1 Solar Gen. (MWh)	Energy Offset
1	Ball Hall	Ballasted Roof Mount	111.9	906.2	151.5	17%
2	Olney Hall	Monolithic Tilt Roof Mount	110.7	4,167.2	141.5	3%
3	Sheehy Hall	Ballasted Roof Mount	59.9	334.0	80.9	24%

¹ Sheehy interval data was not available, energy data from Concordia used for energy profile and scaled up for larger building size
University of Massachusetts at Lowell | Alternative Energy Master Plan

Ball Hall


Ball Hall has a 24,700 SF rooftop with roof mounted HVAC equipment scattered throughout. Future building upgrades may require additional HVAC space provisions which informed a PV layout that creates an available space contingency. Modules are oriented due south to limit the interrow spacing required to keep module edges from shading back rows.



Variable	Value	Description
DC Nameplate	111.9 kW-DC	(273) LG 410 modules
AC Nameplate	100.0 kW	1.12 DC/AC load ratio
Cash Price	\$240,585	\$2.15/W-DC installed
20-yr PPA Price	\$0.12/kWh	Base rate for year 1 plus 1% annual escalator years 2-20
Weather Dataset	TMY, 10km grid	(42.65, -71.32), NREL (prospector)
System Losses	11.9%	Shading, reflection, soiling, irradiance, temperature, module mismatch, optimizer efficiency, wiring, clipping, inverter efficiency, AC losses
kWh/kW	1,354	Annual energy generated per 1 kW of solar installed (site-specific)
Azimuth	180°	
Tilt	10°	
Racking	Ballasted	Non-penetrating module racking w/ integrated grounding

Olney Hall

Olney Hall has a 35,500 SF rooftop with mechanical room located in the center creating two roof levels. Limited roof area for solar equipment informed a fixed tilt array design on the east side of the building. The 10° array tilt will keep the high edge only 3' above the low edge reducing the impact of wind loading and resulting structural requirements.

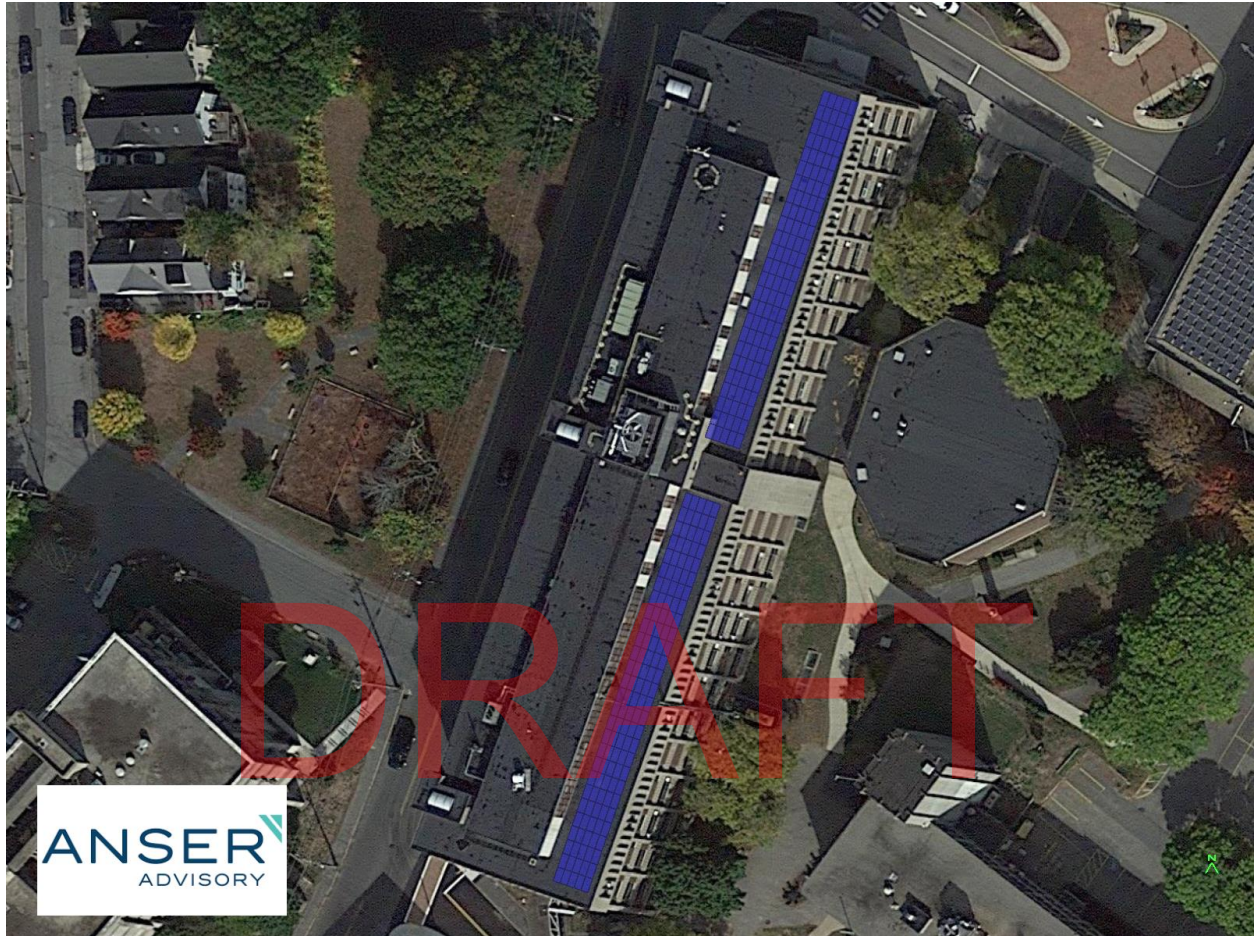

Olney Hall PV Layout

Variable	Value	Description
DC Nameplate	110.7 kW-DC	(270) LG 410W modules
AC Nameplate	100.0 kW	1.11 DC/AC load ratio
Cash Price	\$238,005	\$2.15/W-DC installed
20-yr PPA Price	\$0.13/kWh	Base rate for year 1 plus 1% annual escalator years 2-20
Weather Dataset	TMY, 10km grid	(42.65, -71.35), NREL (prospector)
System Losses	12.0%	Shading, reflection, soiling, irradiance, temperature, module mismatch, optimizer efficiency, wiring, clipping, inverter efficiency, AC losses
kWh/kW	1,279	Annual energy generated per 1 kW of solar installed (site-specific)
Azimuth	109°	
Tilt	10°	
Racking	Monolithic fixed tilt	Penetrating mechanical connection to roof structure

Sheehy Hall

Sheehy Hall has a 15,750 SF roof with several vents and but no existing HVAC equipment. The unique shaped roof is segmented reducing the available area for PV. The southern-most roof was left undeveloped creating a contingency for future HVAC equipment. While a larger system could be sited by shifting the orientation east of south, the net gain is relatively small (~6kW) and further diluted by a lower kWh/kWp factor.



Sheehy Hall PV Layout

Variable	Value	Description
DC Nameplate	59.9 kW-DC	(146) LG 410W modules
AC Nameplate	66.6 kW	0.9 DC/AC load ratio
Cash Price	\$163,594	\$2.90/W-DC installed
20-yr PPA Price	\$0.18/kWh	Base rate for year 1 plus 1% annual escalator years 2-20
Weather Dataset	TMY, 10km grid	(42.65, -71.35), NREL (prospector)
System Losses	12.2%	Shading, reflection, soiling, irradiance, temperature, module mismatch, optimizer efficiency, wiring, clipping, inverter efficiency, AC losses
kWh/kW	1,351	Annual energy generated per 1 kW of solar installed (site-specific)
Azimuth	180°	
Tilt	10°	
Racking	Ballasted	Non-penetrating module racking w/ integrated grounding

Aggregate PV System Sizing and Production Details

A total of 80 sites were included in the Alternatives Analysis for PV feasibility inclusive of campus buildings and parking lots (surface and garage structures). Of these sites, 29 were excluded from further analysis due to limiting factors such as insufficient usable area, shading from buildings and trees, proximity to permanent structures, and presence of existing PV. The remaining 51 sites were modeled with PV systems using assumptions and design criteria as listed in this section. Appendix M provides a breakdown of each site of the 80 sites reviewed during in this report as well as an explanation for exclusion, if ruled out.

Individual PV system designs range from 30 kW-DC to 2,680 kW-DC and are categorized into systems greater than (>) 100 kW-DC and systems less than (<) 100 kW-DC. The intent of this categorization is to focus PV development efforts on larger sites that can leverage more favorable economies of scale. Smaller sites were left within the analysis to show the full PV development potential of the campus.

The table below provides a summary of the quantity of sites evaluated, nameplate PV system size in kW-DC, and resulting PV production in MWh's per year. Note that the 18 sites modeled with PV system sizes under 100 kW make up only 7% of the total annual electricity generation while the 33 sites larger than 100 kW compose the other 93%.

Description	Excluded	PV Size < 100 kW	PV Size > 100 kW	TOTALS
Sites	29	18	33	80
Total Size (kW-DC)	-	936	13,460	14,397
Total Production (MWh/yr)	-	1,235	17,464	18,700

The table below shows a summary breakdown of PV system sizes over 100 kW by UML campus and mounting structure (roof mounted to building or carport canopy structure). 85% of the total PV system capacity and annual production shown below is proposed at parking sites, this capacity represents 84% of the total annual production for systems over 100 kW-DC. The balance system capacity and annual production is attributable to rooftop PV on existing buildings. **PV systems located at parking sites represent a crucial segment for UML to maximize onsite renewable energy generation.**


Campus / Type	Sites	PV Size > 100 kW-DC	Total Production (MWh/yr)
East	18	5,235	6,693
Building	7	1,453	1,915
Parking	11	3,781	4,778
North	9	5,132	6,797
Building	3	323	428
Parking	6	4,809	6,370
South	6	3,094	3,974
Building	2	306	409
Parking	4	2,788	3,565
Grand Total	33	13,460	17,464

The table below shows a summary breakdown of PV system sizes under 100 kW by UML campus and mounting structure (roof mounted to building or carport canopy structure). No PV systems under 100 kW in

size were modeled for parking locations. This is primarily due to the fact that small parking lots tend to be irregular sizes and be located close to buildings and trees. Developing small rooftop PV systems is not the most effective way of achieving UML energy and climate targets as can be seen by the comparatively low electricity generation potential of the 18 sites with systems under 100 kW. That said, some small sites are approaching 100 kW in size or may have other drivers for PV integration such as visibility, research, etc.


Campus / Type	Sites	PV Size < 100 kW-DC	Total Production (MWh/yr)
East	1	41	54
Building	1	41	54
Parking	0	0	0
North	11	632	846
Building	11	632	846
Parking	0	0	0
South	6	263	336
Building	6	263	336
Parking	0	0	0
Grand Total	18	936	1,235

PV Generation Profile

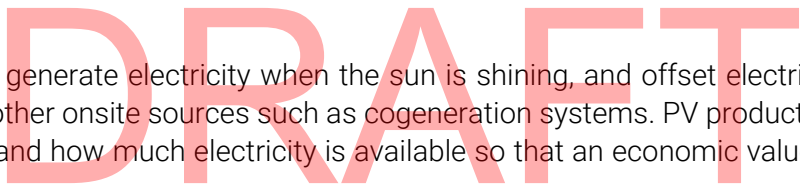

Grid-tied PV systems generate electricity when the sun is shining, and offset electricity purchased from the utility or provided by other onsite sources such as cogeneration systems. PV production models are critical in understanding when and how much electricity is available so that an economic value can be assigned to the generation.


The graph below depicts a simulation of PV production at Ball Hall from Sat. May 4th – Tue. May 7th. The dark gray color represents the site’s electricity use profile and is based on the site’s 2019 15-minute interval utility data. The green color represents solar PV electricity supplied to the building from the 112 kW system modeled above and based on historic weather datasets. The resulting light blue color represents the net demand required from National Grid. The blue and green lines below the demand profile are representative of National Grid peak periods for demand charges and energy charges. Since the utility tariff does not impose time of use (TOU) periods on weekends, there is no change in utility rates on May 4th and 5th. During weekdays the TOU on-peak periods line up with the generation hours for PV, providing an opportunity to generate electricity while rates are the highest.

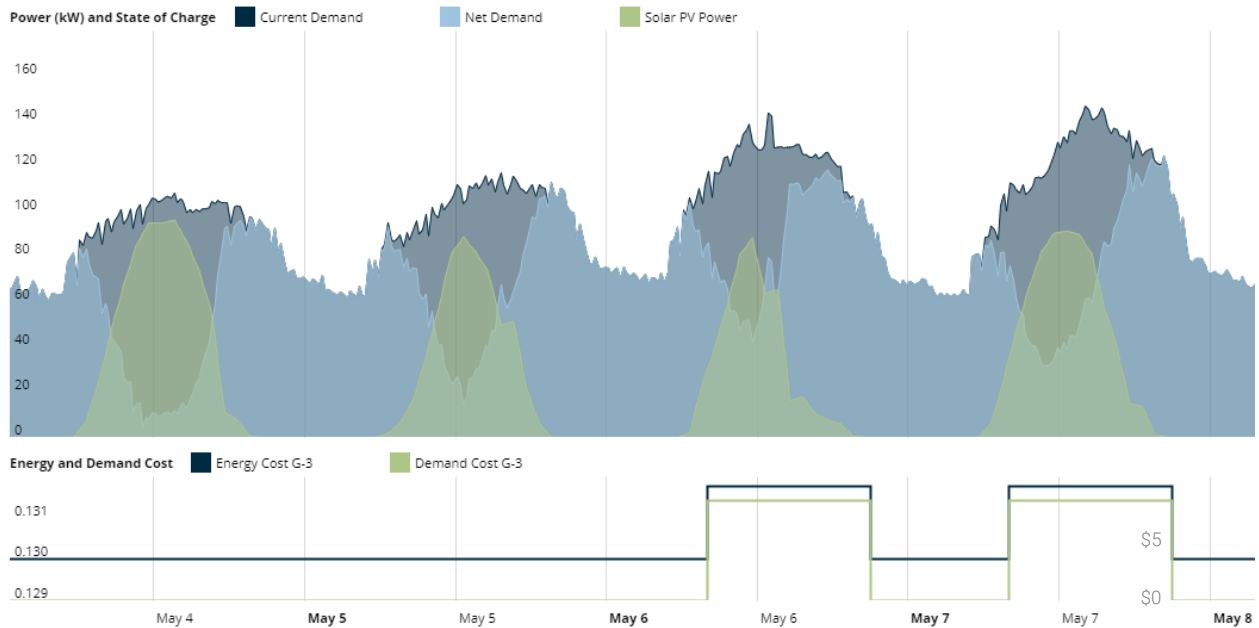

Sample Energy Profile (Ball Hall)

The graphs below are demand simulations for the month of April before and after PV integration. The graph on the left shows the before PV, non-concurrent (NC) peak occurs on April 23rd at 1:15PM. This date depicts low solar production which is likely attributable to inclement weather. However, even during this “rainy day” scenario, the site demand is reduced slightly from 191 kW to 174 kW which shifts the April NC peak demand event to April 2nd at 7:00PM when solar has gone offline for the day. As seen above this peak demand shift can have utility bill implications and offer bill savings in addition to the electricity savings in kilowatt-hours.

Max Demand Before 4/23/19 01:15pm Max Demand After 4/2/19 07:00pm

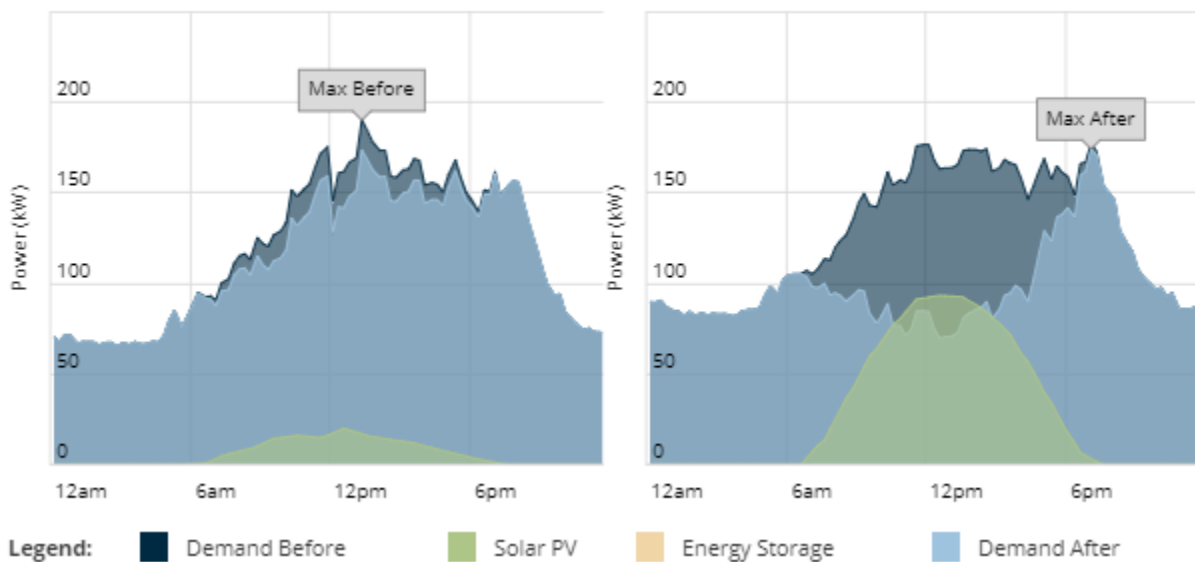

Sample Demand Profile (Ball Hall)

Pilot Project PV System Financial Models

Financial models were built for the three pilot sites to show PV project economics for both direct purchase and power purchase agreement financing mechanisms.

Per Section 0, PV projects connected behind the meter may qualify for the SMART incentive program. The SMART program offers substantial financial benefit to qualifying systems over a 20-year term but is temporal in the sense that entry to the program will eventually be capped once funds are depleted. While it is appropriate to assume that PV projects developed in the next few years could qualify for one of the incentive blocks, this assumption becomes more uncertain the further out a project start moves from the current date. As such, the SMART program should not be relied upon for PV system cost reduction except for projects with an eminent development date. For illustrative purposes, project costs are shown below with and without the SMART program incentive.

The table below shows project financials for the pilot sites including the SMART incentive. Incentive is based on the compensation rate for National Grid’s Capacity Block 10 (systems 25-250 kW-AC). All three pilot sites are able to recover initial investment under 9 years and have positive net present values at the end of the project lifecycle.

System Size (kW-DC)	PV System Cost (\$)	25-year O&M (\$)	SMART PV Incentive (\$)	25-year Utility Bill Savings (\$)	25-year Net Benefit (2019\$)	25-year Net Present Value (\$)	Simple Payback (yrs)	IRR (%)
Ball Hall	\$ (240,585)	\$ (85,135)	\$ 274,484	\$ 847,174	\$ 795,938	\$ 329,683	6.5	15.6%
Olney Hall	\$ (238,005)	\$ (84,199)	\$ 256,357	\$ 824,779	\$ 758,931	\$ 309,705	6.7	15.1%
Sheehy Hall	\$ (173,594)	\$ (45,530)	\$ 146,472	\$ 426,862	\$ 354,210	\$ 173,594	9.0	10.7%

The table below shows the same PV projects without the SMART incentive as is illustrated by lower NPV’s and roughly 3-4 more years to achieve simple payback. While Ball and Olney Halls still look promising from an economic perspective, the smaller Sheehy Hall is less so, with an NPV of just \$26,108 at 25 years.

System Size (kW-DC)	PV System Cost (\$)	25-year O&M (\$)	SMART Incentive (\$)	25-year Utility Bill Savings (\$)	25-year Net Benefit (2019\$)	25-year Net Present Value (\$)	Simple Payback (yrs)	IRR (%)
Ball Hall	\$ (240,585)	\$ (85,135)	\$ -	\$ 847,174	\$ 521,454	\$ 158,512	9.9	10.0%
Olney Hall	\$ (238,005)	\$ (84,199)	\$ -	\$ 824,778	\$ 502,573	\$ 149,848	10.1	9.8%
Sheehy Hall	\$ (173,594)	\$ (45,530)	\$ -	\$ 426,862	\$ 207,738	\$ 26,108	13.5	6.3%

DRAFT

The table below shows the pilot site PV project economics when financed with a 20-year PPA and 1% annual rate escalation. PPA rates are variable from site to site, they are based on the installation cost, system maintenance, tax credits, asset depreciation, and financing risk. It is uncommon to see PPA's for smaller systems such as Sheehy Hall and as such, it is difficult to estimate the rate for this system. There are often economies for bundling several projects into a PPA portfolio and this can be a mechanism to incorporate smaller systems. Additionally, project economics may be further improved by leveraging a 25-year PPA with a reduced PPA rate. The financials shown below are attractive for Ball and Olney Halls but not for Sheehy as the NPV is essentially neutral at project end of life.

Site	PPA Rate	20-year PPA Payments	20-year Utility Bill Savings	20-year Net Benefit (2019\$)	20-year Net Present Value
Ball Hall	\$ 0.12	\$ (398,430)	\$ 625,322	\$ 226,892	\$ 127,298
Olney Hall	\$ 0.13	\$ (403,128)	\$ 608,791	\$ 205,663	\$ 114,584
Sheehy Hall	\$ 0.18	\$ (318,919)	\$ 335,180	\$ 16,261	\$ 3,572

Aggregate PV System Cost

The table below shows approximate project costs per campus and installation type. Project costs were based on system size, type (roof mount or canopy carport), and assumptions identified in Section 0. The blended cost across the portfolio is \$3.42/Watt installed.

Campus / Type	Sites <100 kW	Sites 100 - 500 kW	Sites 500 - 1,000 kW	Sites >1,000 kW	Cost (2021\$)
East	1	16	2	0	\$ 17,943,574
Building	1	6	1	0	\$ 3,116,874
Parking	0	10	1	0	\$ 14,826,700
North	11	6	1	2	\$ 19,870,615
Building	11	3	0	0	\$ 2,748,665
Parking	0	3	1	2	\$ 17,121,950
South	6	4	1	1	\$ 11,423,025
Building	6	2	0	0	\$ 1,512,875
Parking	0	2	1	1	\$ 9,910,150
Grand Total	18	26	4	3	\$ 49,237,214


Battery Energy Storage Systems

Solar generation coupled with battery storage is becoming a viable option in the renewable energy industry. Energy storage systems are more than a battery, a typical BESS includes a battery bank, power inverter (DC/AC), energy management system software (EMS), monitoring equipment, and a climate-controlled enclosure. Ratings of BESS are typically listed in kW and kWh where kW is the maximum instantaneous power output in kilowatts and kWh is the total energy storage capacity of the battery. The quotient of kW/kWh is the hours of operation at full power. For example, a 60kW/120kWh BESS is a 2-hour battery while a 30kW/30kWh BESS is a 1-hour battery. In reality the operation of battery energy storage systems is more nuanced, but these nominal values provide standardization for discussion purposes.

ESS have two primary use cases: electrical bill savings and facility energy resiliency.

Electric Bill Savings

On-site energy storage provides an opportunity to strategically reduce energy and demand charges when utility rates are highest then recharge when rates are lower or when solar energy is readily available. While batteries do not produce their own energy, they enable an on-site PV system to maximize the value of solar energy based on the utility rate characteristics, season, weather, and facility power requirements. The figure below demonstrates how a BESS recharges (peach color) from solar (green color) during the morning and discharges to the facility when energy and demand rates are highest and solar is insufficient to cover the building's need. Demand and energy charges are shown as lines below the x-axis with price units on the y-axis. By deploying the battery during the on-peak period, the net demand is reduced by 44 kW. A BESS operating in this manner over the course of months and years can realize utility bill saving and offset the equipment and software investment.

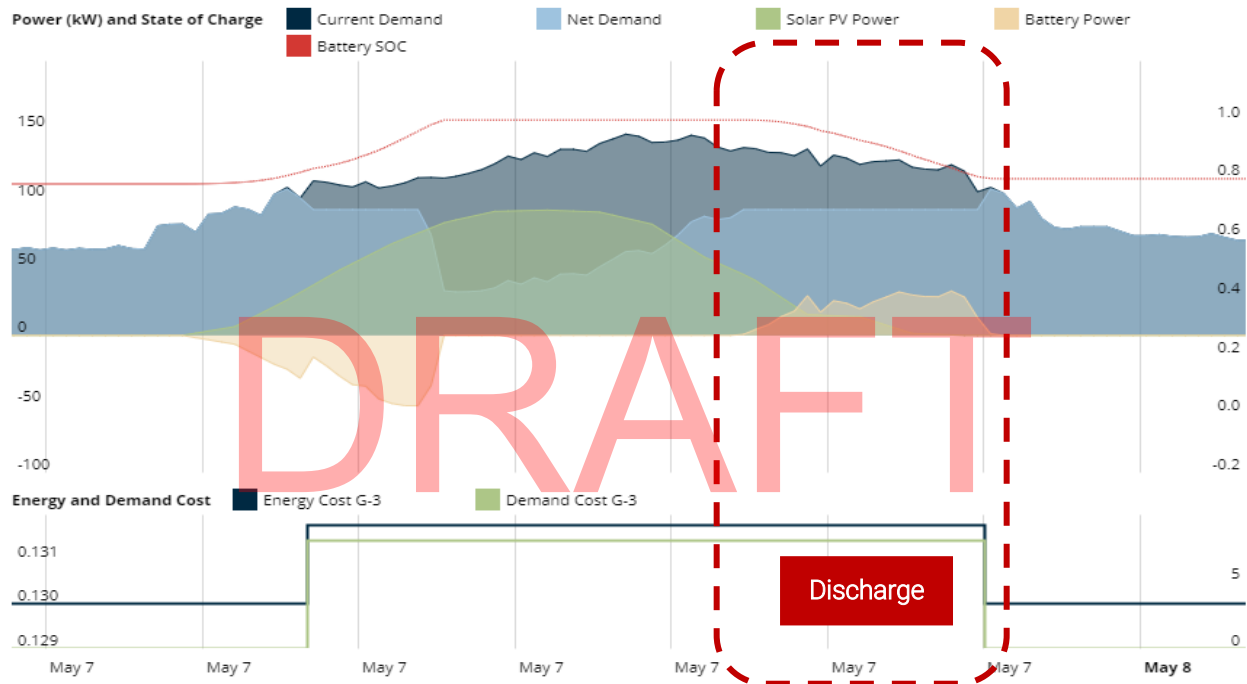

While energy storage systems have the capability to charge from the grid when energy is cheap and discharge to the facility when energy is expensive (energy arbitrage). Energy arbitrage is only effective where there is a large delta between on-peak and off-peak energy rates. In some cases BESS can augment customer savings by participating in ISO-New England's demand response program. Battery storage has the capability to provide more advanced ancillary services to the energy market such as frequency regulation, however the financial analysis of BESS market participation is beyond the scope of this assessment.

Facility Energy Resiliency

BESS installed with the appropriate software and transfer switches have the capability of providing emergency backup power. Resiliency is generally of great interest to public institutions. While there can be clear economic benefits associated with power reliability (e.g. research output and business operation), these benefits are not associated with utility rates and thus cannot be modeled within a typical utility savings financial assessment. BESS designed for resiliency are more complicated and expensive than those designed for utility bill savings by about 20% and typically are slower to recover their investment, if

at all. While BESS resiliency may help harden UML buildings to the impacts of intermittent power disruptions, they are unlikely to supplant a liquid fuel generator and as such would have limited impact on long term energy and climate targets.

Pilot Project BESS Models

In depth battery storage modeling was completed for two representative facilities: Ball Hall and Tsongas Center. Ball Hall was selected from the three pilot sites as a typical small/medium PV system candidate while Tsongas Center was selected due to the PV system size being greater than 500 kW. Per SMART incentive program requirements, any PV incentive application submitted for a system larger than 500 kW-DC must include energy storage. Appendix N contains a list of UML sites where storage is required based on modeled PV system sizes as well as relevant design guidance.

For greatest system efficiency and economy, it is ideal to have batteries located close to both the PV system and the site where electricity is consumed. This can be more complicated when utilizing large carport canopy systems that are distant from buildings. In this case it may be necessary to utilize step up transformers to limit costs or selectively site BESS upstream closer to the utility meter.

BESS must be located outside on grade due to ventilation and fire requirements. Siting of BESS can be a challenge at dense locations where undeveloped/ available space is limited. Battery storage systems range in physical dimension from the size of a typical closet (5’W x 3’D x 7’H) to container-sized enclosures such as the Tesla Megapack that come in scalable packages (24’W x 6’D x 8’H). The BESS modeled for Ball and Tsongas require approximately 27 sqft with an additional 35 sqft of unimpeded access space. As BESS increase in size, siting considerations play an increasingly important constraint on project viability.

UML has two primary utility meters which complicates estimating the value of BESS on a site-by-site basis for the buildings and properties that are bulk metered. Since BESS provides value through peak power demand reduction, shaving demand spikes at one building may not reduce the aggregate peaks as seen by the utility through the meter. For the purposes of this assessment each building submeter was evaluated as if it were a utility meter, however, in practice, savings may differ.

The table below shows PV and BESS system details for the two pilot sites. With each site could accommodate a larger battery bank, the configuration below was found to best leverage the SMART incentive.

#	Site	PV System Type	System Size (kW-DC)	BESS Rating ² (kW/kWh)	Year-1 Total Site Load (MWh)	Year-1 Solar Gen. (MWh)	Energy Offset
1	Ball Hall	Ballasted Roof Mount	111.9	37/74	906.2	151.5	17%
2	Tsongas Center	Mech. Attached on Roof	502.7	150/300	2,939.8	678.9	19%

² Approximate BESS rating. Actual size varies by product specification, product offerings change frequently.
University of Massachusetts at Lowell | Alternative Energy Master Plan

Pilot Project PV+BESS Financial Models

The financial viability of battery energy storage systems are still variable and PV+BESS projects frequently have lower net cost savings than PV only projects. To promote battery storage, the Commonwealth uses incentives such as the SMART battery storage program to improve the cost effectiveness of systems. In practice, UML or the potential third-party system owner will align the BESS design with SMART program requirements to best leverage the incentive and maximize project savings. Over time, the economics of BESS will improve as battery prices decrease and as utilities continue to impose rate changes in response to renewable energy grid penetration.

Both sites reviewed achieve positive NPV's at the end of the project lifecycle both for cash and PPA arrangements and can be seen in the tables below. While the economic outlook of PV+BESS is positive, PV only scenarios still outperform PV+BESS in lifecycle NPV. This is not uncommon across the industry right now and is related to the O&M costs, battery replacement costs at year 15, and BESS product cost.

System Size (kW-DC)	PV+BESS System Cost (\$)	25-year O&M (\$)	SMART Incentive (\$)	25-year Utility Bill Savings (\$)	25-year Net Benefit (2019\$)	25-year Net Present Value (\$)	Simple Payback (yrs)	IRR (%)
Ball Hall	\$ (381,848)	\$ (113,798)	\$ 383,168	\$ 884,171	\$ 771,693	\$ 263,008	8.6	11.0%
Tsongas Center	\$ (1,233,729)	\$ (530,873)	\$ 1,040,163	\$ 3,861,836	\$ 3,137,397	\$ 1,172,537	7.7	12.8%

Site	PPA Rate	20-year PPA Payments	20-year Utility Bill Savings	20-year Net Benefit (2019\$)	20-year Net Present Value
Ball Hall	\$ 0.18	\$ (597,645)	\$ 653,211	\$ 55,566	\$ 21,865
Tsongas Center	\$ 0.17	\$ (2,528,889)	\$ 2,853,174	\$ 324,286	\$ 145,619

Assessing Alternative Strategies

The recommendations contained within this report are based on today's available technology. Technology change is accelerating. Therefore, it is paramount to establish a process for evaluating alternative strategies in order to take advantage of future, more efficient technologies and alternative energies that would align or accelerate UML's path to carbon neutrality. This vetting process is intended to align with Executive Order No. 594 goal to consider opportunities to use innovative technologies that can effectively address challenges not solved by business-as-usual practices.


A proposed process could be similar to a Green Revolving Loan Fund or could be an extension of the Sustainability Engagement & Enrichment Development (S.E.E.D.) Fund. Proposals for energy efficiency, electrification, renewable deployment, and alternative energy are submitted by students, faculty, and staff to a committee representing key University entities (i.e. capital planning, facilities, energy management, sustainability, business development, and research innovation). The funds for projects can be extended as grants or loans. Loans can be repaid with the savings from implemented projects. The current AEMP Steering Committee could be extended to serve as this committee. Proposals could also be accepted from the greater Lowell community as an extension of the Lowell Green Community Partnership.

The recommendations within this Alternative Energy Master Plan (AEMP) and their associated performance targets can provide the baseline by which proposals are compared. Key performance indicators for comparison are: energy, emissions, and load reduction. In addition, other benefits should be considered when vetting proposals: life cycle cost, maintenance, reliability, resiliency, space allocation, educational co-benefits, and student engagement (i.e. behavioral change). The proposal form developed should prompt the applicant on each of these topics to enable an objective review.

It's expected that many of the AEMP recommendations, particularly deep energy retrofits, will be incorporated as part of capital projects. Therefore, it is recommended that a green building standard be established prescribing energy and emissions performance targets for new buildings and major renovations as well as prescriptive strategies for smaller scope projects. This will give design teams the flexibility to investigate alternative strategies while aligning with the overall carbon neutral vision. Education of project managers is important to ensure that design teams are proposing designs aligned with the requirements.

At the start of this process, it is recommended that project prioritization is aligned with the overall AEMP methodology: building energy efficiency/load reduction, plant electrification, renewable energy. Initial projects should target energy efficiency in the form of low temperature hot water and decoupled heating/cooling and ventilation systems, and/or target the top 1/3 of Building Scores (buildings with a score of 60 and above). As these types of projects are completed, project scope can be extended to incorporate electrification, renewable energy, and the top 2/3 of Building Scores (buildings with a score of 40 and above).

ALTERNATIVE STRATEGY ASSESSMENT

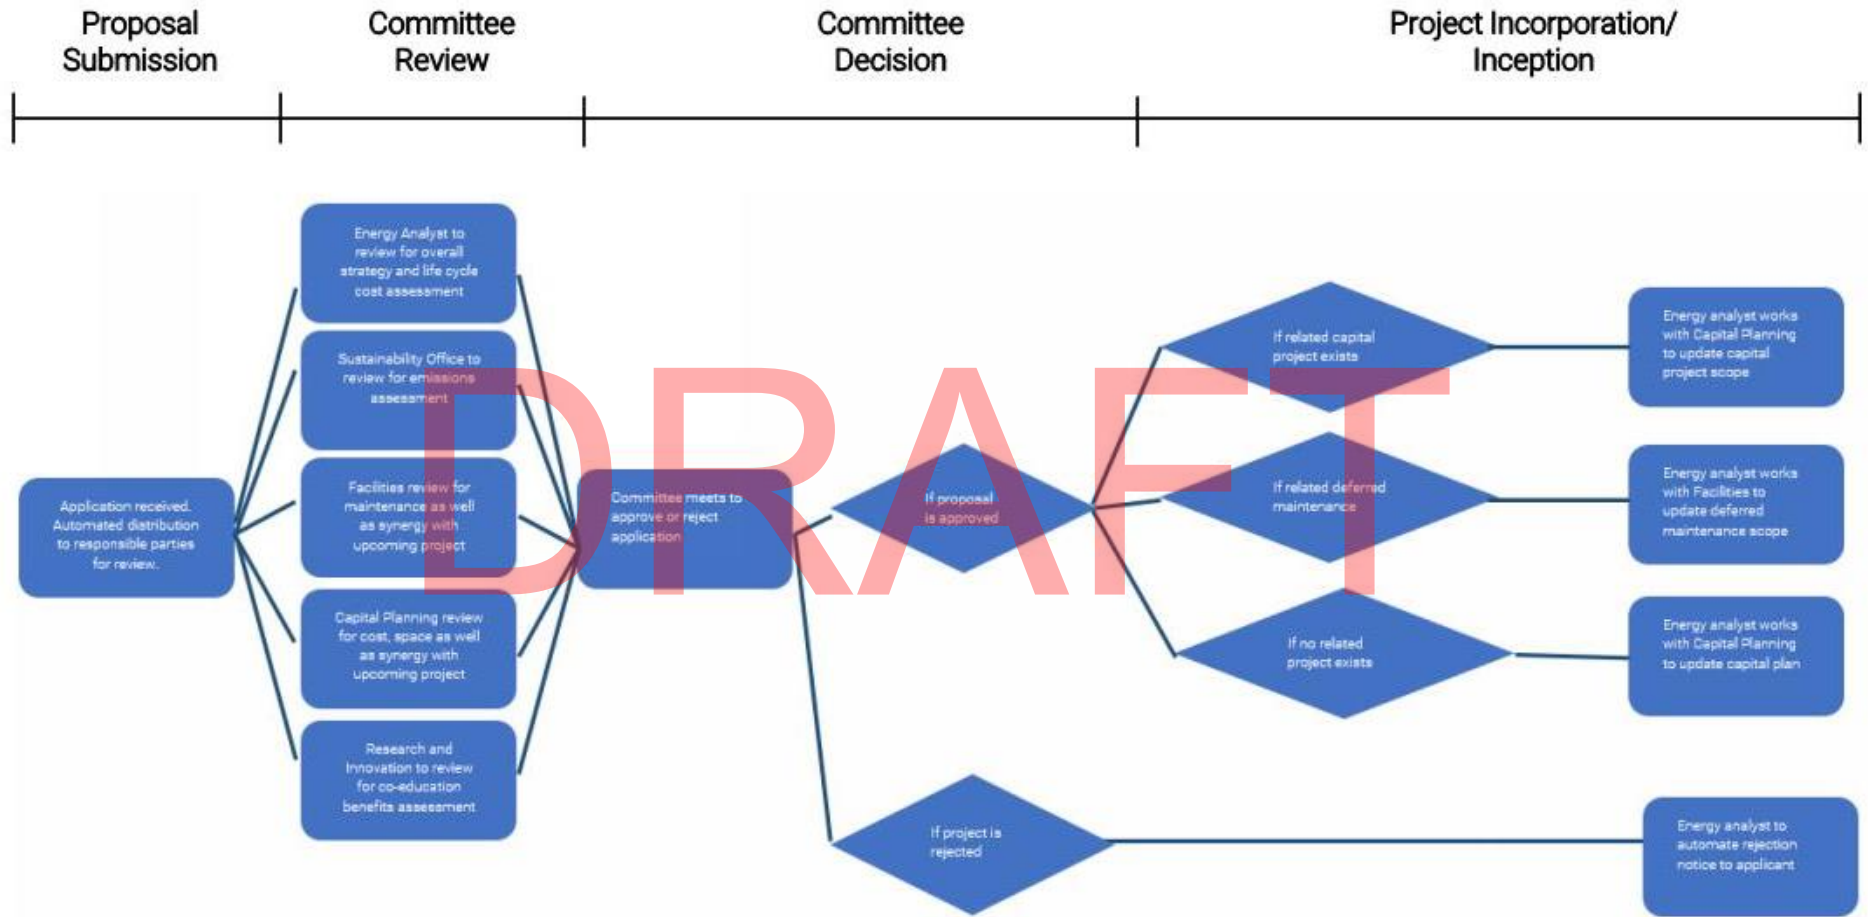



5 Investment Plan

DRAFT

Investment Plan


The goal of the investment plan is to provide UML with actionable, cost-effective energy efficiency and alternative energy projects in order to approach the University's carbon neutral goal by 2050 and the emission and EUI requirements as outlined in Executive Order 594. Building score was used to strategically determine the degree to which building energy efficiency and alternative energy projects are recommended: Business-as-usual (BAU), Good, or Best upgrades. Upgrades on the North Campus are prioritized first, followed by the South Campus, and followed by those on the East Campus in order to sufficiently reduce load before the implementation of a central plant on the North Campus and to maximize the useful life of central plant assets on the North and South campuses. Conformance with the investment plan would result in the following key achievements:

1. Carbon neutrality by 2050 with implementation of this plan and an offset purchase equivalent to approximately 3,300 MTCDE
2. Reduce onsite building fossil fuel emissions by 98% by 2050 meeting all required EO594 targets (compared to 2004 baseline)
3. Reduce EUI by 64% by 2050 meeting all current EO594 targets (compared to 2004 baseline)
4. The Selected Scenario is estimated to be a \$986 million first cost premium as compared to the BAU (Central Steam + Deferred Maintenance).
5. There is a negative return on investment when comparing the Selected Scenario to the BAU (Central Steam + Deferred Maintenance)

DRAFT

Implementation Timeline

The timing of energy efficiency and alternative energy projects were prioritized based on building score, Building score was further used to determine whether a building is recommended for business-as-usual (BAU), Good, or Best upgrades. The timeline below shows the relative timing of energy efficiency and alternative energy projects on each campus as well as critical central plant milestones.

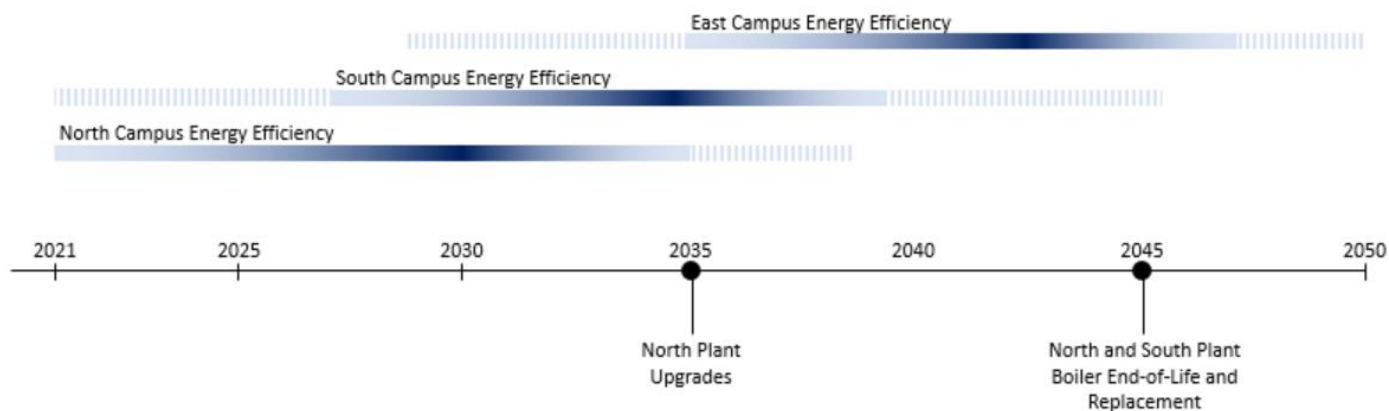

Energy efficiency projects for buildings on the North Campus were prioritized in order to reduce loads ahead of new central plant upgrades. North Campus building energy efficiency projects are recommended to be implemented between the present and 2035. Construction for new heating hot water and chilled water piping infrastructure would take place during this time. 2035 would be targeted for when a new plant and vertical closed loop geothermal boreholes would be built adjacent to the current heating plant location. This new building would house the heat recovery chillers, supplemental chillers, and cooling towers. Air-to-water heat pumps would be located on the roof of the new building as well as the current plant, Falmouth Annex, and ground-mounted (if necessary). The steam plant would be upgraded with a central steam-to-hot water heat exchanger to meet peak load. This allows for UML to maximize the useful life of the two (2) boilers installed in 2015. Furthermore, the capacity of the existing boilers provided redundancy and resiliency in alignment with Executive Order 594. 2045 is the estimated horizon when these boilers would be up for replacement. This affords UML the flexibility to evaluate future fuel type trends whether that's natural gas, biofuel, or another fuel type that may provide efficiency, emissions, availability, and/or resiliency benefits compared to its natural gas and biofuel counterparts.

The South Campus building energy efficiency and alternative energy projects would be prioritized next ahead of retiring the South Plant central plant assets while maximizing their useful life. As proven most cost effective as detailed of the Default-Alternative Analysis, buildings on the South Campus would consist of standalone heat pump heating/cooling plants (individual systems for each building). Projects would generally be targeted between 2035 and 2045. 2045 is the estimated horizon when the boilers would be up for replacement. Therefore, 2045-2050 should be targeted to complete all South Campus projects such that the plant can be retired at that time. Projects on the East Campus would take final priority – generally taking place between 2040-2050 – as completion of these projects do not need to happen before the end of life of central plant assets. As proven most cost effective as part of the Default-Alternative Analysis, buildings on the East Campus would also consist of standalone heat pump heating/cooling plants. The table on the following page details recommended levels of upgrades and timeline for each building defining the Selected Scenario.

2020-2025

North campus infrastructure piping upgrades including:

- Low temperature hot water and chilled water distribution

Best upgrades for the following buildings:

- Ball Hall (North Campus)
- Costello Athletic Center (North Campus)
- Olney Hall (North Campus)

Good upgrades for the following buildings:

- Olsen Hall (North Campus)
-

2025-2030

North campus infrastructure piping upgrades including:

- Low temperature hot water and chilled water distribution

Good upgrades for the following buildings:

- Falmouth Hall (North Campus)
 - Kitson Hall (North Campus)
 - Southwick Hall (North Campus)
 - Cumnock Hall (North Campus)
 - Lydon Library (North Campus)
-

2030-2035

North Plant expansion

- Construction of expanded central plant building
- Geothermal boreholes, air-to-water heat pumps, heat recovery chillers, supplemental chillers, and cooling towers (existing boilers to remain)

Good upgrades for the following buildings:

- Dandeneau Hall (North Campus)

Business-as-usual/deferred maintenance only for the following buildings:

- Perry Hall (North Campus)
 - Pinanski Hall (North Campus)
 - Pulichino Tong Business Center (North Campus)
 - Saab Emerging Technologies & Innovation Center (North Campus)
-

2035-2040

Best upgrades for the following buildings:

- Concordia Hall (South Campus)
- Mahoney Hall (South Campus)
- Sheehy Hall (South Campus)
- Tsongas Center at UMass Lowell (East Campus)
- Weed Hall (South Campus)

Heat pump upgrades for the following buildings:

- Donahue Hall (East Campus)
 - River Hawk Village (East Campus)
 - University Crossing (East Campus)
-

2040-2045

North Plant boiler replacement

Decommission South Plant

Good upgrades for the following buildings:

- Dugan Hall (South Campus)
- Durgin Hall (South Campus)
- Health & Social Sciences Building (South Campus)
- McGauvran Center (South Campus)
- O'Leary Library (South Campus)

Heat pump upgrades for the following buildings:

- Bourgeois Hall (East Campus)
- Campus Recreation Center (East Campus)
- Coburn Hall (South Campus)
- Leitch Hall (East Campus)
- University Suites Residence Hall (East Campus)

2045-2050

Good upgrades for the following buildings:

- Ames Textile (East Campus)
- Fox Hall (East Campus)
- Graduate and Professional Studies Center (East Campus)
- UMass Lowell Inn & Conference Center (East Campus)
- Wannalancit Business Center (East Campus)

Heat pump upgrades for the following buildings:

- 150 Wilder - Desmarais House (East Campus)
 - 820 Broadway (East Campus)
 - Allen House (South Campus)
 - Charles Hoff Alumni Scholarship Center (East Campus)
 - UMass Lowell Bellegarde Boathouse (North Campus)
-

Financial Investment

Three scenarios were developed in order to show the relative cost of the Selected Scenario: BAU (Central Steam + Deferred Maintenance), BAU (Electric + Major Renovation), and the Selected Scenario. All scenarios account for upgrades on all three of the campuses, as summarized below:

1. The BAU (Central Steam + Deferred Maintenance) option assumes that UML would perform the deferred maintenance defined in the Sightlines deferred maintenance backlog and maintain its central steam plant and infrastructure on the North and South Campuses and existing standalone system heating and cooling plant types at existing standalone buildings.
2. The BAU (Electric + Major Renovation) assumes a hypothetical case in which UML would electrify heating systems at individual buildings as part of a decentralized approach with limited amount of building upgrades as would be required as part of a major renovations and system replacements to rely on low-temperature hot water for heating.
3. The Selected Scenario proposes to make optimal building upgrades as part of major renovations to reduce loads and energy consumption and provide electric heat pump heating systems at central and standalone buildings.


The BAU (Central Steam + Deferred Maintenance) scenario would not meet UML's 2050 carbon neutral goal nor the requirements of Executive Order 594. This scenario assumes UML would maintain its central steam plant and infrastructure on the North and South Campuses. Costs were aggregated from the available Sightlines assessment. Plant costs include boiler replacement, piping infrastructure upgrades, and heat exchanger replacements. Plant costs also include decentralized plant equipment replacements at individual buildings (i.e. boiler, chiller). Building upgrades only include deferred maintenance most relevant to: envelope and MEP energy upgrades. It is assumed that these costs are inclusive of all costs including material, labor, and soft costs.

BAU (Electric + Major Renovation) would meet UML's 2050 carbon neutral goal. This scenario assumes electrification using heat pumps with minimal energy efficiency upgrades as part of a major building renovation. This baseline is intended to further demonstrate energy efficiency is key to cost effective carbon neutral solutions.

The graphs on the following page show the total capital costs cost over a 25 year period leading up to 2050 with a breakdown of the costs into 5-year periods when the projects are recommended to occur. Plant costs are in various shades of red. Each shade represents a different scenario. Building costs are shown in various shades of orange. Each shade represents a different scenario. The BAU (Electric + Major Renovation) and Selected Scenario only account for related envelope and MEP energy upgrades. Costs account for mark-ups and escalation (see Appendix R for assumptions). All other unrelated costs are excluded (i.e. FF&E, architectural finishes, structural). Key takeaways are as follows:


1. The Selected Scenario is estimated to be a \$986 million first cost premium as compared to the BAU (Central Steam + Deferred Maintenance).
2. The initial investment in energy efficiency in the Selected Scenario results in reduced plant size and cost which overall results in a \$21 million lower first cost than BAU (Electric + Major Renovation).

CAPEX - Selected Scenario vs. Business-as-usual

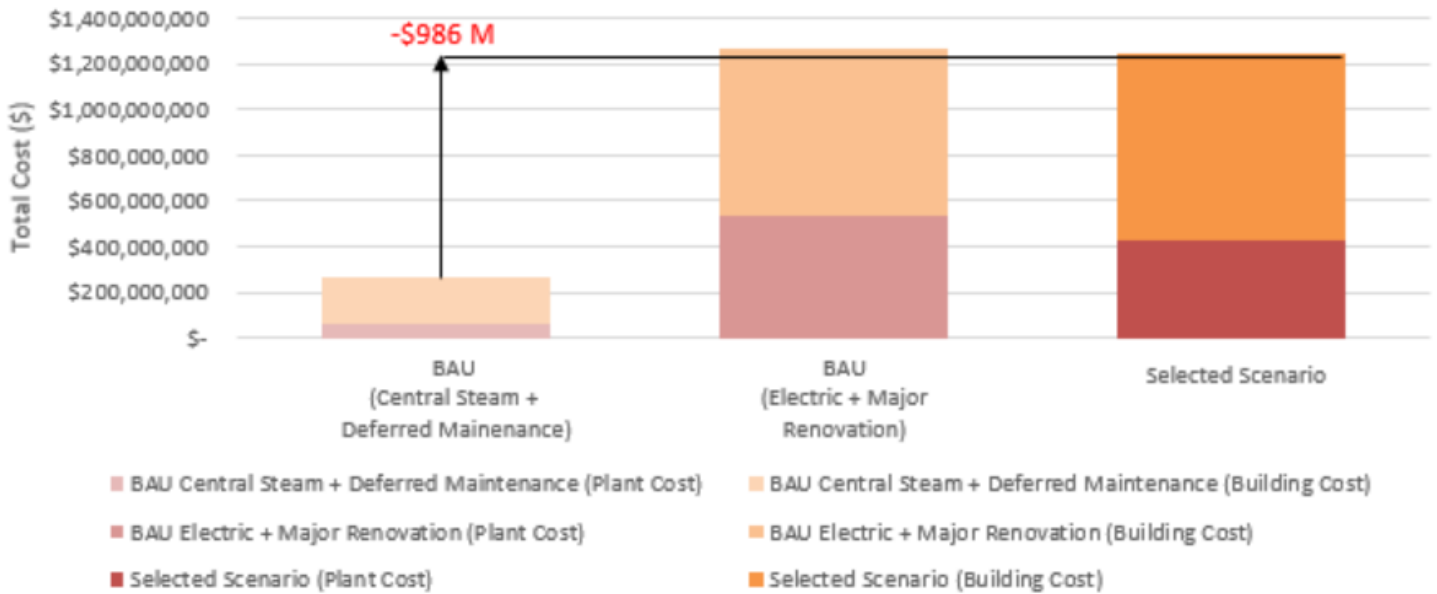


DRAFT

CAPEX - Selected Scenario vs. Business-as-usual

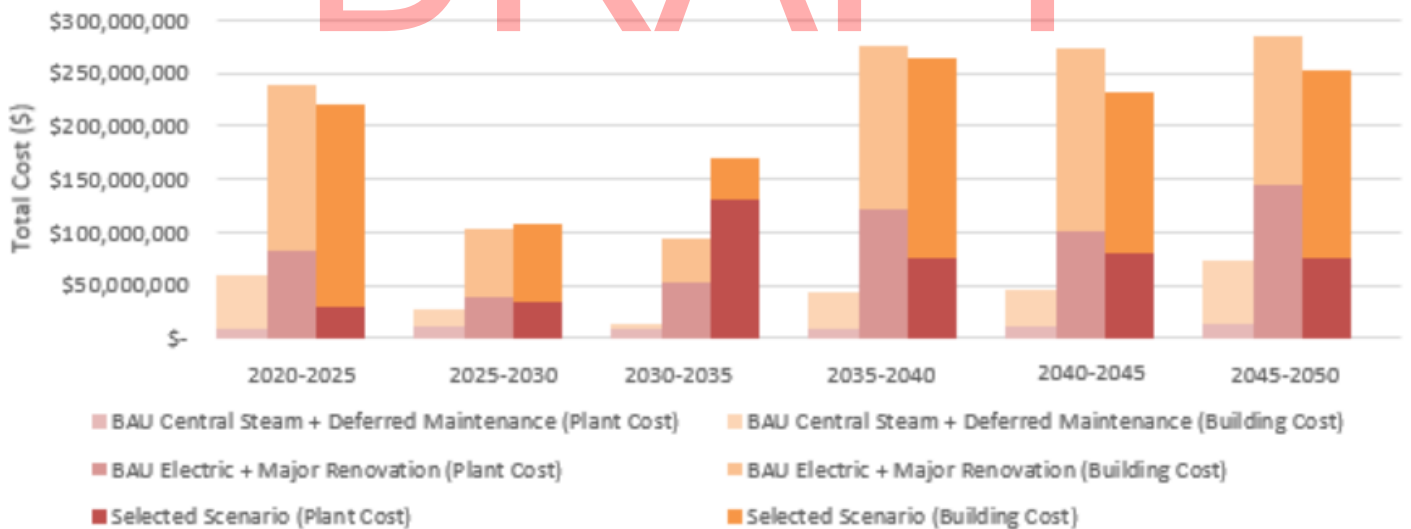

The graph below shows the net present cost for each scenario over a 25-year life cycle. Note that net present cost is shown as opposed to total cost (as shown on the previous page). The 25-year costs for energy, maintenance and replacement are incorporated in addition to the plant and building upgrade costs. The energy costs decrease (green bar) as more building upgrades are incorporated (indicated by the increase in size to the orange bar). Maintenance costs and replacement costs are driven by less equipment in scenarios with central plants. Key takeaways are as follows:

1. The Selected Scenario is estimated to be a \$41 million (10%) net present cost reduction as compared to the BAU (Electric + Major Renovation) scenario.

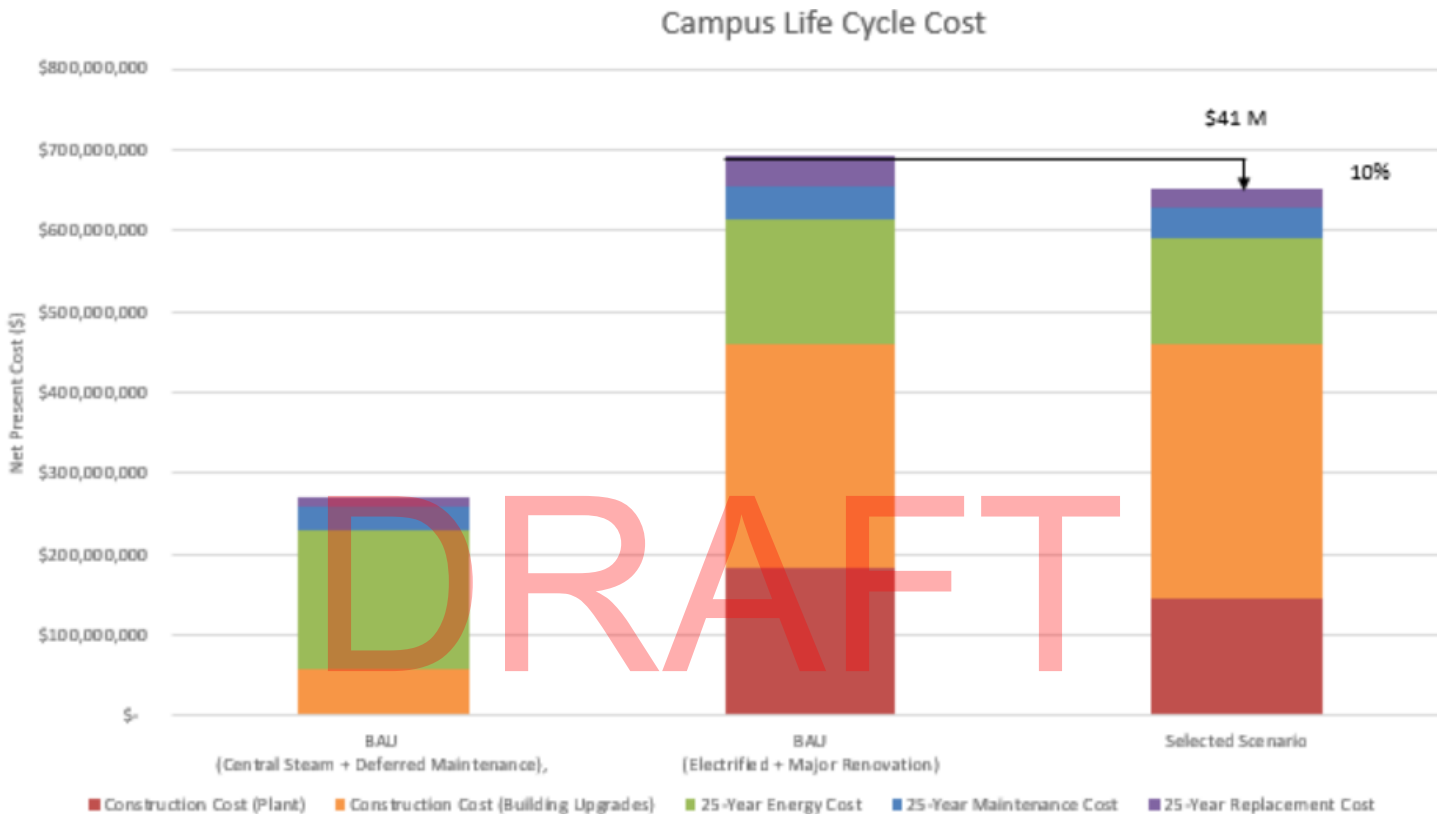

Improved Resiliency


Executive Order 594 requires facility and energy resilience and to adhere to all applicable resiliency requirements, including, but not limited to, Executive Order 569 and the Massachusetts State Hazard Mitigation and Climate Adaptation Plan to improve the capacity of critical infrastructure and energy systems to withstand growing weather-related impacts associated with climate change. This plan incorporates improved levels of resiliency for the campus. The recommended North Campus Central Plant incorporates multiple fuel sources for heating: electric (heat recovery chillers and air-to-water heat pumps), natural gas, and fuel oil (dual fuel boilers). Backup generators are recommended to be provided to maintain heating via the boilers and pump operation for 36 hours as requested by UML. UML should review critical operation in buildings designated for standalone heating/cooling systems to determine if emergency power upgrades are required beyond those currently in place.

Energy, Emissions, EUI Results

The Selected Scenario results in significant reductions in energy and emissions. This creates a pathway towards carbon neutrality by 2050 and achievement of Executive Order 594 target requirements for building emissions and EUI. Note that this section references Executive Order 484. Executive Order 594 replaced Executive Order 484 during the course of this study in April 2021. Both sets of energy and emissions requirements are shown as benchmarks in order to showcase UML’s previous progress as well as potential, future progress.


The graph below shows the energy reduction of implementing the Selected Scenario compared to present day energy consumption. Present day energy consumption is used as the baseline as opposed to 2004 given that there are no related Executive Order requirements for energy consumption. Natural gas consumption is reduced as a result of energy efficiency and electrification of heating systems. In 2035, the natural gas consumption is expected to reduce at a greater rate, which is a result of the North Campus plant upgrades coming online. Electricity consumption reduces as a slower rate as some energy efficiency improvements are offset by electrification. Key takeaways are as follows:

1. The Selected Scenario is estimated to reduce energy consumption 36% compared to energy consumption in 2019.

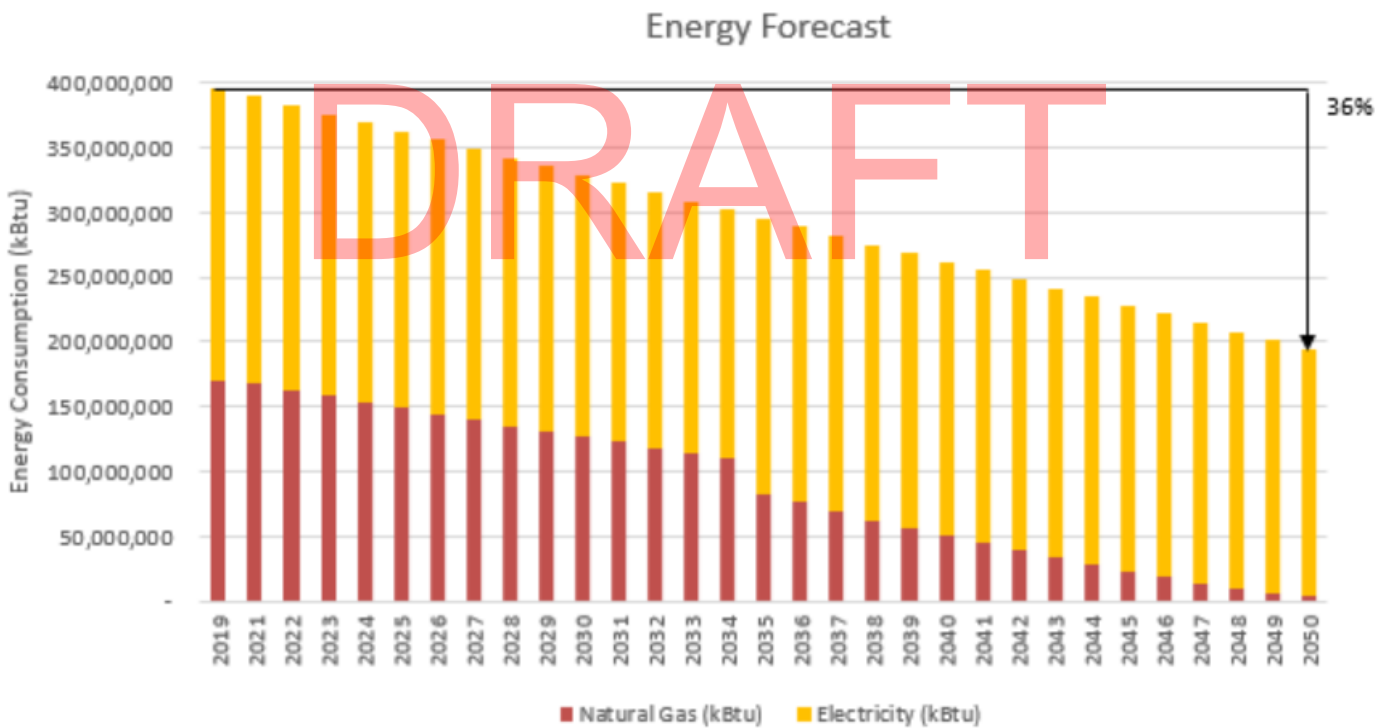


The graph below shows the further energy reduction as a result of deploying all onsite solar PV as identified in the Default-Alternative section. It is not reasonable to assume that UML would deploy onsite solar PV in all locations identified, but this analysis provides a book end for the maximize reduction achievable from onsite renewables. Key takeaways are as follows:

1. The Selected Scenario is estimated to reduce energy consumption 51% compared to energy consumption in 2019.

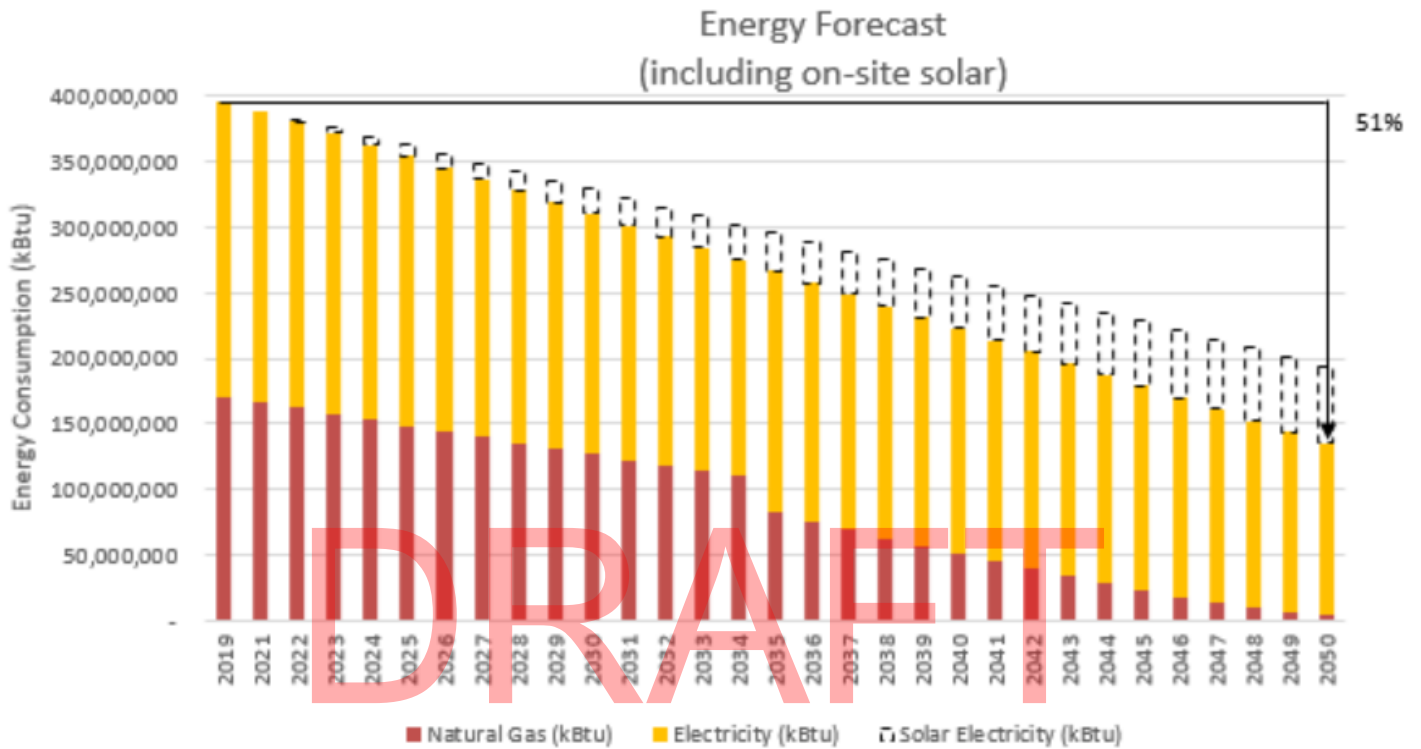


Reduction in natural gas consumption as a result of electrification and reduction in overall energy consumption as result of energy efficiency drives down emissions. Previous to the adoption of Executive Order 594, Executive Order 484 required an 80% emissions reduction compared to a 2004 baseline. The graph below shows the reduction of emissions over time. Key takeaways are as follows:

1. The Selected Scenario is estimated to reduce building emissions 85% compared to emissions in 2004. About half of this reduction is the result of grid emission reductions.
2. Achievement of carbon neutrality by 2050 would require a carbon offset purchase equivalent to approximately 3,300 MTCDE

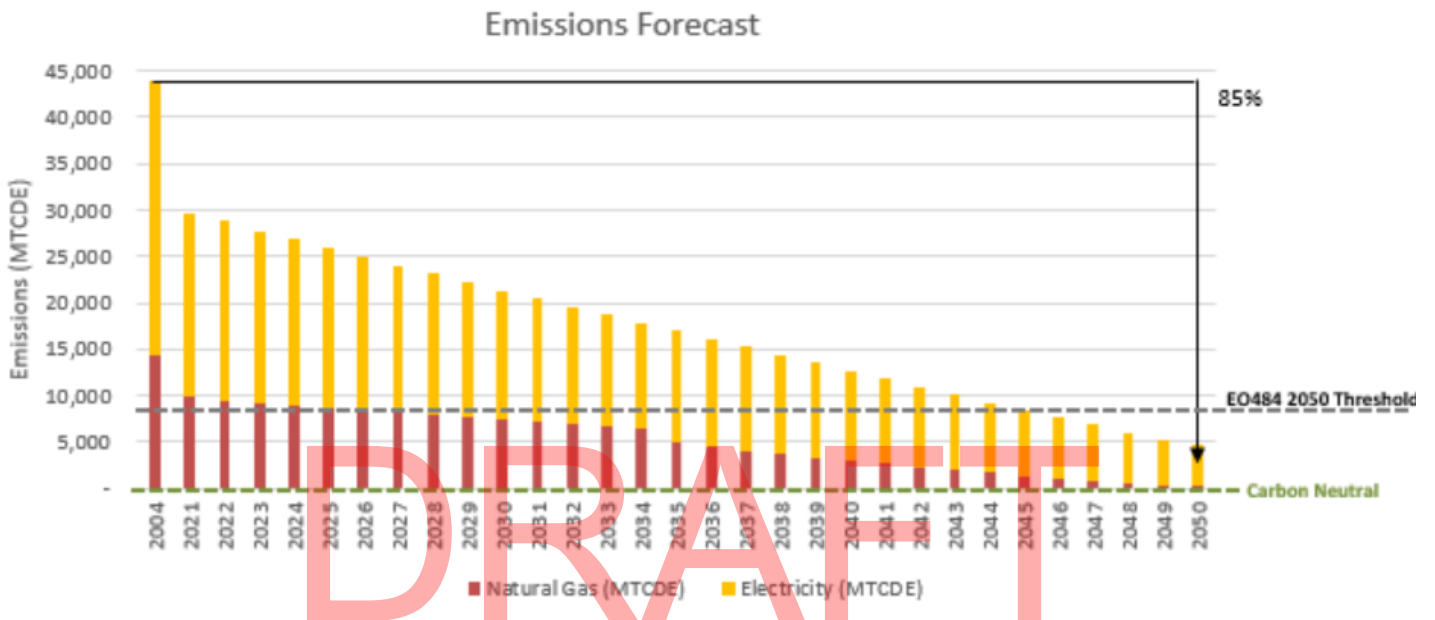


Generation and retirement of renewable energy credits (RECs) from onsite renewables is another means to reduce emissions. At this time, RECs are owned by the utility as part of the SMART incentive program. The financial incentive from SMART is critical in the cost effectiveness of solar PV projects. If the SMART program were to change such that UML could retain and retire the RECs, then the RECs could result in further emission reduction. However, it is expected that UML would sell the RECs given the economic benefit. Therefore, the graph below is intended to serve as a reference only. The graph shows the reduction of emissions over time as a result of onsite solar PV deployment. Key takeaways are as follows:

1. The Selected Scenario is estimated to reduce building emissions 93% compared to emissions in 2004. About half of this reduction is the result of grid emission reductions.
2. Achievement of carbon neutrality by 2050 would require a carbon offset purchase equivalent to approximately 1,900 MTCDE

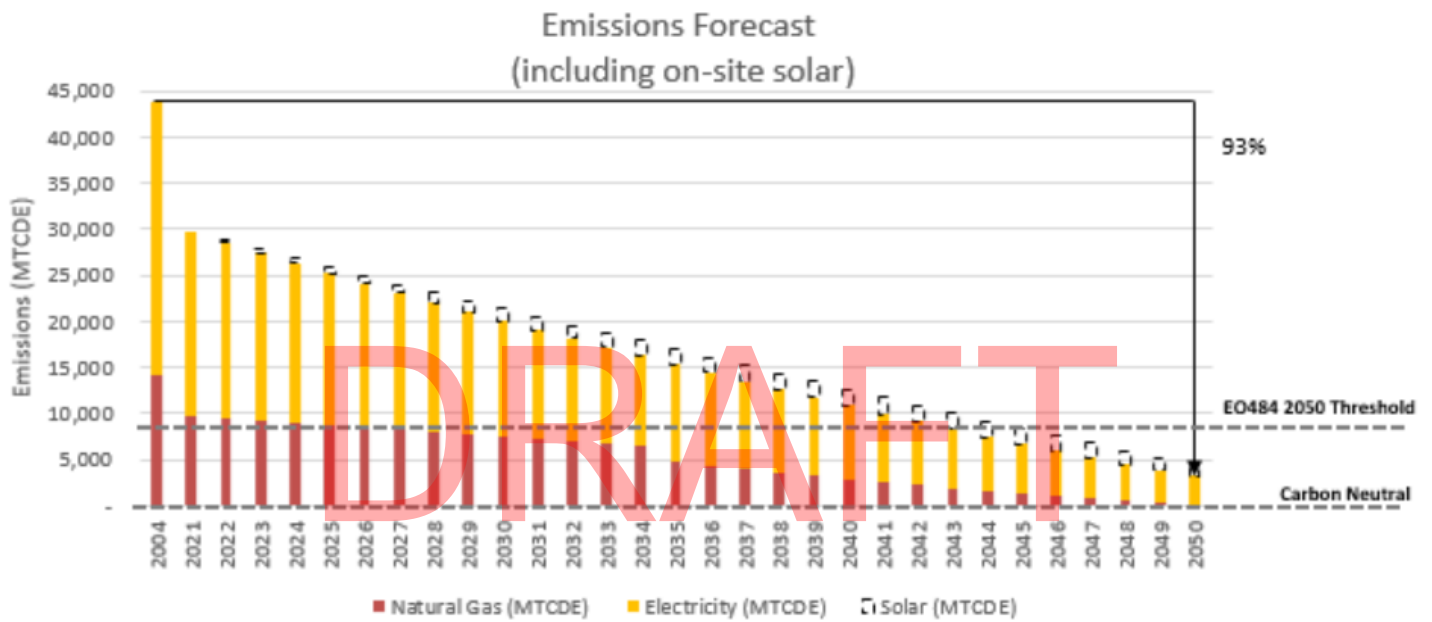


Executive Order 594 (EO594) requires reducing emissions associated with the burning of on-site fossil fuels at buildings and in vehicles by 20% in 2025, 35% in 2030, 60% in 2040 and 95% in 2050 (as compared to a 2004 baseline). UML has already met the 2025 and 2030 thresholds based on data compiled by Competitive Energy Solutions. The scope of this alternative energy master plan was building emissions only. Therefore, the 2004 baseline as indicated on the following page was developed by assuming the 30% reduction in total emissions between 2004 and 2019. The graph shows the reduction in onsite fossil fuel emissions as a result of implementing the Selected Scenario. Key takeaways are as follows:

1. The Selected Scenario is estimated to reduce onsite fossil fuel emissions 98% compared to a 2004 baseline.
2. UML could meet both the EO594 2040 and 2050 targets by fully implementing the plant and building upgrades as part of the Selected Scenario.

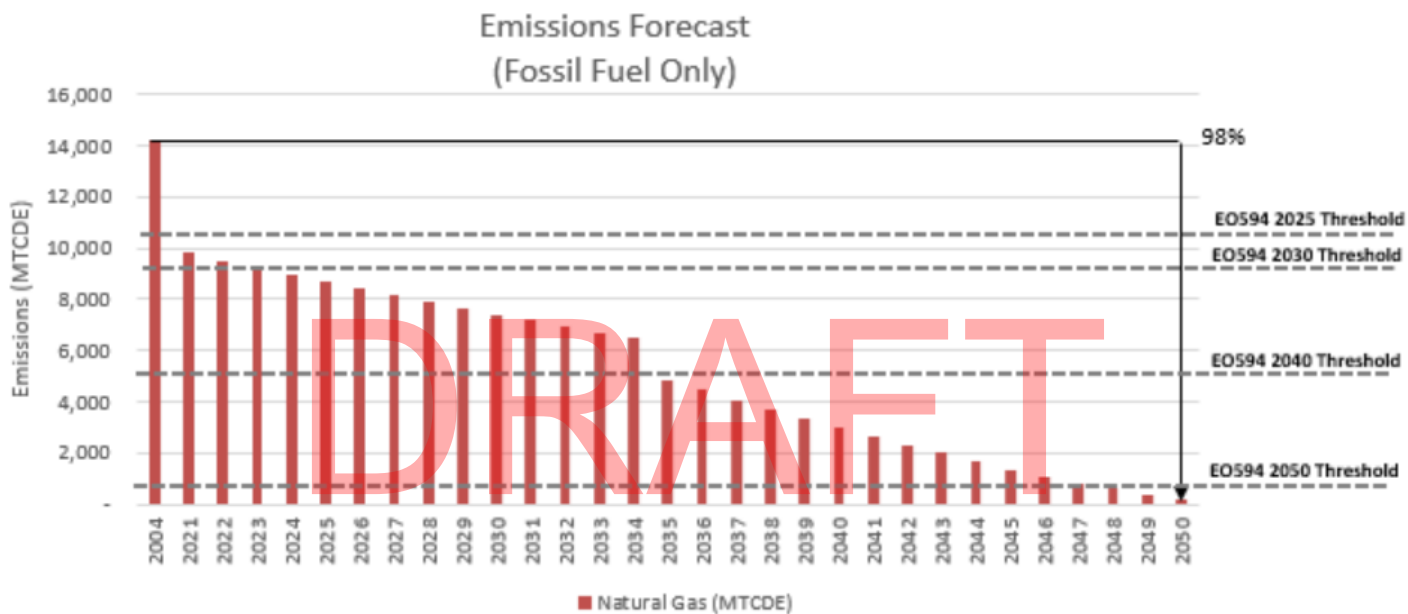


Executive Order 594 (EO594) requires reducing energy use intensity (EUI) from a 2004 baseline by 20% in 2025 and 25% in 2030. UML has already met these thresholds based on data compiled by Competitive Energy Solutions. The scope of this alternative energy master plan was for buildings as indicated as part of the Metering and Data Management Report. Therefore, the 2004 baseline as indicated below was developed by assuming the 43% reduction in EUI between 2004 and 2019. The graph shows the reduction in EUI as a result of implementing the Selected Scenario. The EO594 2040 and 2050 targets are not defined at this time but energy efficiency upgrades as part of the Selected Scenario will certainly contribute to achieving future targets. Key takeaways are as follows:

1. The Selected Scenario is estimated to be emissions 64% compared to EUI of buildings covered under this study in 2004 referenced as part of EO594.

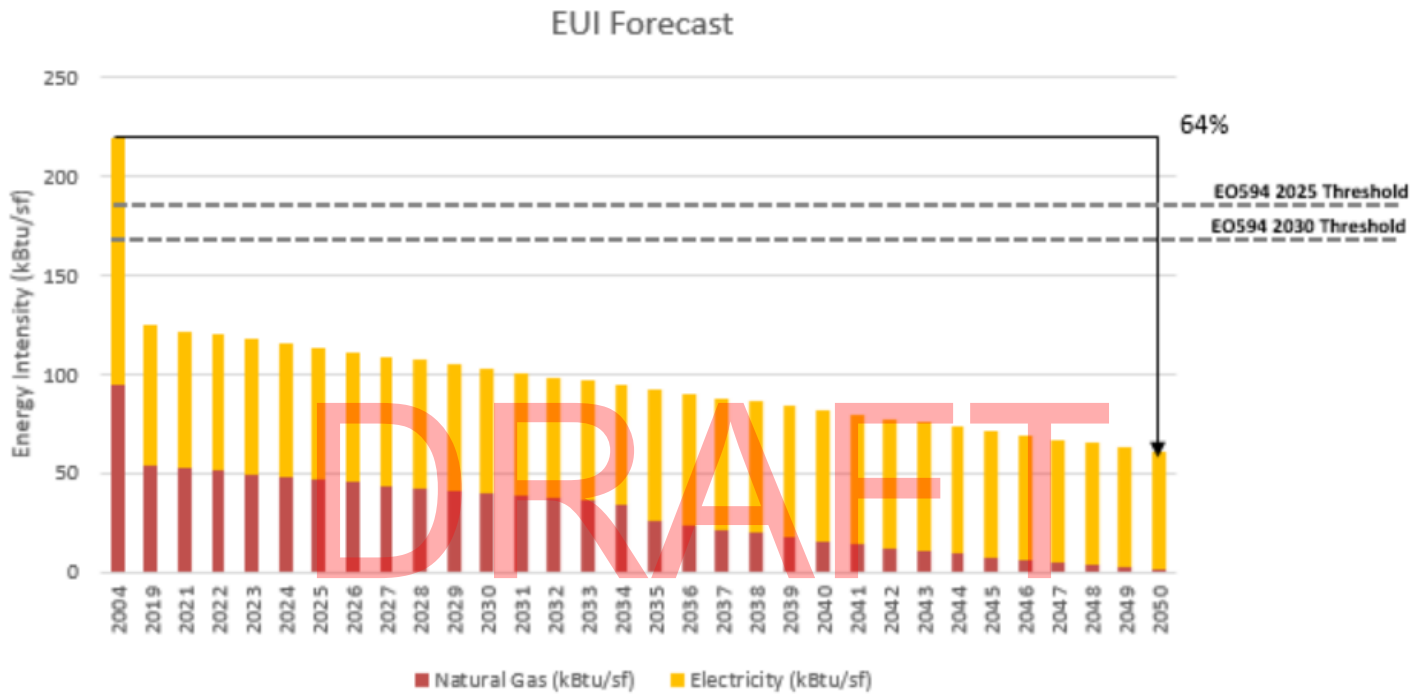

The graph below is intended to serve as a reference for the impact of onsite solar PV deployment if RECs were to be retired. Key takeaways are as follows


1. The Selected Scenario is estimated to be emissions 72% compared to EUI of buildings covered under this study in 2004 referenced as part of EO594.

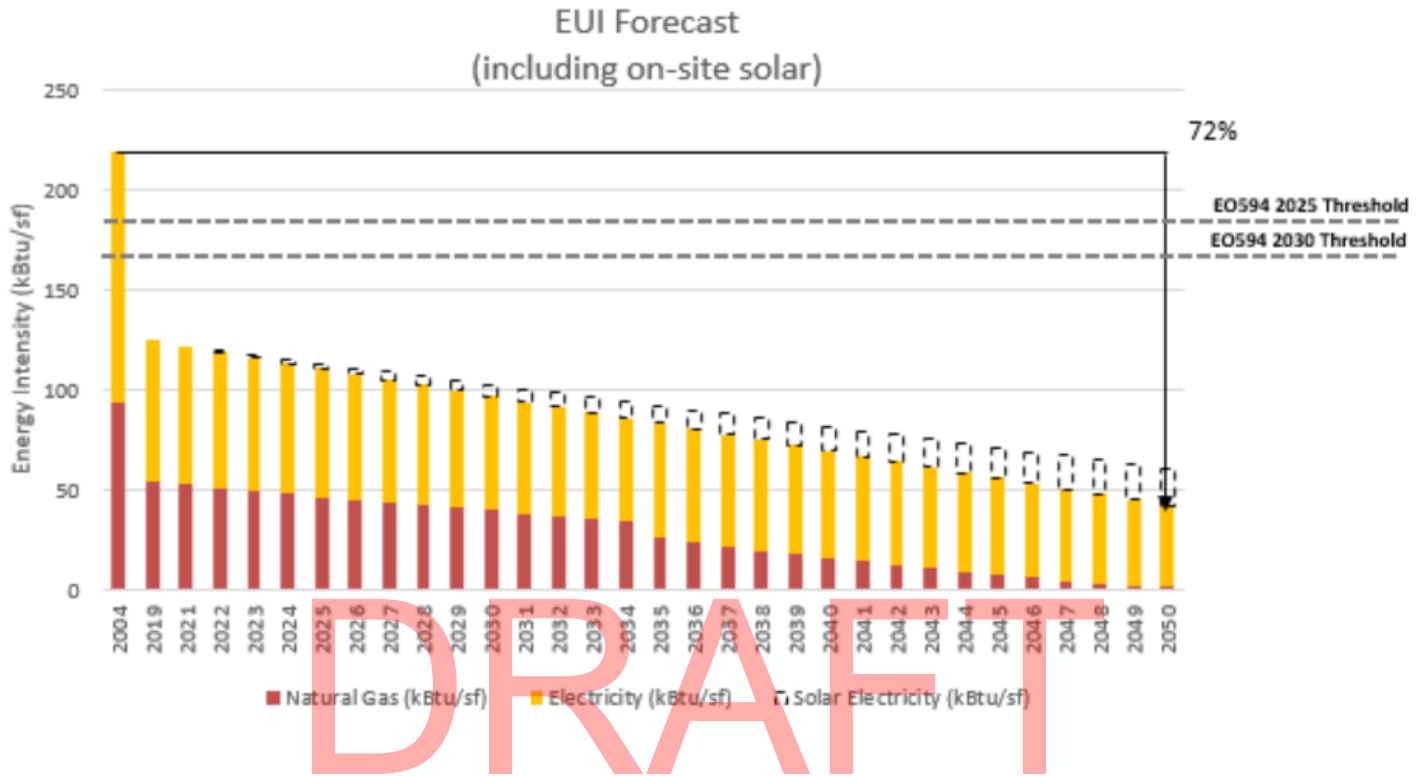

Summary

The investment plan for the Selected Scenario provides UML with actionable, cost-effective energy efficiency and alternative energy projects in order to approach the University's carbon neutral goal by 2050 as well as meet the emission and EUI requirements as outlined in Executive Order 594. The Selected Scenario is estimated to be a \$986 million first cost premium as compared to the BAU (Central Steam + Deferred Maintenance). There is a negative return on investment when comparing the Selected Scenario to the BAU (Central Steam + Deferred Maintenance). A carbon offset purchase equivalent to an estimated 3,300 MTCDE would be required in order to achieve carbon neutrality by 2050. Changes to the Clean Energy Standard (CES) requiring procurement from clean energy sources beyond 80% could reduce this required purchase. Funding of the investment plan is contingent on external funding. Therefore, collaboration with DOER and other DCAMM agencies to agree on a path forward towards a common goal is paramount. UML is uniquely positioned to implement this plan given available operations, teaching, and research resources as well as interagency collaboration.

DRAFT

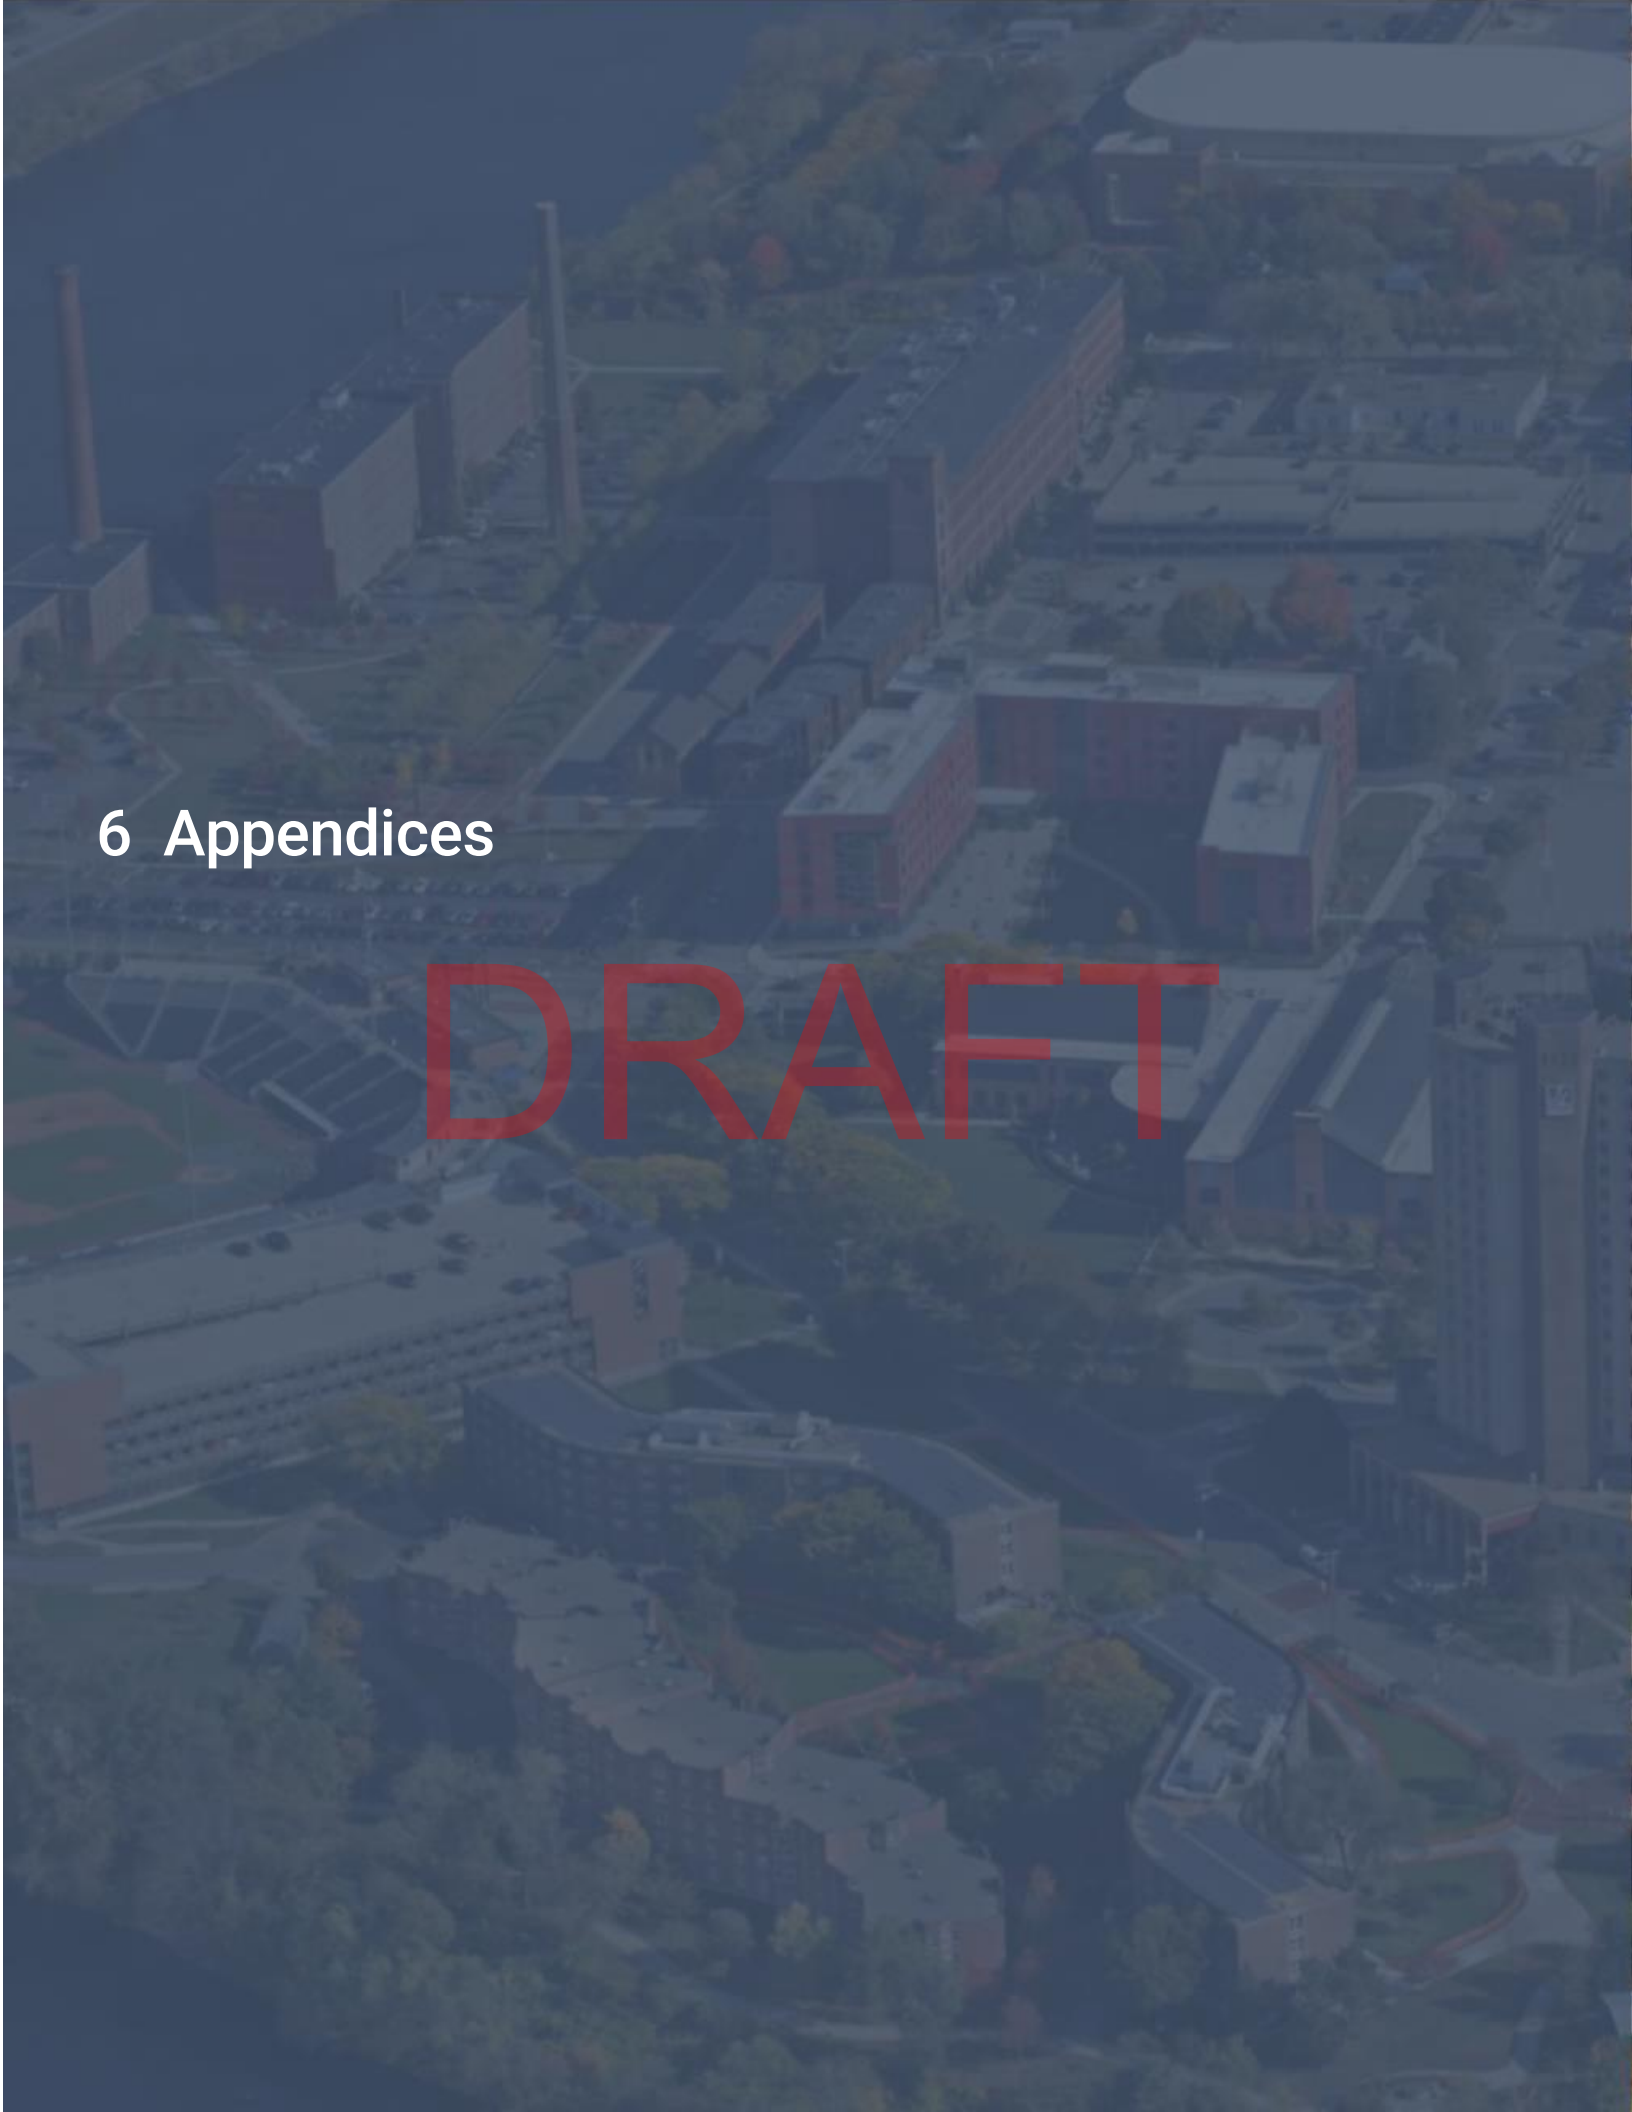

6 Appendices

DRAFT

Appendix A – Work Plan

The enclosed project Work Plan supports the planning, execution, monitoring & control, and closeout of UML’s AEMP effort. The Work Plan spells out the project objectives, scope, schedule, roles and responsibilities, communication methods, and risk tracking. The Work Plan is a “living document” in that it should be reviewed and updated as necessary for the duration of the project.

DRAFT

Introduction

The Project

The University of Massachusetts Lowell (UML) conducted a competitive procurement for planning and consulting services to develop a comprehensive Alternative Energy Master Plan (AEMP). The AEMP effort grew out of a multi-year strategic planning process and in support of campus sustainability objectives, legislative mandates, and university commitments. The AEMP will assist UML in achieving interim carbon reduction goals with the ultimate goal of carbon neutrality by 2050 while aligning multiple stakeholder groups across the campus.

BR+A Consulting Engineers (BR+A) was awarded the contract for the AEMP in September 2020 and is responsible for leading the development of the plan, engaging partner firm Anser Advisory (Anser), and developing project deliverables.

The Work Plan

The enclosed project Work Plan supports the planning, execution, monitoring & control, and closeout of UML's AEMP effort. The Work Plan spells out the project objectives, scope, schedule, roles and responsibilities, communication methods, and risk tracking. The Work Plan is a "living document" in that it should be reviewed and updated as necessary for the duration of the project.

Work Plan Use Guidelines

The Work Plan will remain in Microsoft Word format and be stored in a Project SharePoint file accessible by the Project Team. Comments may be added to the Work Plan by the AEMP Steering Committee but should be added in a manner where they are identifiable. Listed below is the standard guidelines for Work Plan comments and edits:

1. Both the author and the content must be visible
2. For ease of recognition, Microsoft Word Review functions should be used to add comments in the review pane
3. Tracked changes are acceptable for in-text edits
4. The author of a tracked change must not approve their own changes, the Project Manager is solely responsible for accepting tracked changes and resolving comments.
5. Rejected changes shall be discussed as necessary during bi-weekly meetings

Goals

The stated goals of the AEMP are as follows:

1. Evaluate UML's existing energy and metering, data management systems, and data governance practices to establish accurate usage and demand baselines, and to analyze onsite electricity and steam production, building-level performance, and campus-level energy performance on an ongoing basis;
2. Forecast the primary campus' annual energy demands between 2020 and 2050;
3. Identify, scope, and estimate specific energy sources and/or energy savings opportunities that can meet the campus' growth over the next 30 years in a resilient, cost effective, and sustainable manner.
4. Identify and design energy sources and energy savings opportunities that can enable UML to meet the sustainability targets mandated under Executive Order 484 and the campus' carbon neutrality goals in a reliable, cost effective manner;
5. Identify physical infrastructure, operating systems (mechanical, administrative, etc.), advantages and constraints for each identified location, and costs in order for UML to implement or upgrade recommended energy strategies to meet the campus' resiliency, utility cost, and sustainability objectives;
6. Propose mechanisms for stakeholder engagement (students, faculty, staff, and broader community) throughout the planning process that offers opportunities for students and faculty to engage in planning, hands-on projects, and activities associated with the renewable energy goals.

Project goals were reviewed by the Project Team during the kickoff meeting on October 14th 2020. While no additional goals were identified, UML emphasized the importance of the following:

1. Project alternatives must be supported with enough information (including cost) to make the case to external institutions on how programs may need to be adjusted in order to achieve State goals;
2. External partnerships are key to the success of this plan and funding of related upgrades; and
3. Internal stakeholder engagement is key to align similar goals across different stakeholder groups.

Scope and Deliverables

The AEMP project is defined by the following phases, tasks, and deliverables:

Phase	Task	Description	Deliverables
I	Metering & Data Management	+ Evaluate UML’s existing energy metering, data and building management systems, and data governance practices for the purposes of analyzing building-level energy demands, onsite generation performance, and campus-level energy performance.	+ Building energy scorecard template populated with collected data and reference building data
I	30-Year Energy Forecast	+ Project annual campus thermal demands and production by source between 2020 and 2050.	+ Draft 30-Year Energy Forecast
		+ Pair projects with teaching and research objectives to help forecast energy profile.	+ Final 30-Year Energy Forecast integrated into Final AEMP
		+ Develop a plan to engage UML stakeholders throughout the process. Engagement plans should include targeted meetings with established groups (e.g., SGA, CCI), outreach to faculty and students, and online mechanisms for soliciting, collecting, and sharing stakeholder input.	+ Stakeholder Engagement Plan (included as part of Work Plan)
II	Default Case Analysis	+ Evaluate reliability outcomes under a default case in which UML maintains its current centralized steam and electrical distribution infrastructure through 2050.	+ Default Case Analysis + Final Default Case Analysis integrated into Final AEMP
		+ Analyze the campus’ existing electrical grid configuration and identify reliability risks based on forecasted electricity demands	
		+ Analyze the campus’ existing steam production and distribution configuration and identify reliability risks based on forecasted thermal demands	
		+ Evaluate cost outcomes under a default case in which UML maintains its current centralized steam and centralized electric distribution infrastructure through 2050.	
		+ Analyze current and future trends in electricity and fuel costs.	
		+ Evaluate GHG, energy conservation, and renewable energy outcomes under a default case in which UML maintains its current centralized steam and centralized electric distribution infrastructure through 2050.	
		+ Identify gaps between projected outcomes and mandated targets in Executive Order 484	

Phase	Task	Description	Deliverable
II	Alternatives Analysis	+ Establish a framework to identify preferred alternatives to the default case that offer economic benefits, reliability benefits, and/or increased GHG reduction potential.	+ Draft Alternatives Analysis + Final Alternatives Analysis integrated into Final AEMP
		+ Alternatives may include, but are not limited to, energy conservation measures, onsite renewable energy expansion, energy storage, and/or utilization of alternative fuels with current infrastructure	
		+ Develop an energy reliability strategy that details redundancy of utility services on campus and compares costs of various redundancy options in campus energy infrastructure.	
		+ Analyze opportunities for GHG reduction from the default case related to fuel switching, expansion of onsite renewable energy, adoption of new production or distribution technologies, and energy conservation measures.	
		+ Evaluate onsite capacity for development of additional renewable energy sources	
		+ Evaluate onsite capacity for development of energy storage opportunities	
		+ Evaluate market, technical, and regulatory opportunities for alternative fuels and electricity	
II	Investment Plan	+ Identify opportunities to improve existing energy metering, data management systems, and data governance practices to effectively monitor campus-level energy performance, building-level energy performance, and onsite generation performance.	+ Final Investment Plan integrated into Final AEMP
		+ Develop a prioritized list of energy projects between 2020 and 2050 that support UML's reliability, cost, and sustainability objectives.	
		+ In coordination with campus officials, identify appropriate locations on campus to implement energy infrastructure investments consistent with the recommendations of the plan, noting assets and challenges of the proposed sites for various proposed installations.	
		+ Develop a summary and schedule of capital and operating costs as well as a timeline for the default case and preferred alternatives that clearly outline net present value of assets over time and return on investment to the University.	
		+ Highlight financing options for capital upgrades	
		+ Identify industry partnerships that will advance UML stakeholders that support utility cost reduction, clean energy initiatives, and promote student engagement opportunities	

Scope Boundaries

The following is a list of scope boundaries:

#	Included / Excluded	Related Tasks	Boundary	Guidance
1	Excluded	AEMP	Buildings with mixed occupancy (>0% of non-UML tenants) are excluded from greenhouse gas (GHG) accounting and from AEMP <ul style="list-style-type: none"> • Andover Imaging and Research Labs • Boott Cotton Mills • Harbor Place at Haverhill • LeLacheur Park 	10/14 kickoff meeting
2	Excluded	AEMP	UML has discontinued involvement with Second Nature's Presidents' Climate Leadership Commitments but maintains the overarching carbon neutrality goals set forth in the Climate Action Plan (CAP).	10/14 kickoff meeting
3	Excluded	Alternatives Analysis	Bio-based fuels should not be a recommended AEMP strategy	10/14 kickoff meeting
4	Excluded	Metering / Data Management	The following properties are outside the scope of the project given no longer owned or leased: <ul style="list-style-type: none"> • 49 East Meadow Lane (no lease) • 1301 Middlesex (sold) • 61 East Meadow Lane (sold) • 15 Lawrence Dr (no lease) 	10/6 RFI log
5	Excluded	Metering / Data Management	The following properties are outside the scope of the project given being demolished <ul style="list-style-type: none"> • 193-199 Pawtucket • 3 Dane Ave 	10/6 RFI log

Project Schedule

Baseline project schedule shown below for reference, task duration and sequence match that of the proposed project schedule. The start date is based on the kickoff meeting task. The project schedule is to be updated throughout the project and addressed during bi-weekly team meetings.

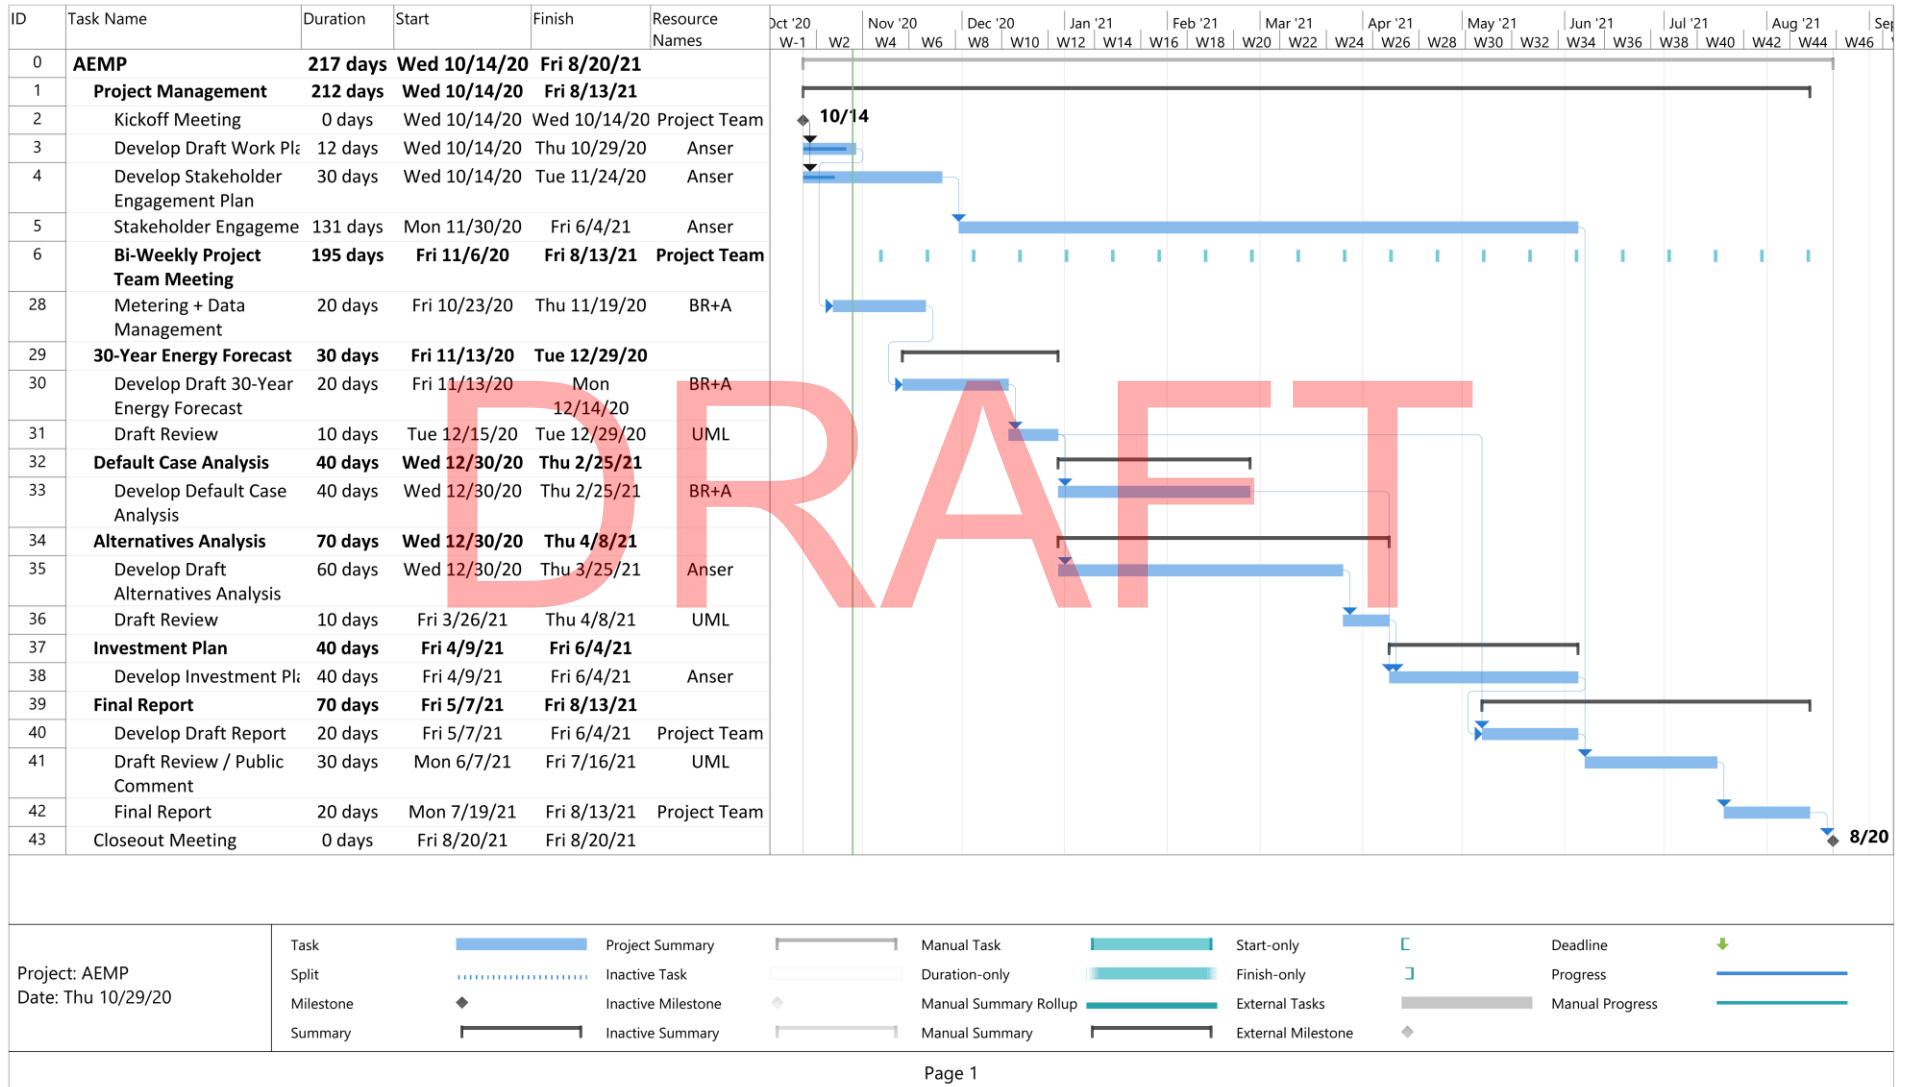


Figure 2 - Project Schedule

Roles and Responsibilities

Project Team

BR+A and Anser have assembled a team of specialists each of which brings a unique skillset to the project. The principal roles are:

The Client – AEMP Steering Committee, University of Massachusetts Lowell

Project Manager/ Consultant – BR+A

Stakeholder Engagement Manager – Anser Advisory

In addition to the key roles above, other specialists will be involved during the lifecycle of the project. Refer to the Organizational Chart below. The group of specialists may be further developed or refined during the project and the organizational chart shall be updated accordingly.

The Project Directory lists the personnel comprising the current Project Team and relevant information such as agency/company, title, phone number, and email address.

Project Governance



Figure 3 - Organizational Chart

Project Directory

Name	Title	Agency	RACI Category	Email
Pat Duffy	Principal-in-charge	BR+A	BR+A-Anser	pduffy@brplusa.com
Jacob Knowles	Senior Advisor	BR+A	BR+A-Anser	jknowles@brplusa.com
Michael Swenson	Project Manager	BR+A	BR+A-Anser	mswenson@brplusa.com
Brendan Surette	HVAC Engineering	BR+A	BR+A-Anser	BSurette@brplusa.com
Don Moynagh	Electrical Engineering	BR+A	BR+A-Anser	dmoynagh@brplusa.com
Zach Rohlfs	Plumbing Engineering	BR+A	BR+A-Anser	ZRohlfs@brplusa.com
Josh Brain	Energy Analyst	BR+A	BR+A-Anser	jbrain@brplusa.com
Sadaf Jafari	Stakeholder Engagement	BR+A	BR+A-Anser	SJafari@brplusa.com
Shasta Culp	Senior Advisor	Anser	BR+A-Anser	shasta.culp@anseradvisory.com
Arun Srinath	Energy Analyst	Anser	BR+A-Anser	runman9@gmail.com
David Lazerwitz	Energy Analyst	Anser	BR+A-Anser	david.lazerwitz@anseradvisory.com
Andraya Lombardi	Energy Analyst	Anser	BR+A-Anser	andraya.lombardi@anseradvisory.com
Dan Abrahamson	Energy Manager	UML	Facilities Management	Daniel_Abrahamson@uml.edu
Tom Miliano	Executive Director	UML	Finance and Operations	Thomas_Miliano@uml.edu
Ruairi O'Mahony	Director - Sustainability	UML	AEMP Steering Committee	Ruairi_OMahony@uml.edu
Christopher Niezrecki	Chair, Professor, Director	UML	AEMP Steering Committee	Christopher_Niezrecki@uml.edu
Mary Ankner Usovicz	Director of Business Development	E2I	AEMP Steering Committee	Mary_AnknerUsovicz@uml.edu
Julie Chen	Vice Chancellor	UML	AEMP Steering Committee	Julie_Chen@uml.edu
Terrance McCarthy	Executive Director	UML	UML	Terrence_McCarthy@uml.edu
Adam Baacke	Executive Director	UML	Facilities Management	Adam_Baacke@uml.edu
Jean Robinson	Associate Vice Chancellor	UML	AEMP Steering Committee	Jean_Robinson@uml.edu
Eric Friedman	Director LBE	DOER	AEMP Steering Committee	eric.friedman@state.ma.us
Ryan Kingston	LBE	DOER	AEMP Steering Committee	Ryan.Kingston@mass.gov

Table 1 - Project Directory

Communication

Efficient and effective communication is integral to the success of the project. As such, the Project Team must be intentional in communicating matters related to the Client's objectives, project design, information requests, contractual/ administrative issues, as well as the resolution of any problems that may arise.

It is the responsibility of each and every member of the Project Team to ensure that information, as it is created or identified, is properly coordinated and communicated to members of the team to whom the information is relevant. Equally, information must be communicated in ways which reflect its importance or urgency.

If there is any doubt as to the status or urgency of information or to whom it should be issued, the matter should be referred to the Project Manager.

All formal communication with and instructions by the Client will be directed through the Project Manager. The Project Manager will transmit all relevant information, instructions, and approvals to the consultant team.

Informal communication is expected to occur between the Client and the consultant team. It is important that a record of any informal communications expressing key information, instructions and approvals from the Client be provided to the Project Manager and circulated to other members of the consultant team as appropriate.

All written communication (email or hard copies) between the consultant team shall be copied to the Project Manager.

Communication between members of the consultant team shall be unrestricted. Each party shall ensure that all other members of the team are kept fully informed of all matters relating to the project.

Verbal Communication

The most common means of communication; may be in person, via web meeting platform, or telephone. Verbal communication should be confirmed in writing or by email when possible. Unnecessary written correspondence is discouraged.

External Communication

The Project Manager and Stakeholder Engagement Manager will develop relationships with DOER, DCAMM, and other agencies as necessary to ensure project objectives are met and input is received.

Electronic Transmittals

Documents should be transmitted as attachments to emails rather than being embedded in the text of the message whenever possible.

Meetings

Meeting are a central method of communication in the project. In all cases meetings shall be planned and coordinated to ensure efficiency and effectiveness:

1. Meetings shall be coordinated in advance to ensure maximum participation and minimum disruption to scheduled activities
2. Meeting invitations shall be extended electronically via Microsoft Outlook for ease of tracking attendance and integration with electronic calendars
3. Invitations shall be directed to key individual based on the intent of the meeting. Additional attendees may be added as "optional" as necessary

4. Meeting agenda shall be disseminated to attendees at minimum 2 days before the scheduled meeting and convey the intent and topics of discussion
5. Meeting notes shall be taken by BR+A and disseminated to all attendees no later than 2 days after the meeting
6. Meeting notes shall clearly list any action items for tracking

Tools

The Project Team will utilize several tools to manage the project.

SharePoint

SharePoint web-based collaborative platform that integrates with Microsoft Office. It should be used as a document management and storage system for the duration of the project and house key project documents relevant to the Project Team.

RFI Log

The Project Manager shall use an RFI Log to track information requests submitted to the Client. The Client shall use the RFI Log to view and manage requests. The RFI Log may be transmitted electronically when necessary and shall be located in the SharePoint Client folder. See Appendix A for the RFI log.

Teams

Teams is a web-based communication platform developed by Microsoft. Teams offers a communal workspace as well as a forum for audio and video meetings. Teams will primarily be used as a meeting venue with the Client.

DRAFT

Goal	Method	Responsible	Audience
Obtain site-specific data, documentation	RFI	Michael Swenson	AEMP Steering Committee, Energy Manager
Obtain site-specific knowledge	Virtual meeting, survey, phone	Michael Swenson	FM, Office of Sustainability, AEMP Steering Committee
Project status update	Web-based meeting	Michael Swenson	Project Team
Stakeholder engagement	Web-based meeting, electronic survey	Andraya Lombardi	Project Team, Stakeholders
Interim deliverable dissemination	Email, SharePoint access	Michael Swenson	AEMP Steering Committee
Interim deliverable feedback	Email, web-based meeting	AEMP Steering Committee	Project Manager

Table 2 - Communication Plan

Approvals

The following deliverables will require feedback and approval by the Client:

1. Project Management Plan
2. 30-Year Energy Forecast (2-week review period)
3. Alternatives Analysis (2-week review period)
4. Final AEMP Report (4-week comment period)

DRAFT

Risk and Issue Management Plan

The risk register is a management tool that logs potential risks to the project, primarily driven by Health and Safety, cost, project delays or any other risks that may be relevant to the successful completion of the project.

The objectives of risk management are:

1. To identify risks to the project before they occur
2. Eliminate risks whenever possible
3. Develop management plans and contingencies to mitigate the impact of risks should they occur
4. Mitigate the impact of a risk occurring

DRAFT

#	Risk Areas	Explanation	Probability (1-5)	Impact (1-5)	Prevention	Responsible
1	Data validation	Missing or erroneous data collected from the Client can impact subsequent tasks	5	2	Identify gaps and irregularities during Task 1. Determine whether data can be utilized in subsequent tasks	Michael Swenson
2	Project funding compliance	Project is funded through the "Leading by Example Clean Energy Grant Program" and as such must meet grant requirements	1	5	Integrate DOER into the project during the initiation phase to ensure that project scope and deliverables align with funding program guidelines	Michael Swenson Andraya Lombardi
3	Stakeholder engagement	Project intent is to engage students, faculty, staff, and the broader community. Wide stakeholder outreach can broaden project scope and objectives based on conflicting input.	3	3	Form an AEMP steering committee to provide a central channel for input and ideas.	Andraya Lombardi UML
4	COVID-19	Project is being executed during a pandemic, as such travel and access to the campus is limited. Not only is there a risk of infection for field work, the team's ability to collect on-site information may be restricted.	3	5	CDC coronavirus guidelines as well as BR+A COVID-19 policy must be adhered to for all field work. Any onsite work will be cleared with the Client in advance. Project work shall be remote to the extent possible, meetings, deliverable reviews, and fact finding shall utilize remote technology in lieu of face-to-face interactions.	Project Team

Table 3 - Risk Register

Appendix B – RFI Log

Date	Request	Responsible Party	Name	Response	Status
4/19/2021	Clarify if there is a preferred discount rate to be used for life cycle cost exercises.	UML	Abrahamson, Dan	5% tentative.	Closed
3/25/2021	Cost of past PV projects.	UML	Abrahamson, Dan		Closed
3/15/2021	Confirm utility prices for use: \$X/therm (gas) \$X/kWh (elec) \$X/kVa (elec demand) Tariffs	UML	Abrahamson, Dan		Closed
3/15/2021	Provide UML facilities labor rates	UML	Abrahamson, Dan	Prevailing rates	Closed
3/15/2021	Clarify E0484 FY2002 emission baseline.	UML	O'Mahony, Ruairi	FY2007 data as baseline	Closed

DRAFT

<p>9/17/2020</p>	<p>No CBEI info.</p> <ul style="list-style-type: none"> • 110 Canal • 1301 Middlesex • 150 Wilder - Desmarais House • 175 Cabot Street • 193-199 Pawtucket • 3 Dane Ave • 45 Lawrence Drive • 49 East Meadow Lane • 5 Lawrence Dr • 61 East Meadow Lane • 820 Broadway • Allen House • Alumni Hall • Andover Imaging and Research Labs (not included in boundary) • Boott Cotton Mills (not included in boundary) • Charles Hoff Alumni Scholarship Center • Coburn Hall (energy model to be shared by UML) • East Parking Garage • Graduate and Professional Studies Center 	<p>Abrahamson, Dan</p>	<p>110 Canal</p> <p>There is no CBEI meter for 110 Canal. Energy data can be found using the cumulative report and aggregating the six accounts associated with this account.</p> <ul style="list-style-type: none"> • 1301 Middlesex <p>This is a terminated lease and do not own any utilities at this site, per A.Baacke's email on 10/6/20</p> <ul style="list-style-type: none"> • 150 Wilder - Desmarais House <p>There is no CBEI meter for this location. Energy data can be found using the cumulative report and aggregating the accounts associated with this address</p> <ul style="list-style-type: none"> • 175 Cabot Street • 193-199 Pawtucket <p>The university demolished the building, per A.Baacke's email on 10/6/20</p> <ul style="list-style-type: none"> • 3 Dane Ave <p>The university demolished the building, per A.Baacke's email on 10/6/20</p> <ul style="list-style-type: none"> • 45 Lawrence Drive <p>No CBEI data. Can use cumulative report to get energy data</p> <ul style="list-style-type: none"> • 49 East Meadow Lane <p>This is sold and no longer owned by the university, per A.Baacke's email on 10/6/20</p> <ul style="list-style-type: none"> • 5 Lawrence Dr <p>This is one of the addresses of the townhouses at River Hawk Village (along with 15 & 21 Lawrence Dr, 61 & 77 Perkins Street). There is no CBEI data, but energy data can be aggregated using the associated energy accounts for these locations</p> <ul style="list-style-type: none"> • 61 East Meadow Lane <p>This is sold and no longer owned by the university, per A.Baacke's email on 10/6/20</p> <ul style="list-style-type: none"> • 820 Broadway <p>this can be found in the cumulative report - please refernce addresses and aggregate in reports</p> <ul style="list-style-type: none"> • Allen House <p>No CBEI data or cumulative report data available</p> <ul style="list-style-type: none"> • Alumni Hall 	<p>Closed</p>
------------------	---	------------------------	---	---------------

DRAFT

No CBEI data or cumulative report data available

- Andover Imaging and Research Labs

Omit from study

- Boott Cotton Mills

Omit from study

- Charles Hoff Alumni Scholarship Center

No CBEI data or cumulative report data available

- Coburn Hall

no cbei data or cumulative data. we are working on comissioning meters there now. May be able to provide energy report from construction documents

- East Parking Garage

This can be found in the cumulative report

- Graduate and Professional Studies Center

This can be found in the cumulative report

<p>9/17/2020</p>	<p>No CBEI info.</p> <ul style="list-style-type: none"> Falmouth Annex Grounds Maint. Garage Harbor Place at Haverhill (outside of scope) LeLacheur Park (outside of scope) North Parking Garage North Plant (gas) Office Services & Central Receiving Perry Hall Pinanski Hall Pulichino Tong Business Center Rist Urban Agriculture Farm River Hawk Village River Hawk Village Townhouses South Maintenance Facility South Parking Garage South Plant (gas) UMass Lowell Bellegarde Boathouse UMass Lowell Research Institute (Dan to follow up) 	<p>UML</p>	<p>Abrahamson, Dan</p>	<ul style="list-style-type: none"> Falmouth Annex Grounds Maint. Garage This is the north power plant building; not the north power plant main connect. There is electric. No heat or steam Harbor Place at Haverhill (outside of scope) outside scope LeLacheur Park (outside of scope) outside scope North Parking Garage this electric consumption can be found in the cumulative report North Plant (gas) This is the north campus main meter for all of north campus steam. there is no gas for the building itself Office Services & Central Receiving this can be found in the cumulative report Perry Hall This should be available Pinanski Hall This should be available Pulichino Tong Business Center this can be found in the cumulative report. we are commissioning meters to load into Hatch at this time Rist Urban Agriculture Farm this is an umbrella under donahue hall River Hawk Village this can be found in the cumulative report - please reference addresses and aggregate in reports River Hawk Village Townhouses this can be found in the cumulative report - please reference addresses and aggregate in reports South Maintenance Facility this can be found in the cumulative report - please reference addresses and aggregate in reports South Parking Garage this can be found in the cumulative report South Plant (gas) this is south campus main meters UMass Lowell Bellegarde Boathouse 	<p>Closed</p>
------------------	---	------------	------------------------	--	---------------

this can be found in the cumulative report -
 please refernece addresses and aggregate
 in reports

- UMass Lowell Research Institute
 (Dan to follow up)

DRAFT

				<p>this can be found in the cumulative report - please refernece addresses and aggregate in reports</p> <ul style="list-style-type: none"> • UMass Lowell Research Institute (Dan to follow up) 	
<p>9/17/2020</p>	<p>Costello Athletic Center and Dandeneau Hall both have negative steam values. Could you speak to any of these anomalies?</p>	<p>UML</p>	<p>Abrahamson, Dan</p>		<p>Closed</p>

<p>10/13/2020</p>	<p>The following buildings have incomplete 2019 electricity data.</p> <ul style="list-style-type: none"> -Campus Recreation Center (2 weeks in May) -Costello Athletic Center (Jun-Oct) -Kitson Hall (2 weeks in April) -Leitch Hall (0 consumption Jul-Dec) -Lydon Library (Sep-Oct) -Saab_ETIC (Apr) -Sheehy Hall -Weed Hall (2 weeks Mar-Apr) 	<p>UML</p>	<p>Abrahamson, Dan</p>	<p>The following buildings have incomplete 2019 electricity data.</p> <ul style="list-style-type: none"> -Campus Recreation Center (2 weeks in May) <ul style="list-style-type: none"> - I don't see this gap. CRC was used as an emergency hospital during COVID shutdown -Costello Athletic Center (Jun-Oct) <ul style="list-style-type: none"> - Construction project led to meter shut down -Kitson Hall (2 weeks in April) <ul style="list-style-type: none"> - Construction -Leitch Hall (0 consumption Jul-Dec) <ul style="list-style-type: none"> - leitch electric meter has not worked for some time. Awaiting DCAMM action to fix -Lydon Library (Sep-Oct) <ul style="list-style-type: none"> - Construction -Saab_ETIC (Apr) <ul style="list-style-type: none"> - Construction -Sheehy Hall <ul style="list-style-type: none"> - Sheehy electric meter has not worked for some time. Awaiting DCAMM action to fix -Weed Hall (2 weeks Mar-Apr) <ul style="list-style-type: none"> - Construction 	<p>Closed</p>
-------------------	--	------------	----------------------------	--	---------------

DRAFT

10/13/2020	<p>The following buildings have incomplete 2018 electricity data.</p> <ul style="list-style-type: none"> -Costello Athletic Center (Apr-Jun) -Cumnock Hall (4 sporadic weeks Sept-Oct) -Dandeneau_Hall (Nov) -Falmouth_Hall (Jan, Jun, Oct) -Leitch_Hall ("0" consumption Jan-Feb) -Mahoney Hall (Apr-Jun) -North Heating Plant (Apr-May) -O'Leary Library (May-Jun, Sept-Nov) -Recreation Center (May-Jul) -South Heating Plant (Apr, Jun-Jul) 	UML	Abrahamson, Dan	<ul style="list-style-type: none"> -Costello Athletic Center (Apr-Jun) construction -Cumnock Hall (4 sporadic weeks Sept-Oct) unknown -Dandeneau Hall (Nov) unknown -Falmouth Hall (Jan, Jun, Oct) unknown -Leitch Hall ("0" consumption Jan-Feb) leitch electric meter has not worked for some time. Awaiting DCAMM action to fix -Mahoney Hall (Apr-Jun) construction -North Heating Plant (Apr-May) unknown -O'Leary Library (May-Jun, Sept-Nov) unknown -Recreation Center (May-Jul) unknown. this can be found -South Heating Plant (Apr, Jun-Jul) unknown 	Closed
10/13/2020	<p>BR+A (11/3/20): Discussion required on how to strategy to develop energy profile.</p> <p>BR+A (10/13/20): The following buildings have incomplete 2019 natural gas data.</p> <ul style="list-style-type: none"> -Saab_ETIC (sporadic 0 consumption) 	UML	Abrahamson, Dan	construction	Closed
10/13/2020	<p>BR+A (11/3/20): Discussion required on how to strategy to develop energy profile.</p> <p>BR+A (10/13/20): The following buildings have incomplete 2019 steam data.</p> <ul style="list-style-type: none"> -Falmouth_Hall ("0" consumption majority of year) -Mahoney Hall (Apr-Aug) 	UML	Abrahamson, Dan	unknown - potentially construction, but nothing should have affected Falmouth for that long	Closed

DRAFT

10/13/2020	The following buildings have incomplete 2018 steam data. -Mahoney Hall (Apr-Aug) -O'Leary Library (negative values) -Pinanski Hall ("0" consumption majority of year)	UML	Abrahamson, Dan		Closed
10/13/2020	Clarify anomaly steam spikes at Olsen Hall (i.e. 2018-04-15T05:00:00.000Z)	UML	Abrahamson, Dan	- Steam condensate spikes are consistent with central Steam boiler start ups	Closed
10/13/2020	The following buildings have duplicate 2019 Jan-Jun steam entries with mismatching data. Clarify correct data set. -Mahoney Hall -O'Leary_Library -Olney Hall -Olsen Hall -Sheehy Hall -Southwick Hall -Weed Hall	UML	Abrahamson, Dan	- Double check to see if duplicate data is still there - If it is still there, please point out where you are seeing this	Closed
10/13/2020	The following buildings have duplicate steam entries with mismatching data. Clarify correct data set. -Pinanski Center	UML	Abrahamson, Dan	- Double check to see if duplicate data is still there - If it is still there, please point out where you are seeing this	Closed
10/16/2020	Provide hydro study.	UML	Mary Ankner-Usovicz	- DA Changed to Mary Ankner_Usovicz - BR+A to confirm hydrogen or hydroturbine?	n/A
1/20/2021	Scheduling of the East Campus buildings' walkthrough	UML	Abrahamson, Dan		Closed
1/19/2021	Follow up from Ruairi/Zac (CES) regular call and feedback on other schools' assumptions (to inform 30-year forecast)	UML	O'Mahony, Ruairi	Information received. UML 30-year emissions forecast will take a more conservative approach assuming that MA will meet RPS requirement (80% energy generation from renewables sources by 2050) as opposed to Dartmouth analysis which assumes zero emission grid by 2050.	Closed

1/19/2021	<p>Connect Brendan (mechanical lead) and Dan M. (electrical lead) with folks who can provide an overview of the central steam plants (for Brendan) and electrical infrastructure (Dan M.) and answer any questions they may have given gaps in available documentation in the Project Archive (old steam plant drawings, electrical site plans, campus electrical one-line, etc.).</p> <ol style="list-style-type: none"> 1. Confirm how campus is served by electrical utility company: <ol style="list-style-type: none"> a. Quantity of utility feeds and voltage? b. Primary metered or secondary metered? c. Have there been discussions with the utility company regarding capacity on the lines serving the campus? 2. Confirm how the campus distribution is configured: <ol style="list-style-type: none"> a. Is there a primary voltage distribution network that is managed by the campus? b. Is it a loop, radial, or other type configuration? c. How is the primary switching set up on campus? Switches on site, outside buildings? Noted switches on-site, outside of building for North and South campuses. d. How are the transformers for the buildings typically configured? Pad mounted outside of buildings? Noted some indoor during our site walkthrough (i.e. Ball Hall). 3. Transformer information: <ol style="list-style-type: none"> a. Could you provide asset database of the main transformers for each building? <p>Question about the North Power Plant: I have in my notes that the boiler sizes are 2x400HP (replaced ~2015) and 1x300HP (backup - ~1960s) in speaking with the plant operator. In reviewing the drawings with our engineering team, they state (1) 400 HP, (1) 800 HP, and (1) 900 HP.</p>	UML	Abrahamson, Dan		Closed
10/31/2020	List of contact names from NGRID	UML	Abrahamson, Dan	Keith Miller - keith.miller2@nationalgrid.com - energy efficiency Sejal Shah - sejal.shah@nationalgrid.com -	Closed

DRAFT

				<p>fleet EV Andrea Moshier - andrea.moshier@nationalgrid.com - engagement</p>	
10/16/2020	<p>Provide updated greenhouse gas accounting and language governing scope (i.e. how lease spaces in buildings not fully occupied by UML are addressed).</p>	UML	O'Mahony, Ruairi	<p>GHG inventory from last FY should be finalized by Friday 10/23. Will send complete info by email to BR+A team. Methodology for including buildings/emissions in GSF from AASHE STARS Program: Gross floor area of building space</p> <p>Gross floor area of building space refers to the total amount of building space that is included within the</p> <p>institutional boundary. Any standard definition of building space may be used (e.g. ASHRAE,</p> <p>ANSI/BOMA, IECC) as long as it is used consistently. Parking structures are included. For guidance on</p> <p>calculating gross square footage of a building, you may also consult 3.2.1 Gross Area of the U.S.</p> <p>Department of Education's Postsecondary Education Facilities Inventory and Classification Manual.</p> <p>Buildings within the overall STARS boundary that the institution leases entirely (i.e. the institution is the only tenant) should be included.</p> <p>Buildings that are not owned by the institution and in which the institution is one of multiple tenants may</p>	Closed

DRAFT

DRAFT

be excluded. If the institution chooses to include such buildings, it must include all multi-tenant buildings

that are included in the institution's overall STARS boundary and in which the institution is a tenant;

institutions cannot choose to include some leased spaces and omit others. If an institution chooses to

include leased spaces, the institution should count only the square footage of building space it occupies

and not the entire building.

				<p>be excluded. If the institution chooses to include such buildings, it must include all multi-tenant buildings</p> <p>that are included in the institution's overall STARS boundary and in which the institution is a tenant;</p> <p>institutions cannot choose to include some leased spaces and omit others. If an institution chooses to</p> <p>include leased spaces, the institution should count only the square footage of building space it occupies</p> <p>and not the entire building.</p>	
10/31/2020	Confirm Steering Committee appointees	UML	O'Mahony, Ruairi		Closed
10/31/2020	List of UML Policy and Grants received and submissions	UML	Mary Ankner-Usovicz		Closed
10/31/2020	MassCEC Grant with Guidehouse (previously Navigant)	UML	Mary Ankner-Usovicz		Closed

9/17/2020	Provide access to the following resources: • Previous enrollment and future projections (Sheri and Adam may be best) - lump with facilities meeting	UML	Abrahamson, Dan	- requested reporting from Ruairi 10/20/20. Ruairi provided relevant links to this request and suggested Sheri Barich as a contact - requested reporting info from Sheri Barich 10/20/20 - historic enrollment can be found here: https://www.uml.edu/institutional-research/facts-at-a-glance.aspx ; future enrollment will be constrained by unfavorable demographics but stability or modest growth is expected in North Campus colleges and ZCHS while declines are likely in FAHSS.	Closed
9/17/2020	Cumnock Hall does not have steam info available. Is this data available from another source? Mike (11/3/20): BR+A will estimate steam consumption based on buildings of similar size and type.	UML	Abrahamson, Dan	No. We are working to bring the steam condensate meter online as of 11/3/2020	Closed
10/13/2020	The following buildings have incomplete 2018 natural gas data. -Saab_ETIC (Dec "0" consumption)	UML	Abrahamson, Dan	construction	Closed
10/16/2020	Provide required attendees for Metering Data Management phase review as well as point of contacts for RFI log and site visits.	UML	Abrahamson, Dan	Dan Abrahamson, Energy Manager, daniel_abrahamson@uml.edu JR Santangelo, BMS, james_santangelo@uml.edu Randy Branson, Assoc. Director of MEP Operations, Randolph_branson@uml.edu Ruairi TJ	Closed
10/16/2020	Provide required attendees for 30-Year Forecast phase review as well as point of contacts for research integration and capital planning review.	UML	Abrahamson, Dan	Facilities Sustainability Administration Faculty	Closed
10/16/2020	Provide required attendees for Default Case phase review as well as the following life cycle cost metrics: energy costs, maintenance costs, discount rate, and target payback.	UML	Abrahamson, Dan	Facilities Sustainability Administration Faculty	Closed

10/16/2020	Provide required attendees for Alternative Case phase review.	UML	Abrahamson, Dan	Facilities Sustainability Administration Faculty	Closed
10/16/2020	Provide required attendees for Investment Plan phase review.	UML	Abrahamson, Dan	Facilities Sustainability Administration Faculty	Closed
10/16/2020	Provide required attendees for Final Report review.	UML	Abrahamson, Dan	Facilities Sustainability Administration Faculty Steering Committee	Closed
10/13/2020	Clarify if steam was turned off in these buildings during the time periods noted below. -Concordia Hall ("0" consumption Jul-Sep) -Duggan Hall ("0" consumption Jul-Sep) -Durgin Hall ("0" consumption Jul) -HSS Building ("0" consumption Jul-Sep) --Sheehy Hall ("0" consumption Jul) -Weed Hall ("0" consumption Jul 2018)	UML	Abrahamson, Dan	Confirmed	Closed
9/17/2020	Provide access to the following resources: • On-site renewable generation	UML	Abrahamson, Dan	List of login information can be found here Issues with firewall. Potential data gap issues 4-5 yr Dugan issue (potential driver) All owned	Closed

9/17/2020	Provide access to the following resources: <ul style="list-style-type: none"> E-builder Capital planning (post-2023) - lump with facilities meeting 	UML	Baacke, Adam	COVID-19 has disrupted capital planning significantly. Resource constraints that existed prior to COVID have been exacerbated. Priorities for major capital investment remain phased renovations of Olsen and Olney Halls but timing is uncertain. Weed Hall and Ball Hall are likely the next candidates for more significant investment. Smaller scale capital spending will likely focus on addressing deferred maintenance, modernizing instructional and research labs, and supporting projects that bring external funding. Post-COVID planning is just beginning but will likely yield additional recommendations including repurposing space in response to successful remote and virtual work and instructional models.	Closed
10/13/2020	UML org chart	UML	Baacke, Adam	UMass Lowell Org Charts	Closed
10/16/2020	Provide Sightline reports.	UML	Abrahamson, Dan	Sightlines data can be found here	Closed
10/16/2020	Provide "no fly zones" for geothermal given historic land. Lump into facilities discussion.	UML	Baacke, Adam	Map of historic sites on or near UMass Lowell campus	Closed
10/16/2020	Provide previous solar PV studies.	UML	Baacke, Adam	In-house evaluation of possible solar sites	Closed
10/16/2020	Provide hazard mitigation plan	UML	Baacke, Adam	Hazard Mitigation Plan	Closed

<p>9/17/2020</p>	<p>Please provide the "built date" for the following facilities.</p> <ul style="list-style-type: none"> • Rist Urban Agriculture Farm • South Maintenance Facility • Office Services & Central Receiving • Charles Hoff Alumni Scholarship Center • East Maintenance Facility • 45 Lawrence Drive • Andover Imaging and Research Labs • Boott Cotton Mills • UMass Lowell Research Institute • Harbor Place at Haverhill • 175 Cabot Street • River Hawk Village Townhouses • 110 Canal • Graduate and Professional Studies Center • Hall Street Parking Garage • River Hawk Village 	<p>UML</p>	<p>Baacke, Adam</p>	<p>Assuming "built date" references the most recent comprehensive renovation not the original date of construction (if different), the following apply:</p> <ul style="list-style-type: none"> • Rist Urban Agriculture Farm - 2017 • South Maintenance Facility - 2017 • Office Services & Central Receiving - 2017 • Charles Hoff Alumni Scholarship Center - 2014 • East Maintenance Facility - ca. 1985 • 45 Lawrence Drive - 2018 • Andover Imaging and Research Labs - 2020 • Boott Cotton Mills - 2017 (TURI) • UMass Lowell Research Institute - 2020 • Harbor Place at Haverhill - 2017 • 175 Cabot Street - various - 2000-2019 • River Hawk Village Townhouses - 2014 • 110 Canal - 2015/2018 • Graduate and Professional Studies Center - 2020 • Hall Street Parking Garage - 2009 • River Hawk Village - 2009 	<p>Closed</p>
------------------	--	------------	---------------------	--	---------------

DRAFT

9/17/2020	<p>Could you please advise if any of the properties below would be under an alias, are no longer owned by UML, or are otherwise not included in the database for some other reason?</p> <ul style="list-style-type: none"> • LeLacheur Park • Falmouth Annex • Grounds Maint. Garage • 61 East Meadow Lane • 5 Lawrence Dr • 49 East Meadow Lane • 3 Dane Ave • 193-199 Pawtucket • 1301 Middlesex 	UML	Abrahamson, Dan	<ul style="list-style-type: none"> • LeLacheur Park – This is a City-owned facility. UMass Lowell is a tenant user. UMass does own some of the property immediately adjacent to the ballpark though. • Grounds Maint. Garage – This was repurposed and renamed as the Falmouth Annex in the Space Inventory. • 61 East Meadow Lane – This was sold and is no longer owned by the university. • 5 Lawrence Dr – This is one of the addresses of the townhouses at River Hawk Village (along with 15 & 21 Lawrence Drive and 61 & 77 Perkins Street) • 49 East Meadow Lane – This was sold and is no longer owned by the university. • 3 Dane Ave – The university demolished the building that was on this parcel and it is now part of the Salem Street parking lot. • 193-199 Pawtucket – The university demolished the buildings that were located on these parcels and constructed the Northern Canal Overlook. There are no active utility services to the overlook. • 1301 Middlesex – we are still receiving utility bills for this location – This was a property that was leased by the university but we terminated the lease in March 2020. We should not be receiving or paying utility bills for this location. 	Closed
9/17/2020	<p>Provide access to the following resources:</p> <ul style="list-style-type: none"> • UMass Lowell’s Utility Tracker/CBEI (energy tracking) • Plant and buildings’ meter data 	UML	Abrahamson, Dan		Closed
9/17/2020	<p>Provide access to the following resources:</p> <ul style="list-style-type: none"> • Plants and buildings’ drawings 	UML	Ourique, Larry		Closed
9/17/2020	<p>Provide access to the following resources:</p> <ul style="list-style-type: none"> • Campus Viewer • Photospheres 	UML	Locke, Pam		Closed
9/17/2020	<p>Provide access to the following resources:</p> <ul style="list-style-type: none"> • Building management system 	UML	Abrahamson, Dan		Closed

DRAFT

Appendix C – Space Types



Building Name	End Use	Core End Use
150 Wilder - Desmarais House	Office	Office/Classroom
175 Cabot Street	Engineering Lab	Lab
820 Broadway	Office	Office/Classroom
Allen House	Office	Office/Classroom
Ames Textile	High-use Lab	Lab
Ball Hall	Classroom	Office/Classroom
Bourgeois Hall	Residential	Residential
Campus Recreation Center	Fitness Center	Office/Classroom
Charles Hoff Alumni Scholarship Center	Office	Office/Classroom
Coburn Hall	Classroom	Office/Classroom
Concordia Hall	Residential	Residential
Costello Athletic Center	Fitness Center	Office/Classroom
Cumnock Hall	Office	Office/Classroom
Dandeneau Hall	Classroom	Office/Classroom
Donahue Hall	Residential	Residential
Dugan Hall	Classroom	Office/Classroom
Durgin Hall	Performance	Office/Classroom
East Maintenance Facility	Maintenance	Other
East Parking Garage	Garage	Other
Falmouth Hall	Classroom	Office/Classroom
Fox Hall	Residential (Dining)	Residential
Graduate and Professional Studies Center	Office	Office/Classroom
Health & Social Sciences Building	Classroom	Office/Classroom
110 Canal	High-use Lab	Lab
Kitson Hall	Classroom	Office/Classroom
Leitch Hall	Residential	Residential
UMass Lowell Research Institute	Classroom	Office/Classroom
Lydon Library	Library	Office/Classroom
Mahoney Hall	Classroom	Office/Classroom
McGauvran Center	Office (Dining)	Office/Classroom
North Parking Garage	Garage	Other
North Power Plant	Plant	
O'Leary Library	Library	Office/Classroom
Olney Hall	Engineering Lab	Lab
Olsen Hall	Classroom	Office/Classroom
Perry Hall	Engineering Lab	Lab
Pinanski Hall	Engineering Lab	Lab
Pulichino Tong Business Center	Classroom	Office/Classroom
Rist Urban Agriculture Farm	Greenhouse	Other
River Hawk Village	Residential	Residential
Saab Emerging Technologies & Innovation Center	High-use Lab	Lab
Sheehy Hall	Residential	Residential
South Maintenance Facility	Maintenance	Other

South Parking Garage	Garage	Other
South Power Plant	Plant	
Southwick Hall	Office (Dining)	Office/Classroom
Tsongas Center at UMass Lowell	Ice Rink	Other
UMass Lowell Bellegarde Boathouse	Recreation	Other
UMass Lowell Inn & Conference Center	Conference center	Residential
University Crossing	Office (Dining)	Office/Classroom
University Suites Residence Hall	Residential	Residential
Wannalancit Business Center	Office	Office/Classroom
Weed Hall	Engineering Lab	Lab

DRAFT

Appendix D – Solar Photovoltaic Generation Supplemental Information

The table graphs below compare hourly 2019 building electricity demand to solar PV demand for Costello Athletic Center and Leitch Hall. Similar to Bourgeois Hall, Dugan Hall solar demand rarely exceeds building demand. Inversely, Costello's solar demand often exceeds its building demand in the summer. This may be a higher priority candidate for microgrid and/or battery storage particularly given its variable building use. Missing information for Costello makes it difficult to provide a complete analysis.

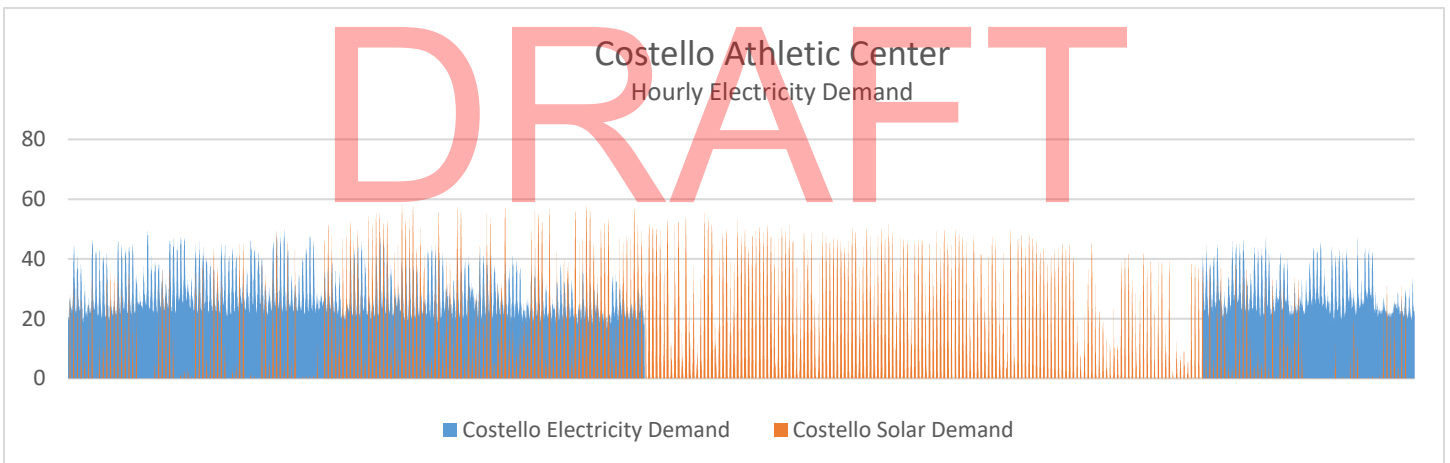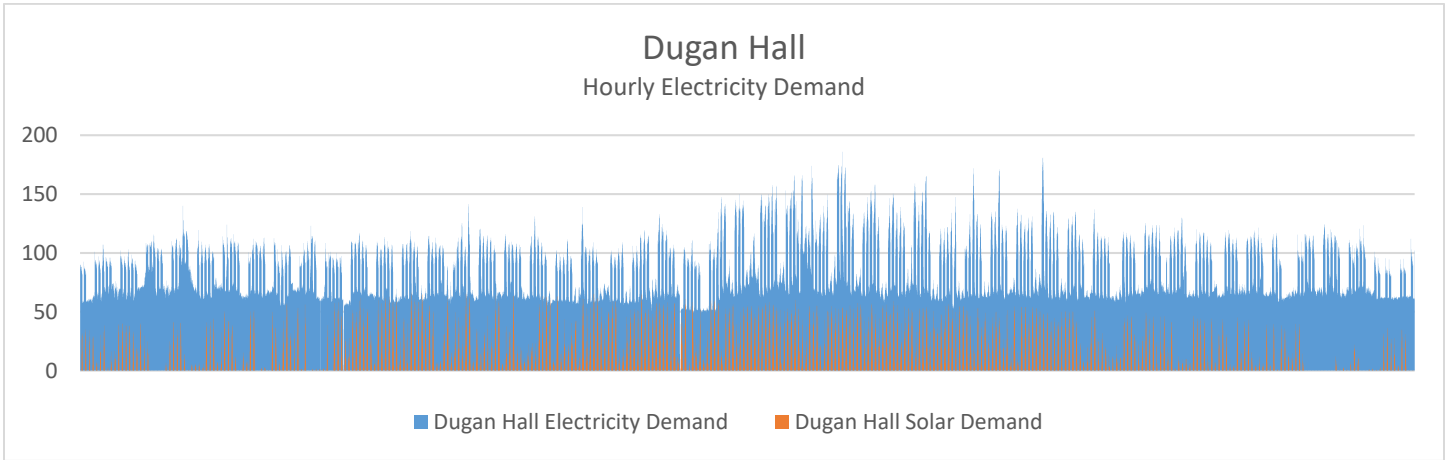

Appendix E – Building Scores

Building Name	Score Weighting Factors						
	22%	6%	22%	22%	22%	6%	
	Building Priority Scores						
	Energy Use Intensity	Energy Change	EUI Target	Combustion Emissions	Facility Condition	Precinct Priority	Overall Score (0-100)
Ball Hall	85	0	92	87	94	100	85
O'Leary Library	77	46	90	90	46	100	75
Dugan Hall	73	72	86	60	74	100	75
Concordia Hall	67	96	84	62	98	0	74
Kitson Hall	75	0	88	69	74	100	73
Olney Hall	92	0	42	96	74	100	73
Ames Textile	100	0	98	54	46	100	72
McGauvran Center	96	0	94	81	12	100	68
Lydon Library	56	74	76	52	74	100	67
Sheehy Hall	54	46	74	65	98	0	67
Bourgeois Hall	60	80	80	67	74	0	67
Mahoney Hall	52	86	70	50	74	100	65
Weed Hall	88	0	30	75	74	100	65
Fox Hall	79	0	60	94	22	100	62
Perry Hall	90	46	34	63	46	100	60
Southwick Hall	62	0	46	44	94	100	60
Cumnock Hall	65	0	82	46	46	100	59
Saab Emerging Technologies & Innovation Center	98	0	50	88	0	100	58
Durgin Hall	87	0	72	79	22	0	57
Campus Recreation Center	83	0	64	71	12	100	57
Wannalancit Business Center	50	100	68	56	22	100	55
Tsongas Center at UMass Lowell	69	0	52	83	46	0	55
River Hawk Village	38	0	44	85	46	100	53
University Crossing	63	0	48	92	22	0	50
South Maintenance Facility	94	0	100	31	0	0	49

University Suites Residence Hall	44	82	58	73	22		48
UMass Lowell Inn & Conference Center	71	0	56	77	12	0	48
Donahue Hall	52	78	62	58	22	0	47
Health & Social Sciences Building	58	0	78	48	22	0	45
East Maintenance Facility	81	0	96	29	0	0	45
820 Broadway	48	84	66	21	46	0	45
Leitch Hall	29	76	26	40	74	0	42
Olsen Hall	37	0	40	37	46	100	41
Pulichino Tong Business Center	35	46	38	42	22	100	39
Pinanski Hall	19	90	4	25	74	100	38
Costello Athletic Center	25	88	12	33	46	100	37
150 Wilder - Desmarais House	42	0	54	19	46	0	36
Coburn Hall	31	46	32	35	12	100	33
Graduate and Professional Studies Center	27	46	24	38	46	0	33
175 Cabot Street	23	46	8	23	74	0	31
Charles Hoff Alumni Scholarship Center	33	0	36	17	46	0	29
Falmouth Hall	21	0	14	15	46	100	27
UMass Lowell Bellegarde Boathouse	40	0	28	27	12	0	24
Dandeneau Hall	15	0	10	0	22	100	16
Allen House	0	46	16	0	46	0	16
East Parking Garage	12	94	0	0	22	0	13
North Parking Garage	13	46	6	0	22	0	12
South Parking Garage	0	46	16	0	22	0	11
110 Canal	17	46	2	0	0	0	7
UMass Lowell Research Institute	0	46	16	0	0	0	6

Below is a table of the calculated data which was used to calculate the building scores.

Building Name	Energy Use Intensity	Energy Change		EUI Target		Combustion Emissions	Facility Condition			
	2019 EUI	2018 EUI	2018-19 Change	Reference EUI	% Off EUI target	2019 Non-electrical Emissions (Tons)	0-4 Exterior	0-3 Interior	0-1 Architectural Preference	Facility Condition
150 Wilder - Desmarais House	57	59	-4.5%	25	55.8%	17	1	2	0	0.99
175 Cabot Street	16	0	0.0%	100	-541.3%	21	2	1	1	1.32
820 Broadway	63	56	13.0%	25	60.6%	20	1	2	0	0.99
Allen House	0	0	0.0%	25	0.0%	0	1	2	0	0.99
Ames Textile	1037	1041	-0.5%	150	85.5%	192	1	1	1	0.99
Ball Hall	124	128	-2.7%	25	79.9%	491	3	3	0	1.98
Bourgeois Hall	97	94	4.0%	25	74.4%	238	2	2	0	1.32
Campus Recreation Center	122	127	-4.1%	50	58.9%	296	1	0	0	0.33
Charles Hoff Alumni Scholarship Center	39	46	-14.9%	25	36.3%	11	1	1	1	0.99
Coburn Hall	33	0	0.0%	25	25.2%	45	0	0	1	0.33
Concordia Hall	105	77	36.7%	25	76.3%	211	4	3	0	2.31
Costello Athletic Center	20	17	17.4%	50	-155.6%	43	2	1	0	0.99
Cumnock Hall	105	86	21.8%	25	76.3%	158	2	0	1	0.99
Dandeneau Hall	5	7	-32.5%	25	-414.8%	0	1	1	0	0.66
Donahue Hall	61	59	3.6%	25	58.9%	207	1	1	0	0.66
Dugan Hall	116	114	1.7%	25	78.4%	209	1	3	0	1.32
Durgin Hall	131	169	-22.5%	45	65.6%	344	1	1	0	0.66
East Maintenance Facility	121	125	-3.1%	20	83.5%	39	0	0	0	0
East Parking Garage	0	0	34.9%	10	-2182.7%	0	1	1	0	0.66

Falmouth Hall	11	20	-47.2%	25	-134.0%	1	2	1	0	0.99
Fox Hall	121	125	-3.5%	50	58.6%	863	1	1	0	0.66
Graduate and Professional Studies Center	26	0	0.0%	25	2.4%	64	2	1	0	0.99
Health & Social Sciences Building	84	84	-0.4%	25	70.1%	183	1	1	0	0.66
110 Canal	9	0	0.0%	150	-1571.6%	0	0	0	0	0
Kitson Hall	117	120	-3.3%	25	78.5%	252	2	2	0	1.32
Leitch Hall	27	26	3.1%	25	7.4%	67	2	2	0	1.32
UMass Lowell Research Institute	0	0	0.0%	25	0.0%	0	0	0	0	0
Lydon Library	79	76	3.0%	25	68.2%	191	2	2	0	1.32
Mahoney Hall	73	64	13.0%	25	65.6%	184	2	2	0	1.32
McGauvran Center	254	276	-7.8%	50	80.3%	346	1	0	0	0.33
North Parking Garage	1	0	0.0%	10	-998.6%	0	1	1	0	0.66
North Power Plant	0	11876	0.0%	0	0.0%	5649	0	0	0	0
O'Leary Library	117	49	0.0%	25	78.7%	569	2	1	0	0.99
Olney Hall	186	189	-1.1%	100	46.4%	1412	2	2	0	1.32
Olsen Hall	43	51	-16.1%	25	41.8%	46	2	1	0	0.99
Perry Hall	145	0	0.0%	100	31.2%	211	2	1	0	0.99
Pinanski Hall	9	8	17.9%	100	-1009.9%	31	3	1	0	1.32
Pulichino Tong Business Center	42	0	0.0%	25	40.0%	107	1	1	0	0.66
Rist Urban Agriculture Farm	0	0	0.0%	10	0.0%	0	0	0	0	0
River Hawk Village	48	63	-23.3%	25	47.9%	476	1	1	1	0.99
Saab Emerging Technologies & Innovation Center	316	469	-32.6%	150	52.6%	522	0	0	0	0

Sheehy Hall	78	0	0.0%	25	67.9%	217	4	3	0	2.31
South Maintenance Facility	205	237	-13.8%	20	90.2%	39	0	0	0	0
South Parking Garage	0	0	0.0%	10	0.0%	0	1	1	0	0.66
South Power Plant	0	9071	0.0%	0	0.0%	3101	0	1	0	0
Southwick Hall	99	106	-7.4%	50	49.3%	134	4	2	0	1.98
Tsongas Center at UMass Lowell	109	120	-8.9%	50	54.1%	434	2	0	1	0.99
UMass Lowell Bellegarde Boathouse	55	77	-27.9%	50	9.4%	34	0	1	0	0.33
UMass Lowell Inn & Conference Center	114	120	-5.2%	50	55.8%	322	1	0	0	0.33
University Crossing	99	104	-4.9%	50	49.4%	688	1	1	0	0.66
University Suites Residence Hall	58	56	4.2%	25	56.8%	306	1	1	0	0.66
Wannalancit Business Center	68	42	60.2%	25	63.0%	192	1	1	0	0.66
Weed Hall	132	89	48.3%	100	24.4%	310	2	2	0	1.32

Appendix F – Metering Sources by Building

Building Name	Utility Energy Meter				End-use Energy Meter								
	Electric	Natural Gas	Steam	Condensate	Heating Hot Water	Chilled Water	Cooling Tower	Condenser Water	Fans	Pumps	Lighting	Domestic Hot Water	Plug Loads
150 Wilder - Desmarais House	Cumulative	Cumulative											
175 Cabot Street	Cumulative	¹											
820 Broadway	Cumulative	Cumulative											
Allen House	BMS		BMS										
Ames Textile	Hatch	Hatch											
Ball Hall	Hatch			Hatch									
Bourgeois Hall	Hatch, BMS	Hatch											
Campus Recreation Center	Hatch	Hatch											
Charles Hoff Alumni Scholarship Center	Cumulative	Cumulative											
Coburn Hall	Hatch/BMS ²		Hatch ²	Hatch, BMS	BMS				BMS		BMS		
Concordia Hall	Hatch		Hatch										
Costello Athletic Center	Hatch		Hatch ²	Hatch ³									
Cummock Hall	Hatch		Hatch										
Dandeneau Hall	Hatch			BMS	BMS				BMS				
Donahue Hall	Hatch	Hatch											
Dugan Hall	Hatch			Hatch									
Durgin Hall	Hatch			Hatch ³									
East Maintenance Facility	Cumulative	Cumulative											
East Parking Garage	Cumulative												
Falmouth Hall	Hatch, BMS			Hatch	BMS				BMS				
Fox Hall	Hatch	Hatch							BMS				
Graduate and Professional Studies Center	¹	¹											
Health & Social Sciences Building	Hatch			Hatch	BMS		BMS		BMS	BMS			
110 Canal	Cumulative	¹											
Kitson Hall	Hatch			Hatch									
Leitch Hall	Hatch, BMS	Hatch											
UMass Lowell Research Institute	¹	¹											
Lydon Library	Hatch			Hatch									
Mahoney Hall	Hatch			Hatch					BMS ⁸				
McGauvran Center	Hatch, BMS	Hatch, BMS											
North Parking Garage	Cumulative												
North Power Plant	Hatch	Cumulative											
O'Leary Library	Hatch			Hatch ³									
Olney Hall	Hatch			Hatch									
Olsen Hall	Hatch			Hatch ³									
Perry Hall	Hatch	Hatch	Hatch, BMS		Hatch, BMS	BMS ⁶		BMS	BMS			BMS	
Pinanski Hall	¹		¹										
Pulichino Tong Business Center	Hatch	Hatch/BMS			BMS	BMS ⁶	BMS	BMS	BMS	BMS			
Rist Urban Agriculture Farm	¹												
River Hawk Village	Cumulative	Cumulative			BMS	BMS							
Saab Emerging Technologies & Innovation	Hatch	Hatch					BMS		BMS	BMS			
Sheehy Hall	Hatch			Hatch ³									
South Maintenance Facility	Cumulative	Cumulative											
South Parking Garage	¹												
South Power Plant	Hatch	BMS ⁵	BMS ⁵										
Southwick Hall	Hatch			Hatch									
Tsongas Center at UMass Lowell	Hatch	Hatch											
UMass Lowell Bellegarde Boathouse	Hatch ⁴	Hatch ⁴											
UMass Lowell Inn & Conference Center	Hatch	Hatch											
University Crossing	Hatch	Hatch					BMS		BMS	BMS			
University Suites Residence Hall	Hatch	Hatch			BMS ⁵	BMS							
Wannalancit Business Center	Hatch	Hatch			BMS								
Weed Hall	Hatch			Hatch									

General Notes
 Refer to "Data Omissions and Anomalies" for more details on metering omissions
 Redundant information may be available in Cumulative Report for utility meters
 BMS data could not be used for this analysis given insufficient trend practices

Footnotes
 Meter information not available¹
 Meter may not longer be active²
 Verify calibration (negative values reported)³
 Information is not sufficient to inform analysis. Cumulative Report used.⁴
 Meters information available for individual boilers. Steam, natural gas, fuel oil available for North and South Power Plants.⁵
 Multiple chilled water loop meter information available⁶

Appendix G – EIA New England Data

The tables below are excerpts from the U.S. Energy Information Administration’s (EIA) Annual Energy Outlook (AEO), Table 2.1.

Calendar Year	Total Electricity (quads): Baseline Economic Growth	Year Over Year Change	Total Electricity (quads): High economic growth	Year Over Year Change	Total Electricity (quads): Low economic growth	Year Over Year Change
2020	0.172179	-1.3%	0.172158	-1.3%	0.172379	-1.2%
2021	0.171677	-0.3%	0.171722	-0.3%	0.17186	-0.3%
2022	0.170807	-0.5%	0.170928	-0.5%	0.170965	-0.5%
2023	0.170476	-0.2%	0.170619	-0.2%	0.170522	-0.3%
2024	0.170213	-0.2%	0.170328	-0.2%	0.170227	-0.2%
2025	0.16962	-0.3%	0.169853	-0.3%	0.16973	-0.3%
2026	0.169049	-0.3%	0.16906	-0.5%	0.169013	-0.4%
2027	0.167788	-0.7%	0.168214	-0.5%	0.16773	-0.8%
2028	0.167811	0.0%	0.168487	0.2%	0.1676	-0.1%
2029	0.168835	0.6%	0.169494	0.6%	0.16799	0.2%
2030	0.16909	0.2%	0.17021	0.4%	0.168814	0.5%
2031	0.169816	0.4%	0.170383	0.1%	0.169409	0.4%
2032	0.170248	0.3%	0.17077	0.2%	0.169931	0.3%
2033	0.170687	0.3%	0.171111	0.2%	0.170238	0.2%
2034	0.17099	0.2%	0.171492	0.2%	0.170527	0.2%
2035	0.171978	0.6%	0.17253	0.6%	0.17135	0.5%
2036	0.172638	0.4%	0.173182	0.4%	0.171946	0.3%
2037	0.173602	0.6%	0.173954	0.4%	0.17267	0.4%
2038	0.174064	0.3%	0.174791	0.5%	0.173396	0.4%
2039	0.174821	0.4%	0.175755	0.6%	0.17432	0.5%
2040	0.1756	0.4%	0.176733	0.6%	0.175221	0.5%
2041	0.176651	0.6%	0.177827	0.6%	0.176331	0.6%
2042	0.17778	0.6%	0.179021	0.7%	0.177541	0.7%
2043	0.179072	0.7%	0.180386	0.8%	0.178964	0.8%
2044	0.180499	0.8%	0.181734	0.7%	0.180426	0.8%
2045	0.182044	0.9%	0.183238	0.8%	0.182029	0.9%
2046	0.183623	0.9%	0.184737	0.8%	0.183596	0.9%
2047	0.185381	1.0%	0.186638	1.0%	0.185458	1.0%
2048	0.187359	1.1%	0.188701	1.1%	0.187312	1.0%
2049	0.189519	1.2%	0.190956	1.2%	0.18939	1.1%
2050	0.191692	1.1%	0.193684	1.4%	0.191678	1.2%

Calendar Year	Total Natural Gas (quads): Baseline Economic Growth	Year Over Year Change	Total Natural Gas (quads): High economic growth	Year Over Year Change	Total Natural Gas (quads): Low economic growth	Year Over Year Change
2020	0.215041	-4.3%	0.215041	-4.3%	0.215041	-4.3%
2021	0.220069	2.3%	0.219952	2.3%	0.219934	2.3%
2022	0.218866	-0.5%	0.218803	-0.5%	0.218892	-0.5%
2023	0.217921	-0.4%	0.217585	-0.6%	0.217834	-0.5%
2024	0.21667	-0.6%	0.216185	-0.6%	0.216615	-0.6%
2025	0.215062	-0.7%	0.214666	-0.7%	0.214971	-0.8%
2026	0.214543	-0.2%	0.21421	-0.2%	0.214388	-0.3%
2027	0.214912	0.2%	0.214638	0.2%	0.214676	0.1%
2028	0.215587	0.3%	0.2155	0.4%	0.215293	0.3%
2029	0.216629	0.5%	0.21651	0.5%	0.216374	0.5%
2030	0.217965	0.6%	0.217851	0.6%	0.217749	0.6%
2031	0.219031	0.5%	0.21894	0.5%	0.218874	0.5%
2032	0.219806	0.4%	0.219655	0.3%	0.21971	0.4%
2033	0.220423	0.3%	0.220195	0.2%	0.220407	0.3%
2034	0.221005	0.3%	0.220741	0.2%	0.221036	0.3%
2035	0.221596	0.3%	0.221324	0.3%	0.221687	0.3%
2036	0.222152	0.3%	0.221931	0.3%	0.222339	0.3%
2037	0.222756	0.3%	0.222611	0.3%	0.222936	0.3%
2038	0.223376	0.3%	0.223251	0.3%	0.223485	0.2%
2039	0.224018	0.3%	0.223882	0.3%	0.224067	0.3%
2040	0.224612	0.3%	0.224489	0.3%	0.224664	0.3%
2041	0.225103	0.2%	0.225013	0.2%	0.225175	0.2%
2042	0.225635	0.2%	0.225558	0.2%	0.225502	0.1%
2043	0.226095	0.2%	0.225953	0.2%	0.225771	0.1%
2044	0.226413	0.1%	0.226234	0.1%	0.225956	0.1%
2045	0.226795	0.2%	0.226416	0.1%	0.226193	0.1%
2046	0.227152	0.2%	0.226617	0.1%	0.226302	0.0%
2047	0.227446	0.1%	0.22686	0.1%	0.226421	0.1%
2048	0.227686	0.1%	0.227234	0.2%	0.226446	0.0%
2049	0.227979	0.1%	0.227674	0.2%	0.22655	0.0%
2050	0.228294	0.1%	0.227928	0.1%	0.226707	0.1%

Appendix H – Building Cooling Equipment

The rough estimates below were developed based on the building management systems and building plans. These results will be updated as part of BR+A-Anser’s site visits scheduled for January 2021. Note that maintenance facilities are not expected to need cooling.

Building Name	Primary Cooling Type	Secondary Cooling Type	Primary Cooling square footage	Secondary Cooling square footage	No Cooling square footage
150 Wilder - Desmarais House	None		0%	-	0%
820 Broadway	DX Cooling		0%	-	0%
Allen House	Air-cooled Chiller		100%	7,607	0%
Ames Textile	DX Cooling		100%	7,985	0%
Ball Hall	Air-cooled Chiller	ASHP	50%	46,198	50%
Bourgeois Hall	DX Cooling		25%	13,245	0%
Campus Recreation Center	Water-cooled Chiller		100%	62,185	0%
Charles Hoff Alumni Scholarship Center	DX Cooling		100%	5,815	0%
Coburn Hall	Air-cooled Chiller		100%	67,889	0%
Concordia Hall	None		0%	0	0%
Costello Athletic Center	None		0%	-	0%
Cumnock Hall	ASHP	Window AC	25%	8,692	25%
Dandeneau Hall	Water-cooled Chiller	Window AC	75%	33,127	25%
Donahue Hall	Water-cooled Chiller		25%	20,398	0%
Dugan Hall	DX Cooling		100%	52,643	0%
Durgin Hall	Water-cooled Chiller		100%	70,865	0%
Falmouth Hall	DX Cooling	Window AC	25%	12,323	50%
Fox Hall	Air-cooled Chiller		70%	137,334	0%
Graduate and Professional Studies Center	Air-cooled Chiller		100%	50,119	0%
Health & Social Sciences Building	Water-cooled Chiller		100%	63,237	0%
110 Canal	DX Cooling		100%	48,364	0%
Kitson Hall	Window AC		75%	34,884	0%
Leitch Hall	DX Cooling		25%	13,192	0%
Lydon Library	Air-cooled Chiller		100%	67,329	0%
Mahoney Hall	Window AC		75%	37,796	0%

McGauvran Center	Air-cooled Chiller		100%	44,756	0%
O'Leary Library	Water-cooled Chiller		100%	109,788	0%
Olney Hall	Water-cooled Chiller	Window AC	25%	51,388	50%
Olsen Hall	Air-cooled Chiller	Water-cooled Chiller	50%	58,382	50%
Perry Hall	Water-cooled Chiller		100%	50,158	0%
Pinanski Hall	Water-cooled Chiller	Window AC	50%	29,848	25%
Pulichino Tong Business Center	Water-cooled Chiller		100%	51,345	0%
Rist Urban Agriculture Farm	WSHP		100%	197,841	0%
River Hawk Village	Water-cooled Chiller		100%	73,637	0%
Saab Emerging Technologies & Innovation Center	None		0%	-	0%
Sheehy Hall	Water-cooled Chiller		100%	109,788	0%
South Maintenance Facility					
Southwick Hall	DX Cooling	Air-cooled Chiller	75%	46,735	25%
Tsongas Center at UMass Lowell	Air-cooled Chiller		100%	181,230	0%
UMass Lowell Bellegarde Boathouse	Window AC		100%	11,272	
UMass Lowell Inn & Conference Center	DX Cooling		100%	163,946	0%
University Crossing	Water-cooled Chiller		100%	202,969	0%
University Suites Residence Hall	Water-cooled Chiller		100%	124,323	0%
Wannalancit Business Center	DX Cooling		100%	122,721	0%
Weed Hall	Water-cooled Chiller		100%	63,469	0%

Appendix I – UML Enrollment Data

The table below is based on reporting from The Office of Strategic Analysis and Data Management (UML), “Enrollment at a Glance.”

Calendar Year	On-campus (undergrad)	Year-over-year change	On-campus (grad)	Total Off Campus	On-Campus %
Fall 2007	2,228		20	7,156	24%
Fall 2008	2,597	17%	26	7,452	26%
Fall 2009	2,930	13%	31	8,124	27%
Fall 2010	3,032	3%	31	9,054	25%
Fall 2011	3,064	1%	40	9,624	24%
Fall 2012	3,092	1%	36	10,280	23%
Fall 2013	3,461	12%	52	10,489	25%
Fall 2014	3,775	9%	56	10,521	26%
Fall 2015	3,979	5%	47	10,615	27%
Fall 2016	4,010	1%	50	11,009	27%
Fall 2017	3,581	-11%	37	11,943	23%
Fall 2018	4,466	25%	66	11,175	29%

DRAFT

Appendix J – UML Operating Revenue Data

The table below is based on reporting from the Budget & Financial Planning Office (UML), “Annual Budget & Financial Reports.”

Fiscal Year	Millions \$	Year-over-year change
FY2007	116.1	
FY2008	129.4	11%
FY2009	149.3	15%
FY2010	170.5	14%
FY2011	189.3	11%
FY2012	203.8	8%
FY2013	220.8	8%
FY2014	244	11%
FY2015	270.1	11%
FY2016	286	6%
FY2017	299	5%
FY2018	313	5%

DRAFT

Appendix K – Energy Forecast Data

The table below shows the estimated year-over-year energy forecast broken down into electricity consumption and natural gas consumption. The baseline year is based on CES reporting for calendar year 2019. Adjustment factors have been determine using data from EIA AEO as well as UML specific factors accounting for space conversions to lab and expanding cooling operation.

Calendar Year	Electricity (kBtu)	Electrical Adjustment Factor	Natural Gas (kBtu)	Natural Gas Adjustment Factor	Total (kBtu)
2019	228,712,706		262,977,500		491,690,206
2020	227,191,022	-0.7%	257,315,778	-2.2%	484,506,800
2021	226,859,826	-0.1%	260,324,004	1.2%	487,183,830
2022	226,285,002	-0.3%	259,612,478	-0.3%	485,897,480
2023	226,065,748	-0.1%	259,052,012	-0.2%	485,117,760
2024	225,891,368	-0.1%	258,308,453	-0.3%	484,199,821
2025	225,497,880	-0.2%	257,349,945	-0.4%	482,847,825
2026	225,442,815	0.0%	257,686,516	0.1%	483,129,331
2027	224,926,392	-0.2%	258,556,061	0.3%	483,482,454
2028	225,265,473	0.2%	259,612,230	0.4%	484,877,704
2029	226,276,923	0.4%	260,892,410	0.5%	487,169,333
2030	226,773,410	0.2%	262,352,905	0.6%	489,126,316
2031	227,586,567	0.4%	263,654,126	0.5%	491,240,693
2032	228,203,542	0.3%	264,783,520	0.4%	492,987,063
2033	228,826,145	0.3%	265,820,935	0.4%	494,647,080
2034	229,358,526	0.2%	266,840,266	0.4%	496,198,792
2035	230,351,199	0.4%	267,868,011	0.4%	498,219,210
2036	231,124,680	0.3%	268,877,605	0.4%	500,002,285
2037	232,102,557	0.4%	269,919,208	0.4%	502,021,765
2038	232,745,391	0.3%	270,973,546	0.4%	503,718,937
2039	233,586,410	0.4%	272,044,298	0.4%	505,630,708
2040	234,442,965	0.4%	273,089,016	0.4%	507,531,982
2041	235,481,918	0.4%	274,074,174	0.4%	509,556,092
2042	236,573,270	0.5%	275,087,192	0.4%	511,660,462
2043	237,773,333	0.5%	276,059,297	0.4%	513,832,630
2044	239,062,876	0.5%	276,947,575	0.3%	516,010,451
2045	240,430,025	0.6%	277,877,580	0.3%	518,307,605
2046	241,818,712	0.6%	278,794,998	0.3%	520,613,710
2047	243,324,266	0.6%	279,676,439	0.3%	523,000,705
2048	244,972,531	0.7%	280,527,232	0.3%	525,499,762
2049	246,737,146	0.7%	281,413,107	0.3%	528,150,252
2050	248,506,724	0.7%	282,315,125	0.3%	530,821,849

Appendix L – Emissions Forecast Data

The table below shows the estimated year-over-year emissions forecast broken down into electricity emissions and natural gas emissions. The baseline year is based on CES reporting for calendar year 2019. Emissions conversion factors are based on current ISO-NE emissions. The reduction in the electricity emissions factor assumes Massachusetts meets the Clean Energy Standard of 80% carbon-free generation. Reduction is interpolated linearly between 2018 and 2050.

Calendar Year	Electricity (MTCDE)	Electricity (lbs/MWh)	Natural Gas (MTCDE)	Gas (lbs/MMBtu)	Total (MTCDE)
2019	21,003.32	627	15,384.18	117	36,387.50
2020	20,863.58	627	15,052.97	117	35,916.55
2021	20,312.33	611	15,228.95	117	35,541.29
2022	19,741.35	595	15,187.33	117	34,928.68
2023	19,203.22	580	15,154.54	117	34,357.76
2024	18,669.80	564	15,111.04	117	33,780.85
2025	18,119.58	548	15,054.97	117	33,174.55
2026	17,597.58	533	15,074.66	117	32,672.24
2027	17,040.88	517	15,125.53	117	32,166.41
2028	16,549.40	501	15,187.32	117	31,736.71
2029	16,104.21	486	15,262.21	117	31,366.42
2030	15,618.92	470	15,347.64	117	30,966.56
2031	15,152.43	454	15,423.77	117	30,576.19
2032	14,669.59	439	15,489.84	117	30,159.43
2033	14,184.27	423	15,550.52	117	29,734.79
2034	13,690.71	407	15,610.16	117	29,300.86
2035	13,221.11	392	15,670.28	117	28,891.39
2036	12,734.89	376	15,729.34	117	28,464.23
2037	12,255.90	360	15,790.27	117	28,046.18
2038	11,755.51	345	15,851.95	117	27,607.46
2039	11,261.71	329	15,914.59	117	27,176.30
2040	10,764.77	313	15,975.71	117	26,740.48
2041	10,271.85	298	16,033.34	117	26,305.19
2042	9,776.33	282	16,092.60	117	25,868.93
2043	9,280.04	266	16,149.47	117	25,429.50
2044	8,781.52	251	16,201.43	117	24,982.95
2045	8,279.76	235	16,255.84	117	24,535.59
2046	7,772.41	219	16,309.51	117	24,081.91
2047	7,262.17	204	16,361.07	117	23,623.24
2048	6,748.95	188	16,410.84	117	23,159.79
2049	6,231.10	172	16,462.67	117	22,693.77
2050	5,705.26	157	16,515.43	117	22,220.70

Appendix M – Site-by-site PV Modeling Results

#	Campus	Site Name	Type 1	Type 2	Mod- eled	PV Size > 100 kW	Size (kW-DC)	Annual Prod. (MWh)	Est. Cost (2021\$)	Reason for Exclusion from Modeling
1	East	110 Canal	Building	Flat Roof	X	X			\$ -	Insufficient area, green roof & mech. equip.
2	East	Ames Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area and tree shade
3	East	Ames Textile	Building	Flat Roof	X	X			\$ -	Insufficient area and tree shade
4	East	Bourgeois Hall	Building	Flat Roof	X	X			\$ -	Existing PV system
5	East	Campus Rec Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area, narrow lot dimension
6	East	Campus Rec. Center	Building	Flat/ Pitched	✓	✓	224.7	269.7	\$ 483,105	
7	East	Canal Lot	Parking	Surface Lot	✓	✓	289.1	372.6	\$ 1,156,400	
8	East	Charles Hoff Alumni Scholarship Center	Building	Pitched	X	X			\$ -	Insufficient area, bldg. shade
9	East	Donahue Hall	Building	Flat Roof	✓	✓	109.1	145.6	\$ 234,565	
10	East	East Parking Garage	Parking	Garage Lot	✓	✓	334.6	432.6	\$ 1,338,400	
11	East	Fletcher Lot	Parking	Surface Lot	✓	✓	317.3	401.8	\$ 1,269,200	
12	East	Fox Hall	Building	Flat Roof	X	X			\$ -	Insufficient area
13	East	Fox Lot	Parking	Surface Lot	✓	✓	307.5	389.1	\$ 1,230,000	
14	East	Fr. Morrisette Blvd	Parking	Surface Lot	✓	✓	157.4	197.4	\$ 629,600	

15	East	Graduate and Prof. Studies Center	Building	Flat Roof	✓	✗	41	53.74	\$ -	
16	East	Hall St. Garage	Parking	Garage Lot	✓	✓	362.4	464.4	\$ 1,449,600	
17	East	Lawrence Drive Lot	Parking	Surface Lot	✗	✗			\$ -	Insufficient area, shade from bldg.
18	East	Leitch Hall	Building	Flat Roof	✗	✗			\$ -	Has existing PV system
19	East	Lower Locks Garage	Parking	Garage Lot	✓	✓	469	606.6	\$ 1,876,000	
20	East	Merrimack Lot	Parking	Surface Lot	✗	✗			\$ -	Insufficient area, bldg. shade
21	East	Merrimack St. Lot	Parking	Surface Lot	✗	✗			\$ -	Insufficient area, tree and bldg shade
22	East	Pawtucket Visitor/ Metered Lot	Parking	Surface Lot	✗	✗			\$ -	Insufficient area, incompatible layout
23	East	Perkins Lot	Parking	Surface Lot	✓	✓	310	390.2	\$ 1,240,000	
24	East	River Hawk Village	Building	Flat Roof	✓	✓	180	243.3	\$ 387,000	
25	East	Salem Street/ Admissions Lot	Parking	Surface Lot	✓	✓	341.9	413.9	\$ 1,367,600	
26	East	Tremont Lot	Parking	Surface Lot	✓	✓	597.8	734.6	\$ 2,092,300	
27	East	Tsongas Center at UMass Lowell	Building	Flat/ Low Pitch	✓	✓	502.7	678.9	\$ 940,049	
28	East	Tsongas Lot B	Parking	Surface Lot	✓	✓	294.4	375.2	\$ 1,177,600	
29	East	University Crossing	Building	Flat Roof	✓	✓	109.5	143.3	\$ 235,425	
30	East	University Suites Residence Hall	Building	Flat Roof	✓	✓	103.7	133.3	\$ 222,955	
31	East	Wannalancit Business Center	Building	Flat Roof	✓	✓	223.5	300.8	\$ 480,525	

32	East	Wannalancit East Courtyard	Parking	Surface Lot	X	X			\$ -	Bldg. shade
33	North	Ball Hall	Building	Flat Roof	✓	✓	111.9	151.5	\$ 240,585	
34	North	Costello Athletic Center	Building	Flat Roof	X	X			\$ -	Existing PV system
35	North	Cross River Ctr. Lot	Parking	Surface Lot	✓	✓	2680	3460	\$ 9,380,000	
36	North	Cummnock Hall	Building	Flat Roof	✓	X	52.5	70.96	\$ -	
37	North	Cummnock Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area, bldg. shade
38	North	Dandeneau Hall	Building	Flat Roof	✓	X	35.7	47.78	\$ -	
39	North	Falmouth Hall	Building	Flat Roof	✓	X	90.2	120.2	\$ -	
40	North	Kitson Hall	Building	Flat Roof	✓	X	88.2	119.2	\$ -	
41	North	Lydon Library	Building	Flat Roof	✓	X	44.7	59.5	\$ -	
42	North	North Parking Garage	Parking	Garage Lot	✓	✓	306.7	385.1	\$ 1,226,800	
43	North	North Power Plant	Building	Flat Roof	X	X			\$ -	
44	North	Olney Hall	Building	Flat Roof	✓	✓	110.7	141.5	\$ 238,005	
45	North	Olsen Hall	Building	Flat Roof	✓	X	57	76.79	\$ -	
46	North	Olsen Lot	Parking	Surface Lot	X	X			\$ -	Narrow parking lot, bldg. shade
47	North	Perry Hall	Building	Flat Roof	✓	X	45.1	58.32	\$ -	
48	North	Pinanski Hall	Building	Flat Roof	✓	X	29.5	39.95	\$ -	
49	North	Pinanski/ Costello Lot	Parking	Surface Lot	✓	✓	171	215.7	\$ 684,000	

50	North	Pulichino Tong Business Center	Building	Flat Roof	✓	✗	69.7	93.67	\$ -	
51	North	Riverside Lot A	Parking	Surface Lot	✓	✓	528.9	684.1	\$ 1,851,150	
52	North	Riverside Lot B	Parking	Surface Lot	✓	✓	1020	1499	\$ 3,570,000	
53	North	Saab Emerging Technologies & Innovation Center	Building	Flat Roof	✓	✗	71.8	96.2	\$ -	
54	North	Southwick Hall	Building	Flat Roof	✓	✓	100.5	134.6	\$ 216,075	
55	North	Standish Visitor/ Metered Lot	Parking	Surface Lot	✓	✓	102.5	125.6	\$ 410,000	
56	North	UML Bellegarde Boathouse	Building	Pitched Roof	✓	✗	47.6	63.29	\$ -	
57	South	150 Wilder - Desmarais House	Building	Pitched Roof	✗	✗			\$ -	Insufficient usable roof area
58	South	820 Broadway	Building	Pitched Roof	✗	✗			\$ -	Insufficient usable roof area
59	South	Allen House	Building	Pitched Roof	✗	✗			\$ -	Insufficient usable roof area, tree shade
60	South	Broadway/ Riverview Lot	Parking	Surface Lot	✓	✓	1660	2127	\$ 5,810,000	
61	South	Coburn Hall	Building	Pitched Roof	✓	✗	48.4	62.27	\$ -	
62	South	Coburn Lot	Parking	Surface Lot	✓	✓	133.3	171.9	\$ 533,200	
63	South	Concordia Hall	Building	Flat Roof	✓	✗	29.9	38.98	\$ -	
64	South	Dugan Hall	Building	Flat Roof	✗	✗			\$ -	Existing PV system
65	South	Durgin Hall	Building	Flat Roof	✓	✗	32	42.63	\$ -	
66	South	Durgin Lot	Parking	Surface Lot	✗	✗			\$ -	Insufficient area, bldg. shade
67	South	Health & Social Sciences Building	Building	Flat Roof	✓	✗	34	43.33	\$ -	

68	South	Lower Mahoney Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area, constrained by bldg.
69	South	Mahoney Hall	Building	Flat Roof	✓	✓	166.1	221.6	\$ 357,115	
70	South	McGauvran Center	Building	Flat Roof	X	X			\$ -	Insufficient area
71	South	O'Leary Library	Building	Flat Roof	✓	✓	139.4	187.1	\$ 299,710	
72	South	Riverview Suites Lot	Parking	Surface Lot	✓	✓	171	216.4	\$ 684,000	
73	South	Sheehy Hall	Building	Flat Roof	✓	X	59.9	80.86	\$ -	
74	South	Solomont Way Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area
75	South	South Maintenance Facility	Building	-	X	X			\$ -	
76	South	South Parking Garage	Parking	Garage Lot	X	X			\$ -	Existing PV system
77	South	South Power Plant	Building	Flat Roof	X	X			\$ -	Insufficient area, bldg. shade
78	South	Upper Mahoney Lot	Parking	Surface Lot	X	X			\$ -	Insufficient area
79	South	Weed Hall	Building	Flat Roof	✓	X	59.2	67.75	\$ -	
80	South	Wilder Faculty/ Staff/ Visitor Lot	Parking	Surface Lot	✓	✓	823.7	1050	\$ 2,882,950	

Appendix N – Site-by-site BESS Requirements

#	Campus	Site Name	PV Location	PV Size >100 kW	Size (kW-DC)	Requires BESS for SMART	Min. BESS Rating (kW)	Min. BESS Rating (kWh)	Min. BESS Footprint (sq.ft.)	BESS Est. Cost. (2021\$)
1	East	110 Canal	Building	X		X				
2	East	Ames Lot	Parking	X		X				
3	East	Ames Textile	Building	X		X				
4	East	Bourgeois Hall	Building	X		X				
5	East	Campus Rec Lot	Parking	X		X				
6	East	Campus Recreation Center	Building	✓	224.7	X				
7	East	Canal Lot	Parking	✓	289.1	X				
8	East	Charles Hoff Alumni Scholarship Center	Building	X		X				
9	East	Donahue Hall	Building	✓	109.1	X				
10	East	East Parking Garage	Parking	✓	334.6	X				
11	East	Fletcher Lot	Parking	✓	317.3	X				
12	East	Fox Hall	Building	X		X				
13	East	Fox Lot	Parking	✓	307.5	X				
14	East	Fr. Morrissette Blvd	Parking	✓	157.4	X				
15	East	Graduate and Professional Studies Center	Building	X	41	X				
16	East	Hall St. Garage	Parking	✓	362.4	X				
17	East	Lawrence Drive Lot	Parking	X		X				
18	East	Leitch Hall	Building	X		X				
19	East	Lower Locks Garage	Parking	✓	469	X				
20	East	Merrimack Lot	Parking	X		X				
21	East	Merrimack Street Lot	Parking	X		X				
22	East	Pawtucket Visitor. Metered Lot	Parking	X		X				
23	East	Perkins Lot	Parking	✓	310	X				
24	East	River Hawk Village	Building	✓	180	X				
25	East	Salem Street/ Admissions Lot	Parking	✓	341.9	X				

DRAFT

26	East	Tremont Lot	Parking	✓	597.8	✓	149	298	86	\$ 298,000
27	East	Tsongas Center at UMass Lowell	Building	✓	502.7	✓	126	252	86	\$ 252,000
28	East	Tsongas Lot B	Parking	✓	294.4	✗				
29	East	University Crossing	Building	✓	109.5	✗				
30	East	University Suites Residence Hall	Building	✓	103.7	✗				
31	East	Wannalancit Business Center	Building	✓	223.5	✗				
32	East	Wannalancit East Courtyard	Parking	✗		✗				
33	North	Ball Hall	Building	✓	111.9	✗				
34	North	Costello Athletic Center	Building	✗		✗				
35	North	Cross River Center Lot	Parking	✓	2680	✓	670	1340	433	\$ 1,340,000
36	North	Cummnock Hall	Building	✗	52.5	✗				
37	North	Cummnock Lot	Parking	✗		✗				
38	North	Dandeneau Hall	Building	✗	35.7	✗				
39	North	Falmouth Hall	Building	✗	90.2	✗				
40	North	Kitson Hall	Building	✗	88.2	✗				
41	North	Lydon Library	Building	✗	44.7	✗				
42	North	North Parking Garage	Parking	✓	306.7	✗				
43	North	North Power Plant	Building	✗		✗				
44	North	Olney Hall	Building	✓	110.7	✗				
45	North	Olsen Hall	Building	✗	57	✗				
46	North	Olsen Lot	Parking	✗		✗				
47	North	Perry Hall	Building	✗	45.1	✗				
48	North	Pinanski Hall	Building	✗	29.5	✗				
49	North	Pinanski/ Costello Lot	Parking	✓	171	✗				
50	North	Pulichino Tong Business Center	Building	✗	69.7	✗				
51	North	Riverside Lot A	Parking	✓	528.9	✓	132	264	86	\$ 264,000
52	North	Riverside Lot B	Parking	✓	1020	✓	255	510	172	\$ 510,000
53	North	Saab Emerging Technologies & Innovation Center	Building	✗	71.8	✗				
54	North	Southwick Hall	Building	✓	100.5	✗				
55	North	Standish Visitor/ Metered Lot	Parking	✓	102.5	✗				

DRAFT

56	North	UMass Lowell Bellegarde Boathouse	Building	X	47.6	X				
57	South	150 Wilder - Desmarais House	Building	X		X				
58	South	820 Broadway	Building	X		X				
59	South	Allen House	Building	X		X				
60	South	Broadway/ Riverview Lot	Parking	✓	1660	✓	415	830	301	\$ 830,000
61	South	Coburn Hall	Building	X	48.4	X				
62	South	Coburn Lot	Parking	✓	133.3	X				
63	South	Concordia Hall	Building	X	29.9	X				
64	South	Dugan Hall	Building	X		X				
65	South	Durgin Hall	Building	X	32	X				
66	South	Durgin Lot	Parking	X		X				
67	South	Health & Social Sciences Building	Building	X	34	X				
68	South	Lower Mahoney Lot	Parking	X		X				
69	South	Mahoney Hall	Building	✓	166.1	X				
70	South	McGauvran Center	Building	X		X				
71	South	O'Leary Library	Building	✓	139.4	X				
72	South	Riverview Suites Lot	Parking	✓	171	X				
73	South	Sheehy Hall	Building	X	59.9	X				
74	South	Solomont Way Lot	Parking	X		X				
75	South	South Maintenance Facility	Building	X		X				
76	South	South Parking Garage	Parking	X		X				
77	South	South Power Plant	Building	X		X				
78	South	Upper Mahoney Lot	Parking	X		X				
79	South	Weed Hall	Building	X	59.2	X				
80	South	Wilder Faculty/ Staff/ Visitor Lot	Parking	✓	823.7	✓	206	412	129	\$ 412,000

DRAFT

DRAFT

Table of Contents

Ball Hall	3
Bellegarde Boathouse	5
Broadway Riverview Lot	8
Campus Rec Center	11
Canal Lot	13
Coburn House	15
Coburn Lot	17
Concordia House	19
Cross River Center Lot	21
Cumnock Hall	24
Dandeneau Hall	26
Donahue Hall	28
Durgin Hall	30
East Parking Garage	32
Falmouth Hall	34
Fletcher Lot	36
Fox Lot	38
Fr. Morrissette Blvd. Lot	40
Graduate and Professional Studies Center	42
Hall St. Garage	45
Health & Social Sciences Building	47
Kitson Hall	50
Lower Locks Garage	52
Lydon Library	54
Mahoney Hall	56
North Parking Garage	58
O'Leary Library	60
Olney Hall	62
Olsen Hall	64
Perkins Lot	66
Perry Hall	68
Pinanski Costello Lot	70
Pinanski Hall	72
Pulichino Tong Business Center	74
River Hawk Village	77
Riverside Lot A	79
Riverside Lot B	81
Riverview Suites Lot	83
Saab Emerging Tech & Innovation Center	85
Salem St Admissions Lot	88
Sheehy Hall	91
Southwick Hall	93
Standish Visitor Metered Lot	95

Tremont Lot	98
Tsongas Center	100
Tsongas Lot B	102
University Crossing	104
University Suites Residence Hall	106
Wannalancit Business Center	109
Weed Hall	112
Wilder Faculty, Staff, Visitor Lot	114

DRAFT

Ball Hall UML - Ball Hall, 185 Riverside St, Lowell, MA 01854

Report

Project Name	UML - Ball Hall
Project Address	185 Riverside St, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Ball Hall
Module DC Nameplate	111.9 kW
Inverter AC Nameplate	100.0 kW Load Ratio: 1.12
Annual Production	151.5 MWh
Performance Ratio	88.7%
kWh/kWp	1,353.9
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89


Project Location



Monthly Production

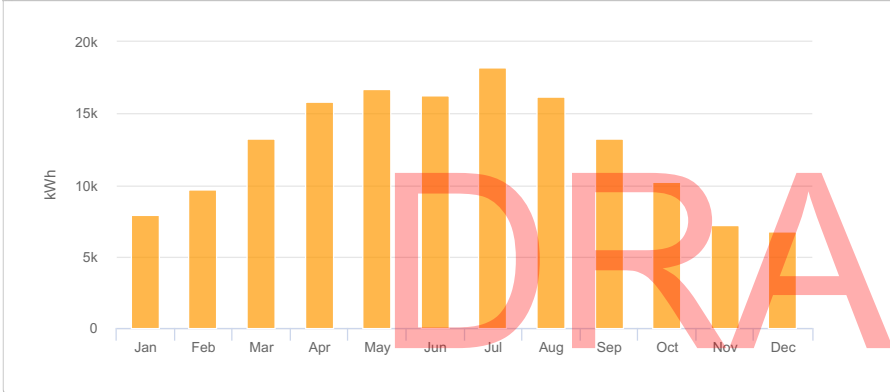

Sources of System Loss

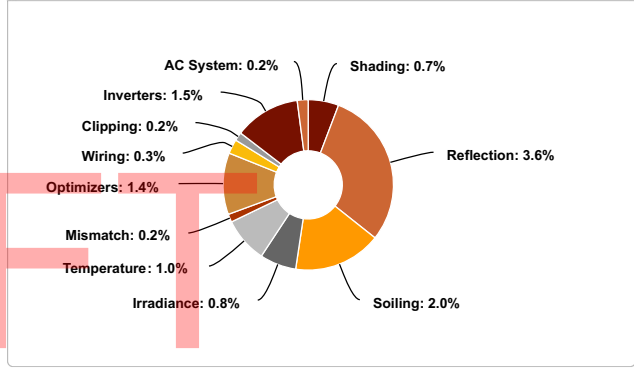

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.3	-0.7%
	Irradiance after Reflection	1,462.0	-3.6%
	Irradiance after Soiling	1,432.8	-2.0%
	Total Collector Irradiance	1,432.8	0.0%
Energy (kWh)	Nameplate	160,488.0	
	Output at Irradiance Levels	159,157.7	-0.8%
	Output at Cell Temperature Derate	157,520.9	-1.0%
	Output After Mismatch	157,234.1	-0.2%
	Optimizer Output	155,028.4	-1.4%
	Optimal DC Output	154,523.9	-0.3%
	Constrained DC Output	154,227.2	-0.2%
	Inverter Output	151,913.7	-1.5%
	Energy to Grid	151,536.6	-0.2%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1															
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)															
Solar Angle Location	Meteo Lat/Lng															
Transposition Model	Perez Model															
Temperature Model	Sandia Model															
Temperature Model Parameters	Rack Type	a	b	Temperature Delta												
	Fixed Tilt	-3.56	-0.075	3°C												
	Flush Mount	-2.81	-0.0455	0°C												
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D				
	2	2	2	2	2	2	2	2	2	2	2	2				
Irradiation Variance	5%															
Cell Temperature Spread	4° C															
Module Binning Range	-2.5% to 2.5%															
AC System Derate	0.50%															
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization	Spec Sheet Characterization, PAN	
	Component Characterizations	Device	Uploaded By						Characterization							

Components		
Component	Name	Count
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
AC Home Runs	1/0 AWG (Aluminum)	1 (143.9 ft)
Combiners	8 input Combiner	1
Strings	10 AWG (Copper)	8 (2,193.9 ft)
Optimizers	P850 (SolarEdge)	137 (116.5 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	273 (111.9 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	12	13-37	Along Racking
Wiring Zone 2	12	-	Along Racking
Wiring Zone 3	12	13-37	Along Racking




Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	289	273	111.9 kW
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1			0



Bellegarde Boathouse UML - UMass Lowell Bellegarde Boathouse, 500 Pawtucket Blvd. Lowell, MA 01854

Report	
Project Name	UML - UMass Lowell Bellegarde Boathouse
Project Address	500 Pawtucket Blvd. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Bellegarde Boathouse
Module DC Nameplate	47.6 kW
Inverter AC Nameplate	43.2 kW Load Ratio: 1.10
Annual Production	63.29 MWh
Performance Ratio	82.9%
kWh/kWp	1,330.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

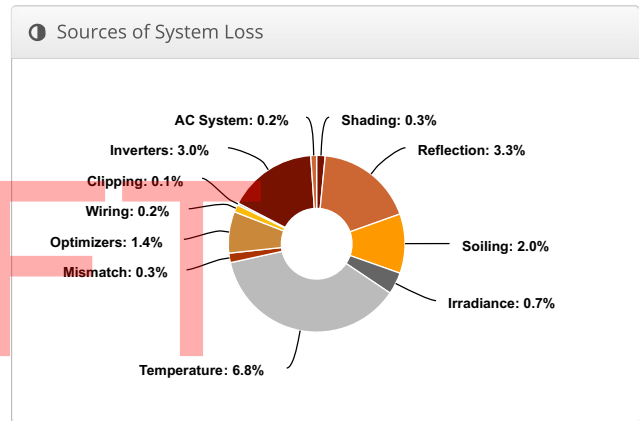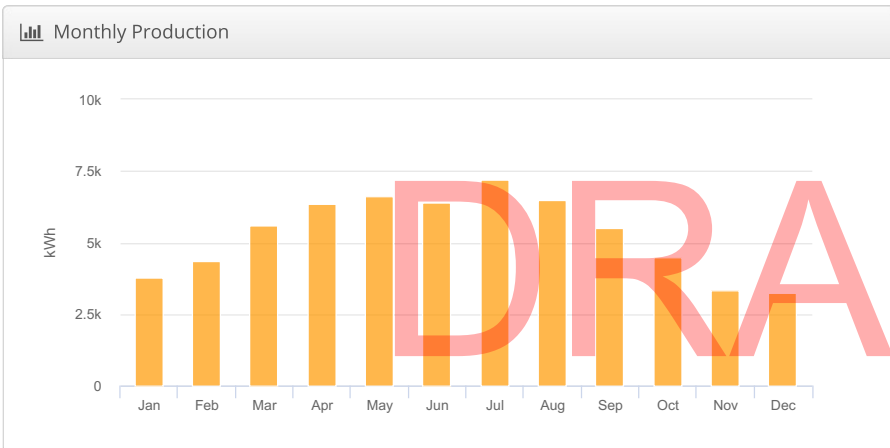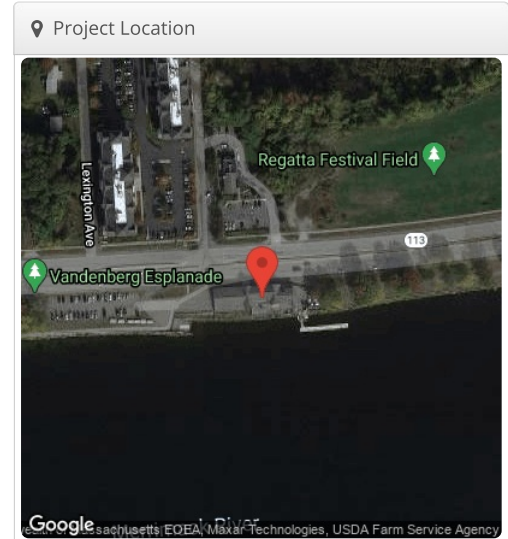

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,604.4	14.3%
	Shaded Irradiance	1,599.8	-0.3%
	Irradiance after Reflection	1,546.8	-3.3%
	Irradiance after Soiling	1,515.9	-2.0%
	Total Collector Irradiance	1,516.0	0.0%
Energy (kWh)	Nameplate	72,158.5	
	Output at Irradiance Levels	71,625.5	-0.7%
	Output at Cell Temperature Derate	66,729.2	-6.8%
	Output After Mismatch	66,515.3	-0.3%
	Optimizer Output	65,583.9	-1.4%
	Optimal DC Output	65,421.7	-0.2%
	Constrained DC Output	65,379.0	-0.1%
	Inverter Output	63,416.3	-3.0%
Energy to Grid	63,291.3	-0.2%	
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		28.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By					Characterization						
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs					Spec Sheet Characterization, PAN						
Component Characterizations	Device	Uploaded By					Characterization						

Components		
Component Name		Count
Inverters	SE14.4KUS (2020) (SolarEdge)	3 (43.2 kW)
AC Home Runs	8 AWG (Copper)	3 (606.3 ft)
Strings	10 AWG (Copper)	8 (958.8 ft)
Optimizers	P850 (2020) (SolarEdge)	60 (51.0 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	116 (47.6 kW)

Wiring Zones									
Description	Combiner Poles		String Size			Stringing Strategy			
Wiring Zone	-		13-15			Along Racking			
Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Flush Mount	Portrait (Vertical)	18.4°	176.5°	0.0 ft	1x1	75	75	30.8 kW
Field Segment 2	Flush Mount	Portrait (Vertical)	18.4°	176.5°	0.0 ft	1x1	30	30	12.3 kW
Field Segment 3	Flush Mount	Portrait (Vertical)	18.4°	176.5°	0.0 ft	1x1	11	11	4.51 kW




Detailed Layout



Broadway/ Riverview Lot UML - Broadway/ Riverview Lot, 322 Aiken St. Lowell, MA

Report	
Project Name	UML - Broadway/ Riverview Lot
Project Address	322 Aiken St. Lowell, MA
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Broadway/ Riverview Lot
Module DC Nameplate	1.66 MW
Inverter AC Nameplate	1.38 MW Load Ratio: 1.20
Annual Production	2,127 GWh
Performance Ratio	85.8%
kWh/kWp	1,279.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

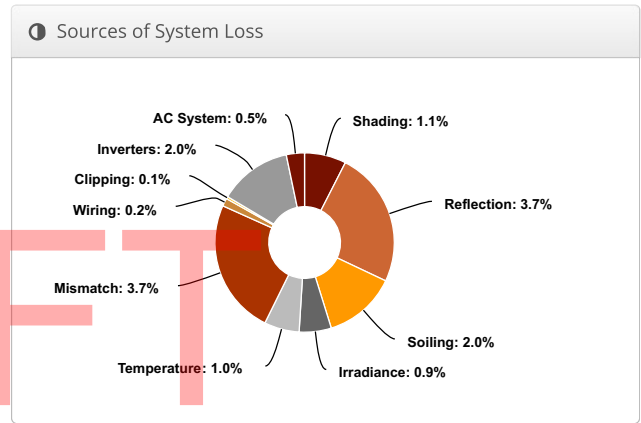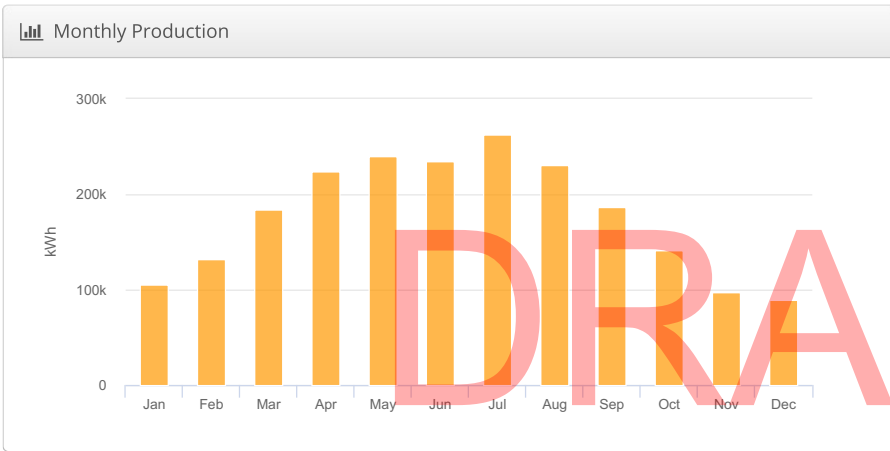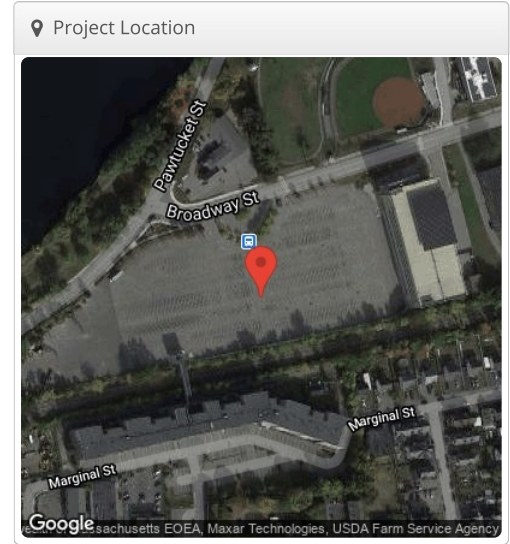

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.3	6.3%
	Shaded Irradiance	1,474.3	-1.1%
	Irradiance after Reflection	1,419.3	-3.7%
	Irradiance after Soiling	1,390.9	-2.0%
	Total Collector Irradiance	1,390.9	0.0%
Energy (kWh)	Nameplate	2,313,997.0	
	Output at Irradiance Levels	2,293,622.7	-0.9%
	Output at Cell Temperature Derate	2,271,571.1	-1.0%
	Output After Mismatch	2,187,247.2	-3.7%
	Optimal DC Output	2,182,505.1	-0.2%
	Constrained DC Output	2,181,197.1	-0.1%
	Inverter Output	2,137,550.1	-2.0%
	Energy to Grid	2,126,862.2	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By						Characterization				
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs						Spec Sheet Characterization, PAN				
Component Characterizations	Device	Uploaded By						Characterization				
	PVI 60TL (Solectria)	Folsom Labs						Spec Sheet				


Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	23 (1.38 MW)
Strings	10 AWG (Copper)	237 (42,273.4 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	4,055 (1.66 MW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Carport	Portrait (Vertical)	7°	167.77931793955986°	1.6 ft	5x1	86	430	176.3 kW	
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	86	430	176.3 kW	
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	86	430	176.3 kW	
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	98	490	200.9 kW	
Field Segment 1 (copy 3)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	123	615	252.2 kW	
Field Segment 1 (copy 4)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	147	735	301.4 kW	
Field Segment 1 (copy 5)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	68	340	139.4 kW	
Field Segment 1 (copy 6)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	59	295	121.0 kW	
Field Segment 1 (copy 7)	Carport	Portrait (Vertical)	7°	167.77931°	1.6 ft	5x1	58	290	118.9 kW	

DRAFT




Detailed Layout

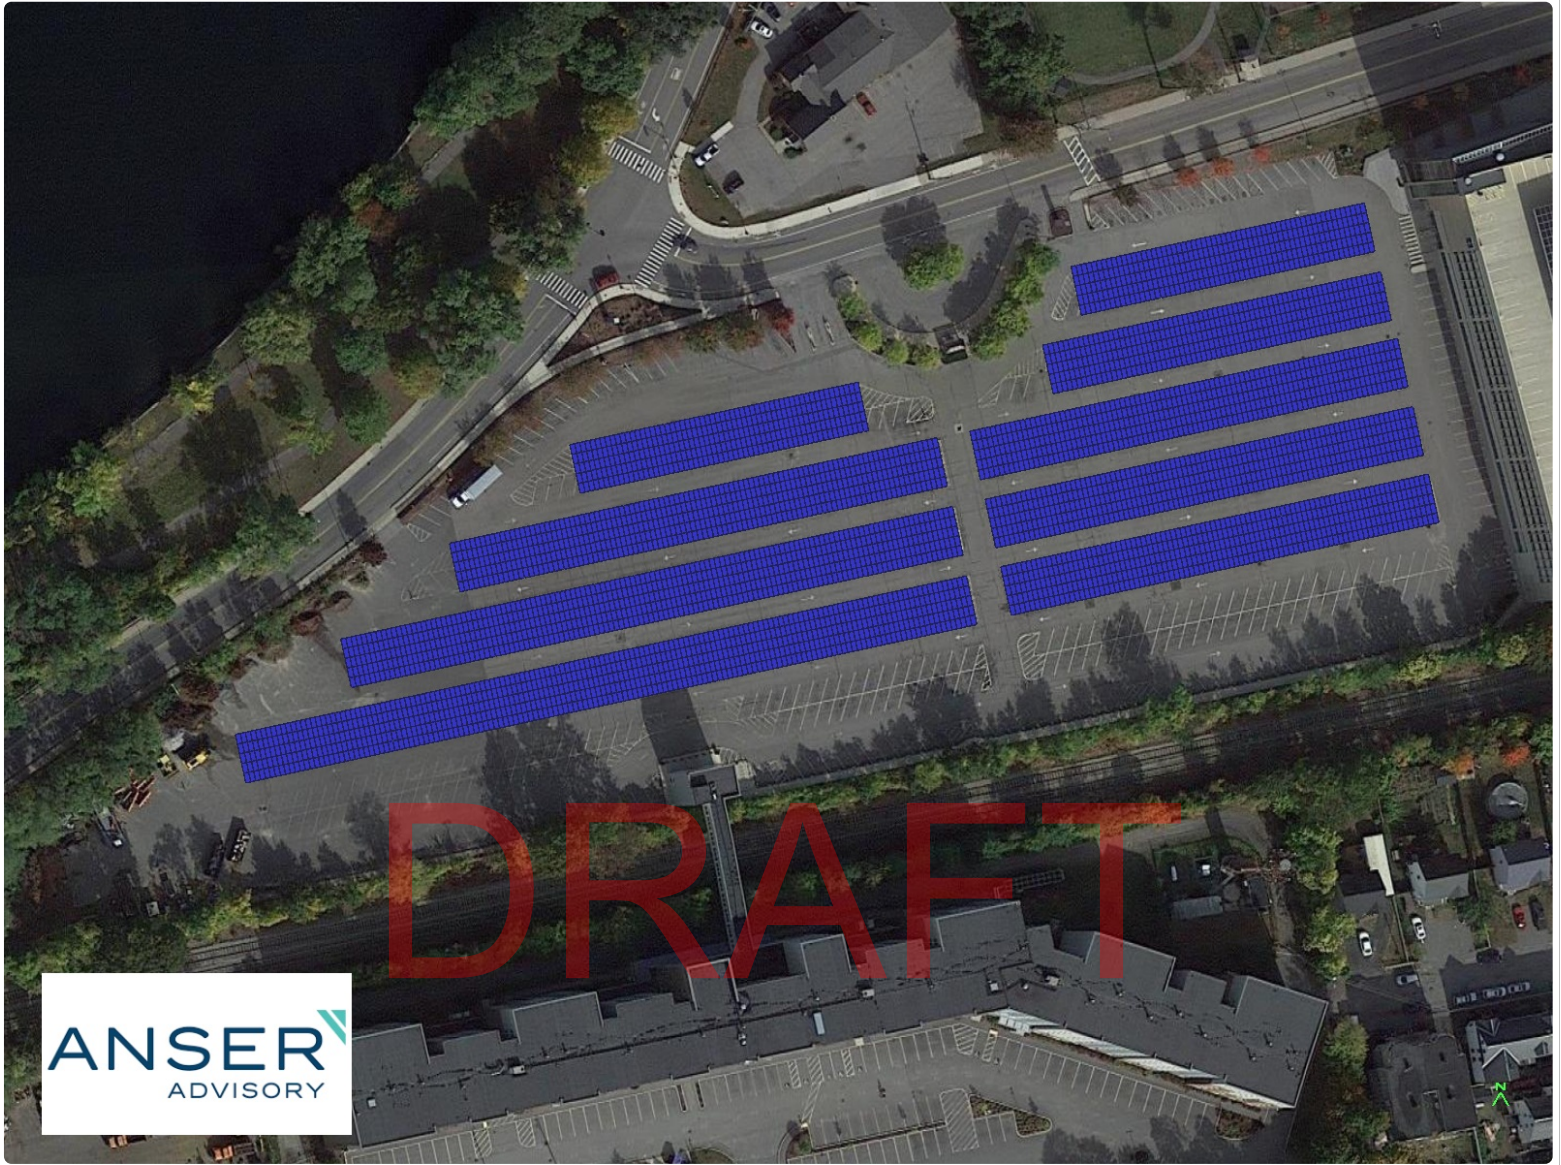

Campus Recreation Center UML - Campus Recreation Center, 322 Aiken St. Lowell, MA 01854

Report	
Project Name	UML - Campus Recreation Center
Project Address	322 Aiken St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Campus Recreation Center
Module DC Nameplate	224.7 kW
Inverter AC Nameplate	199.8 kW Load Ratio: 1.12
Annual Production	269.7 MWh
Performance Ratio	77.5%
kWh/kWp	1,200.2
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

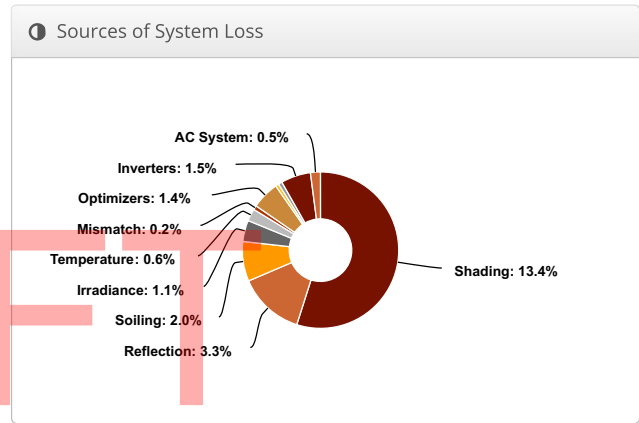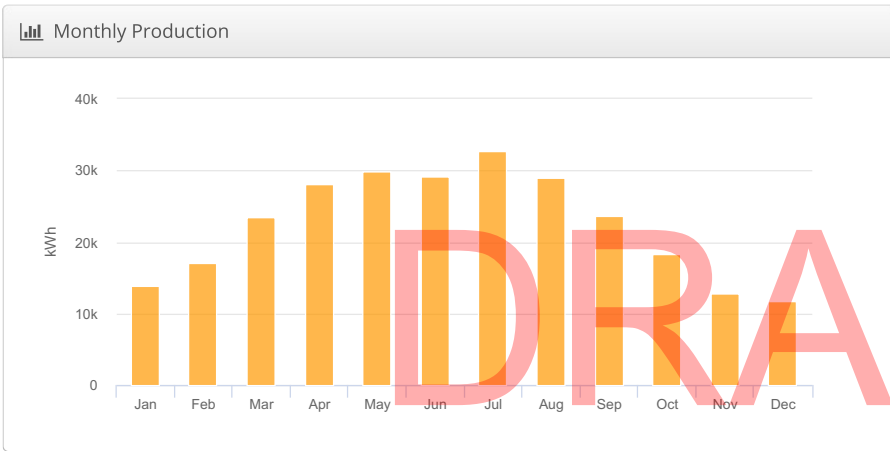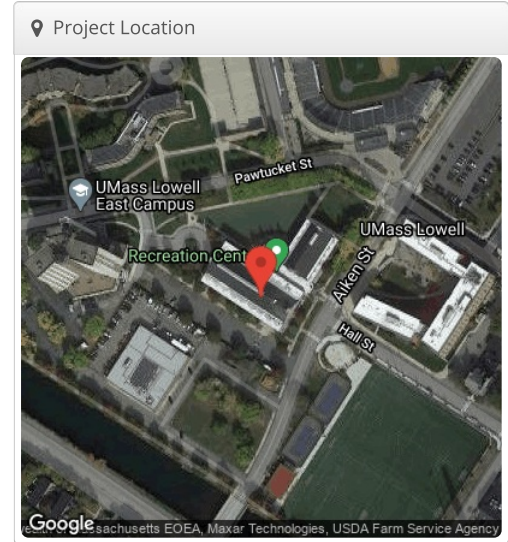

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,548.3	10.3%
	Shaded Irradiance	1,341.2	-13.4%
	Irradiance after Reflection	1,296.5	-3.3%
	Irradiance after Soiling	1,270.6	-2.0%
	Total Collector Irradiance	1,269.6	-0.1%
Energy (kWh)	Nameplate	285,443.9	
	Output at Irradiance Levels	282,392.9	-1.1%
	Output at Cell Temperature Derate	280,635.5	-0.6%
	Output After Mismatch	280,052.3	-0.2%
	Optimizer Output	276,129.1	-1.4%
	Optimal DC Output	275,694.6	-0.2%
	Constrained DC Output	275,154.7	-0.2%
	Inverter Output	271,022.5	-1.5%
	Energy to Grid	269,667.4	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.1 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	3 (199.8 kW)
Strings	10 AWG (Copper)	16 (1,926.5 ft)
Optimizers	P850 (2020) (SolarEdge)	278 (236.3 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	548 (224.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking
Wiring Zone 2	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Portrait (Vertical)	28°	212.9151°	0.0 ft	1x1	244	244	100.0 kW
Field Segment 2	Fixed Tilt	Portrait (Vertical)	28°	122.176735°	0.0 ft	4x1	36	144	59.0 kW
Field Segment 3	Fixed Tilt	Portrait (Vertical)	10°	213.35205°	0.0 ft	1x1	102	102	41.8 kW
Field Segment 4	Fixed Tilt	Portrait (Vertical)	10°	122.82667°	0.0 ft	1x1	58	58	23.8 kW



Canal Lot UML - Canal Lot, 110 Canal St. Lowell, MA 01853


Report

Project Name	UML - Canal Lot
Project Address	110 Canal St. Lowell, MA 01853
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Canal Lot
Module DC Nameplate	289.1 kW
Inverter AC Nameplate	240.0 kW Load Ratio: 1.20
Annual Production	372.6 MWh
Performance Ratio	86.6%
kWh/kWp	1,289.0
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

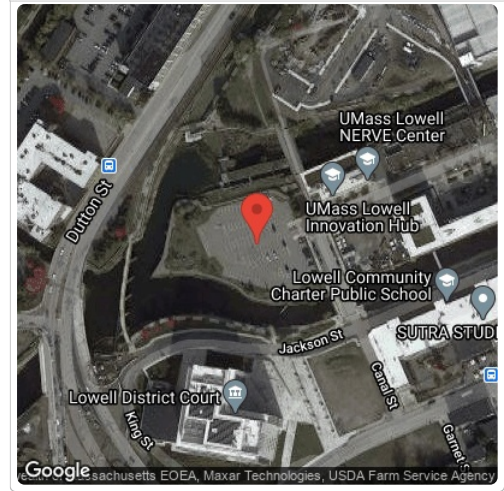

Monthly Production

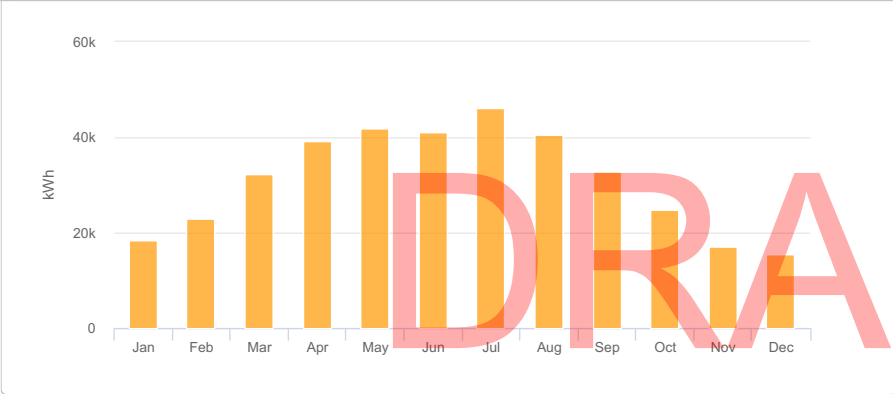

Sources of System Loss

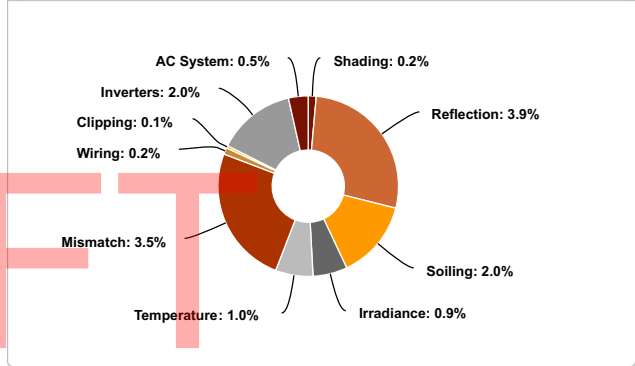

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,487.7	6.0%
	Shaded Irradiance	1,484.7	-0.2%
	Irradiance after Reflection	1,426.6	-3.9%
	Irradiance after Soiling	1,398.1	-2.0%
Total Collector Irradiance		1,398.1	0.0%
Energy (kWh)	Nameplate	404,397.6	
	Output at Irradiance Levels	400,857.6	-0.9%
	Output at Cell Temperature Derate	397,032.7	-1.0%
	Output After Mismatch	382,968.4	-3.5%
	Optimal DC Output	382,330.9	-0.2%
	Constrained DC Output	382,095.2	-0.1%
	Inverter Output	374,448.9	-2.0%
Energy to Grid		372,576.7	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By										Characterization
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs										Spec Sheet Characterization, PAN
Component Characterizations	Device	Uploaded By										Characterization
	PVI 60TL (Solectria)	Folsom Labs										Spec Sheet

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	4 (240.0 kW)
Strings	10 AWG (Copper)	41 (4,700.9 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	705 (289.1 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	157.473939453271°	0.0 ft	1x1	336	336	137.8 kW
Field Segment 2	Carport	Portrait (Vertical)	7°	157.47394°	0.0 ft	1x1	174	174	71.3 kW
Field Segment 3	Carport	Portrait (Vertical)	7°	165.6844034091837°	0.0 ft	1x1	195	195	80.0 kW

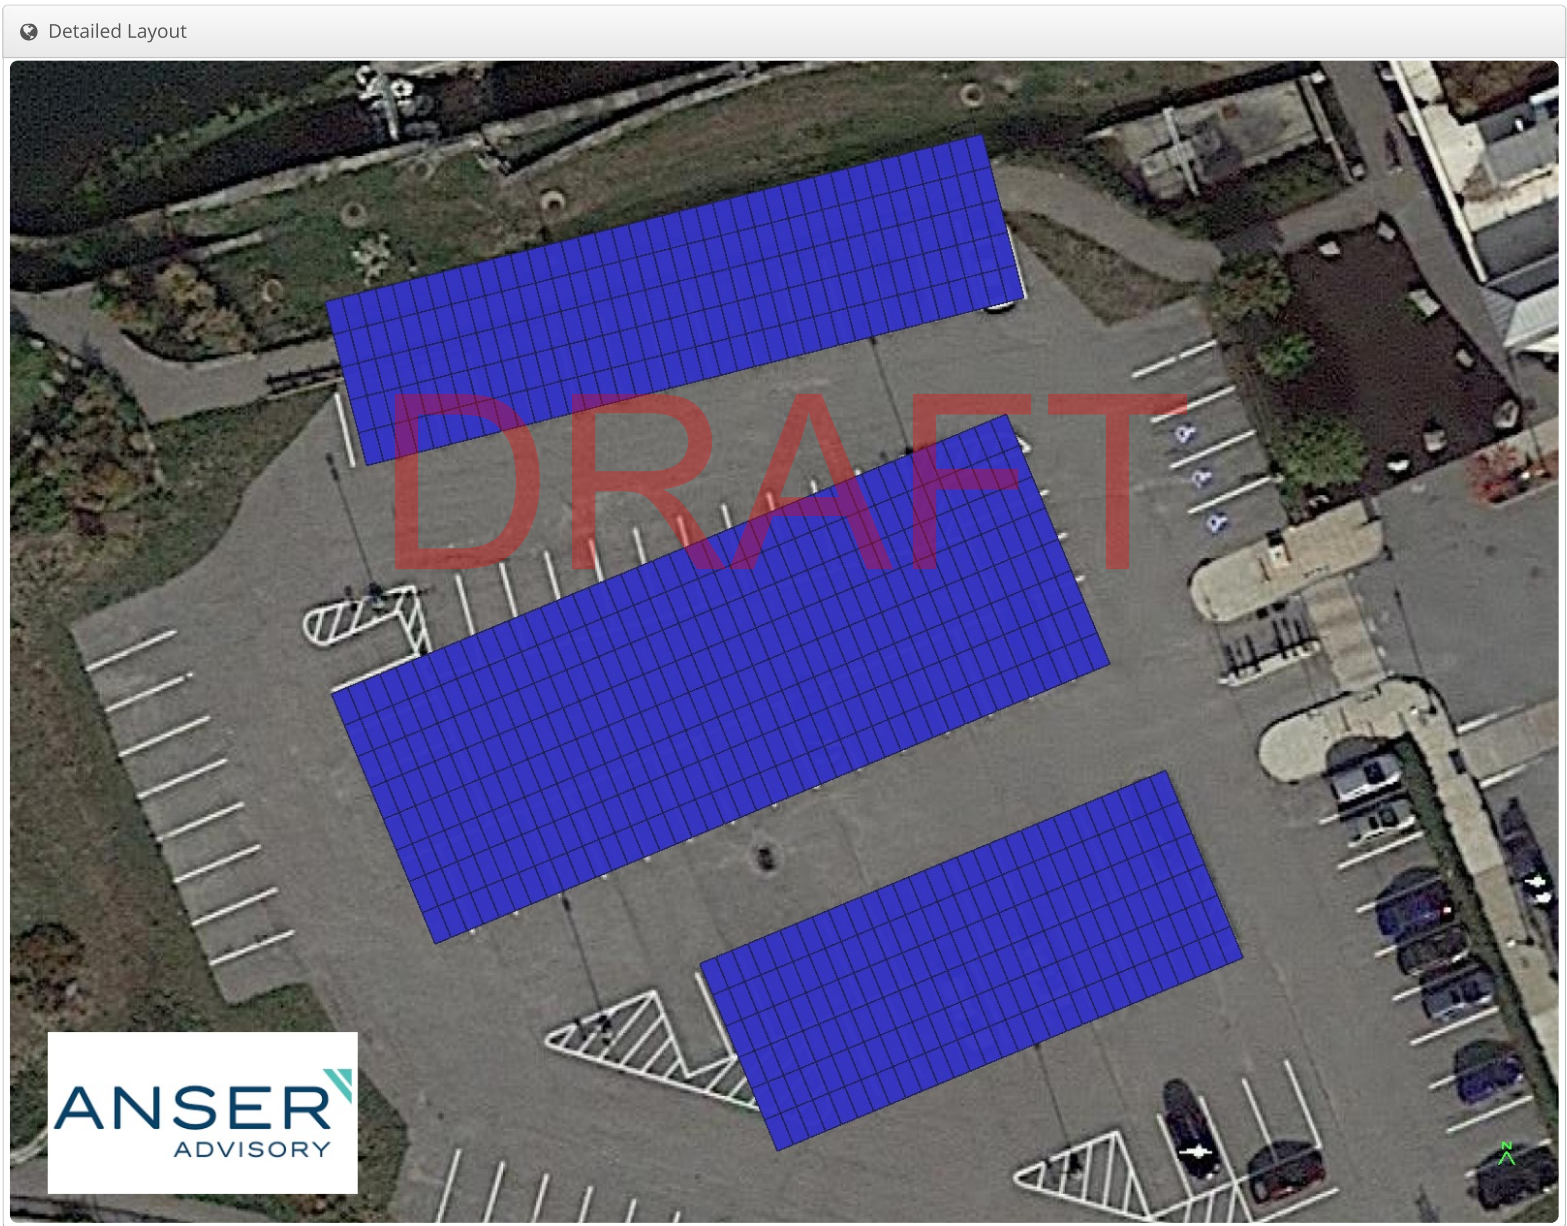

Coburn House UML - Coburn Hall, 850 Broadway St. Lowell, MA 01854


Report

Project Name	UML - Coburn Hall
Project Address	850 Broadway St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Coburn House
Module DC Nameplate	48.4 kW
Inverter AC Nameplate	50.6 kW Load Ratio: 0.96
Annual Production	62.27 MWh
Performance Ratio	83.1%
kWh/kWp	1,287.1
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

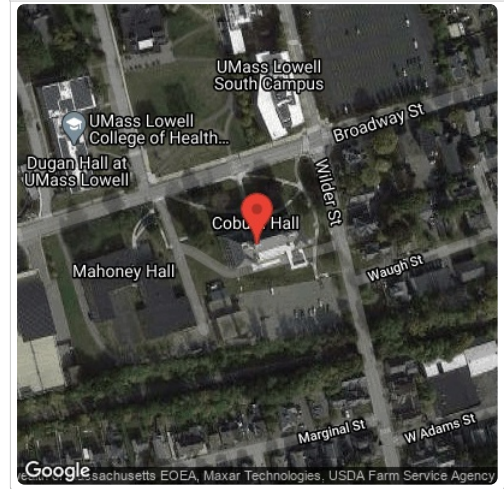

Monthly Production

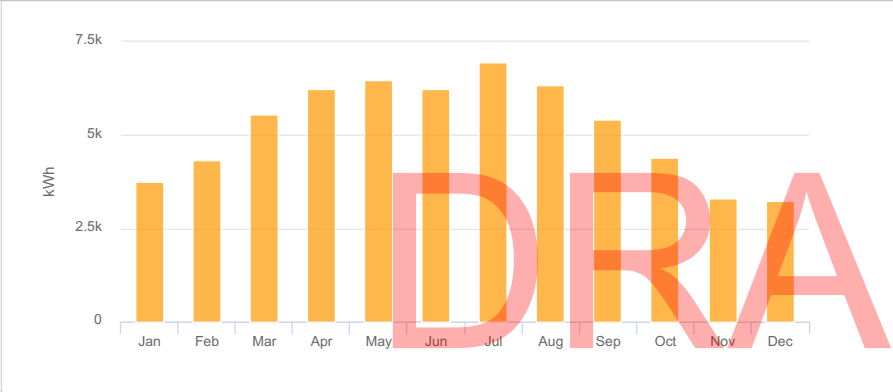

Sources of System Loss

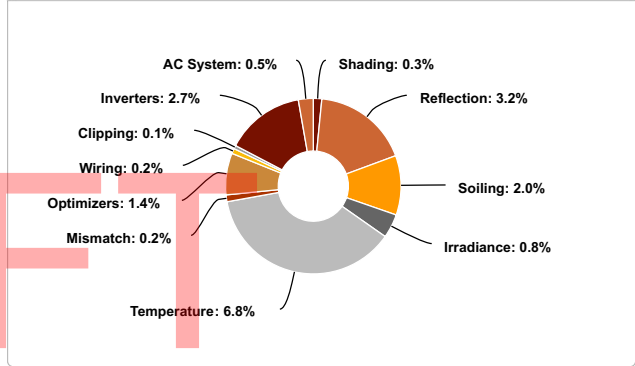

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,549.1	10.4%
	Shaded Irradiance	1,544.7	-0.3%
	Irradiance after Reflection	1,494.5	-3.2%
	Irradiance after Soiling	1,464.6	-2.0%
	Total Collector Irradiance	1,465.1	0.0%
Energy (kWh)	Nameplate	70,920.8	
	Output at Irradiance Levels	70,349.5	-0.8%
	Output at Cell Temperature Derate	65,545.6	-6.8%
	Output After Mismatch	65,396.1	-0.2%
	Optimizer Output	64,479.7	-1.4%
	Optimal DC Output	64,368.7	-0.2%
	Constrained DC Output	64,294.9	-0.1%
	Inverter Output	62,582.7	-2.7%
	Energy to Grid	62,269.8	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		28.3 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE33.3KUS (2020) (SolarEdge)	1 (33.3 kW)
Inverters	SE17.3KUS (2020) (SolarEdge)	1 (17.3 kW)
Strings	10 AWG (Copper)	6 (378.8 ft)
Optimizers	P850 (2020) (SolarEdge)	60 (51.0 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	118 (48.4 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-17	Along Racking
Wiring Zone 2	-	13-37	Along Racking

Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Flush Mount	Portrait (Vertical)	32°	161.88823103454695°	0.0 ft	1x1	57	56	23.0 kW	
Field Segment 2	Flush Mount	Portrait (Vertical)	32°	252.71850162818328°	0.0 ft	1x1	42	42	17.2 kW	
Field Segment 3	Flush Mount	Landscape (Horizontal)	10°	162.3531468339321°	0.0 ft	1x1	21	20	8.20 kW	



Coburn Lot UML - Coburn Lot, 850 Broadway St. Lowell, MA

Report

Project Name	UML - Coburn Lot
Project Address	850 Broadway St. Lowell, MA
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Coburn Lot
Module DC Nameplate	133.3 kW
Inverter AC Nameplate	120.0 kW Load Ratio: 1.11
Annual Production	171.9 MWh
Performance Ratio	86.4%
kWh/kWp	1,289.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location



Monthly Production

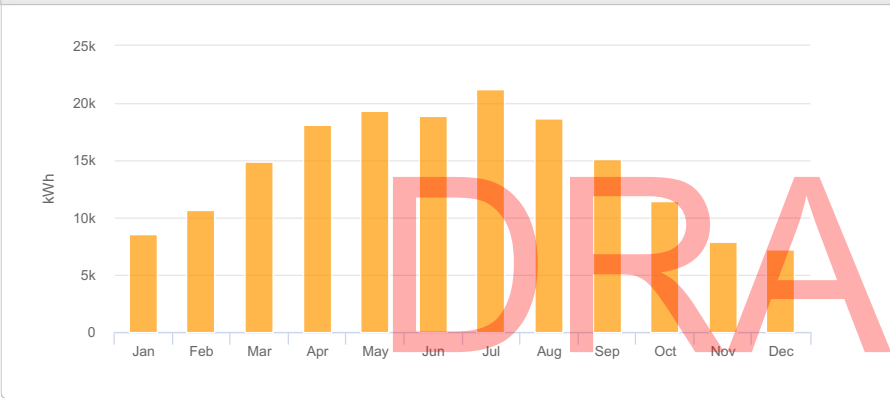

Sources of System Loss

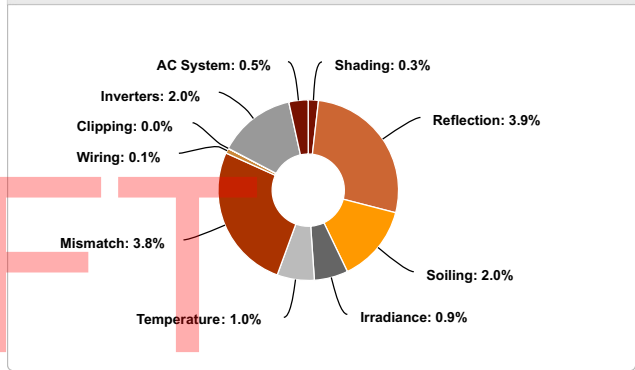

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.9	6.3%
	Shaded Irradiance	1,488.0	-0.3%
	Irradiance after Reflection	1,429.6	-3.9%
	Irradiance after Soiling	1,401.0	-2.0%
	Total Collector Irradiance	1,401.0	0.0%
Energy (kWh)	Nameplate	186,815.1	
	Output at Irradiance Levels	185,187.0	-0.9%
	Output at Cell Temperature Derate	183,403.7	-1.0%
	Output After Mismatch	176,474.1	-3.8%
	Optimal DC Output	176,248.3	-0.1%
	Constrained DC Output	176,239.9	0.0%
	Inverter Output	172,715.1	-2.0%
	Energy to Grid	171,851.5	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	2 (120.0 kW)
Strings	10 AWG (Copper)	19 (1,357.4 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	325 (133.3 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	169.96646169483938°	0.0 ft	5x1	65	325	133.3 kW




☑ Detailed Layout



Concordia House UML - Concordia House, 71 Wilder St. Lowell, MA 01854

Report	
Project Name	UML - Concordia House
Project Address	71 Wilder St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Concordia House
Module DC Nameplate	29.9 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 0.90
Annual Production	38.98 MWh
Performance Ratio	85.4%
kWh/kWp	1,302.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

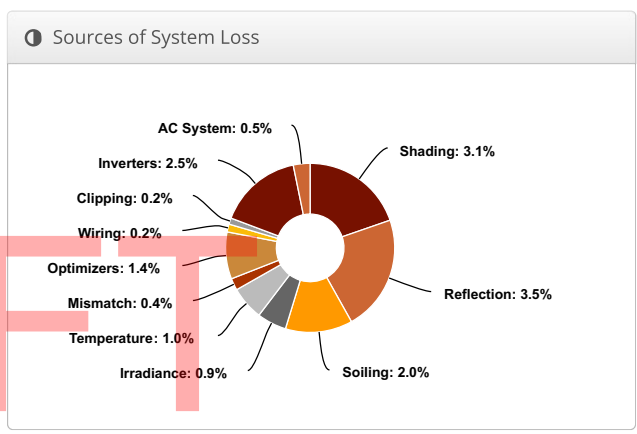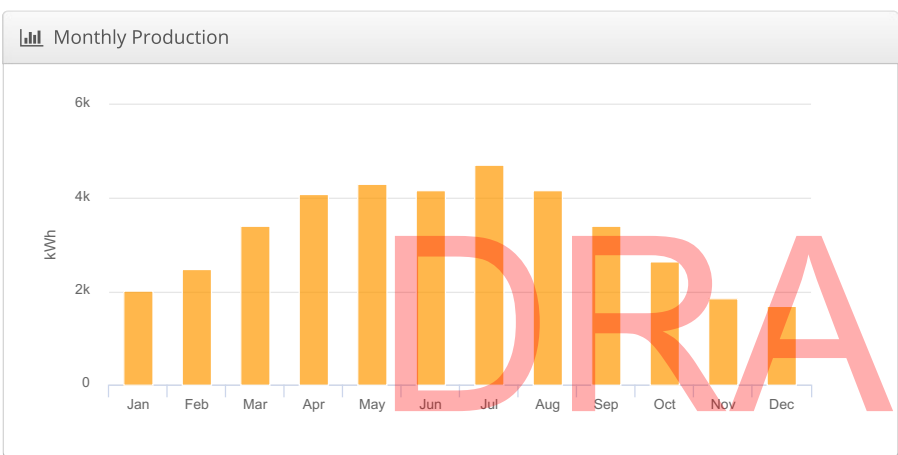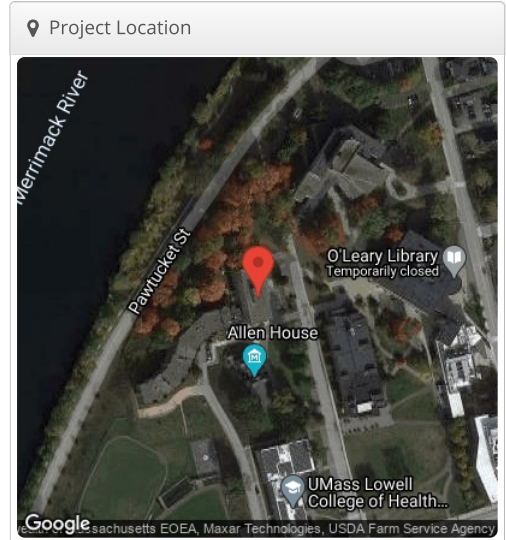

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,524.1	8.6%
	Shaded Irradiance	1,477.4	-3.1%
	Irradiance after Reflection	1,426.3	-3.5%
	Irradiance after Soiling	1,397.8	-2.0%
	Total Collector Irradiance	1,397.1	0.0%
Energy (kWh)	Nameplate	41,845.4	
	Output at Irradiance Levels	41,479.0	-0.9%
	Output at Cell Temperature Derate	41,064.1	-1.0%
	Output After Mismatch	40,918.3	-0.4%
	Optimizer Output	40,345.3	-1.4%
	Optimal DC Output	40,251.4	-0.2%
	Constrained DC Output	40,176.7	-0.2%
	Inverter Output	39,172.2	-2.5%
	Energy to Grid	38,976.4	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE33.3K (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	2 (233.9 ft)
Optimizers	P850 (2020) (SolarEdge)	37 (31.5 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	73 (29.9 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	167.10951937024868°	2.0 ft	1x1	75	73	29.9 kW

Detailed Layout

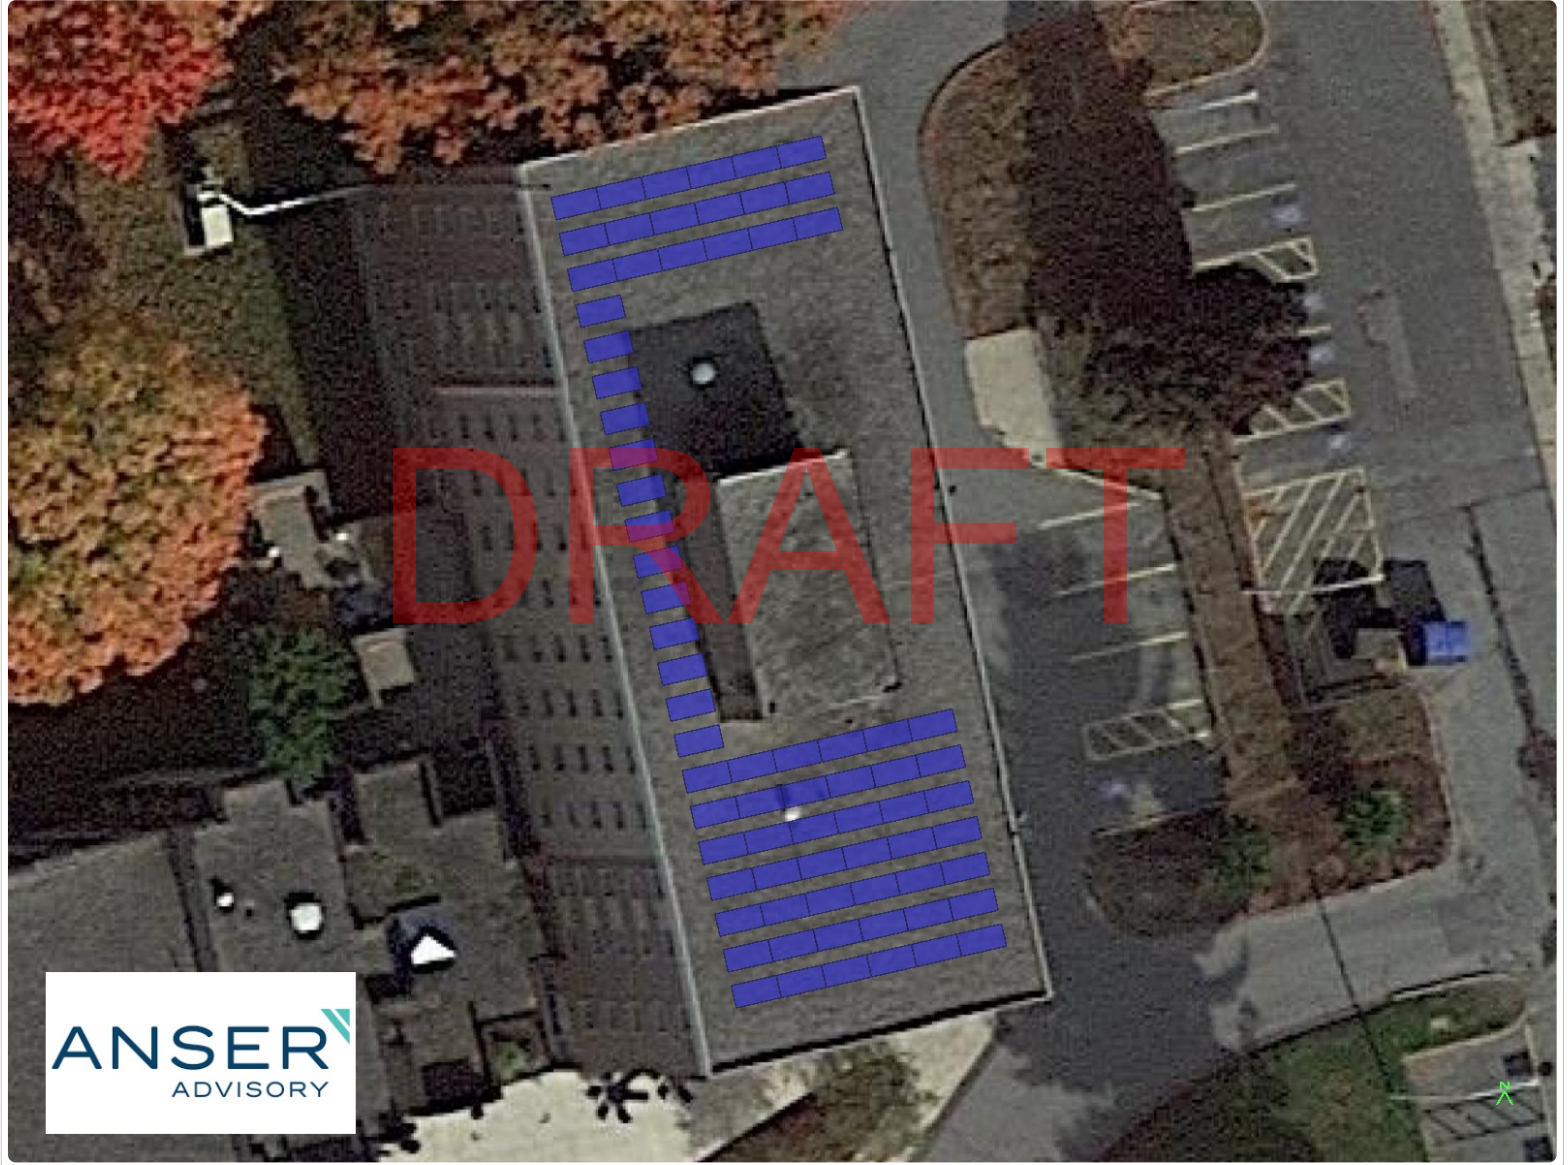

Cross River Center Lot UML - Cross River Center Lot, 1001 Pawtucket Blvd. Lowell, MA 01854


Report

Project Name	UML - Cross River Center Lot
Project Address	1001 Pawtucket Blvd. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Cross River Center Lot
Module DC Nameplate	2.68 MW
Inverter AC Nameplate	2.16 MW Load Ratio: 1.24
Annual Production	3,460 GWh
Performance Ratio	86.4%
kWh/kWp	1,289.5
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

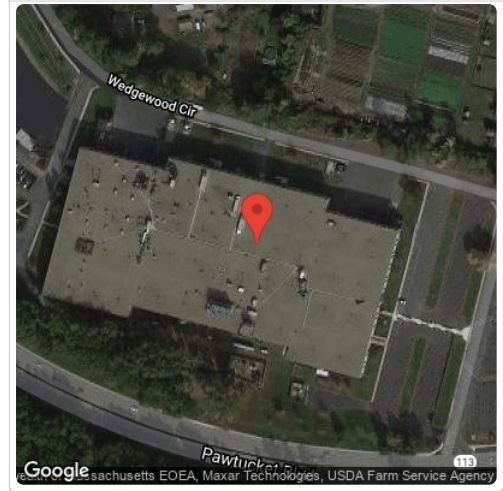

Monthly Production

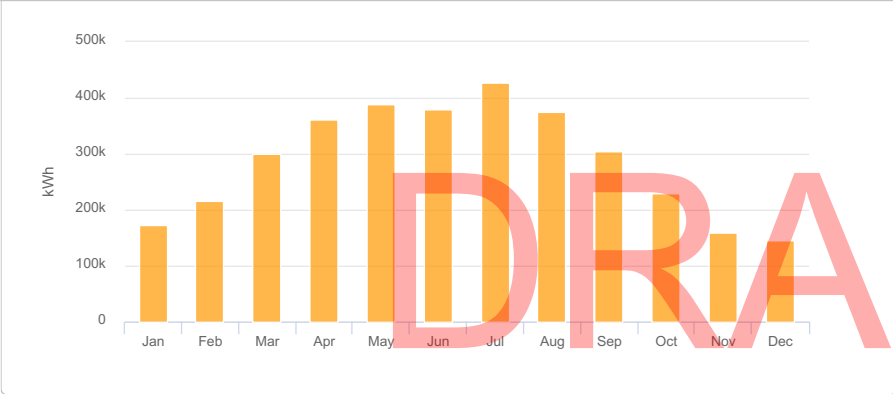

Sources of System Loss

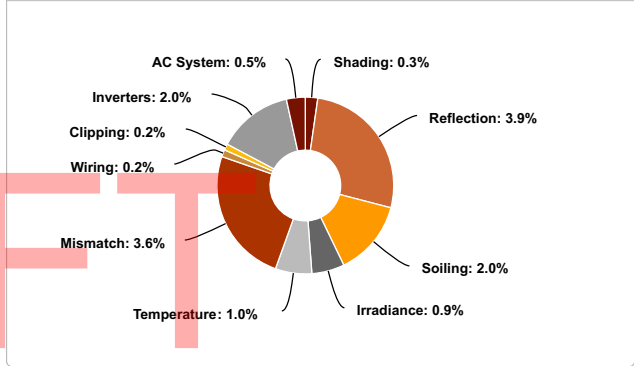

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,492.9	6.4%
	Shaded Irradiance	1,488.0	-0.3%
	Irradiance after Reflection	1,430.1	-3.9%
	Irradiance after Soiling	1,401.5	-2.0%
	Total Collector Irradiance	1,401.5	0.0%
Energy (kWh)	Nameplate	3,762,754.5	
	Output at Irradiance Levels	3,730,011.3	-0.9%
	Output at Cell Temperature Derate	3,693,902.1	-1.0%
	Output After Mismatch	3,560,723.6	-3.6%
	Optimal DC Output	3,553,972.1	-0.2%
	Constrained DC Output	3,548,139.2	-0.2%
	Inverter Output	3,477,063.4	-2.0%
	Energy to Grid	3,459,678.2	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet Characterization, PAN				
Component Characterizations	Device	PVI 60TL (Solectria)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet				


Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	36 (2.16 MW)
Strings	10 AWG (Copper)	396 (55,263.5 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	6,544 (2.68 MW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	6x1	111	666	273.1 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	8x1	156	1,248	511.7 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	10x1	141	1,410	578.1 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	6x1	149	894	366.5 kW
Field Segment 1 (copy 3)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	6x1	134	804	329.6 kW
Field Segment 1 (copy 4)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	6x1	95	570	233.7 kW
Field Segment 7	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	14x1	34	476	195.2 kW
Field Segment 7 (copy)	Carport	Portrait (Vertical)	7°	175.17479°	1.6 ft	14x1	34	476	195.2 kW

DRAFT




Detailed Layout

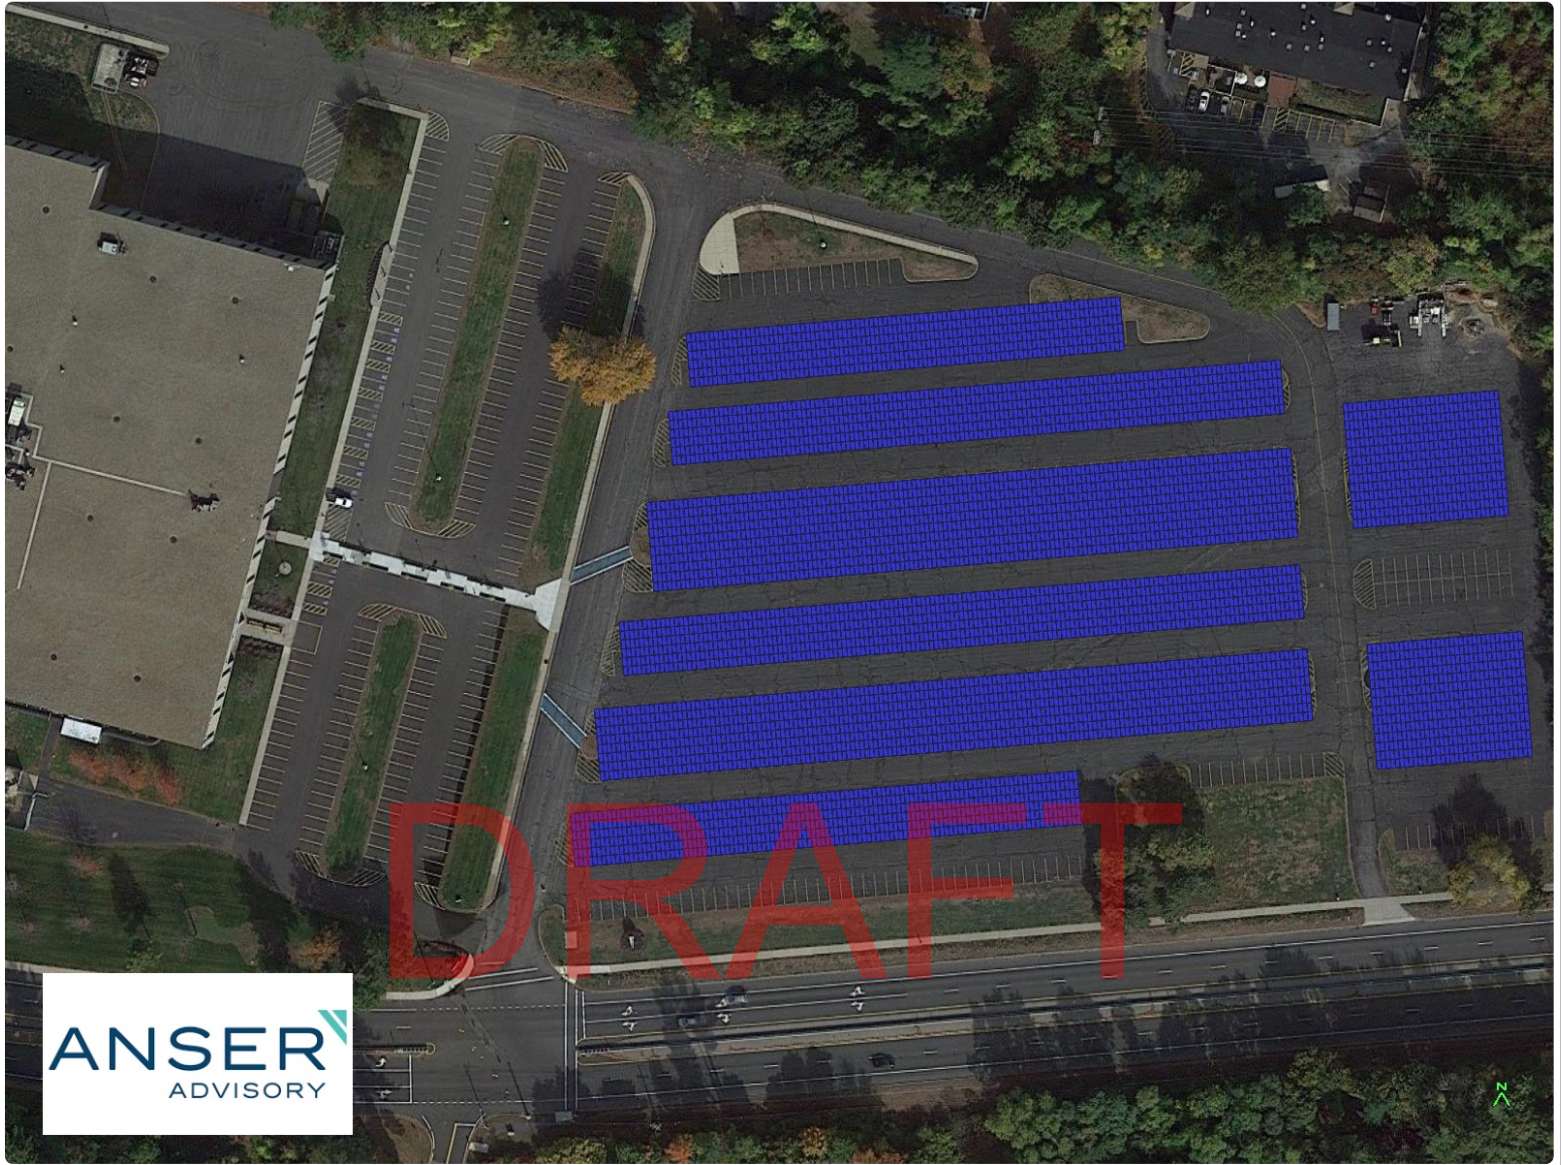

Cummnock Hall UML - Cummnock Hall, 31 University Ave. Lowell, MA 01854

Report	
Project Name	UML - Cummnock Hall
Project Address	31 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Cummnock Hall
Module DC Nameplate	52.5 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 0.79
Annual Production	70.96 MWh
Performance Ratio	88.5%
kWh/kWp	1,352.1
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

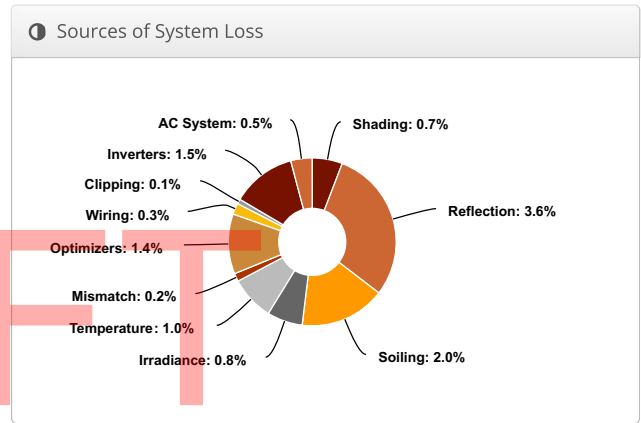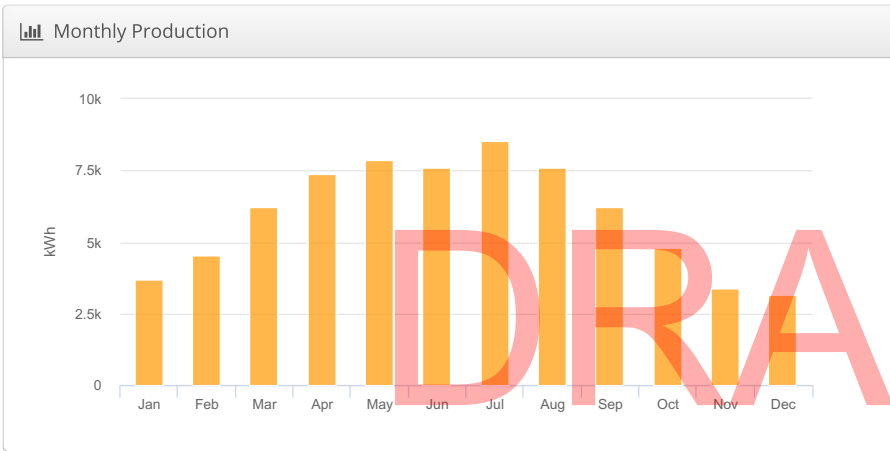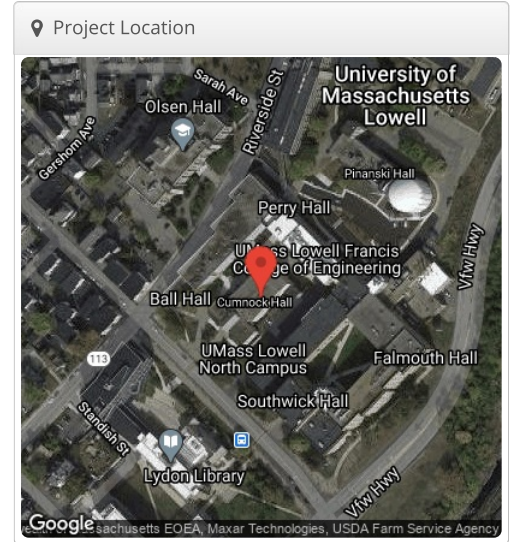

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.2	-0.7%
	Irradiance after Reflection	1,461.9	-3.6%
	Irradiance after Soiling	1,432.7	-2.0%
	Total Collector Irradiance	1,432.7	0.0%
Energy (kWh)	Nameplate	75,232.4	
	Output at Irradiance Levels	74,608.9	-0.8%
	Output at Cell Temperature Derate	73,841.9	-1.0%
	Output After Mismatch	73,702.5	-0.2%
	Optimizer Output	72,670.3	-1.4%
	Optimal DC Output	72,481.3	-0.3%
	Constrained DC Output	72,399.5	-0.1%
	Inverter Output	71,313.5	-1.5%
	Energy to Grid	70,957.0	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Strings	10 AWG (Copper)	4 (731.4 ft)
Optimizers	P850 (SolarEdge)	64 (54.4 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	128 (52.5 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	128	128	52.5 kW

Detailed Layout

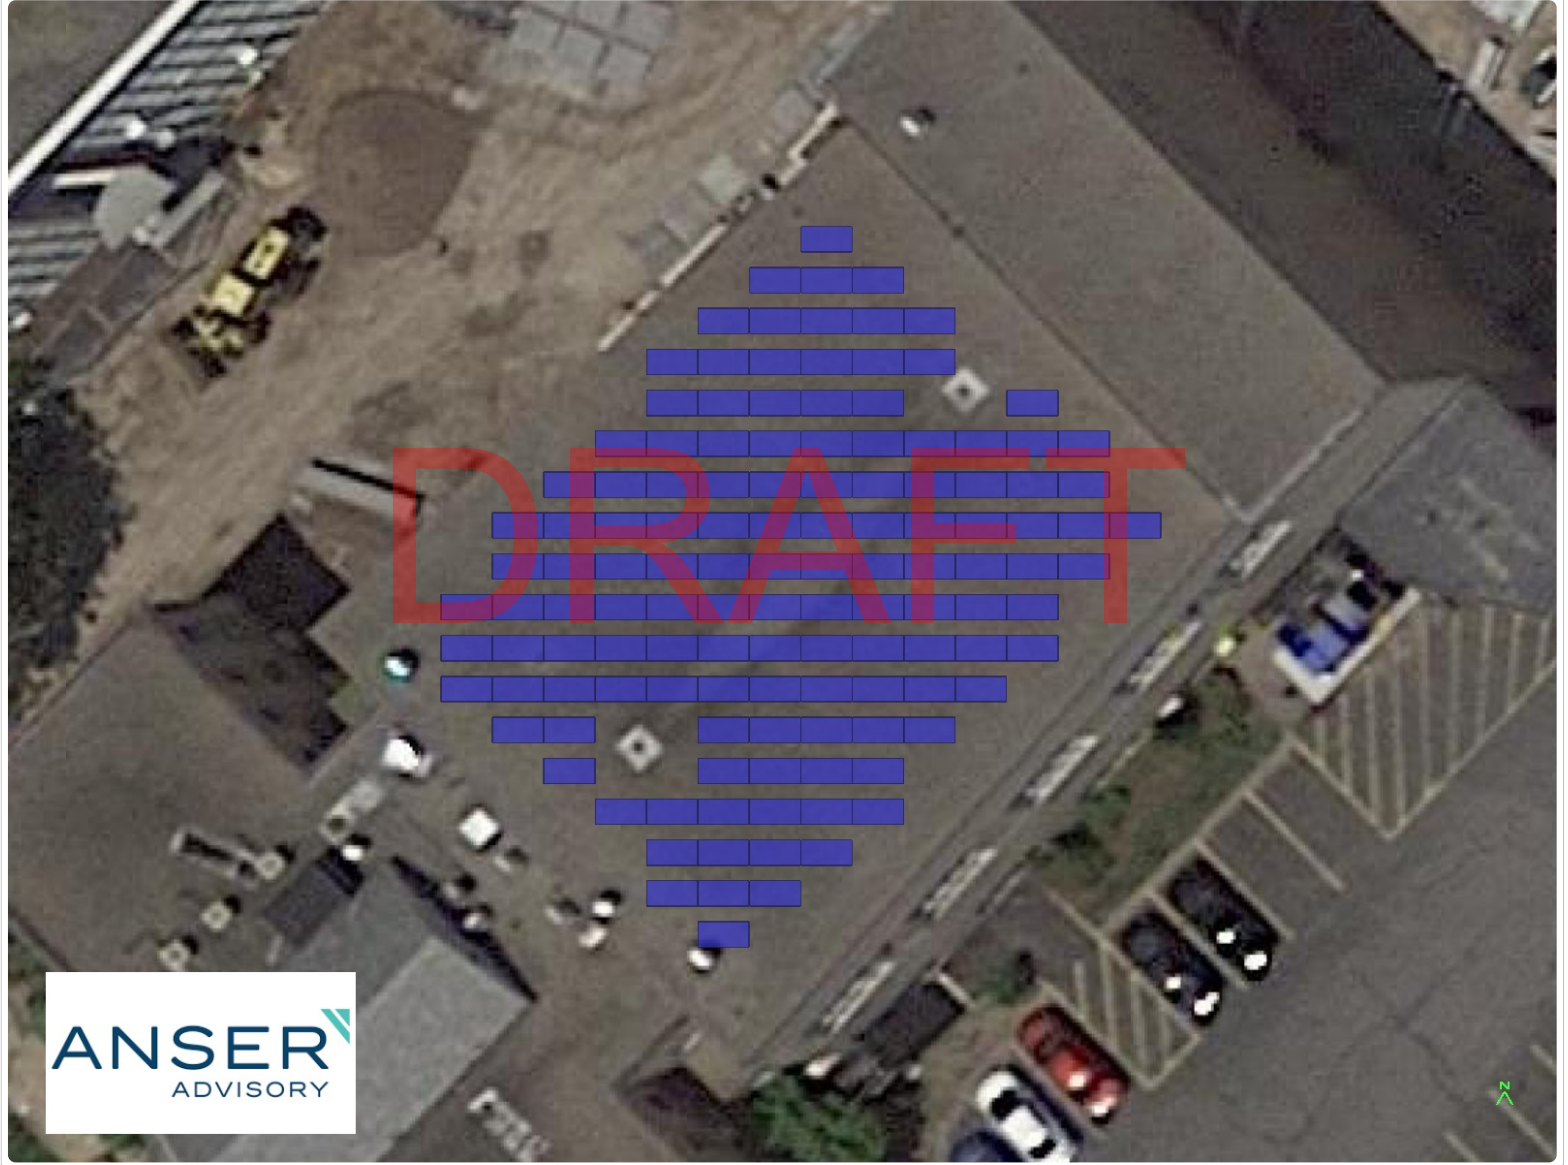

Dandeneau Hall UML - Dandeneau Hall, 1 University Ave. Lowell, MA 01854


Report

Project Name	UML - Dandeneau Hall
Project Address	1 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Dandeneau Hall
Module DC Nameplate	35.7 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 1.07
Annual Production	47.78 MWh
Performance Ratio	87.7%
kWh/kWp	1,339.6
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

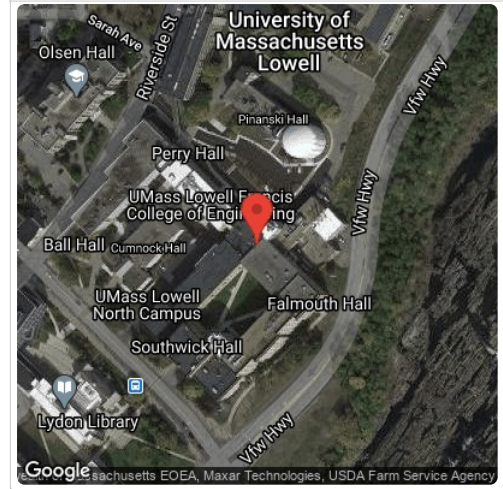

Monthly Production

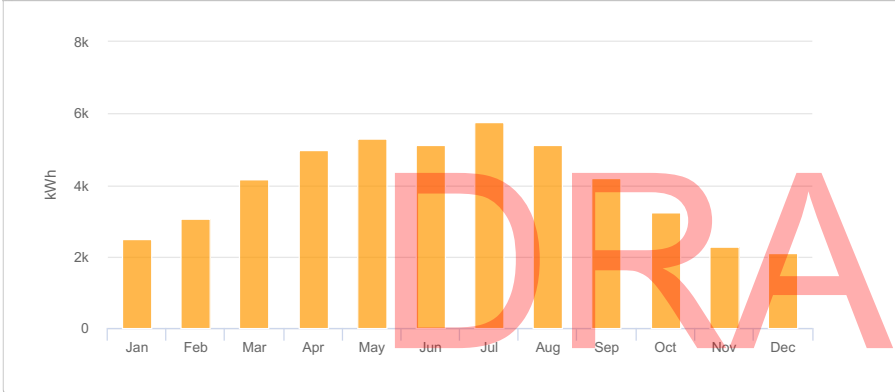

Sources of System Loss

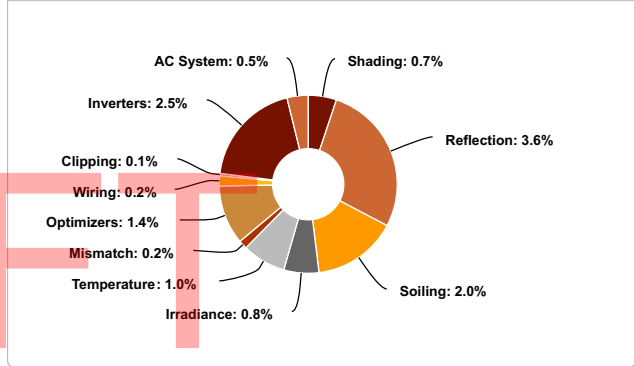

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.7	-0.7%
	Irradiance after Reflection	1,462.3	-3.6%
	Irradiance after Soiling	1,433.1	-2.0%
	Total Collector Irradiance	1,433.1	0.0%
Energy (kWh)	Nameplate	51,148.3	
	Output at Irradiance Levels	50,724.6	-0.8%
	Output at Cell Temperature Derate	50,203.0	-1.0%
	Output After Mismatch	50,100.2	-0.2%
	Optimizer Output	49,398.7	-1.4%
	Optimal DC Output	49,279.8	-0.2%
	Constrained DC Output	49,253.6	-0.1%
	Inverter Output	48,022.3	-2.5%
	Energy to Grid	47,782.1	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1															
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)															
Solar Angle Location	Meteo Lat/Lng															
Transposition Model	Perez Model															
Temperature Model	Sandia Model															
Temperature Model Parameters	Rack Type	a	b	Temperature Delta												
	Fixed Tilt	-3.56	-0.075	3°C												
	Flush Mount	-2.81	-0.0455	0°C												
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D				
	2	2	2	2	2	2	2	2	2	2	2	2				
Irradiation Variance	5%															
Cell Temperature Spread	4° C															
Module Binning Range	-2.5% to 2.5%															
AC System Derate	0.50%															
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization	Spec Sheet Characterization, PAN	
	Component Characterizations	Device	Uploaded By					Characterization								

Components		
Component	Name	Count
Inverters	SE33.3KUS (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	3 (389.0 ft)
Optimizers	P850 (2020) (SolarEdge)	45 (38.3 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	87 (35.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	87	87	35.7 kW

Detailed Layout



Donahue Hall UML - Donahue Hall, 91 Pawtucket St. Lowell, MA 01854

Report

Project Name	UML - Donahue Hall
Project Address	91 Pawtucket St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Donahue Hall
Module DC Nameplate	109.1 kW
Inverter AC Nameplate	99.9 kW Load Ratio: 1.09
Annual Production	145.6 MWh
Performance Ratio	87.6%
kWh/kWp	1,335.4
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location



Monthly Production

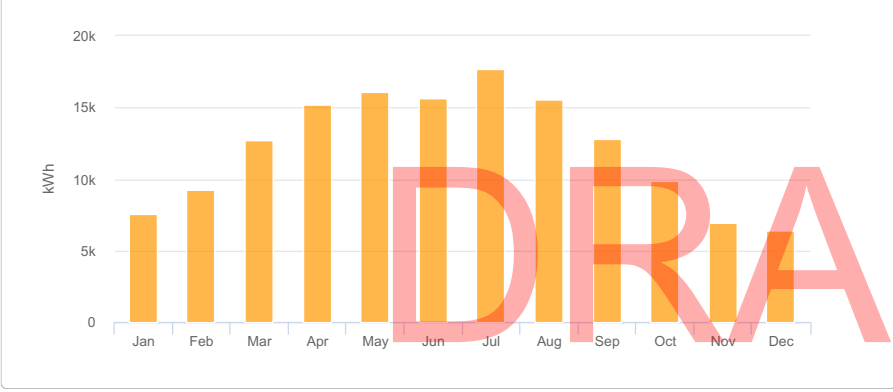

Sources of System Loss

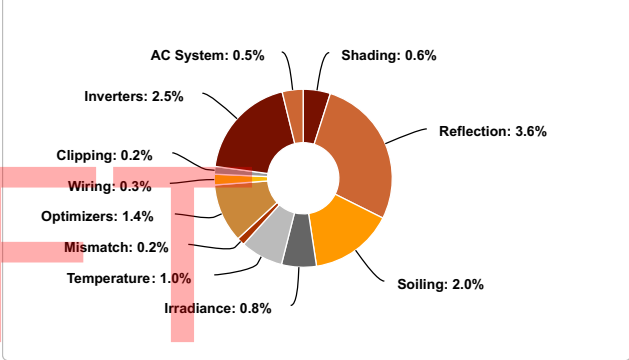

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,524.0	8.6%
	Shaded Irradiance	1,514.1	-0.6%
	Irradiance after Reflection	1,459.5	-3.6%
	Irradiance after Soiling	1,430.3	-2.0%
	Total Collector Irradiance	1,430.3	0.0%
Energy (kWh)	Nameplate	156,091.6	
	Output at Irradiance Levels	154,792.5	-0.8%
	Output at Cell Temperature Derate	153,217.1	-1.0%
	Output After Mismatch	152,931.6	-0.2%
	Optimizer Output	150,790.0	-1.4%
	Optimal DC Output	150,404.6	-0.3%
	Constrained DC Output	150,130.1	-0.2%
	Inverter Output	146,372.5	-2.5%
	Energy to Grid	145,640.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1															
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)															
Solar Angle Location	Meteo Lat/Lng															
Transposition Model	Perez Model															
Temperature Model	Sandia Model															
Temperature Model Parameters	Rack Type	a	b	Temperature Delta												
	Fixed Tilt	-3.56	-0.075	3°C												
	Flush Mount	-2.81	-0.0455	0°C												
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D				
	2	2	2	2	2	2	2	2	2	2	2	2				
Irradiation Variance	5%															
Cell Temperature Spread	4° C															
Module Binning Range	-2.5% to 2.5%															
AC System Derate	0.50%															
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization	Spec Sheet Characterization, PAN	
	Component Characterizations	Device	Uploaded By						Characterization							

Components

Component	Name	Count
Inverters	SE33.3K (2020) (SolarEdge)	3 (99.9 kW)
Combiners	1 input Combiner	1
Combiners	3 input Combiner	1
Strings	10 AWG (Copper)	9 (1,003.8 ft)
Optimizers	P850 (2020) (SolarEdge)	135 (114.8 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	266 (109.1 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	12	13-37	Along Racking
Wiring Zone 2	-	13-37	Along Racking
Wiring Zone 3	-	13-37	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	44	43	17.6 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	43	43	17.6 kW
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	41	41	16.8 kW
Field Segment 5	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	38	38	15.6 kW
Field Segment 6	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	55	55	22.6 kW
Field Segment 7	Fixed Tilt	Landscape (Horizontal)	10°	166.784°	2.0 ft	1x1	46	46	18.9 kW




Detailed Layout



Durgin Hall UML - Durgin Hall, 35 Wilder St. Lowell, MA 01854

Report	
Project Name	UML - Durgin Hall
Project Address	35 Wilder St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Durgin Hall
Module DC Nameplate	32.0 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 0.96
Annual Production	42.63 MWh
Performance Ratio	87.7%
kWh/kWp	1,333.1
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	5f5cdd1076-3edb84d28b-6bff68b913-0b0d9d60b5

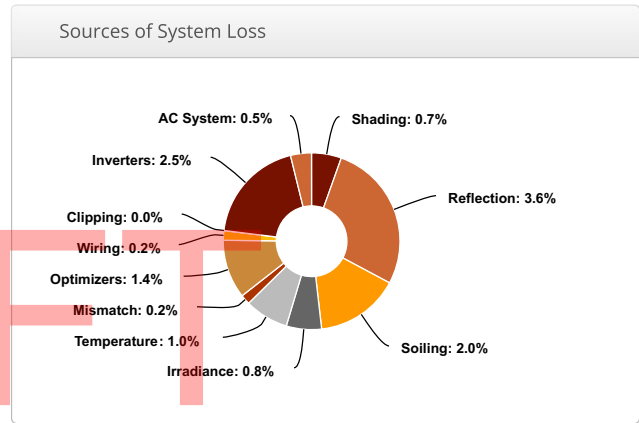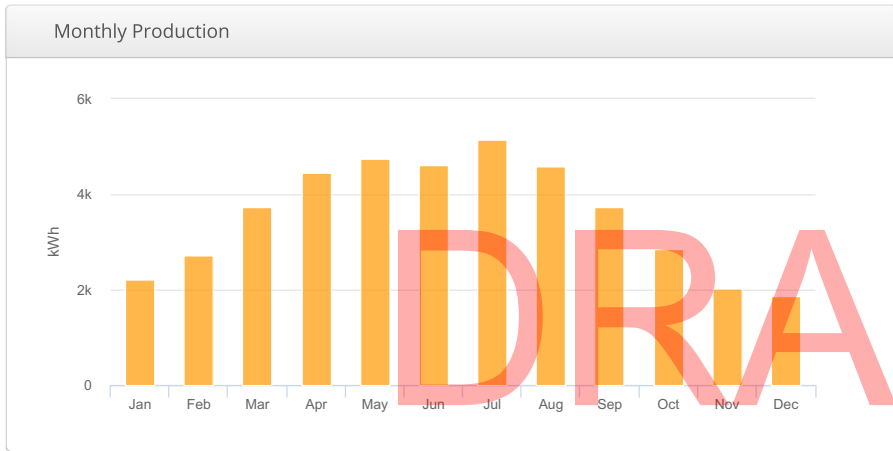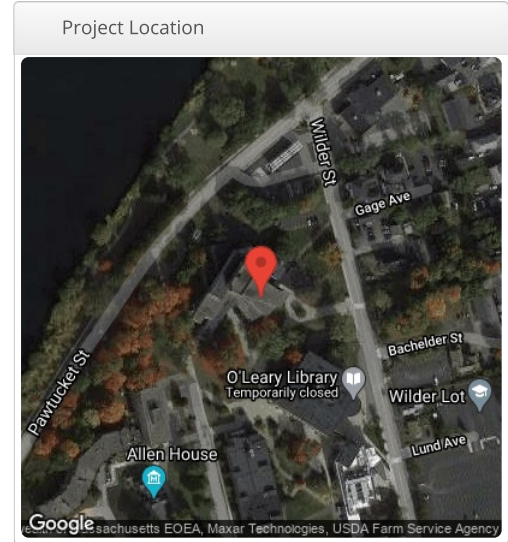

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,519.4	8.3%
	Shaded Irradiance	1,508.7	-0.7%
	Irradiance after Reflection	1,454.9	-3.6%
	Irradiance after Soiling	1,425.8	-2.0%
	Total Collector Irradiance	1,425.9	0.0%
Energy (kWh)	Nameplate	45,629.1	
	Output at Irradiance Levels	45,246.6	-0.8%
	Output at Cell Temperature Derate	44,774.9	-1.0%
	Output After Mismatch	44,671.3	-0.2%
	Optimizer Output	44,045.7	-1.4%
	Optimal DC Output	43,945.1	-0.2%
	Constrained DC Output	43,944.8	0.0%
	Inverter Output	42,846.2	-2.5%
	Energy to Grid	42,632.0	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE33.3KUS (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	3 (191.8 ft)
Optimizers	P850 (2020) (SolarEdge)	39 (33.2 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	78 (32.0 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	198.64954°	2.0 ft	1x1	66	66	27.1 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	198.64954°	2.0 ft	1x1	12	12	4.92 kW




Detailed Layout

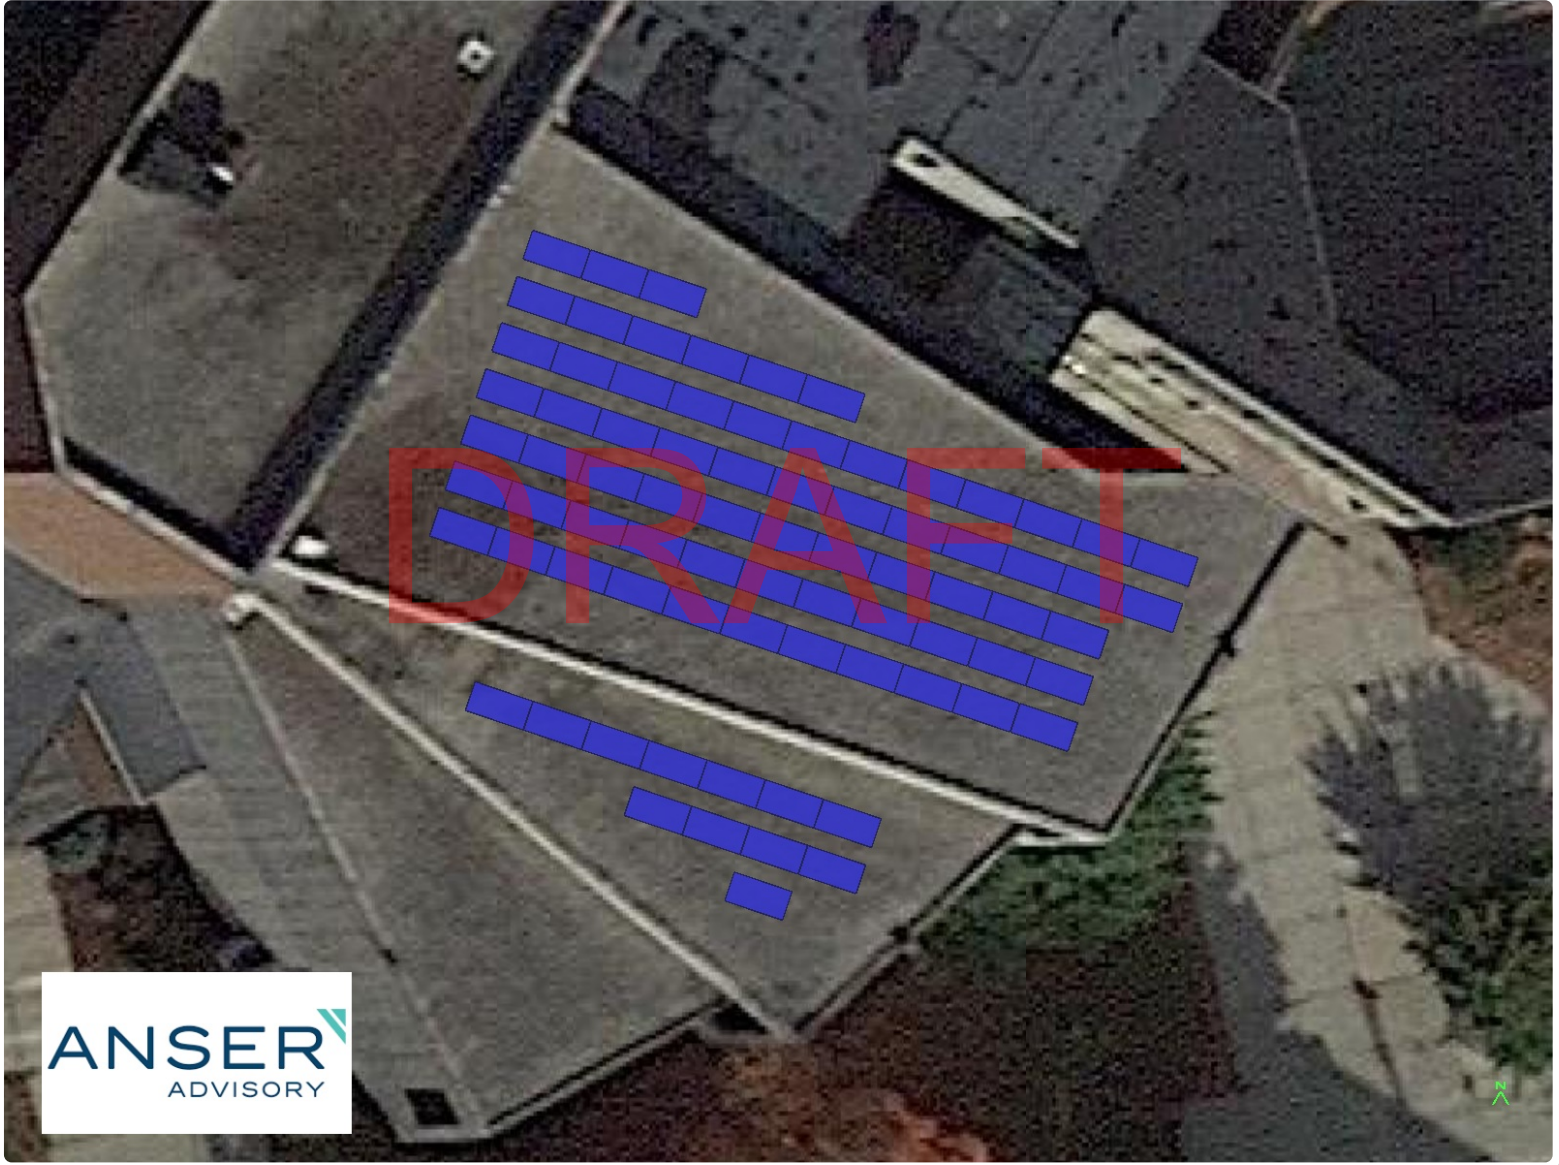

East Parking Garage UML - East Parking Garage, 47 Pawtucket St. Lowell, MA 01854

Report	
Project Name	UML - East Parking Garage
Project Address	47 Pawtucket St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	East Parking Garage
Module DC Nameplate	334.6 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.12
Annual Production	432.6 MWh
Performance Ratio	86.7%
kWh/kWp	1,293.0
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

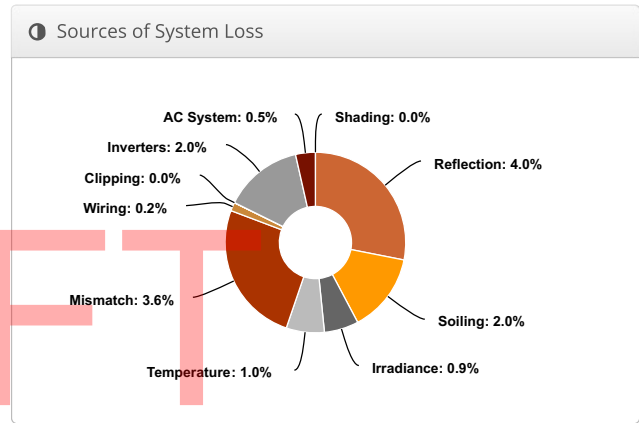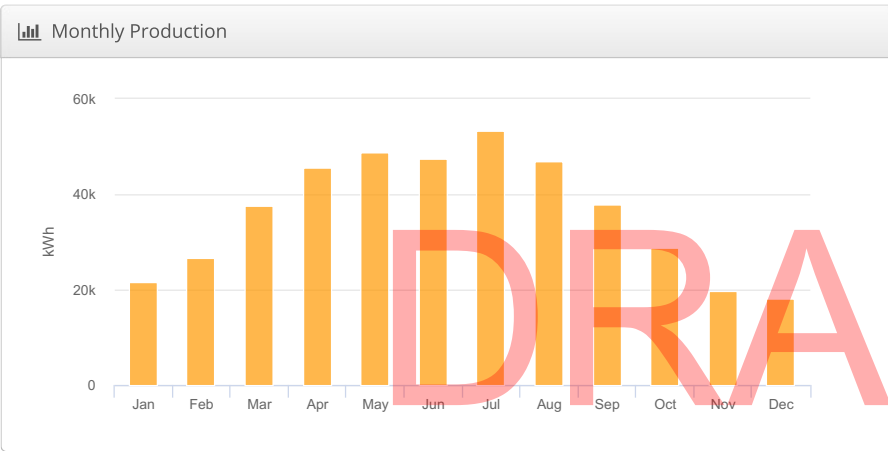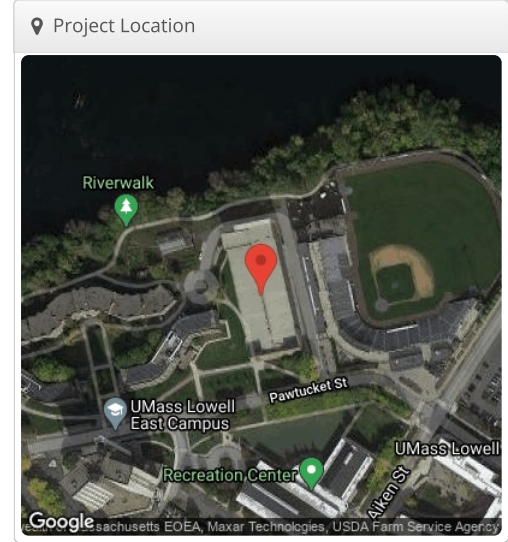

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.1	6.3%
	Shaded Irradiance	1,491.1	0.0%
	Irradiance after Reflection	1,431.9	-4.0%
	Irradiance after Soiling	1,403.3	-2.0%
	Total Collector Irradiance	1,403.3	0.0%
Energy (kWh)	Nameplate	469,803.5	
	Output at Irradiance Levels	465,718.1	-0.9%
	Output at Cell Temperature Derate	461,229.0	-1.0%
	Output After Mismatch	444,608.0	-3.6%
	Optimal DC Output	443,654.9	-0.2%
	Constrained DC Output	443,630.9	0.0%
	Inverter Output	434,758.2	-2.0%
	Energy to Grid	432,584.5	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								
	PVI 60TL (Solectria)	Folsom Labs		Spec Sheet								

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	50 (4,239.8 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	816 (334.6 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Landscape (Horizontal)	7°	167.25258302400846°	4.0 ft	4x1	204	816	334.6 kW




☑ Detailed Layout



Falmouth Hall UML Falmouth Hall, 1 University Ave. Lowell, MA 01854

Report	
Project Name	UML Falmouth Hall
Project Address	1 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Falmouth Hall
Module DC Nameplate	90.2 kW
Inverter AC Nameplate	99.9 kW Load Ratio: 0.90
Annual Production	120.2 MWh
Performance Ratio	87.3%
kWh/kWp	1,332.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

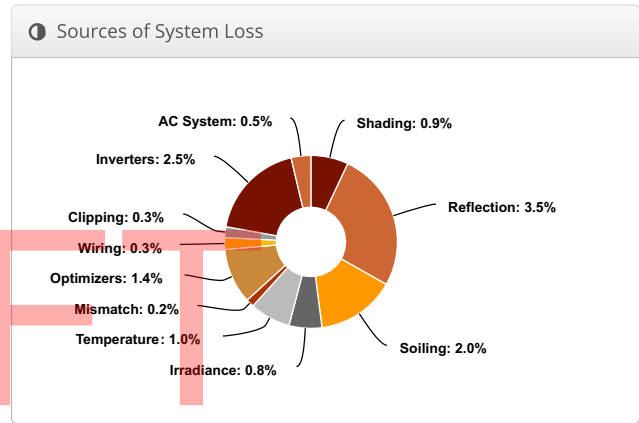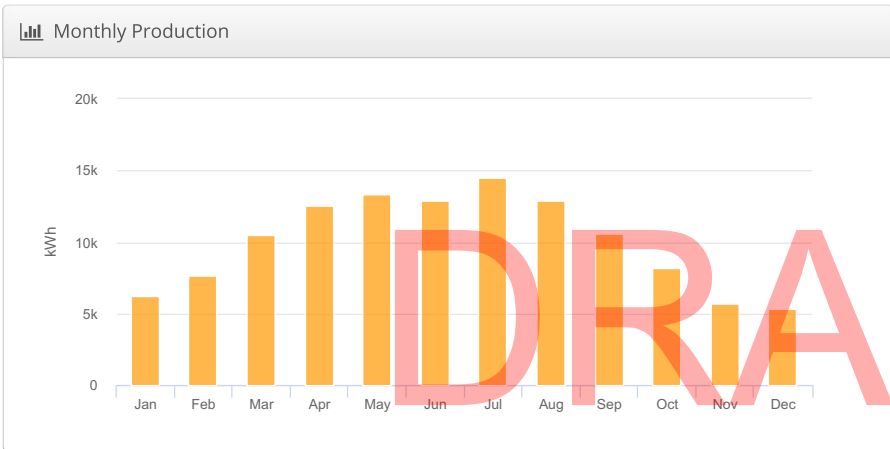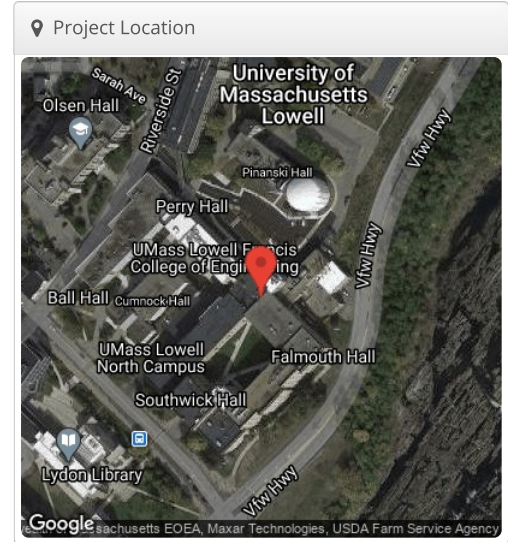

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,512.5	-0.9%
	Irradiance after Reflection	1,458.9	-3.5%
	Irradiance after Soiling	1,429.7	-2.0%
	Total Collector Irradiance	1,429.7	0.0%
Energy (kWh)	Nameplate	129,049.9	
	Output at Irradiance Levels	127,976.9	-0.8%
	Output at Cell Temperature Derate	126,658.2	-1.0%
	Output After Mismatch	126,400.8	-0.2%
	Optimizer Output	124,630.5	-1.4%
	Optimal DC Output	124,256.7	-0.3%
	Constrained DC Output	123,918.6	-0.3%
	Inverter Output	120,820.7	-2.5%
	Energy to Grid	120,216.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b									
	Fixed Tilt	-3.56	-0.075									
	Flush Mount	-2.81	-0.0455									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE33.3KUS (2020) (SolarEdge)	3 (99.9 kW)
Strings	10 AWG (Copper)	6 (1,489.3 ft)
Optimizers	P850 (2020) (SolarEdge)	112 (95.2 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	220 (90.2 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	220	220	90.2 kW

Detailed Layout



Fletcher Lot UML - Fletcher Lot, 20 Whiting St, Lowell, MA 01854


Report

Project Name	UML - Fletcher Lot
Project Address	20 Whiting St, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Fletcher Lot
Module DC Nameplate	317.3 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.06
Annual Production	401.8 MWh
Performance Ratio	86.6%
kWh/kWp	1,266.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

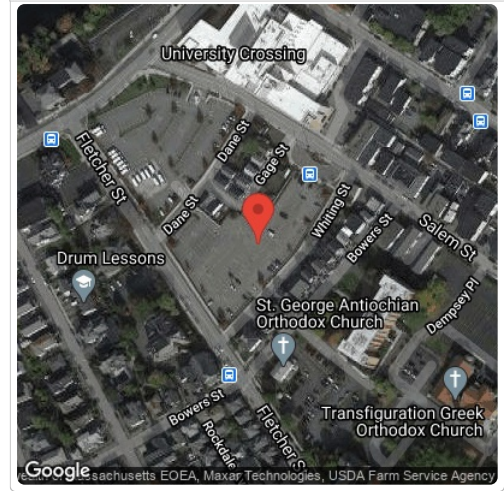

Monthly Production

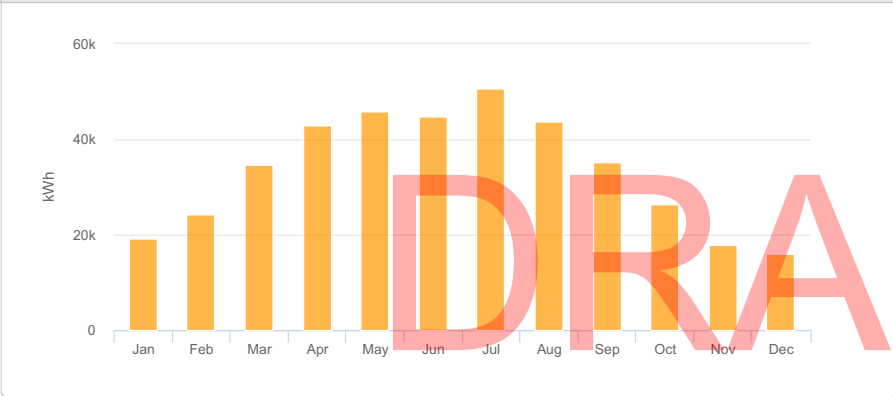

Sources of System Loss

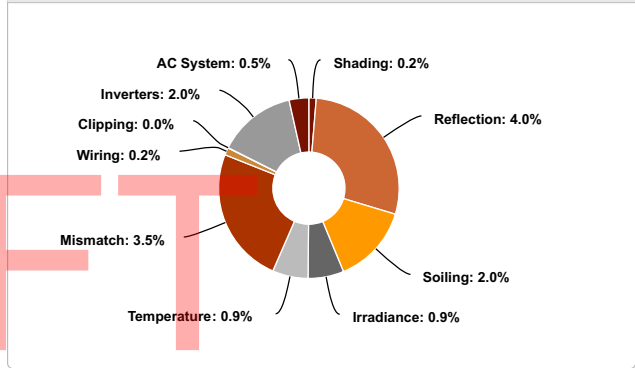

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,461.6	4.2%
	Shaded Irradiance	1,458.8	-0.2%
	Irradiance after Reflection	1,400.0	-4.0%
	Irradiance after Soiling	1,372.0	-2.0%
	Total Collector Irradiance	1,372.0	0.0%
Energy (kWh)	Nameplate	435,689.0	
	Output at Irradiance Levels	431,717.7	-0.9%
	Output at Cell Temperature Derate	427,795.1	-0.9%
	Output After Mismatch	412,908.6	-3.5%
	Optimal DC Output	412,125.5	-0.2%
	Constrained DC Output	412,099.4	0.0%
	Inverter Output	403,857.4	-2.0%
	Energy to Grid	401,838.1	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	49 (6,589.8 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	774 (317.3 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	120.96375653207355°	0.0 ft	1x1	210	210	86.1 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	133.90783840902867°	0.0 ft	1x1	204	204	83.6 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	133.90784°	0.0 ft	1x1	108	108	44.3 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	133.90784°	0.0 ft	1x1	96	96	39.4 kW
Field Segment 1 (copy 3)	Carport	Portrait (Vertical)	7°	133.90784°	0.0 ft <td 1x1	156	156	64.0 kW	



Fox Lot UML - Fox Lot, 100 Pawtucket St. Lowell, MA 01854


Report

Project Name	UML - Fox Lot
Project Address	100 Pawtucket St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Fox Lot
Module DC Nameplate	307.5 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.03
Annual Production	389.1 MWh
Performance Ratio	86.7%
kWh/kWp	1,265.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

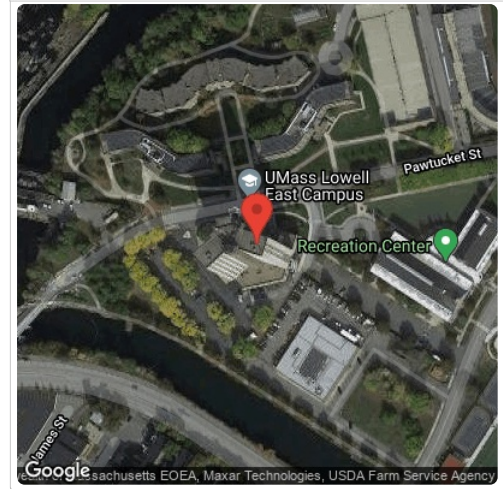

Monthly Production

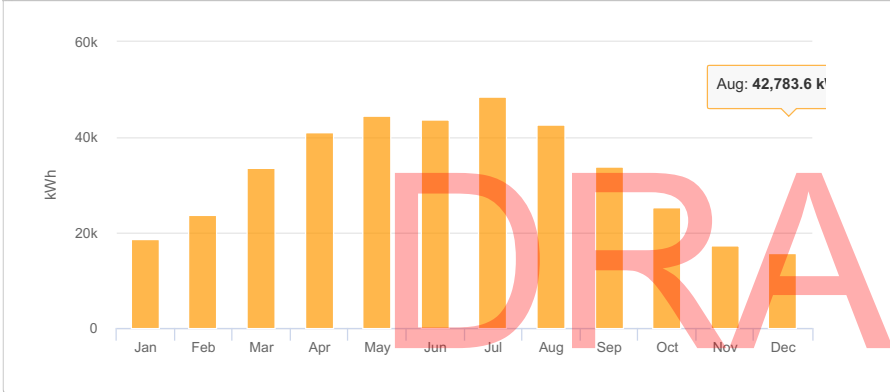

Sources of System Loss

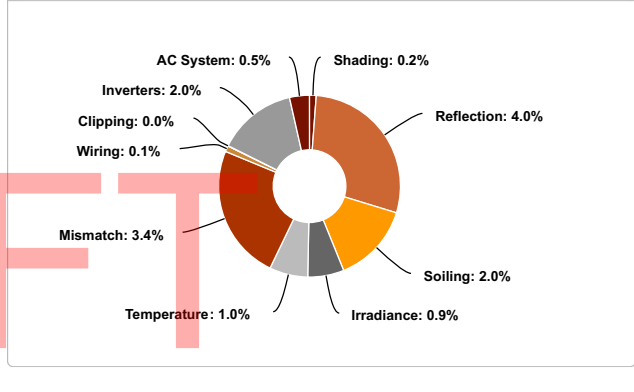

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,459.5	4.0%
	Shaded Irradiance	1,457.0	-0.2%
	Irradiance after Reflection	1,398.2	-4.0%
	Irradiance after Soiling	1,370.2	-2.0%
	Total Collector Irradiance	1,370.2	0.0%
Energy (kWh)	Nameplate	421,613.4	
	Output at Irradiance Levels	417,761.3	-0.9%
	Output at Cell Temperature Derate	413,731.3	-1.0%
	Output After Mismatch	399,618.1	-3.4%
	Optimal DC Output	399,022.3	-0.1%
	Constrained DC Output	399,000.8	0.0%
	Inverter Output	391,020.8	-2.0%
	Energy to Grid	389,065.7	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet Characterization, PAN				
Component Characterizations	Device	PVI 60TL (Solectria)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet				

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	45 (4,026.2 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	750 (307.5 kW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	229.6784506060385°	1.6 ft	6x1	35	210	86.1 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	229.67845°	1.6 ft	6x1	66	396	162.4 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	229.67845°	1.6 ft	6x1	24	144	59.0 kW

Detailed Layout

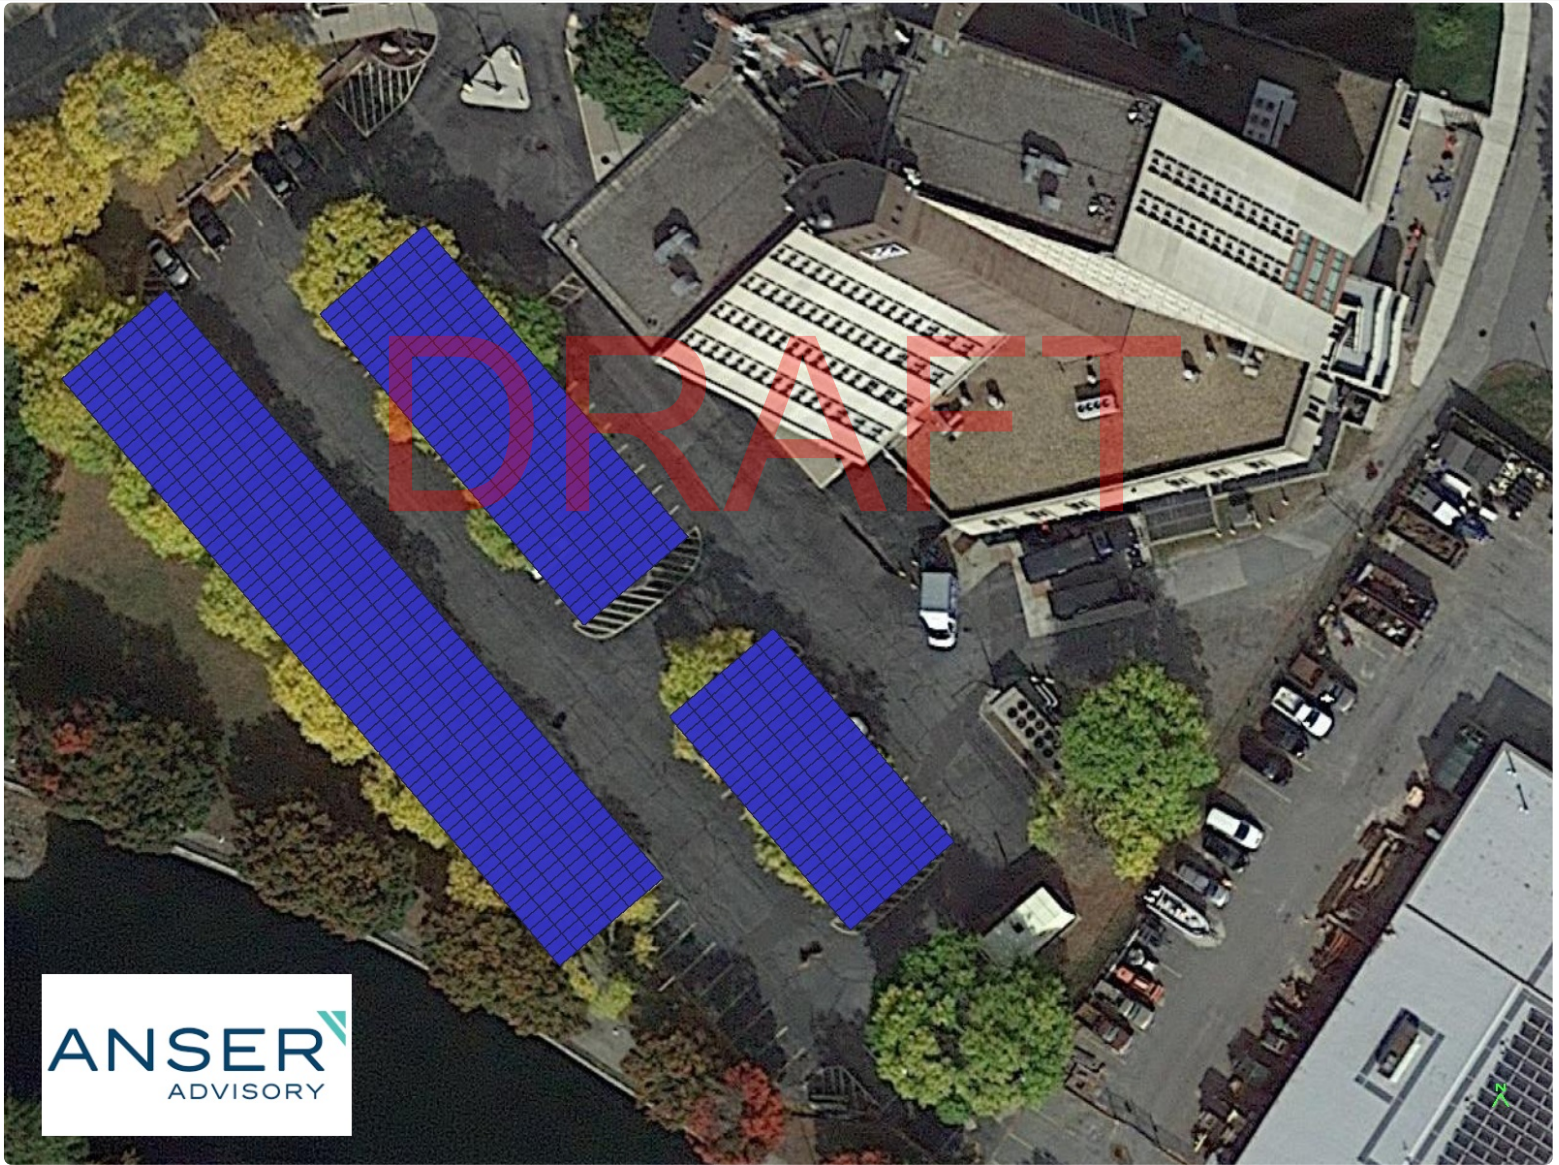

Fr. Morrissette Blvd. UML - Fr. Morrissette Blvd., 600 Suffolk St. Lowell, MA 01854


Report

Project Name	UML - Fr. Morrissette Blvd.
Project Address	600 Suffolk St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Fr. Morrissette Blvd.
Module DC Nameplate	157.4 kW
Inverter AC Nameplate	144.0 kW Load Ratio: 1.09
Annual Production	197.4 MWh
Performance Ratio	85.7%
kWh/kWp	1,253.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

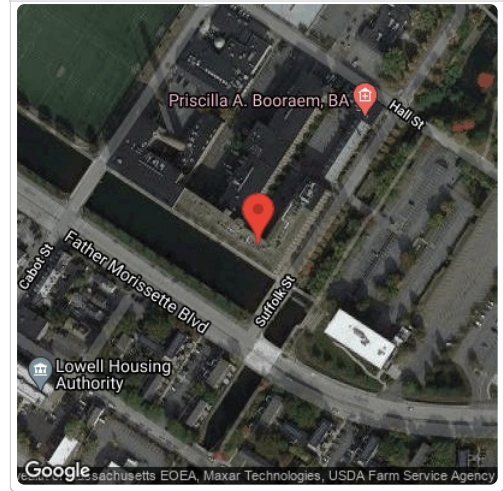

Monthly Production

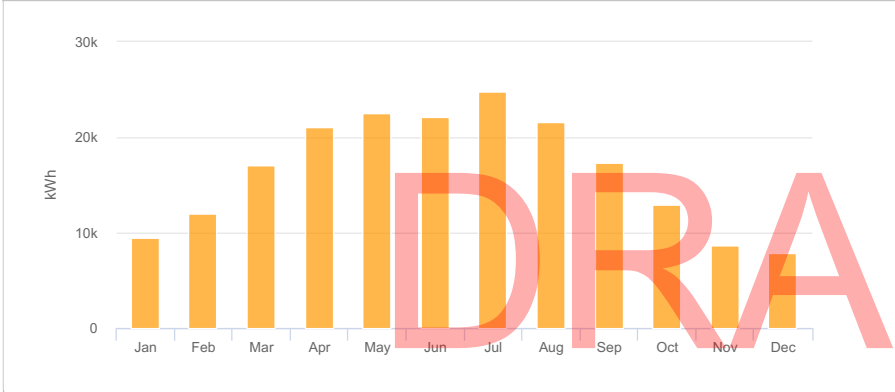

Sources of System Loss

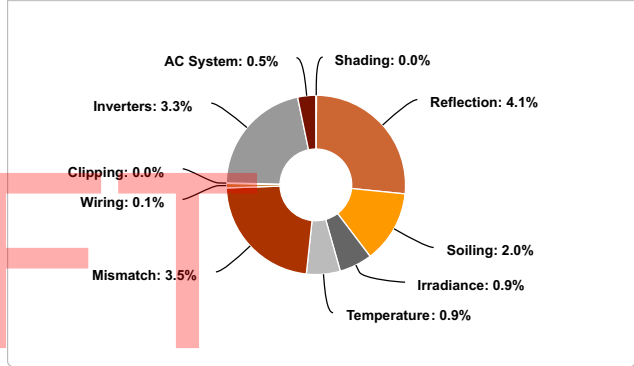

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,463.7	4.3%
	Shaded Irradiance	1,463.4	0.0%
	Irradiance after Reflection	1,404.1	-4.1%
	Irradiance after Soiling	1,376.0	-2.0%
	Total Collector Irradiance	1,376.0	0.0%
Energy (kWh)	Nameplate	216,775.2	
	Output at Irradiance Levels	214,809.1	-0.9%
	Output at Cell Temperature Derate	212,804.9	-0.9%
	Output After Mismatch	205,388.4	-3.5%
	Optimal DC Output	205,132.5	-0.1%
	Constrained DC Output	205,109.8	0.0%
	Inverter Output	198,397.7	-3.3%
	Energy to Grid	197,405.7	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								
	PVI 36TL 480V (Solectria)	Folsom Labs		Manufacturer								

Components

Component	Name	Count
Inverters	PVI 36TL 480V (Solectria)	4 (144.0 kW)
Strings	10 AWG (Copper)	24 (1,610.2 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	384 (157.4 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	121.57630389402976°	0.0 ft	1x1	192	192	78.7 kW
Field Segment 2	Carport	Portrait (Vertical)	7°	213.69006752597966°	0.0 ft	1x1	192	192	78.7 kW

Detailed Layout






Graduate and Professional Studies Center UML - Graduate and Professional Studies

Center, 839 Merrimack St. Lowell, MA 01854

Report	
Project Name	UML - Graduate and Professional Studies Center
Project Address	839 Merrimack St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Graduate and Professional Studies Center
Module DC Nameplate	41.0 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 1.23
Annual Production	53.74 MWh
Performance Ratio	85.8%
kWh/kWp	1,310.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

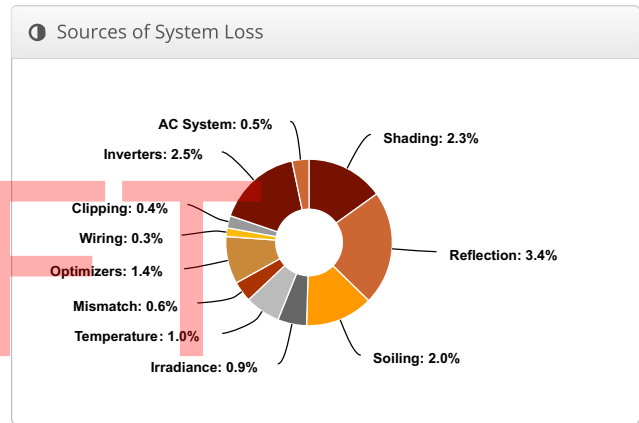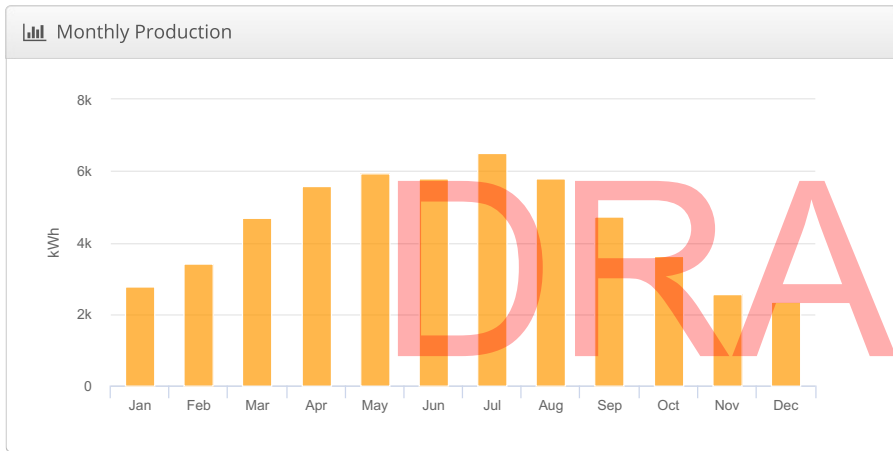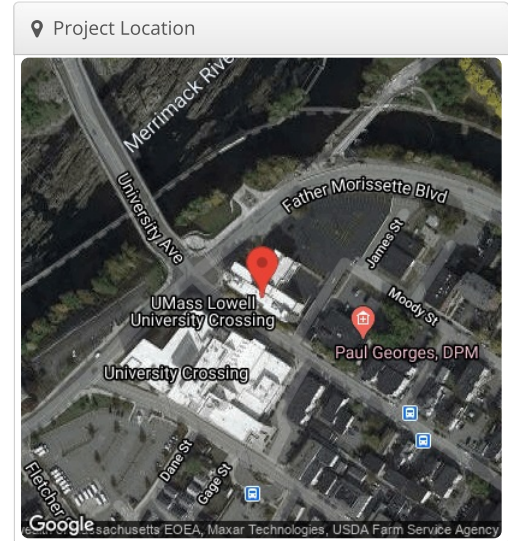

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,491.9	-2.3%
	Irradiance after Reflection	1,441.6	-3.4%
	Irradiance after Soiling	1,412.7	-2.0%
	Total Collector Irradiance	1,412.9	0.0%
Energy (kWh)	Nameplate	57,967.7	
	Output at Irradiance Levels	57,474.6	-0.9%
	Output at Cell Temperature Derate	56,876.5	-1.0%
	Output After Mismatch	56,532.3	-0.6%
	Optimizer Output	55,740.6	-1.4%
	Optimal DC Output	55,599.5	-0.3%
	Constrained DC Output	55,397.4	-0.4%
	Inverter Output	54,009.3	-2.5%
Energy to Grid	53,739.3	-0.5%	
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By		Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By		Characterization									

Components		
Component Name		Count
Inverters	SE33.3K (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	3 (345.9 ft)
Optimizers	P850 (2020) (SolarEdge)	51 (43.4 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	100 (41.0 kW)

Wiring Zones										
Description	Combiner Poles	String Size		Stringing Strategy						
Wiring Zone	-	13-37		Along Racking						
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	65	65	26.7 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	35	35	14.4 kW	

DRAFT

Detailed Layout






ANSER
ADVISORY

Hall St. Garage UML - Hall St. Garage, 21 Perkins St. Lowell, MA 01854

Report	
Project Name	UML - Hall St. Garage
Project Address	21 Perkins St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Hall St. Garage
Module DC Nameplate	362.4 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.21
Annual Production	464.4 MWh
Performance Ratio	86.7%
kWh/kWp	1,281.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

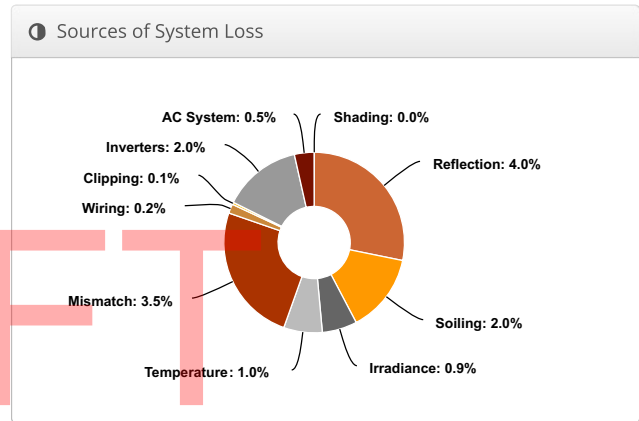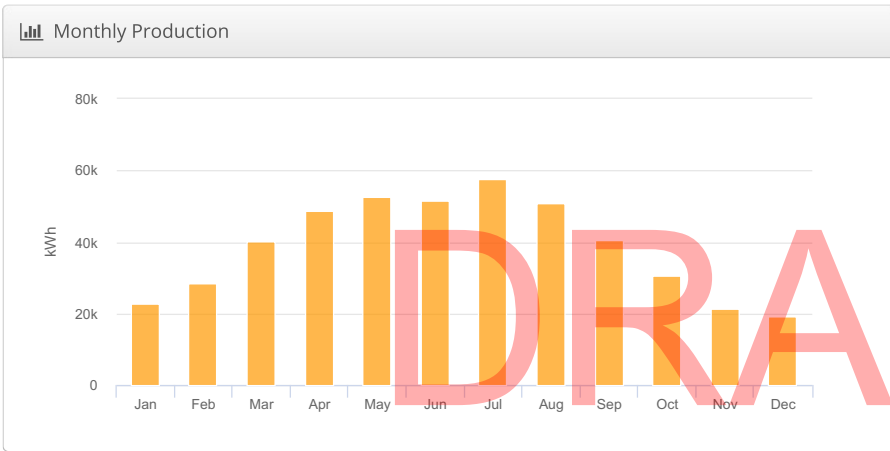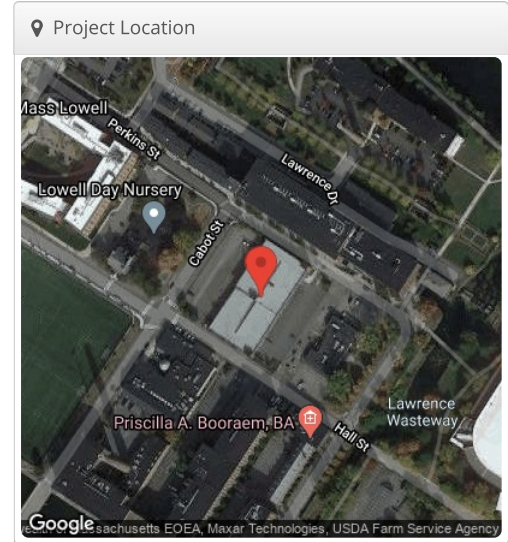

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,478.3	5.4%
	Shaded Irradiance	1,478.2	0.0%
	Irradiance after Reflection	1,419.2	-4.0%
	Irradiance after Soiling	1,390.8	-2.0%
	Total Collector Irradiance	1,390.8	0.0%
Energy (kWh)	Nameplate	504,429.9	
	Output at Irradiance Levels	499,960.8	-0.9%
	Output at Cell Temperature Derate	495,069.0	-1.0%
	Output After Mismatch	477,631.2	-3.5%
	Optimal DC Output	476,508.5	-0.2%
	Constrained DC Output	476,241.3	-0.1%
	Inverter Output	466,711.7	-2.0%
	Energy to Grid	464,378.1	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								
	PVI 60TL (Solectria)	Folsom Labs		Spec Sheet								

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	55 (6,019.3 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	884 (362.4 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-17	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Landscape (Horizontal)	7°	212.02466822233782°	4.0 ft	4x1	221	884	362.4 kW

Detailed Layout






Health & Social Sciences Building UML - Health & Social Sciences Building, 113 Wilder St. Lowell, MA 01854

MA 01854

Report	
Project Name	UML - Health & Social Sciences Building
Project Address	113 Wilder St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Health & Social Sciences Building
Module DC Nameplate	34.0 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 1.02
Annual Production	43.33 MWh
Performance Ratio	83.9%
kWh/kWp	1,273.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	5f5cdd1076-3edb84d28b-6bff68b913-0b0d9d60b5

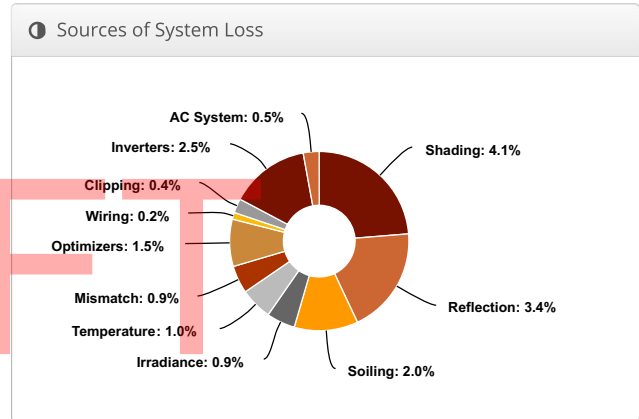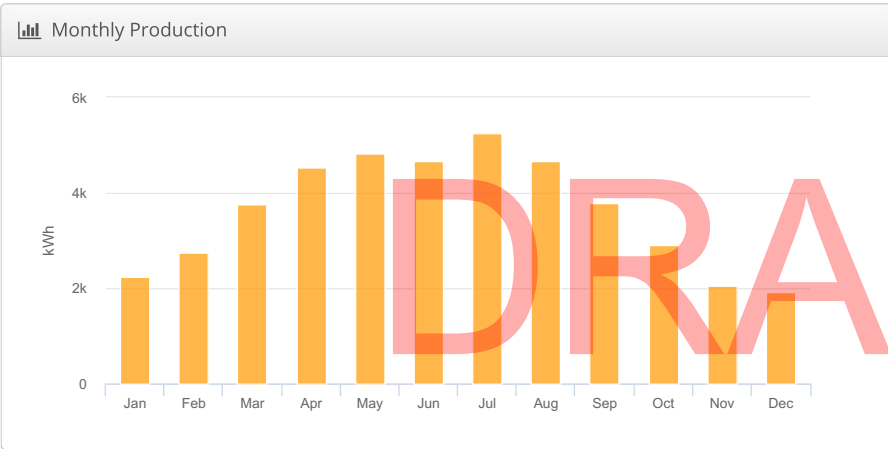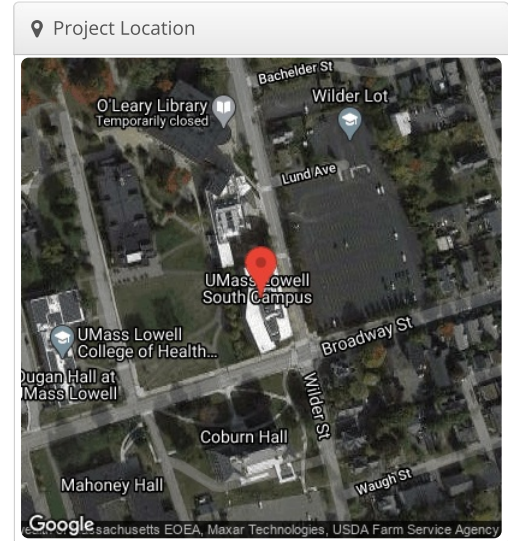


Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,517.1	8.1%
	Shaded Irradiance	1,454.5	-4.1%
	Irradiance after Reflection	1,405.7	-3.4%
	Irradiance after Soiling	1,377.6	-2.0%
	Total Collector Irradiance	1,378.0	0.0%
Energy (kWh)	Nameplate	46,928.6	
	Output at Irradiance Levels	46,506.5	-0.9%
	Output at Cell Temperature Derate	46,039.4	-1.0%
	Output After Mismatch	45,639.7	-0.9%
	Optimizer Output	44,963.0	-1.5%
	Optimal DC Output	44,867.0	-0.2%
	Constrained DC Output	44,665.7	-0.4%
	Inverter Output	43,549.1	-2.5%
	Energy to Grid	43,331.3	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By					Characterization						
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs					Spec Sheet Characterization, PAN						
Component Characterizations	Device	Uploaded By					Characterization						

Components		
Component Name		Count
Inverters	SE33.3KUS (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	3 (207.2 ft)
Optimizers	P850 (2020) (SolarEdge)	42 (35.7 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	83 (34.0 kW)

Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		13-37		Along Racking					
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	156.70543674610553°	2.0 ft	1x1	86	83	34.0 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	3	0	0	

Detailed Layout

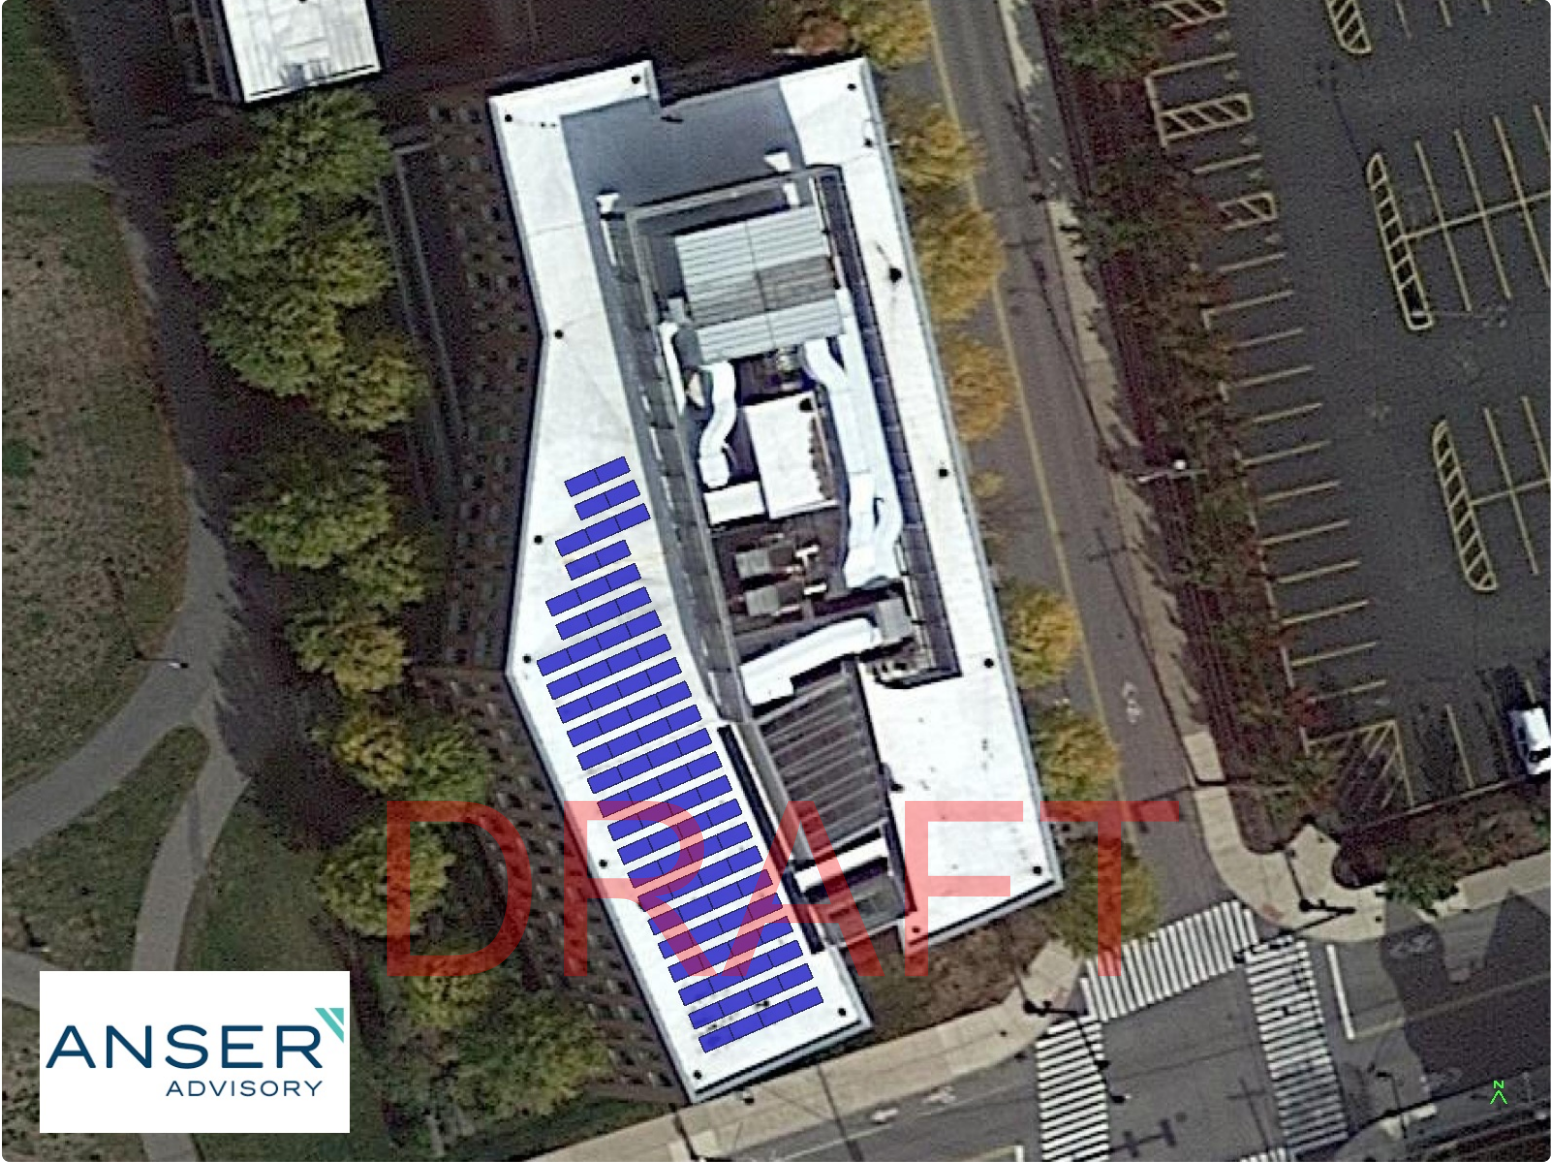

ANSER
ADVISORY

Kitson Hall UML - Kitson Hall, 21 University Ave, Lowell, MA 01854


Report

Project Name	UML - Kitson Hall
Project Address	21 University Ave, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Kitson Hall
Module DC Nameplate	88.2 kW
Inverter AC Nameplate	100.0 kW Load Ratio: 0.88
Annual Production	119.2 MWh
Performance Ratio	88.5%
kWh/kWp	1,351.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

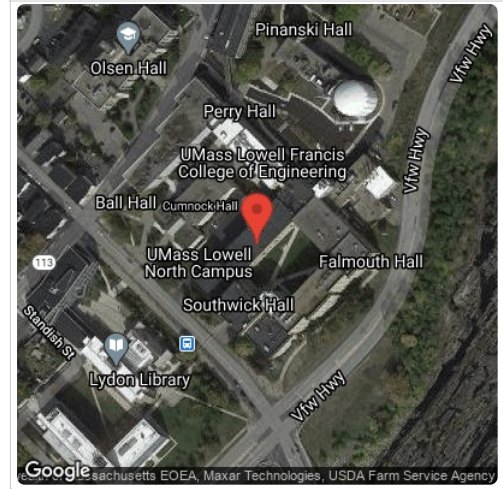

Monthly Production

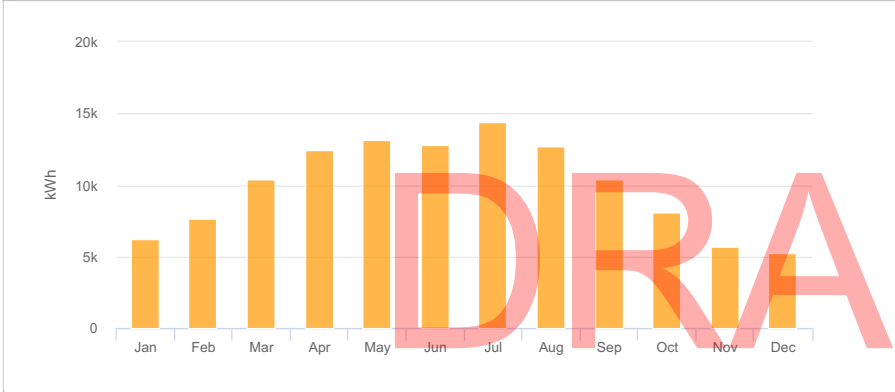

Sources of System Loss

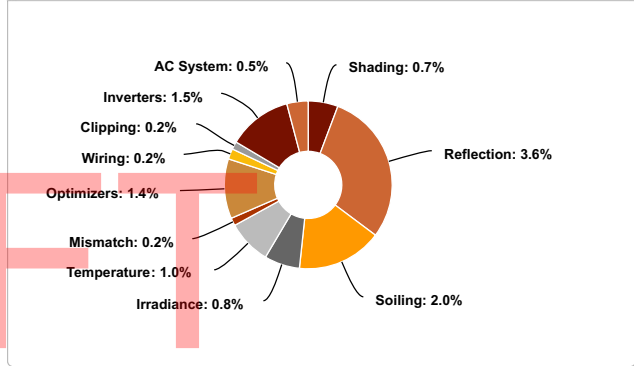

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.3	-0.7%
	Irradiance after Reflection	1,462.0	-3.6%
	Irradiance after Soiling	1,432.8	-2.0%
	Total Collector Irradiance	1,432.8	0.0%
Energy (kWh)	Nameplate	126,392.7	
	Output at Irradiance Levels	125,345.1	-0.8%
	Output at Cell Temperature Derate	124,055.0	-1.0%
	Output After Mismatch	123,829.8	-0.2%
	Optimizer Output	122,095.3	-1.4%
	Optimal DC Output	121,797.0	-0.2%
	Constrained DC Output	121,575.6	-0.2%
	Inverter Output	119,752.0	-1.5%
	Energy to Grid	119,153.2	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
									Spec Sheet Characterization, PAN				
Component Characterizations	Device							Uploaded By					

Components		
Component	Name	Count
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
Strings	10 AWG (Copper)	6 (796.5 ft)
Optimizers	P850 (2020) (SolarEdge)	108 (91.8 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	215 (88.2 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	215	215	88.2 kW

Detailed Layout



Lower Locks Garage UML - Lower Locks Garage, 50 Warren St. Lowell, MA 01854


Report

Project Name	UML - Lower Locks Garage
Project Address	50 Warren St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Lower Locks Garage
Module DC Nameplate	469.0 kW
Inverter AC Nameplate	420.0 kW Load Ratio: 1.12
Annual Production	606.6 MWh
Performance Ratio	86.7%
kWh/kWp	1,293.2
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89


Project Location

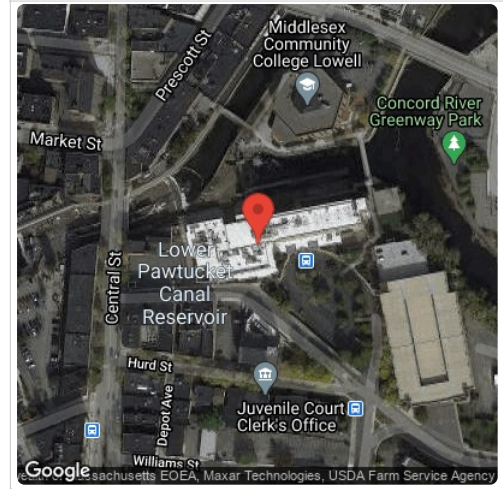

Monthly Production

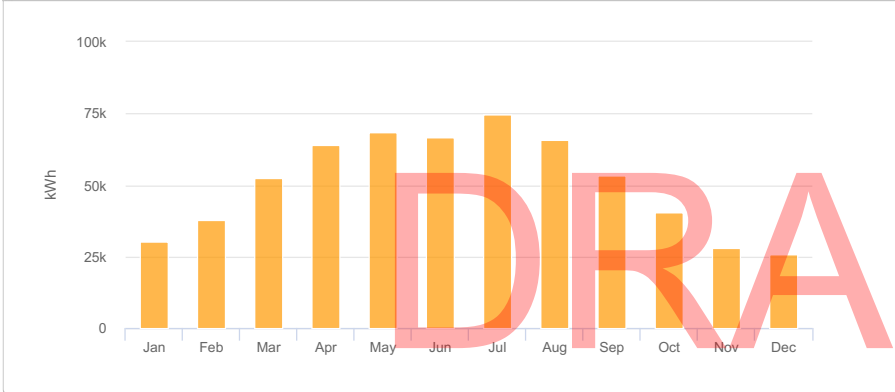

Sources of System Loss

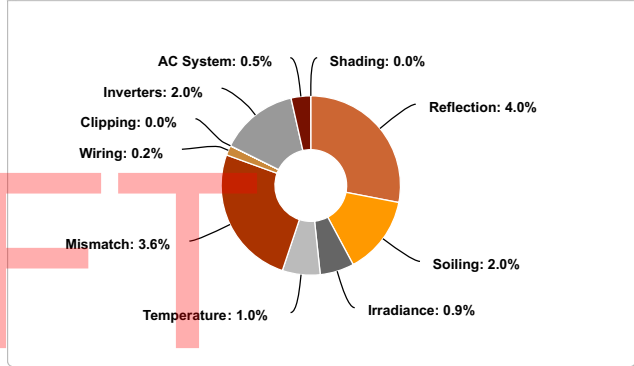

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.7	6.3%
	Shaded Irradiance	1,491.7	0.0%
	Irradiance after Reflection	1,432.5	-4.0%
	Irradiance after Soiling	1,403.9	-2.0%
	Total Collector Irradiance	1,403.9	0.0%
Energy (kWh)	Nameplate	658,907.5	
	Output at Irradiance Levels	653,182.8	-0.9%
	Output at Cell Temperature Derate	646,876.2	-1.0%
	Output After Mismatch	623,632.8	-3.6%
	Optimal DC Output	622,088.9	-0.2%
	Constrained DC Output	622,055.2	0.0%
	Inverter Output	609,614.1	-2.0%
	Energy to Grid	606,566.0	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
									Spec Sheet Characterization, PAN				
Component Characterizations	Device	PVI 60TL (Solectria)						Uploaded By	Folsom Labs				
									Spec Sheet				

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	7 (420.0 kW)
Strings	10 AWG (Copper)	70 (8,421.2 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	1,144 (469.0 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Landscape (Horizontal)	7°	169.1203925423357°	4.0 ft	4x1	286	1,144	469.0 kW




Detailed Layout



Lydon Library UML - Lydon Library, 84 University Ave. Lowell, MA 01854

Report	
Project Name	UML - Lydon Library
Project Address	84 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Lydon Library
Module DC Nameplate	44.7 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 0.67
Annual Production	59.50 MWh
Performance Ratio	87.2%
kWh/kWp	1,331.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

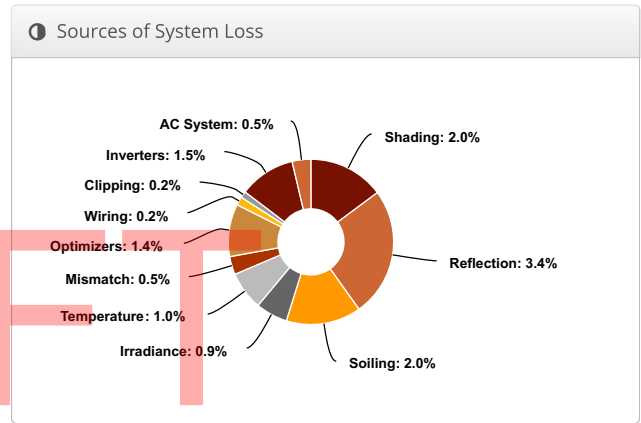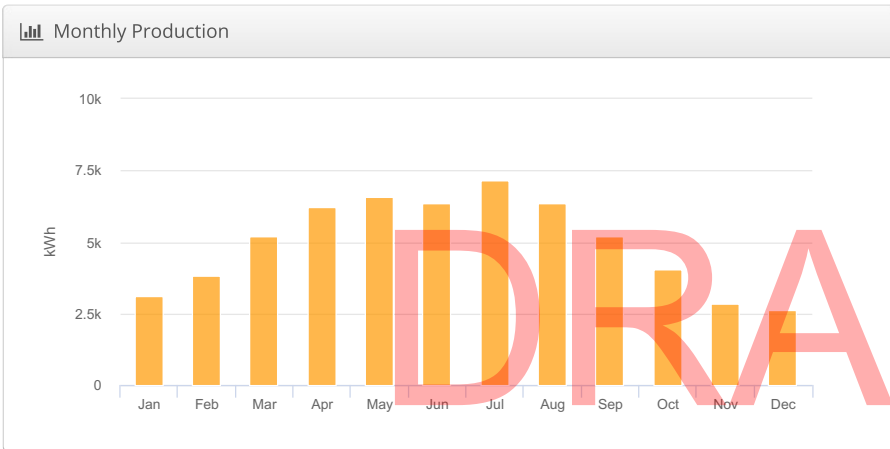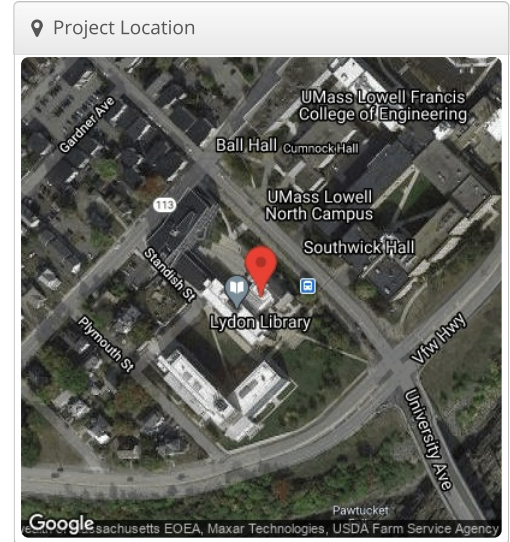

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,496.0	-2.0%
	Irradiance after Reflection	1,444.4	-3.4%
	Irradiance after Soiling	1,415.5	-2.0%
	Total Collector Irradiance	1,415.4	0.0%
Energy (kWh)	Nameplate	63,295.3	
	Output at Irradiance Levels	62,757.2	-0.9%
	Output at Cell Temperature Derate	62,113.9	-1.0%
	Output After Mismatch	61,812.1	-0.5%
	Optimizer Output	60,946.6	-1.4%
	Optimal DC Output	60,810.4	-0.2%
	Constrained DC Output	60,705.1	-0.2%
	Inverter Output	59,794.5	-1.5%
	Energy to Grid	59,495.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Strings	10 AWG (Copper)	3 (337.9 ft)
Optimizers	P850 (2020) (SolarEdge)	55 (46.8 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	109 (44.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	109	109	44.7 kW

Detailed Layout



Mahoney Hall UML - Mahoney Hall, 870 Broadway St. Lowell, MA 01854

Report

Project Name	UML - Mahoney Hall
Project Address	870 Broadway St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Mahoney Hall
Module DC Nameplate	166.1 kW
Inverter AC Nameplate	133.2 kW Load Ratio: 1.25
Annual Production	221.6 MWh
Performance Ratio	87.7%
kWh/kWp	1,334.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	5f5cdd1076-3edb84d28b-6bff68b913-0b0d9d60b5


Project Location



Monthly Production

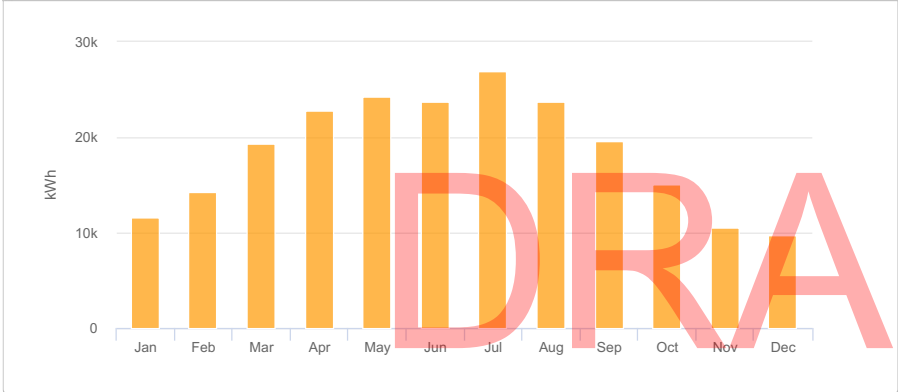

Sources of System Loss

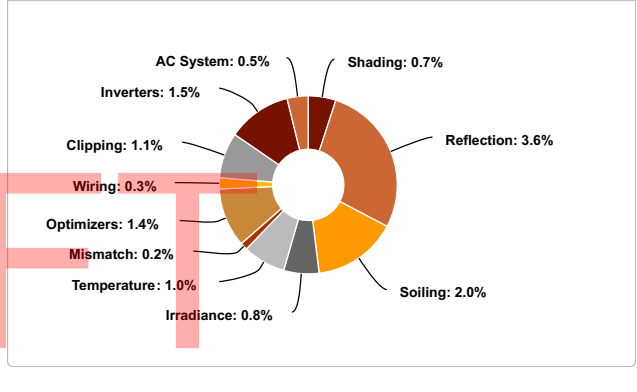

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,521.7	8.4%
	Shaded Irradiance	1,511.7	-0.7%
	Irradiance after Reflection	1,457.1	-3.6%
	Irradiance after Soiling	1,427.9	-2.0%
	Total Collector Irradiance	1,427.9	0.0%
Energy (kWh)	Nameplate	237,273.0	
	Output at Irradiance Levels	235,291.0	-0.8%
	Output at Cell Temperature Derate	232,904.4	-1.0%
	Output After Mismatch	232,505.7	-0.2%
	Optimizer Output	229,248.6	-1.4%
	Optimal DC Output	228,644.0	-0.3%
	Constrained DC Output	226,176.3	-1.1%
	Inverter Output	222,754.4	-1.5%
	Energy to Grid	221,640.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components

Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	2 (133.2 kW)
Strings	10 AWG (Copper)	11 (1,159.8 ft)
Optimizers	P850 (2020) (SolarEdge)	207 (176.0 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	405 (166.1 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	162.7214859387965°	2.0 ft	1x1	187	187	76.7 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	162.72148°	2.0 ft	1x1	228	218	89.4 kW

Detailed Layout



North Parking Garage UML - North Parking Garage, 293 Riverside St, Lowell, MA 01854


Report

Project Name	UML - North Parking Garage
Project Address	293 Riverside St, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	North Parking Garage
Module DC Nameplate	306.7 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.02
Annual Production	385.1 MWh
Performance Ratio	86.6%
kWh/kWp	1,255.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

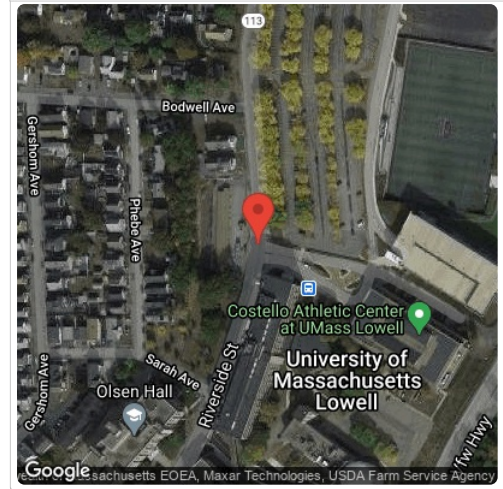

Monthly Production

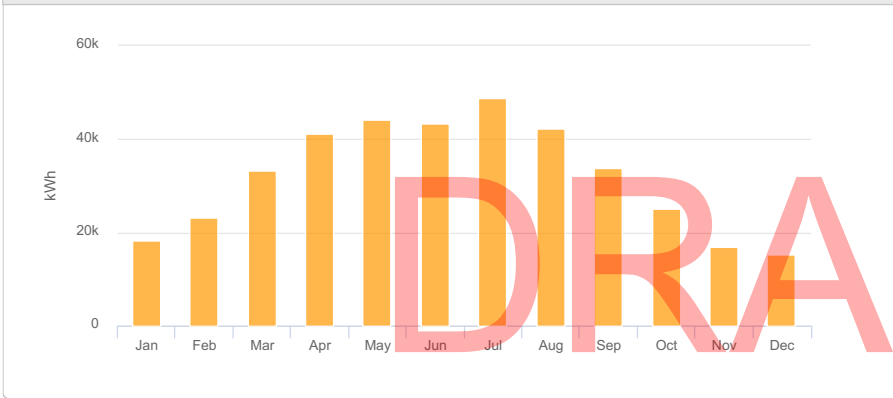

Sources of System Loss

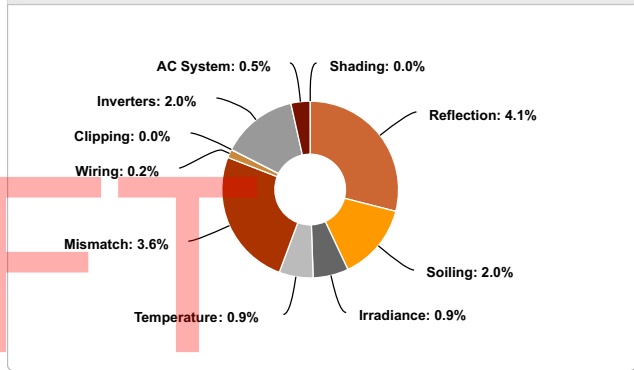

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,450.6	3.4%
	Shaded Irradiance	1,450.5	0.0%
	Irradiance after Reflection	1,390.6	-4.1%
	Irradiance after Soiling	1,362.8	-2.0%
	Total Collector Irradiance	1,362.8	0.0%
Energy (kWh)	Nameplate	418,208.4	
	Output at Irradiance Levels	414,334.2	-0.9%
	Output at Cell Temperature Derate	410,656.7	-0.9%
	Output After Mismatch	395,857.0	-3.6%
	Optimal DC Output	394,995.8	-0.2%
	Constrained DC Output	394,974.7	0.0%
	Inverter Output	387,075.2	-2.0%
	Energy to Grid	385,139.8	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	45 (4,231.6 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	748 (306.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-17	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Landscape (Horizontal)	7°	121.6°	4.0 ft	4x1	187	748	306.7 kW

Detailed Layout



O'Leary Library UML - O'Leary Library, 61 Wilder St. Lowell, MA 01854


Report

Project Name	UML - O'Leary Library
Project Address	61 Wilder St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	O'Leary Library
Module DC Nameplate	139.4 kW
Inverter AC Nameplate	133.2 kW Load Ratio: 1.05
Annual Production	187.1 MWh
Performance Ratio	87.9%
kWh/kWp	1,342.4
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	5f5cdd1076-3edb84d28b-6bff68b913-0b0d9d60b5


Project Location

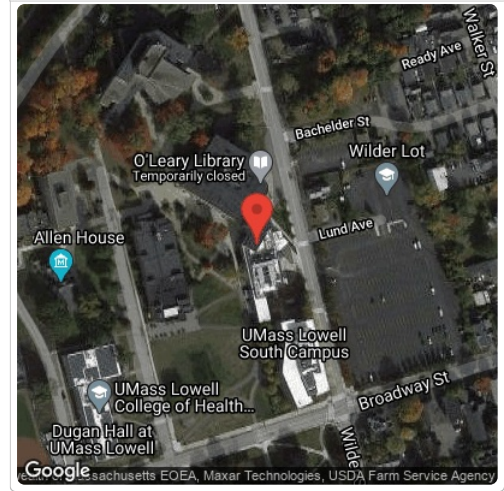

Monthly Production

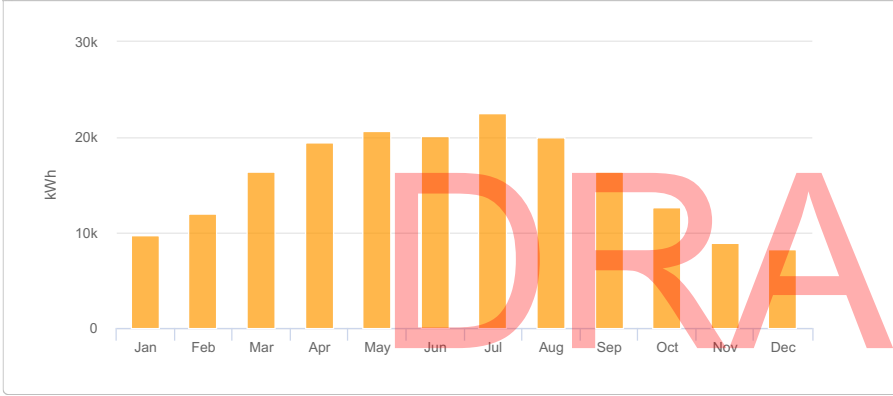

Sources of System Loss

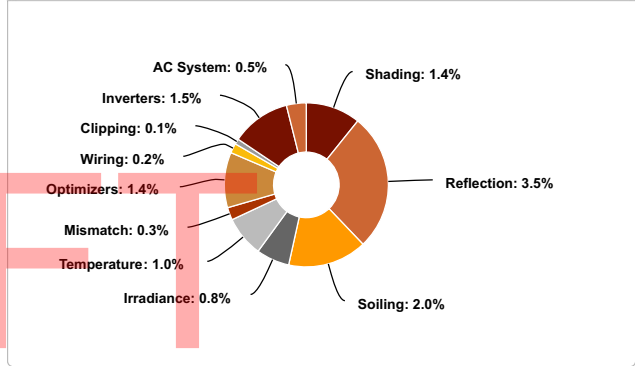

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,505.8	-1.4%
	Irradiance after Reflection	1,453.5	-3.5%
	Irradiance after Soiling	1,424.4	-2.0%
	Total Collector Irradiance	1,424.5	0.0%
Energy (kWh)	Nameplate	198,698.2	
	Output at Irradiance Levels	197,033.6	-0.8%
	Output at Cell Temperature Derate	195,006.2	-1.0%
	Output After Mismatch	194,387.9	-0.3%
	Optimizer Output	191,665.0	-1.4%
	Optimal DC Output	191,194.0	-0.2%
	Constrained DC Output	190,937.2	-0.1%
	Inverter Output	188,073.1	-1.5%
	Energy to Grid	187,132.8	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
									Spec Sheet Characterization, PAN				
Component Characterizations	Device							Uploaded By					

Components

Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	2 (133.2 kW)
Strings	10 AWG (Copper)	10 (1,287.5 ft)
Optimizers	P850 (2020) (SolarEdge)	170 (144.5 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	340 (139.4 kW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	356	340	139.4 kW




Detailed Layout

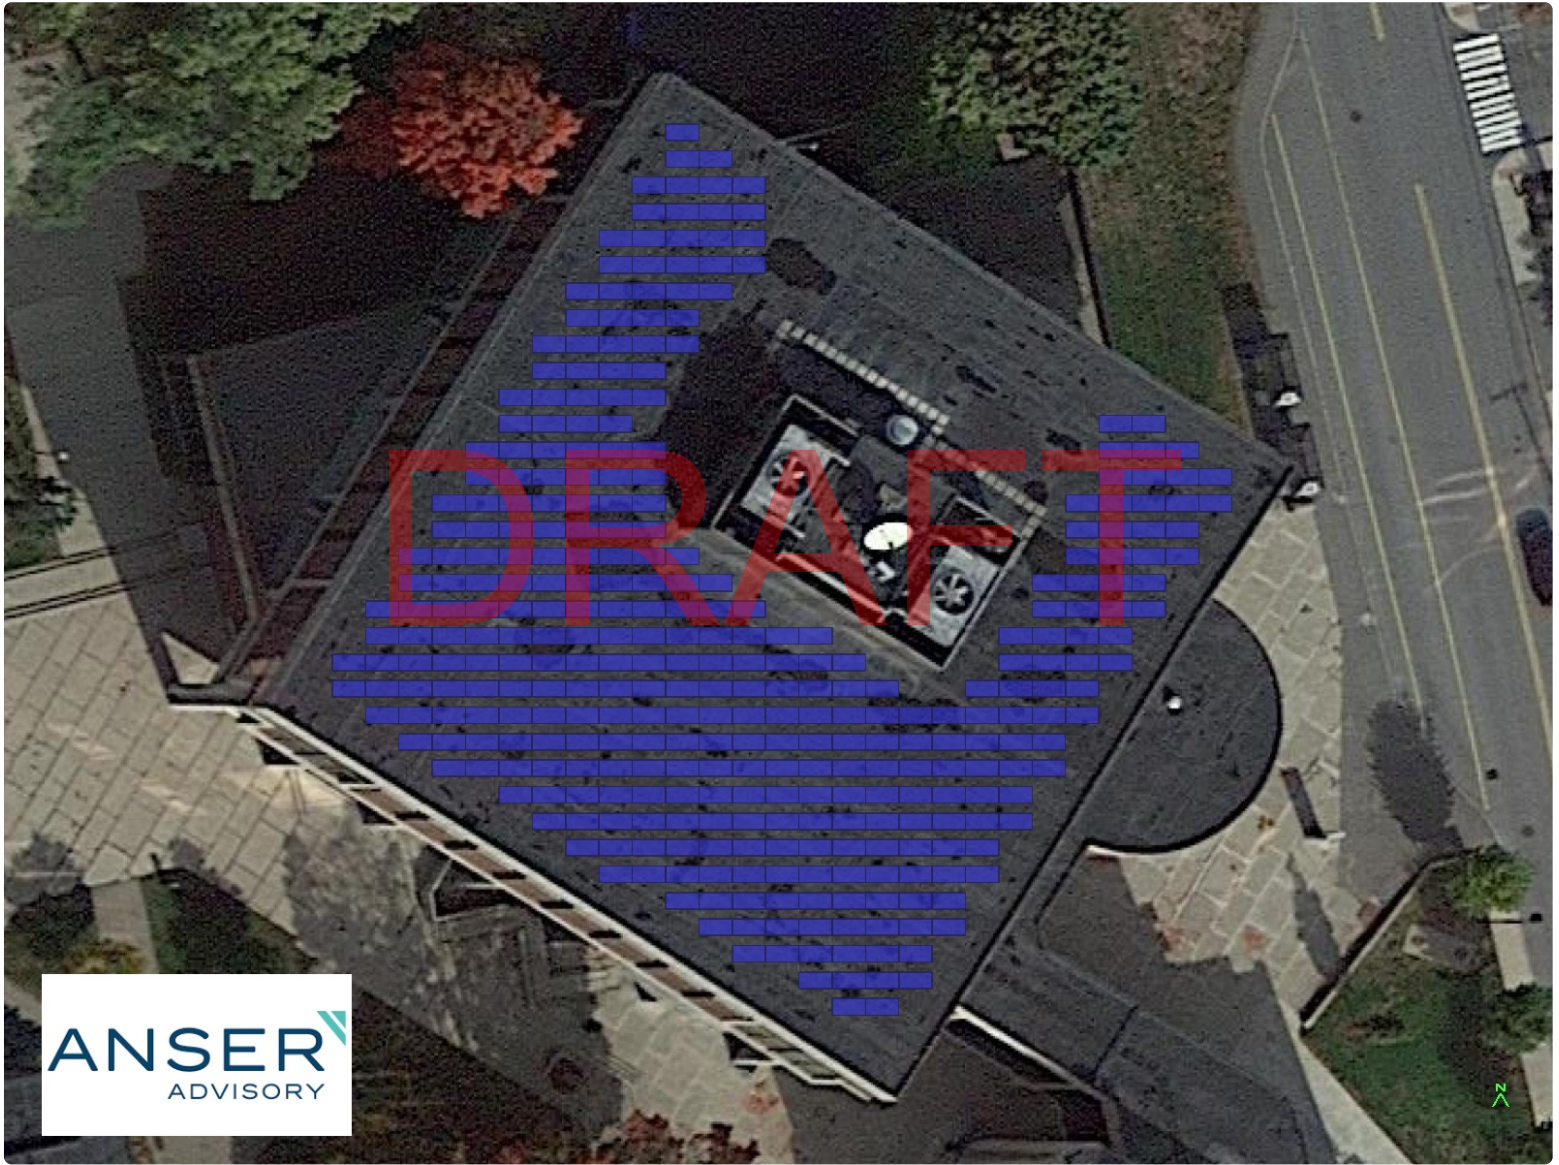

Olney Hall UML - Olney Hall, 265 Riverside St, Lowell, MA 01854

Report	
Project Name	UML - Olney Hall
Project Address	265 Riverside St, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Olney Hall
Module DC Nameplate	110.7 kW
Inverter AC Nameplate	100.0 kW Load Ratio: 1.11
Annual Production	141.5 MWh
Performance Ratio	88.7%
kWh/kWp	1,278.5
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89

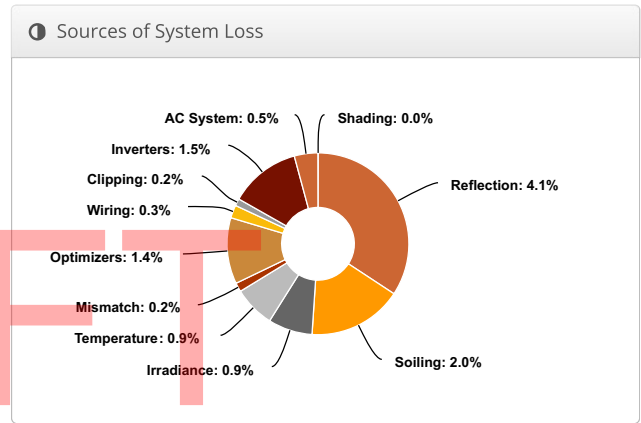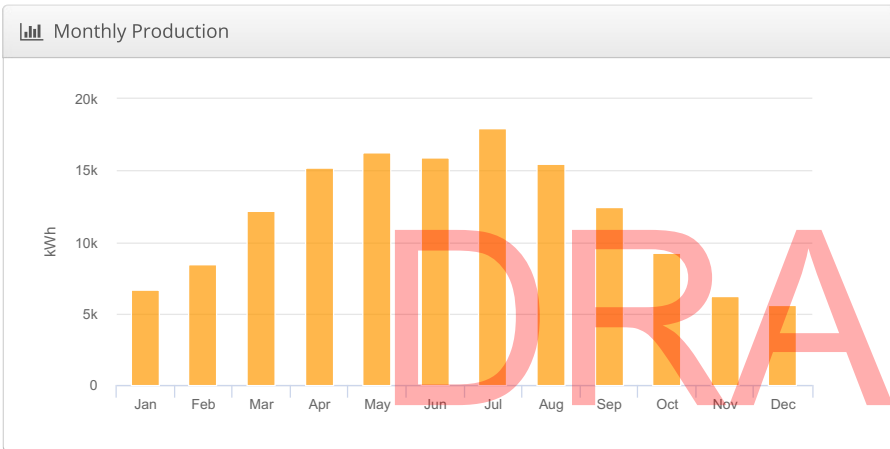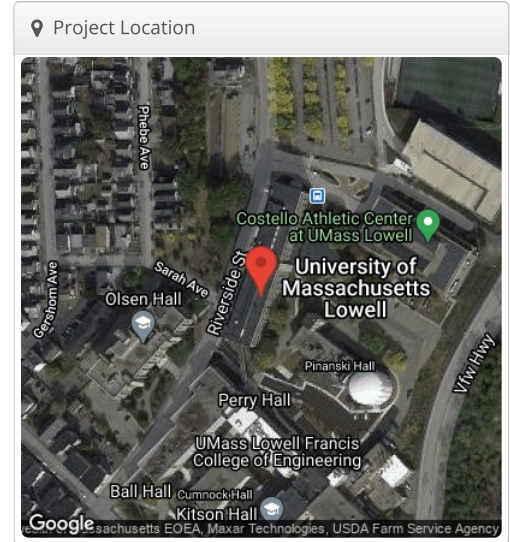

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,441.3	2.7%
	Shaded Irradiance	1,441.2	0.0%
	Irradiance after Reflection	1,382.5	-4.1%
	Irradiance after Soiling	1,354.8	-2.0%
	Total Collector Irradiance	1,354.8	0.0%
Energy (kWh)	Nameplate	150,069.1	
	Output at Irradiance Levels	148,660.1	-0.9%
	Output at Cell Temperature Derate	147,362.6	-0.9%
	Output After Mismatch	147,081.7	-0.2%
	Optimizer Output	145,020.0	-1.4%
	Optimal DC Output	144,623.1	-0.3%
	Constrained DC Output	144,403.2	-0.2%
	Inverter Output	142,237.1	-1.5%
	Energy to Grid	141,525.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
Strings	10 AWG (Copper)	8 (1,329.2 ft)
Optimizers	P850 (2020) (SolarEdge)	136 (115.6 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	270 (110.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	108.92132°	0.0 ft	5x1	54	270	110.7 kW

Detailed Layout

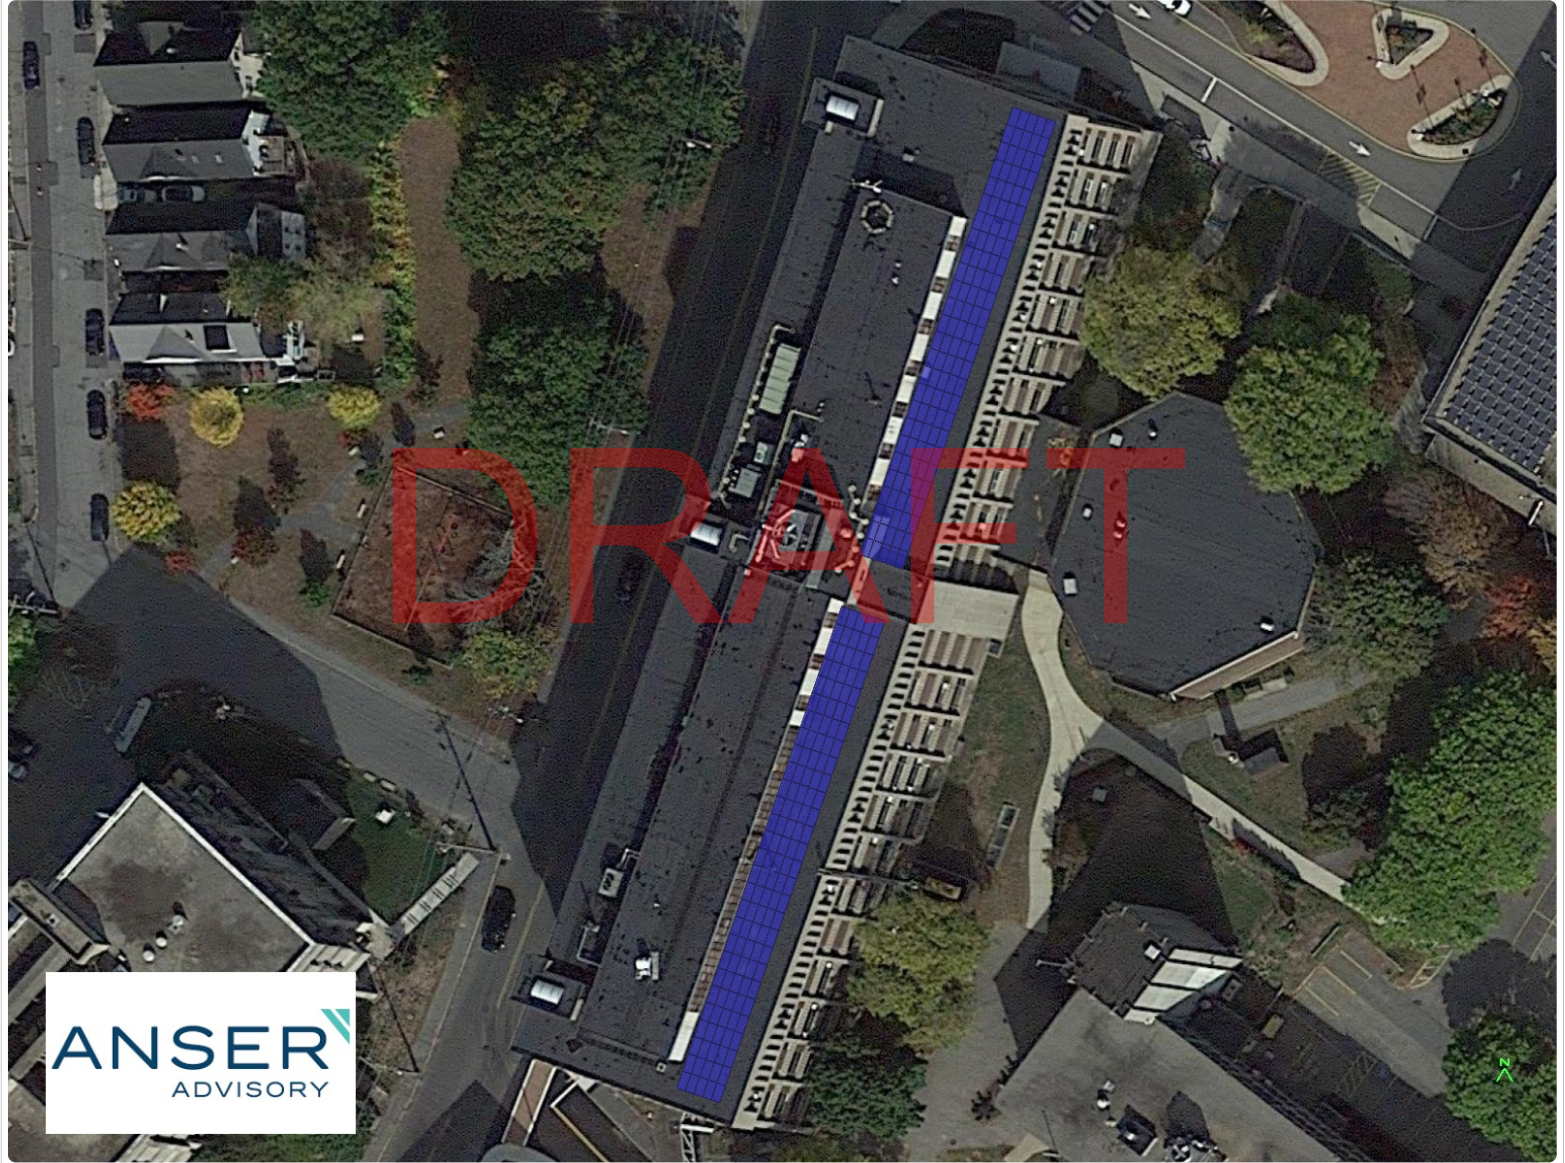

Olsen Hall UML - Olsen Hall, 198 Riverside St. Lowell, MA 01854


Report

Project Name	UML - Olsen Hall
Project Address	198 Riverside St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Olsen Hall
Module DC Nameplate	57.0 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 0.86
Annual Production	76.79 MWh
Performance Ratio	88.2%
kWh/kWp	1,347.4
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

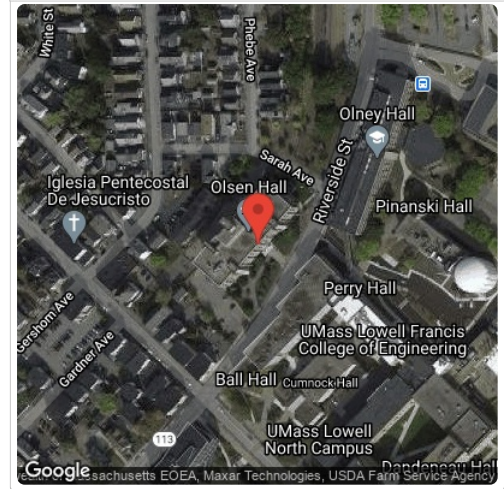

Monthly Production

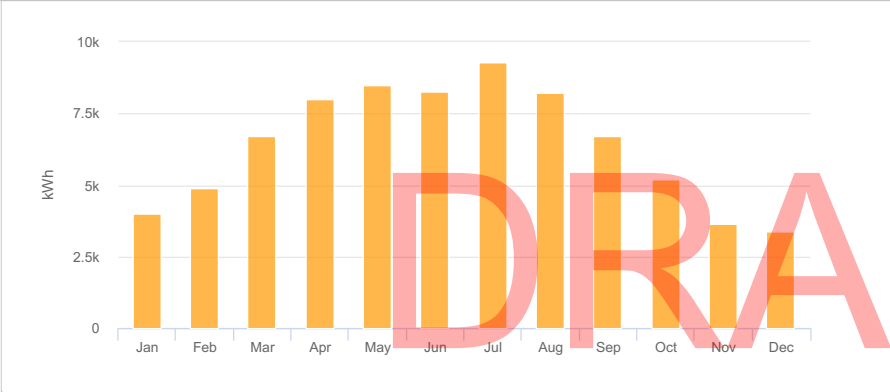

Sources of System Loss

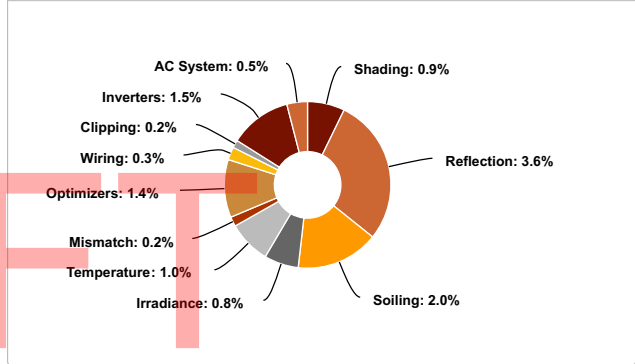

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,513.2	-0.9%
	Irradiance after Reflection	1,459.4	-3.6%
	Irradiance after Soiling	1,430.2	-2.0%
	Total Collector Irradiance	1,430.2	0.0%
Energy (kWh)	Nameplate	81,566.0	
	Output at Irradiance Levels	80,888.0	-0.8%
	Output at Cell Temperature Derate	80,051.3	-1.0%
	Output After Mismatch	79,864.1	-0.2%
	Optimizer Output	78,745.3	-1.4%
	Optimal DC Output	78,498.2	-0.3%
	Constrained DC Output	78,350.9	-0.2%
	Inverter Output	77,175.7	-1.5%
	Energy to Grid	76,789.8	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set


Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Strings	10 AWG (Copper)	4 (788.3 ft)
Optimizers	P850 (2020) (SolarEdge)	71 (60.4 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	139 (57.0 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	139	139	57.0 kW




Detailed Layout

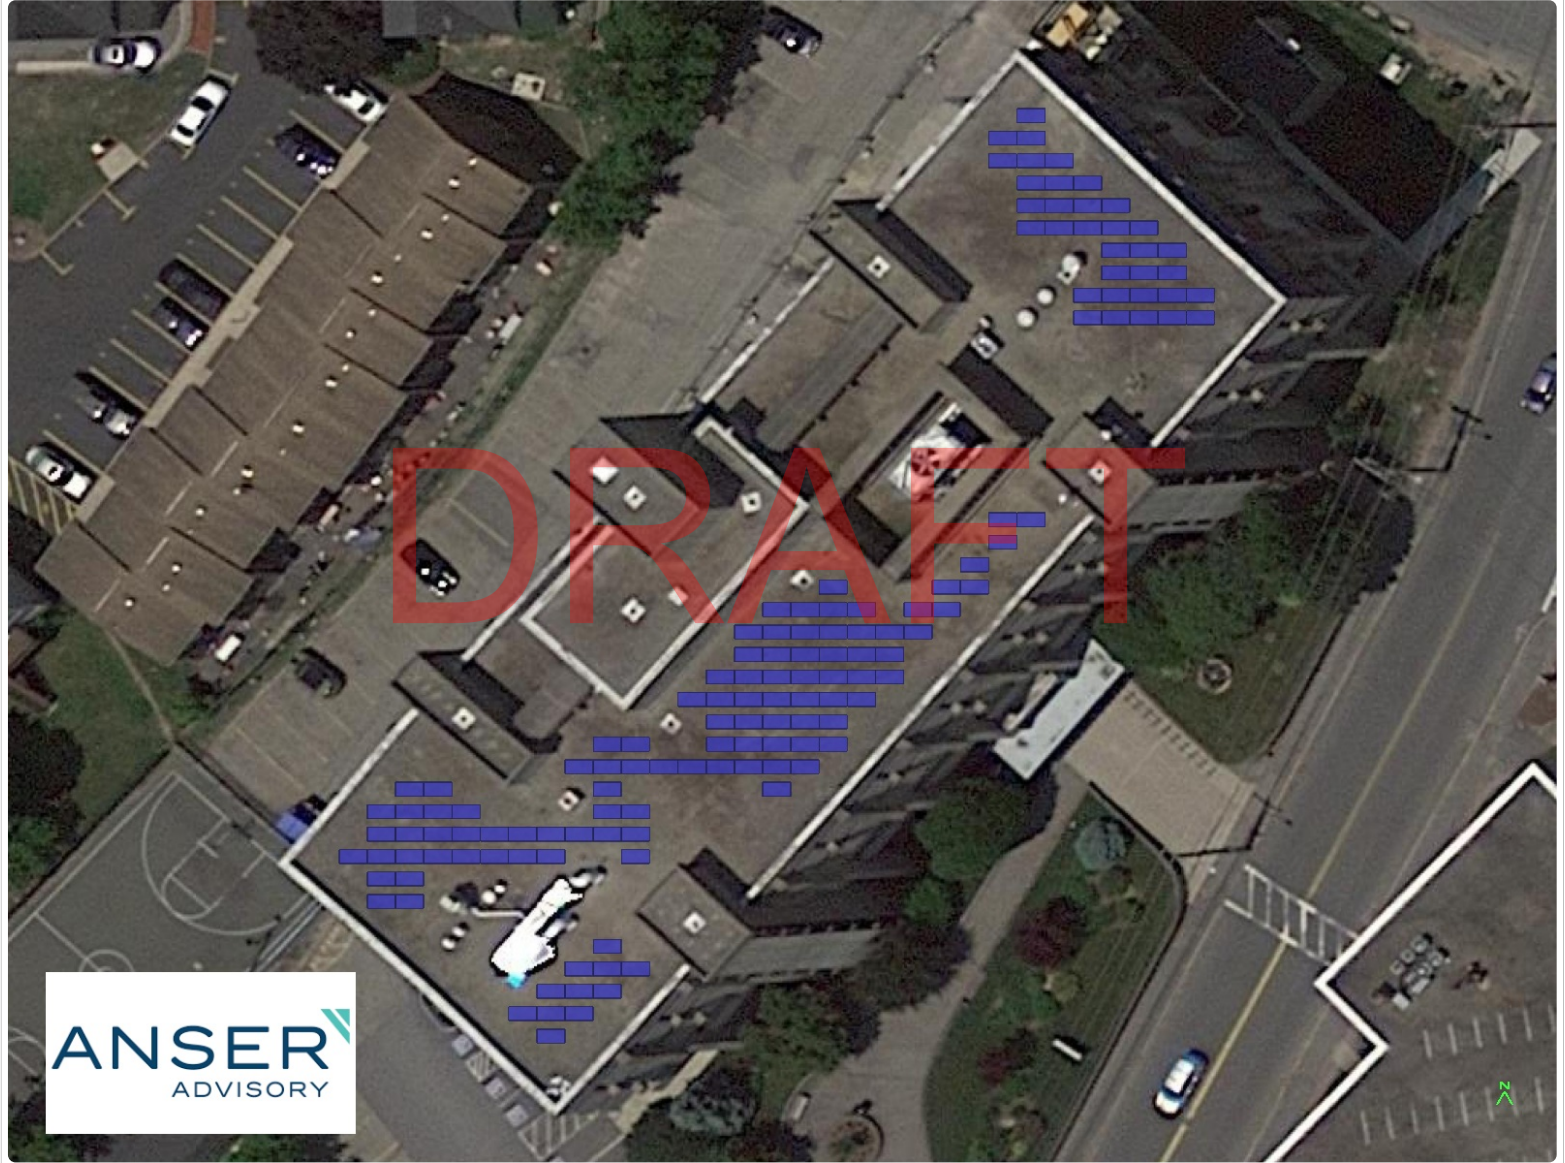

Perkins Lot UML - Perkins Lot, 322 Aiken St. Lowell, MA 01854

Report	
Project Name	UML - Perkins Lot
Project Address	322 Aiken St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Perkins Lot
Module DC Nameplate	310.0 kW
Inverter AC Nameplate	300.0 kW Load Ratio: 1.03
Annual Production	390.2 MWh
Performance Ratio	86.7%
kWh/kWp	1,259.0
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

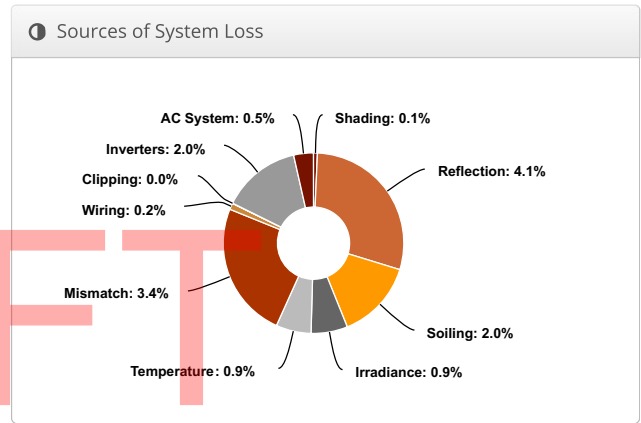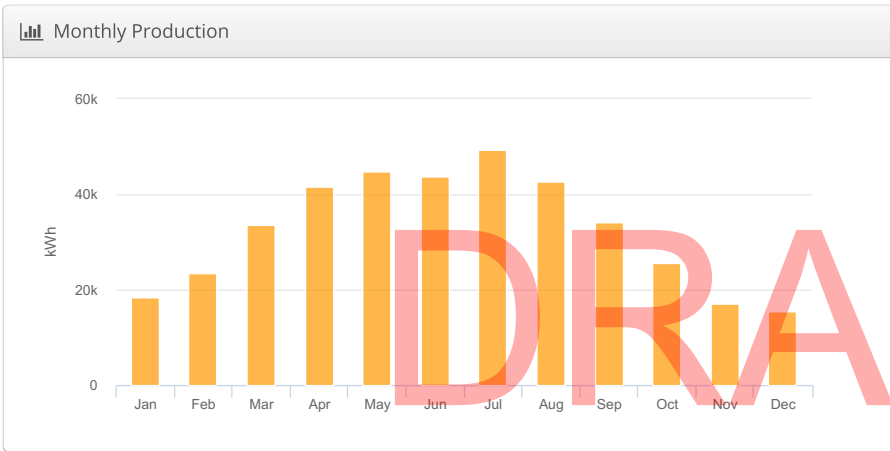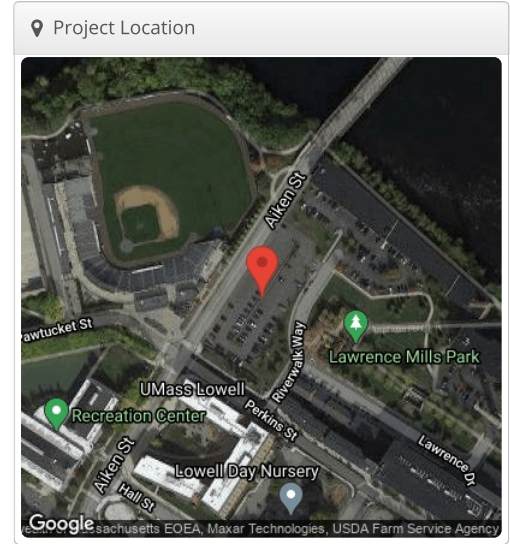

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,452.0	3.5%
	Shaded Irradiance	1,450.6	-0.1%
	Irradiance after Reflection	1,391.1	-4.1%
	Irradiance after Soiling	1,363.2	-2.0%
	Total Collector Irradiance	1,363.2	0.0%
Energy (kWh)	Nameplate	422,819.0	
	Output at Irradiance Levels	418,910.8	-0.9%
	Output at Cell Temperature Derate	415,183.6	-0.9%
	Output After Mismatch	400,871.6	-3.4%
	Optimal DC Output	400,232.4	-0.2%
	Constrained DC Output	400,211.2	0.0%
	Inverter Output	392,207.0	-2.0%
	Energy to Grid	390,246.0	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b									
	Fixed Tilt	-3.56	-0.075									
	Flush Mount	-2.81	-0.0455									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	5 (300.0 kW)
Strings	10 AWG (Copper)	45 (4,965.8 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	756 (310.0 kW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	122.66589453015729°	1.6 ft	6x1	84	504	206.6 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	122.66589°	20.0 ft	3x1	84	252	103.3 kW




Detailed Layout

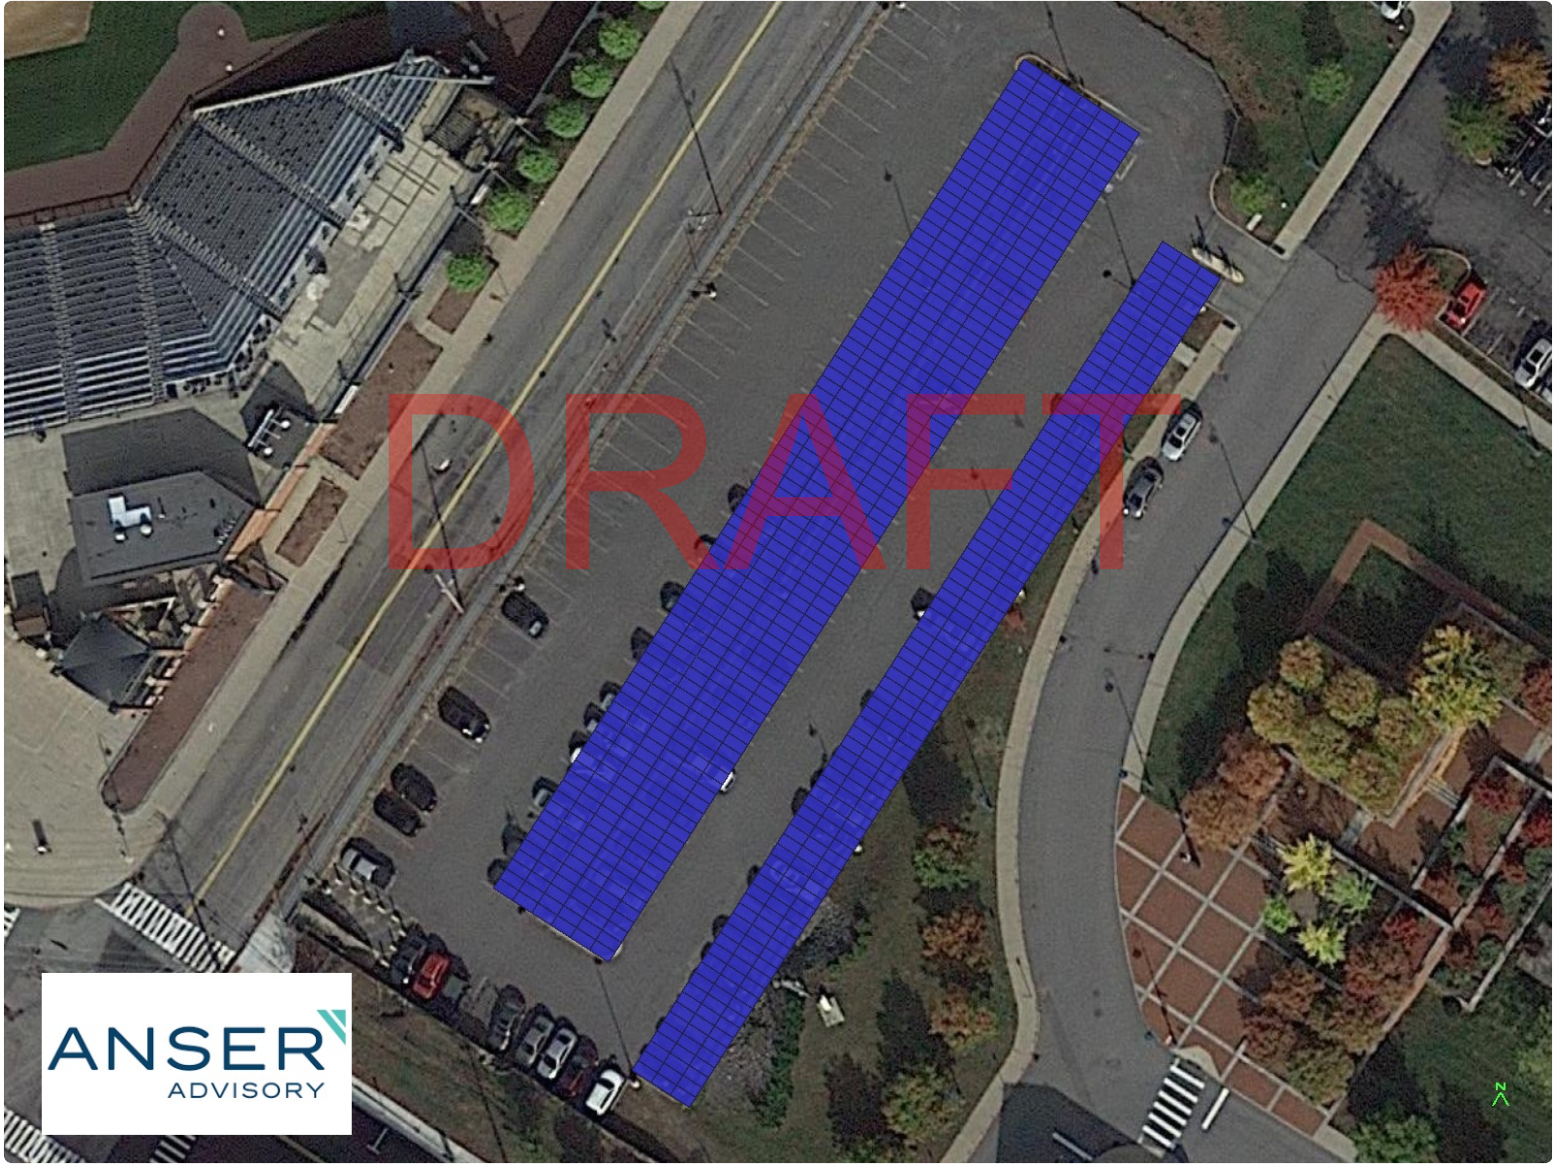

Perry Hall UML - Perry Hall, 1 University Ave. Lowell, MA 01854

Report	
Project Name	UML - Perry Hall
Project Address	1 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Perry Hall
Module DC Nameplate	45.1 kW
Inverter AC Nameplate	33.3 kW Load Ratio: 1.35
Annual Production	58.32 MWh
Performance Ratio	87.0%
kWh/kWp	1,293.2
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89

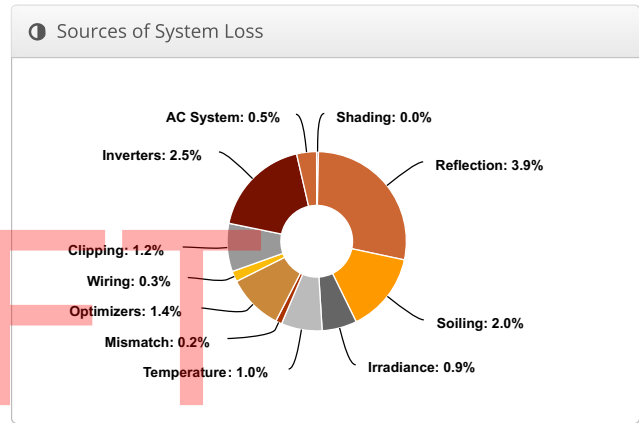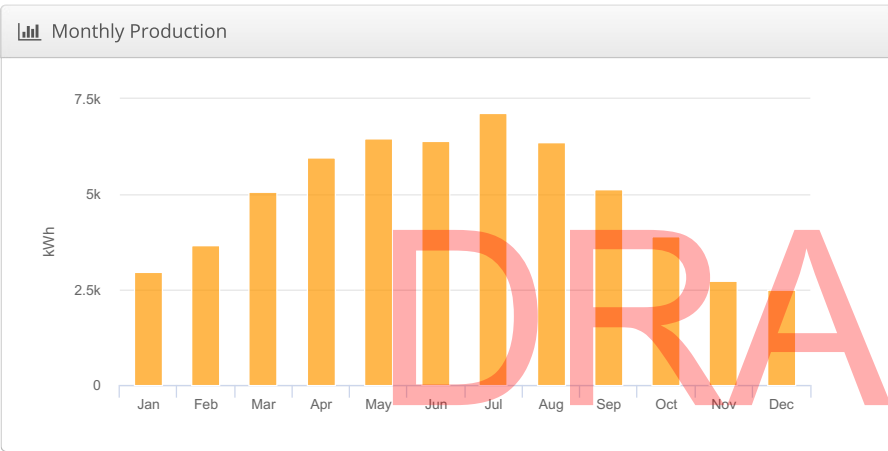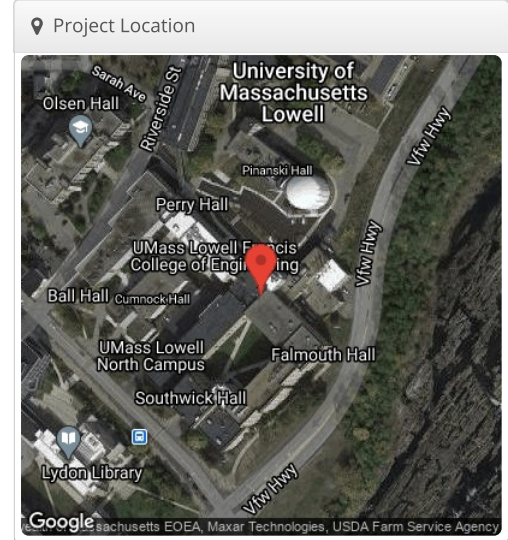

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,487.2	6.0%
	Shaded Irradiance	1,486.6	0.0%
	Irradiance after Reflection	1,428.7	-3.9%
	Irradiance after Soiling	1,400.1	-2.0%
	Total Collector Irradiance	1,400.1	0.0%
Energy (kWh)	Nameplate	63,188.6	
	Output at Irradiance Levels	62,636.4	-0.9%
	Output at Cell Temperature Derate	61,993.8	-1.0%
	Output After Mismatch	61,897.3	-0.2%
	Optimizer Output	61,030.4	-1.4%
	Optimal DC Output	60,868.0	-0.3%
	Constrained DC Output	60,132.5	-1.2%
	Inverter Output	58,614.2	-2.5%
	Energy to Grid	58,321.1	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE33.3K (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	3 (554.4 ft)
Optimizers	P850 (2020) (SolarEdge)	56 (47.6 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	110 (45.1 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	225.0243°	0.0 ft	5x1	17	85	34.9 kW
Field Segment 1 (copy)	Fixed Tilt	Landscape (Horizontal)	10°	225.0243°	0.0 ft	5x1	5	25	10.3 kW




Detailed Layout



Pinanski/ Costello Lot UML - Pinanski/ Costello Lot, 275 Riverside St. Lowell, MA 01854

Report	
Project Name	UML - Pinanski/ Costello Lot
Project Address	275 Riverside St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Pinanski/ Costello Lot
Module DC Nameplate	171.0 kW
Inverter AC Nameplate	144.0 kW Load Ratio: 1.19
Annual Production	215.7 MWh
Performance Ratio	85.3%
kWh/kWp	1,261.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

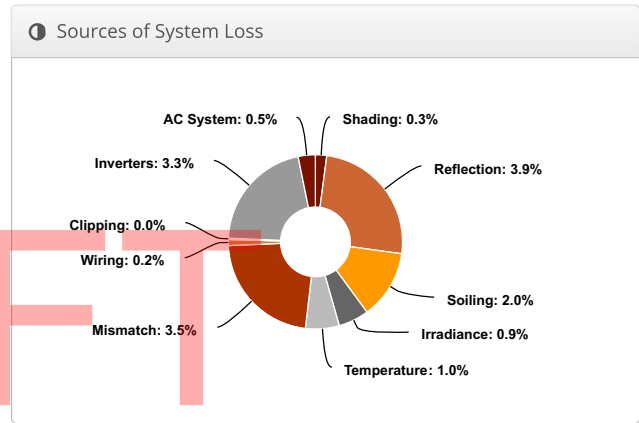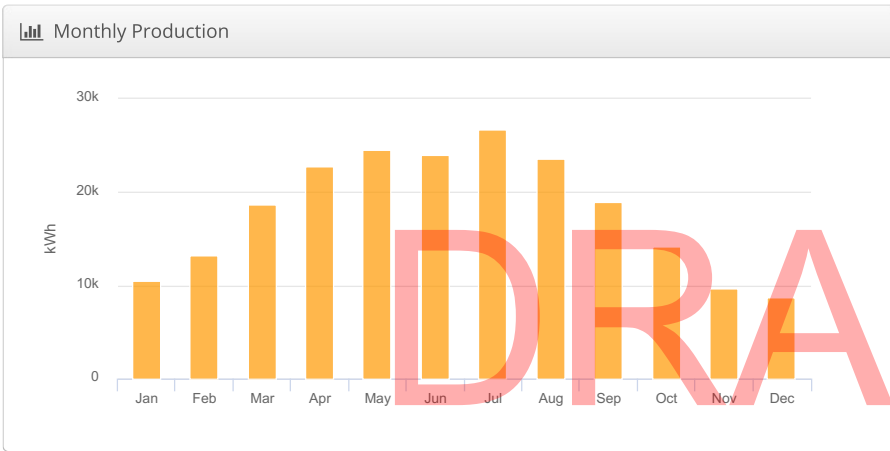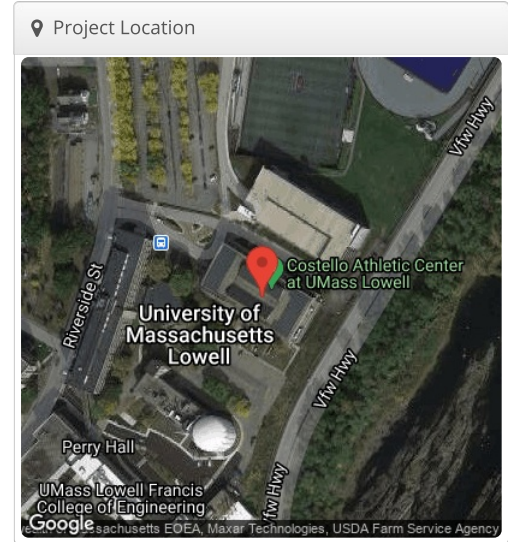

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,478.2	5.4%
	Shaded Irradiance	1,473.4	-0.3%
	Irradiance after Reflection	1,415.4	-3.9%
	Irradiance after Soiling	1,387.1	-2.0%
	Total Collector Irradiance	1,387.1	0.0%
Energy (kWh)	Nameplate	237,321.9	
	Output at Irradiance Levels	235,212.4	-0.9%
	Output at Cell Temperature Derate	232,909.0	-1.0%
	Output After Mismatch	224,696.3	-3.5%
	Optimal DC Output	224,307.5	-0.2%
	Constrained DC Output	224,210.2	0.0%
	Inverter Output	216,791.4	-3.3%
	Energy to Grid	215,707.4	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								
	PVI 36TL 480V (Solectria)	Folsom Labs		Manufacturer								

Components		
Component	Name	Count
Inverters	PVI 36TL 480V (Solectria)	4 (144.0 kW)
Strings	10 AWG (Copper)	28 (3,059.4 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	417 (171.0 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-17	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	212.11123156265876°	0.0 ft	1x1	153	153	62.7 kW
Field Segment 2	Carport	Portrait (Vertical)	7°	212.11124°	0.0 ft	1x1	264	264	108.2 kW

Detailed Layout



Pinanski Hall UML - Pinanski Hall, 205 Riverside St. Lowell, MA 01854

Report

Project Name	UML - Pinanski Hall
Project Address	205 Riverside St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Pinanski Hall
Module DC Nameplate	29.5 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 0.44
Annual Production	39.95 MWh
Performance Ratio	88.6%
kWh/kWp	1,353.2
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location



Monthly Production

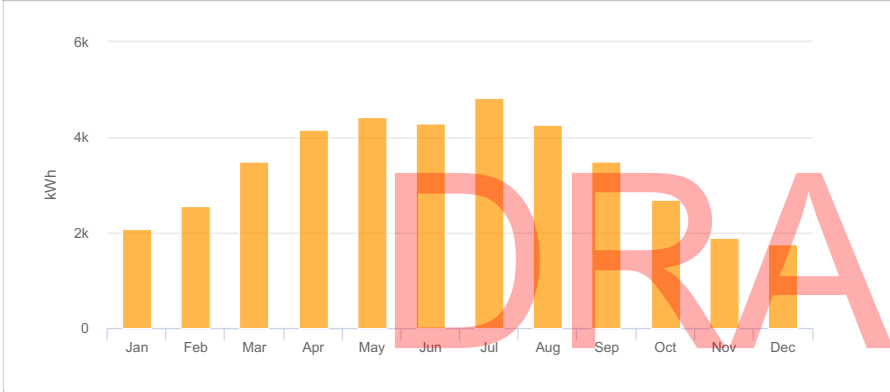

Sources of System Loss

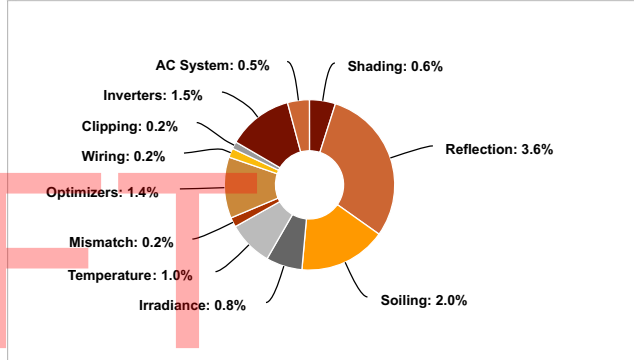

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,517.9	-0.6%
	Irradiance after Reflection	1,463.2	-3.6%
	Irradiance after Soiling	1,434.0	-2.0%
	Total Collector Irradiance	1,434.1	0.0%
Energy (kWh)	Nameplate	42,365.4	
	Output at Irradiance Levels	42,014.7	-0.8%
	Output at Cell Temperature Derate	41,582.2	-1.0%
	Output After Mismatch	41,491.8	-0.2%
	Optimizer Output	40,910.8	-1.4%
	Optimal DC Output	40,825.0	-0.2%
	Constrained DC Output	40,758.7	-0.2%
	Inverter Output	40,147.3	-1.5%
	Energy to Grid	39,946.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		20.0 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1															
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)															
Solar Angle Location	Meteo Lat/Lng															
Transposition Model	Perez Model															
Temperature Model	Sandia Model															
Temperature Model Parameters	Rack Type	a	b	Temperature Delta												
	Fixed Tilt	-3.56	-0.075	3°C												
	Flush Mount	-2.81	-0.0455	0°C												
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D				
	2	2	2	2	2	2	2	2	2	2	2	2				
Irradiation Variance	5%															
Cell Temperature Spread	4° C															
Module Binning Range	-2.5% to 2.5%															
AC System Derate	0.50%															
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization	Spec Sheet Characterization, PAN	
	Component Characterizations	Device	Uploaded By					Characterization								

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Strings	10 AWG (Copper)	2 (119.9 ft)
Optimizers	P850 (2020) (SolarEdge)	36 (30.6 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	72 (29.5 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	72	72	29.5 kW




Detailed Layout



Pulichino Tong Business Center UML - Pulichino Tong Business Center, 72 University Ave, Lowell, MA 01854

Report	
Project Name	UML - Pulichino Tong Business Center
Project Address	72 University Ave, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Pulichino Tong Business Center
Module DC Nameplate	69.7 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 1.05
Annual Production	93.67 MWh
Performance Ratio	87.2%
kWh/kWp	1,343.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

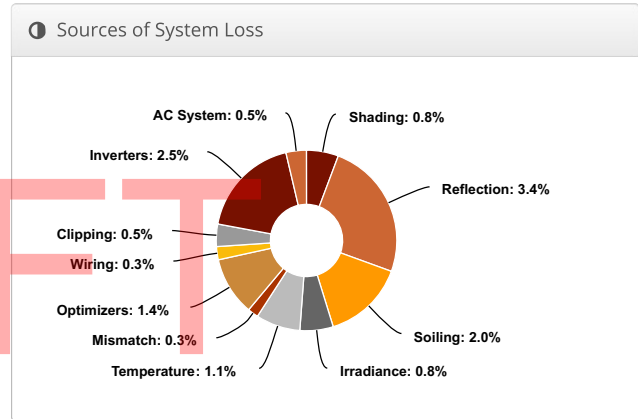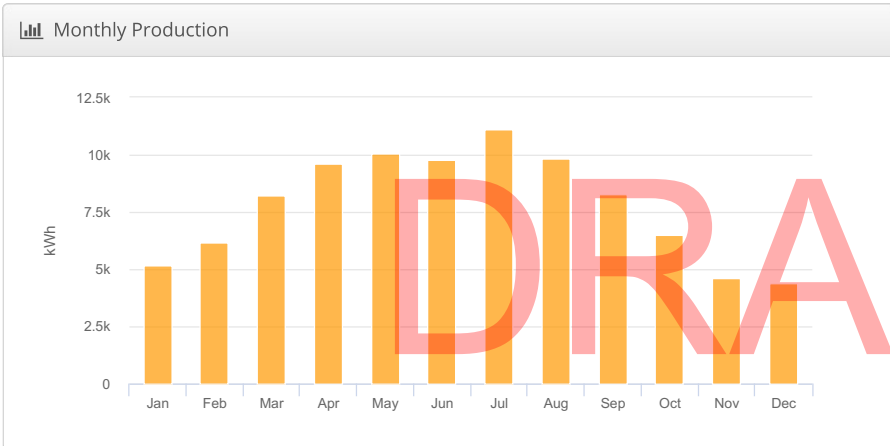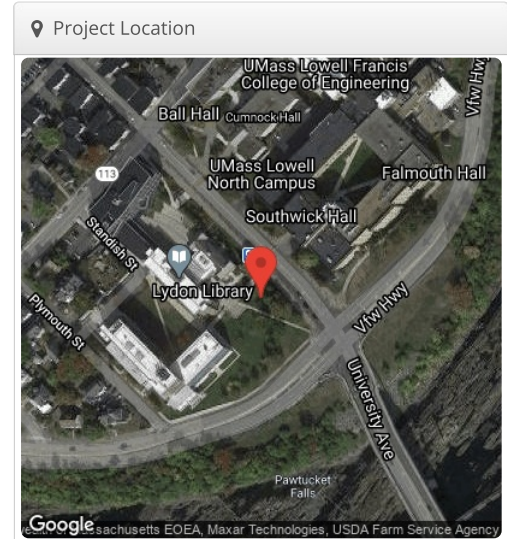

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,541.2	9.8%
	Shaded Irradiance	1,529.2	-0.8%
	Irradiance after Reflection	1,477.4	-3.4%
	Irradiance after Soiling	1,447.9	-2.0%
	Total Collector Irradiance	1,448.0	0.0%
Energy (kWh)	Nameplate	100,987.3	
	Output at Irradiance Levels	100,163.8	-0.8%
	Output at Cell Temperature Derate	99,077.7	-1.1%
	Output After Mismatch	98,817.9	-0.3%
	Optimizer Output	97,404.3	-1.4%
	Optimal DC Output	97,090.8	-0.3%
	Constrained DC Output	96,559.0	-0.5%
	Inverter Output	94,136.6	-2.5%
	Energy to Grid	93,665.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		20.0 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By		Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By		Characterization									

Components		
Component Name		Count
Inverters	SE33.3K (2020) (SolarEdge)	2 (66.6 kW)
Strings	10 AWG (Copper)	5 (835.4 ft)
Optimizers	P850 (2020) (SolarEdge)	85 (72.3 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	170 (69.7 kW)

Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		13-37		Along Racking					
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	20°	130°	12.0 ft	5x1	14	70	28.7 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	20°	134°	2.0 ft	5x1	8	40	16.4 kW	
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	20°	222°	12.0 ft	5x1	12	60	24.6 kW	

DRAFT

Detailed Layout

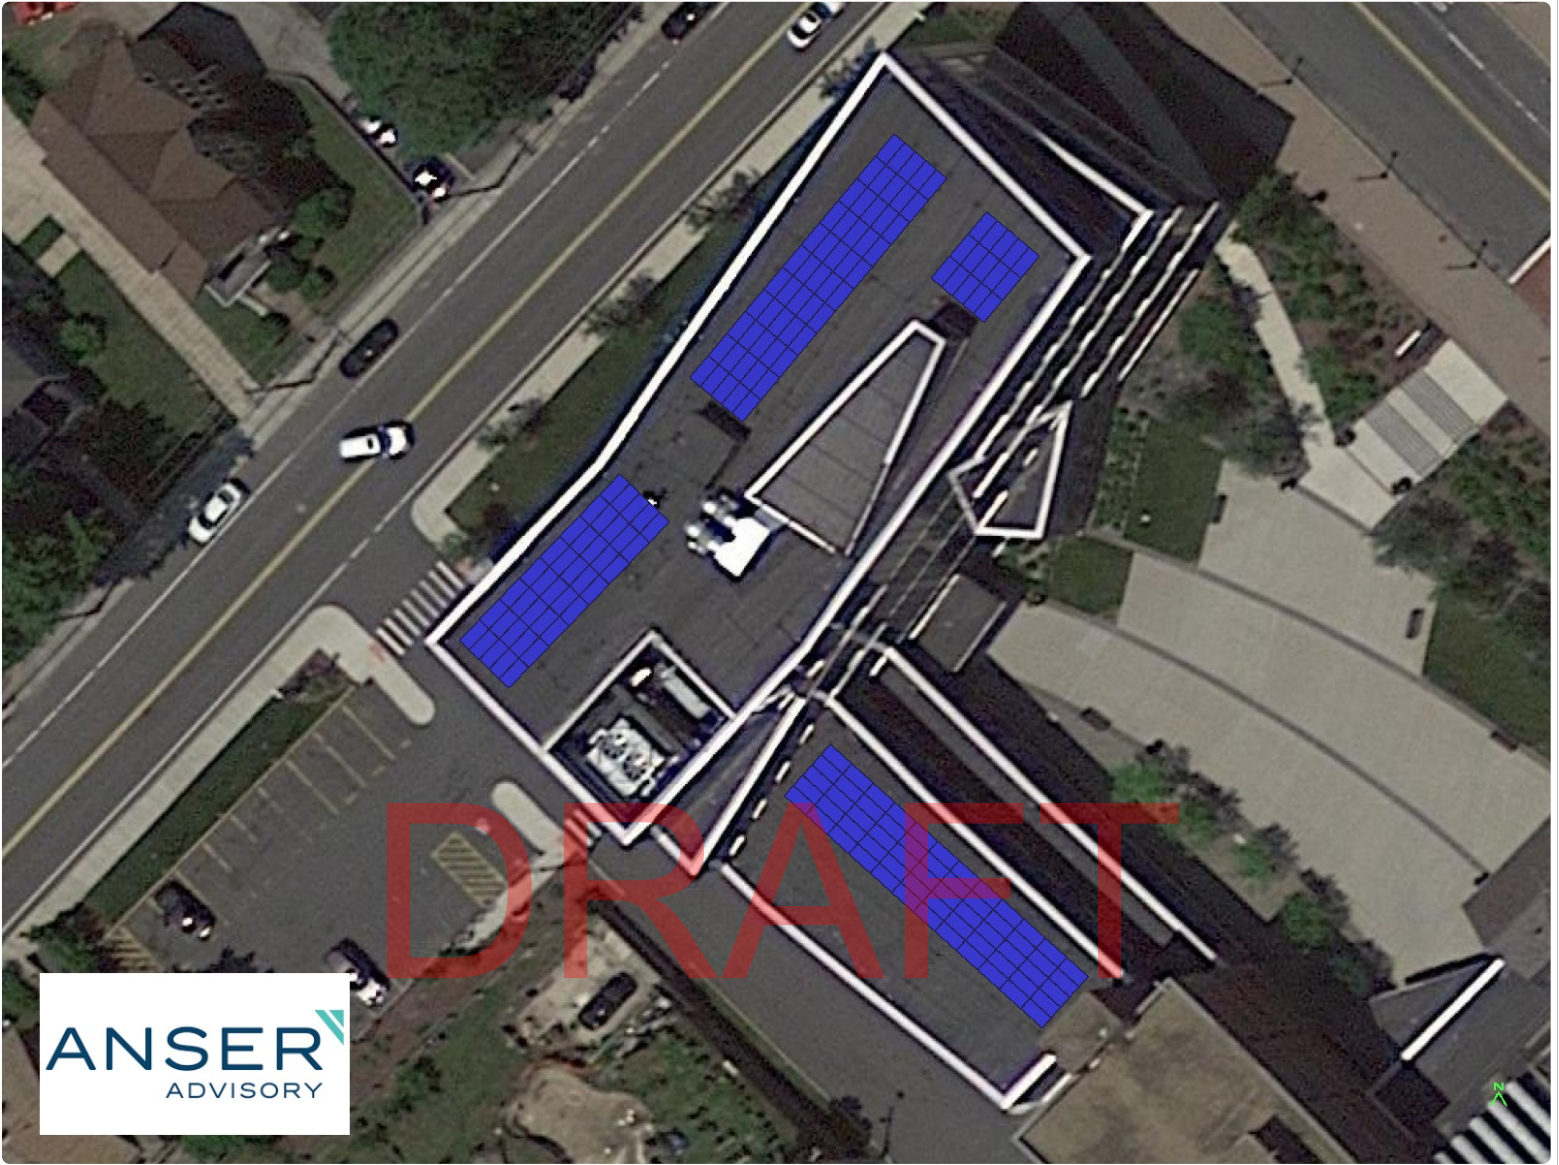

River Hawk Village UML - River Hawk Village, 39 Perkins St, Lowell, MA 01854

Report

Project Name	UML - River Hawk Village
Project Address	39 Perkins St, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	River Hawk Village
Module DC Nameplate	180.0 kW
Inverter AC Nameplate	166.6 kW Load Ratio: 1.08
Annual Production	243.3 MWh
Performance Ratio	88.5%
kWh/kWp	1,351.9
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location



Monthly Production

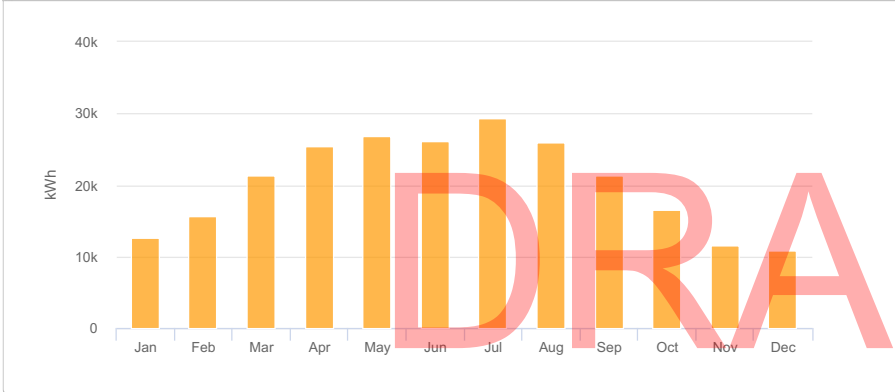

Sources of System Loss

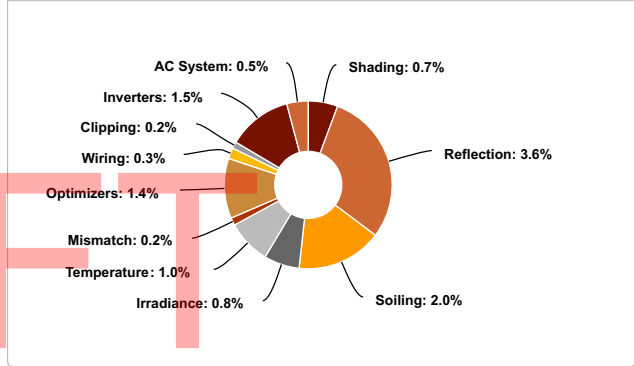

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.4	-0.7%
	Irradiance after Reflection	1,462.1	-3.6%
	Irradiance after Soiling	1,432.9	-2.0%
	Total Collector Irradiance	1,432.9	0.0%
Energy (kWh)	Nameplate	258,060.9	
	Output at Irradiance Levels	255,922.3	-0.8%
	Output at Cell Temperature Derate	253,290.9	-1.0%
	Output After Mismatch	252,840.4	-0.2%
	Optimizer Output	249,298.0	-1.4%
	Optimal DC Output	248,662.3	-0.3%
	Constrained DC Output	248,276.9	-0.2%
	Inverter Output	244,552.7	-1.5%
	Energy to Grid	243,330.0	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
Strings	10 AWG (Copper)	13 (2,100.1 ft)
Optimizers	P850 (2020) (SolarEdge)	226 (192.1 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	439 (180.0 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking
Wiring Zone 2	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	264	264	108.2 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	178	175	71.8 kW




Detailed Layout



Riverside Lot A UML - Riverside Lot A, 311 Riverside St. Lowell, MA 01854

Report	
Project Name	UML - Riverside Lot A
Project Address	311 Riverside St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Riverside Lot A
Module DC Nameplate	528.9 kW
Inverter AC Nameplate	480.0 kW Load Ratio: 1.10
Annual Production	684.1 MWh
Performance Ratio	86.7%
kWh/kWp	1,293.5
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

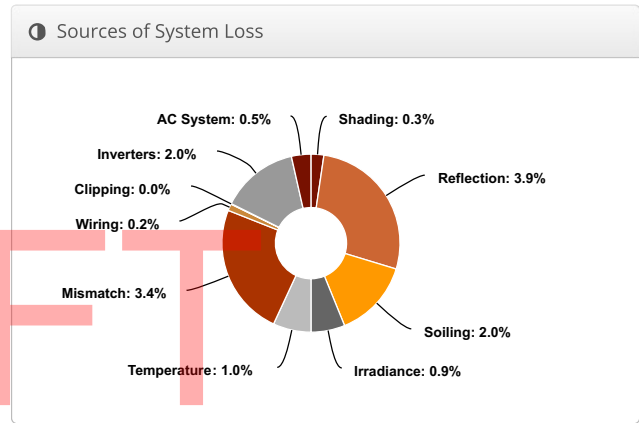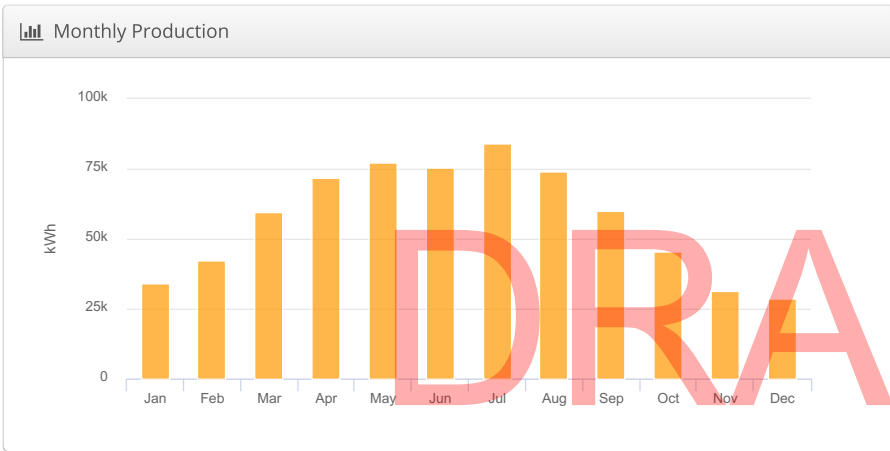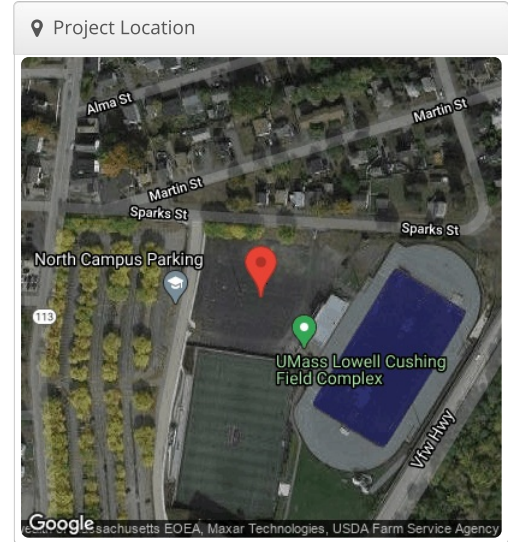

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.9	6.3%
	Shaded Irradiance	1,486.9	-0.3%
	Irradiance after Reflection	1,429.4	-3.9%
	Irradiance after Soiling	1,400.8	-2.0%
	Total Collector Irradiance	1,400.8	0.0%
Energy (kWh)	Nameplate	741,358.1	
	Output at Irradiance Levels	734,898.7	-0.9%
	Output at Cell Temperature Derate	727,719.0	-1.0%
	Output After Mismatch	702,922.2	-3.4%
	Optimal DC Output	701,694.2	-0.2%
	Constrained DC Output	701,609.7	0.0%
	Inverter Output	687,577.5	-2.0%
	Energy to Grid	684,139.6	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By						Characterization					
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs						Spec Sheet Characterization, PAN					
Component Characterizations	Device	Uploaded By						Characterization					
	PVI 60TL (Solectria)	Folsom Labs						Spec Sheet					

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	8 (480.0 kW)
Strings	10 AWG (Copper)	86 (9,576.4 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	1,290 (528.9 kW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-17	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	188.51972028567047°	1.6 ft	5x1	65	325	133.3 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	188.51971°	1.6 ft	5x1	65	325	133.3 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	188.51971°	1.6 ft	5x1	65	325	133.3 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	188.51971°	1.6 ft	5x1	63	315	129.2 kW

Detailed Layout

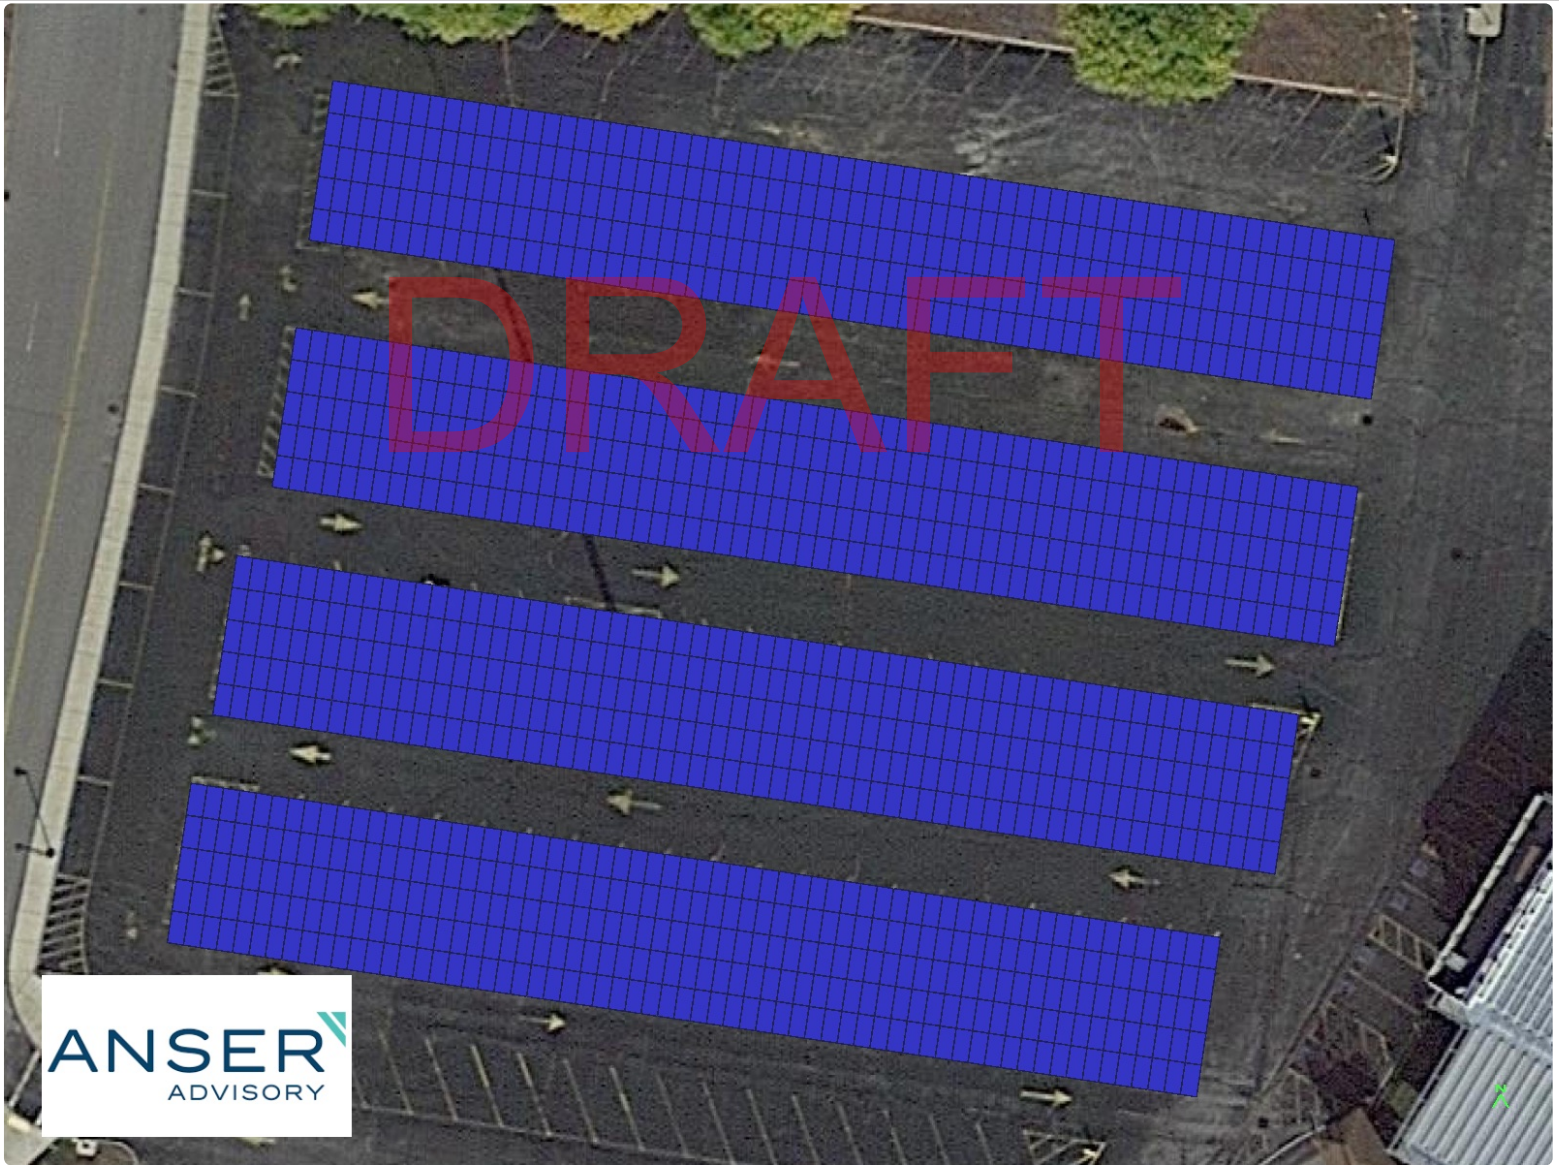

Riverside Lot B UML - Riverside Lot B, 307 Riverside St. Lowell, MA 01854


Report

Project Name	UML - Riverside Lot B
Project Address	307 Riverside St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Riverside Lot B
Module DC Nameplate	1.23 MW
Inverter AC Nameplate	1.02 MW Load Ratio: 1.21
Annual Production	1,499 GWh
Performance Ratio	86.3%
kWh/kWp	1,216.4
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5


Project Location

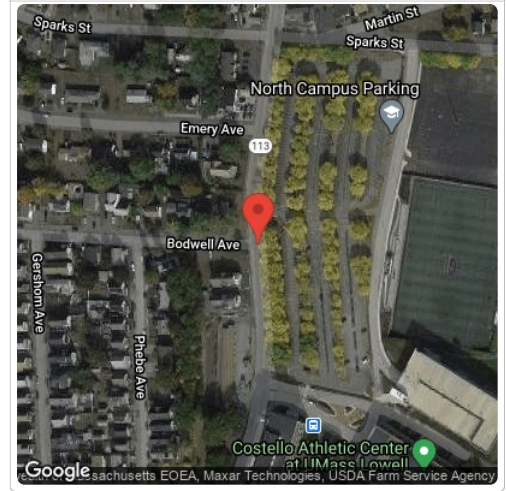

Monthly Production

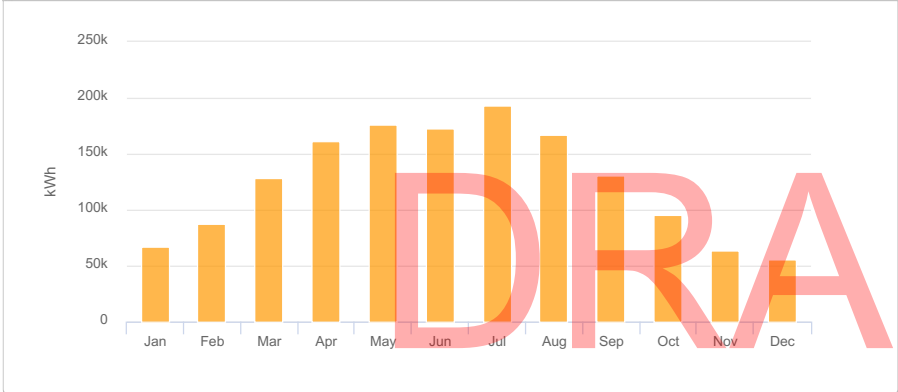

Sources of System Loss

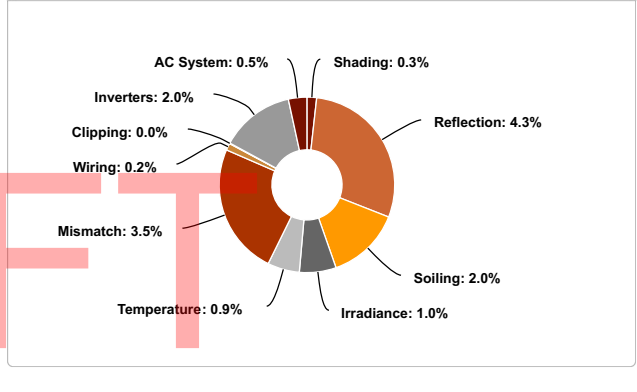

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,410.0	0.5%
	Shaded Irradiance	1,406.4	-0.3%
	Irradiance after Reflection	1,346.3	-4.3%
	Irradiance after Soiling	1,319.4	-2.0%
	Total Collector Irradiance	1,319.4	0.0%
Energy (kWh)	Nameplate	1,627,148.8	
	Output at Irradiance Levels	1,611,061.2	-1.0%
	Output at Cell Temperature Derate	1,597,180.4	-0.9%
	Output After Mismatch	1,540,532.7	-3.5%
	Optimal DC Output	1,537,664.4	-0.2%
	Constrained DC Output	1,537,426.7	0.0%
	Inverter Output	1,506,675.3	-2.0%
	Energy to Grid	1,499,141.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.4 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set

Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet Characterization, PAN				
Component Characterizations	Device	PVI 60TL (Solectria)						Uploaded By	Folsom Labs				
	Characterization							Characterization	Spec Sheet				

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	17 (1.02 MW)
Strings	10 AWG (Copper)	187 (26,980.3 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	3,006 (1.23 MW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-17	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	96.00203736357207°	0.0 ft	6x1	97	582	238.6 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	96.00204°	0.0 ft	6x1	89	534	218.9 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	96.00204°	0.0 ft	6x1	97	582	238.6 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	265.30300512367364°	0.0 ft	6x1	106	636	260.8 kW
Field Segment 1 (copy 3)	Carport	Portrait (Vertical)	7°	265.303°	0.0 ft	6x1	112	672	275.5 kW

Detailed Layout

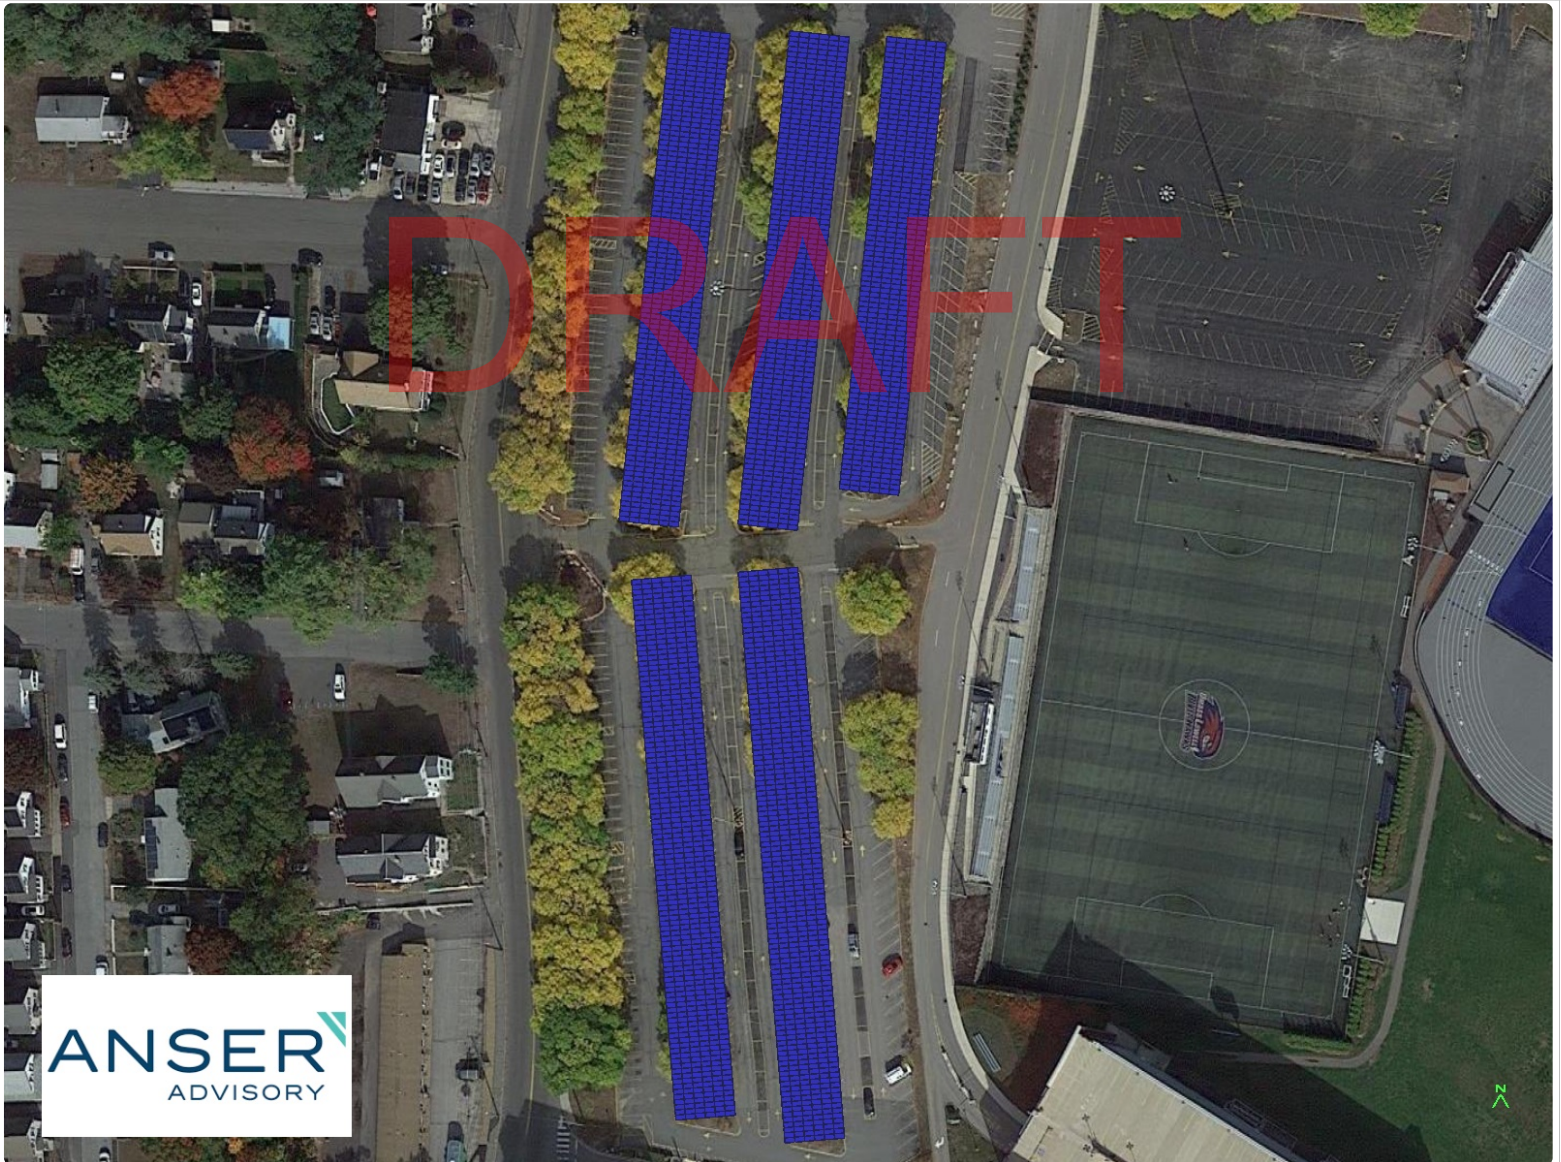

Riverview Suites Lot UML - Riverview Suites Lot, 1291 Middlesex St. Lowell, MA


Report

Project Name	UML - Riverview Suites Lot
Project Address	1291 Middlesex St. Lowell, MA
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Riverview Suites Lot
Module DC Nameplate	171.0 kW
Inverter AC Nameplate	144.0 kW Load Ratio: 1.19
Annual Production	216.4 MWh
Performance Ratio	84.9%
kWh/kWp	1,265.9
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

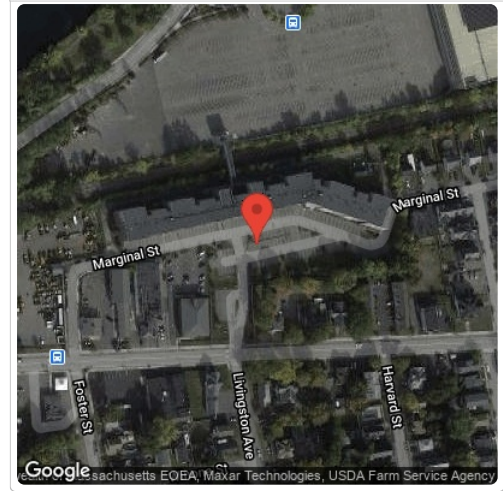

Monthly Production

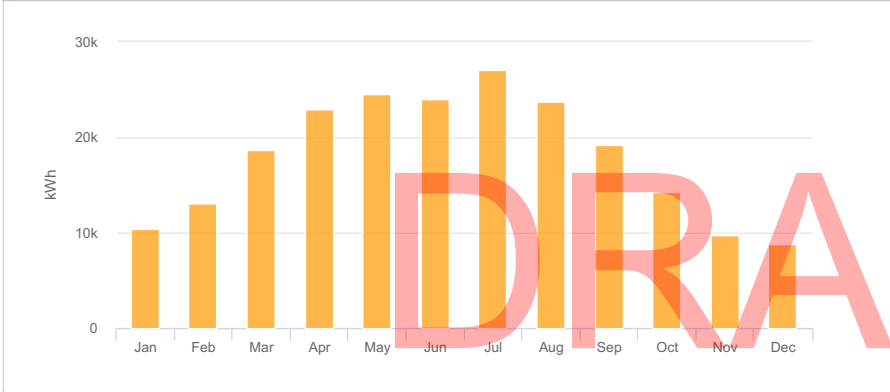

Sources of System Loss

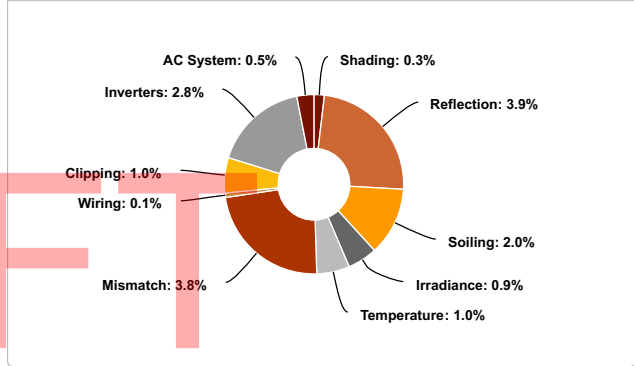

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,491.4	6.3%
	Shaded Irradiance	1,486.9	-0.3%
	Irradiance after Reflection	1,428.9	-3.9%
	Irradiance after Soiling	1,400.3	-2.0%
	Total Collector Irradiance	1,400.3	0.0%
Energy (kWh)	Nameplate	239,577.2	
	Output at Irradiance Levels	237,489.5	-0.9%
	Output at Cell Temperature Derate	235,205.8	-1.0%
	Output After Mismatch	226,374.3	-3.8%
	Optimal DC Output	226,073.8	-0.1%
	Constrained DC Output	223,740.4	-1.0%
	Inverter Output	217,524.6	-2.8%
	Energy to Grid	216,436.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.8 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set

Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By									Characterization	
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs									Spec Sheet Characterization, PAN	
Component Characterizations	Device	Uploaded By									Characterization	
	PVI 36TL 480V (Solectria)	Folsom Labs									Manufacturer	

Components		
Component	Name	Count
Inverters	PVI 36TL 480V (Solectria)	4 (144.0 kW)
Strings	10 AWG (Copper)	24 (1,796.5 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	417 (171.0 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking




Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	168.19012°	0.0 ft	1x1	216	216	88.6 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	168.19012°	0.0 ft	3x1	67	201	82.4 kW

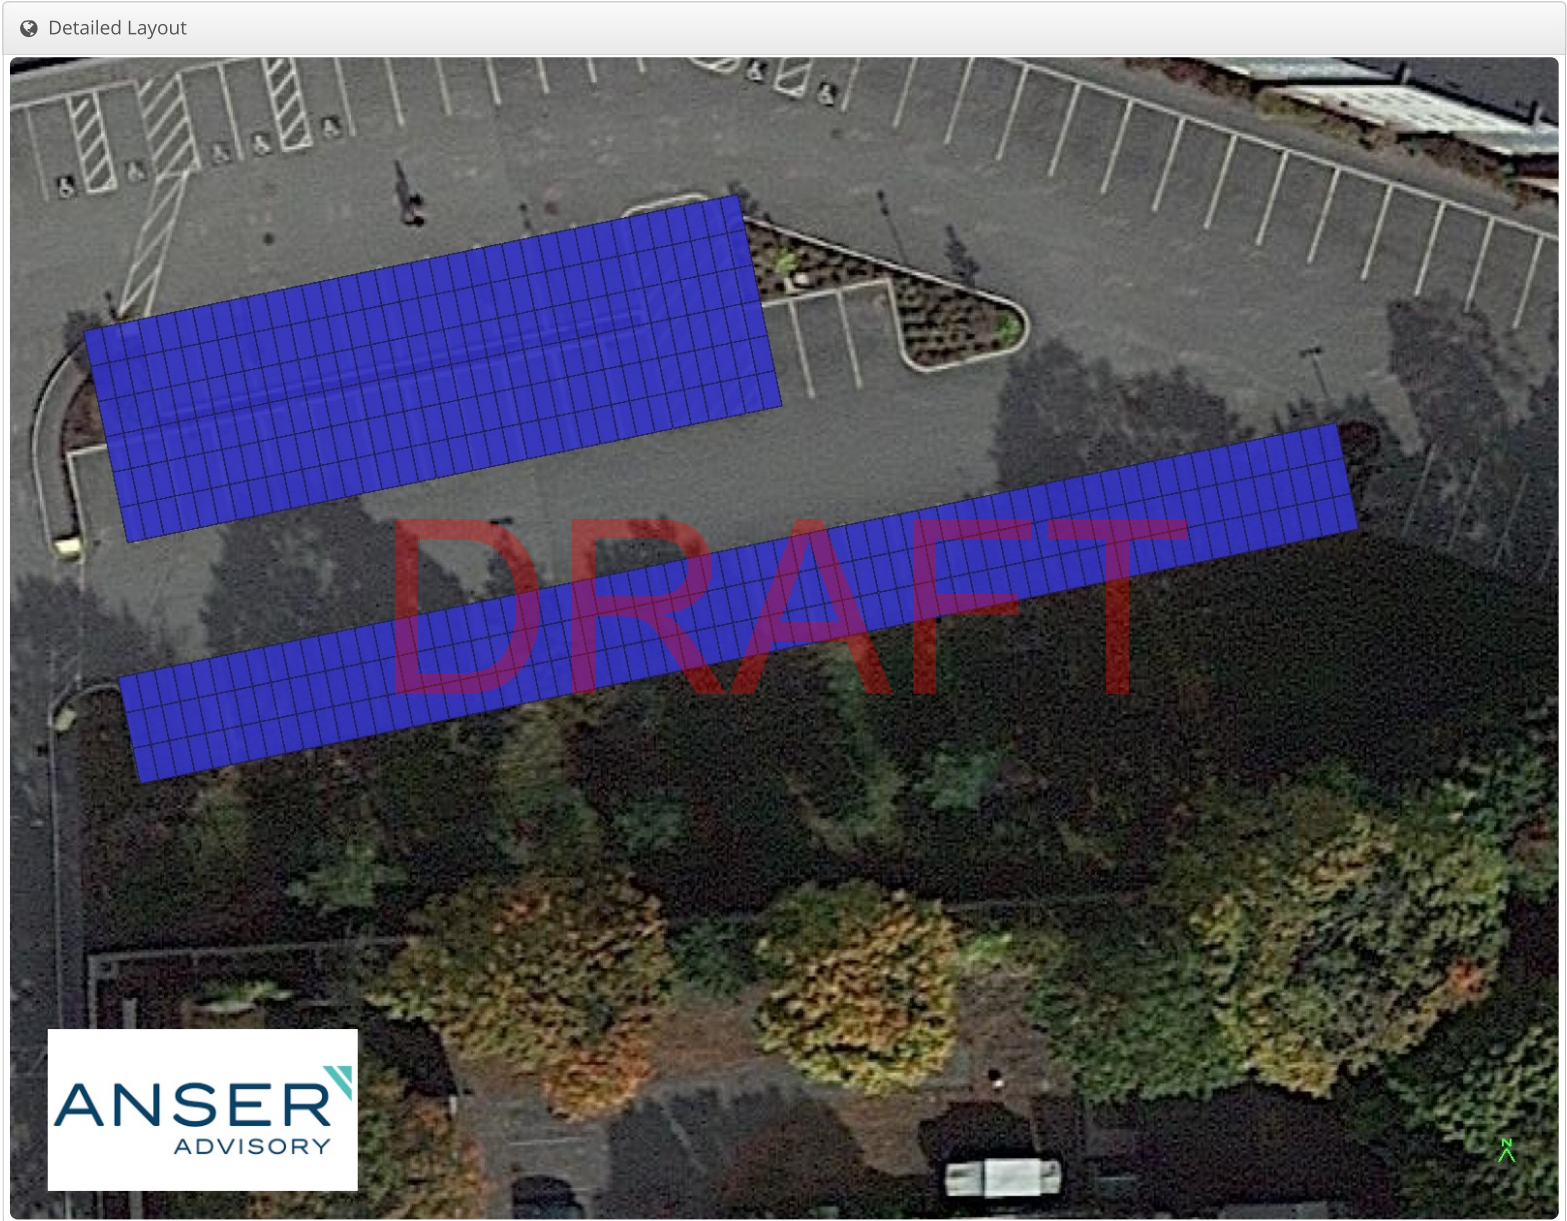

Saab Emerging Tech & Innovation Center UML - Saab Emerging Tech & Innovation Center, 40 University Ave. Lowell, MA 01854

Report	
Project Name	UML - Saab Emerging Tech & Innovation Center
Project Address	40 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Saab Emerging Tech & Innovation Center
Module DC Nameplate	71.8 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 1.08
Annual Production	96.20 MWh
Performance Ratio	87.0%
kWh/kWp	1,340.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

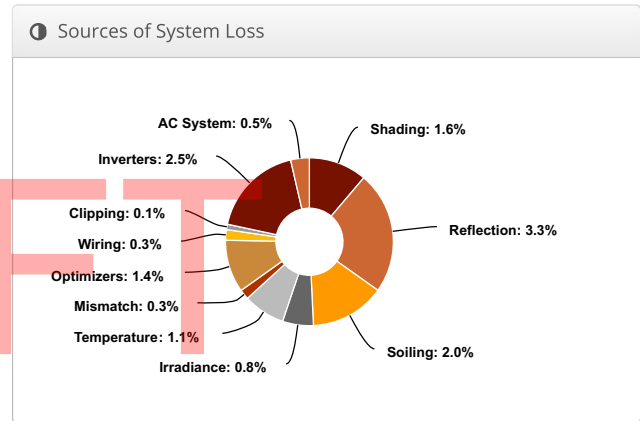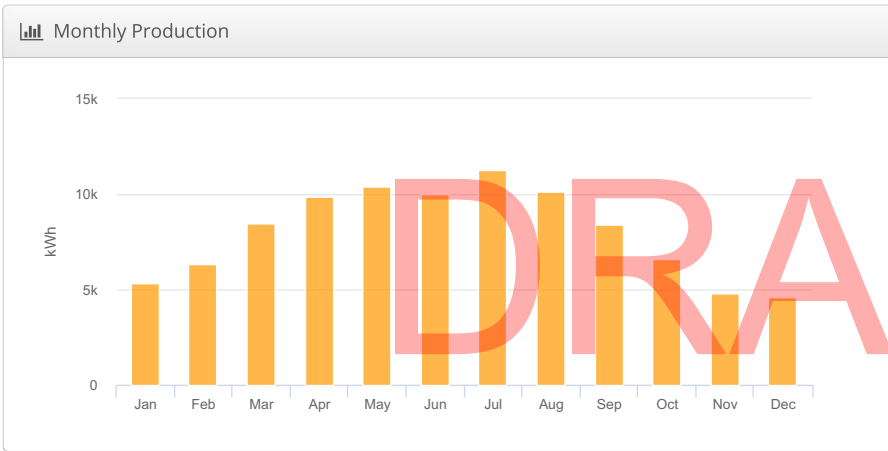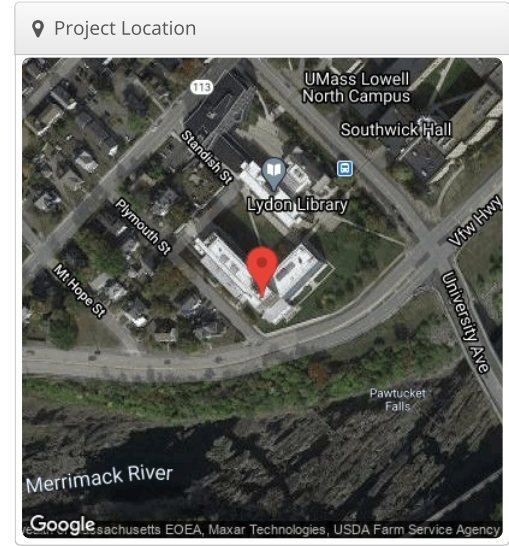


⚡ Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,541.8	9.9%
	Shaded Irradiance	1,517.8	-1.6%
	Irradiance after Reflection	1,468.1	-3.3%
	Irradiance after Soiling	1,438.7	-2.0%
	Total Collector Irradiance	1,438.5	0.0%
Energy (kWh)	Nameplate	103,273.1	
	Output at Irradiance Levels	102,418.5	-0.8%
	Output at Cell Temperature Derate	101,275.2	-1.1%
	Output After Mismatch	101,005.7	-0.3%
	Optimizer Output	99,586.5	-1.4%
	Optimal DC Output	99,304.1	-0.3%
	Constrained DC Output	99,160.4	-0.1%
	Inverter Output	96,680.2	-2.5%
	Energy to Grid	96,196.8	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		20.0 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

☁ Condition Set														
Description	Condition Set 1													
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)													
Solar Angle Location	Meteo Lat/Lng													
Transposition Model	Perez Model													
Temperature Model	Sandia Model													
Temperature Model Parameters	Rack Type	a	b	Temperature Delta										
	Fixed Tilt	-3.56	-0.075	3°C										
	Flush Mount	-2.81	-0.0455	0°C										
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D		
	2	2	2	2	2	2	2	2	2	2	2	2		
Irradiation Variance	5%													
Cell Temperature Spread	4° C													
Module Binning Range	-2.5% to 2.5%													
AC System Derate	0.50%													
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization
														Spec Sheet Characterization, PAN
Component Characterizations	Device	Uploaded By					Characterization							

📦 Components		
Component	Name	Count
Inverters	SE33.3KUS (2020) (SolarEdge)	2 (66.6 kW)
Strings	10 AWG (Copper)	6 (970.4 ft)
Optimizers	P850 (2020) (SolarEdge)	89 (75.7 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	175 (71.8 kW)

🔌 Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		13-37		Along Racking					
Wiring Zone 2	-		13-37		Along Racking					
🏠 Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	20°	226.20558°	20.0 ft	5x1	19	95	39.0 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	20°	135°	20.0 ft	5x1	16	80	32.8 kW	

Detailed Layout

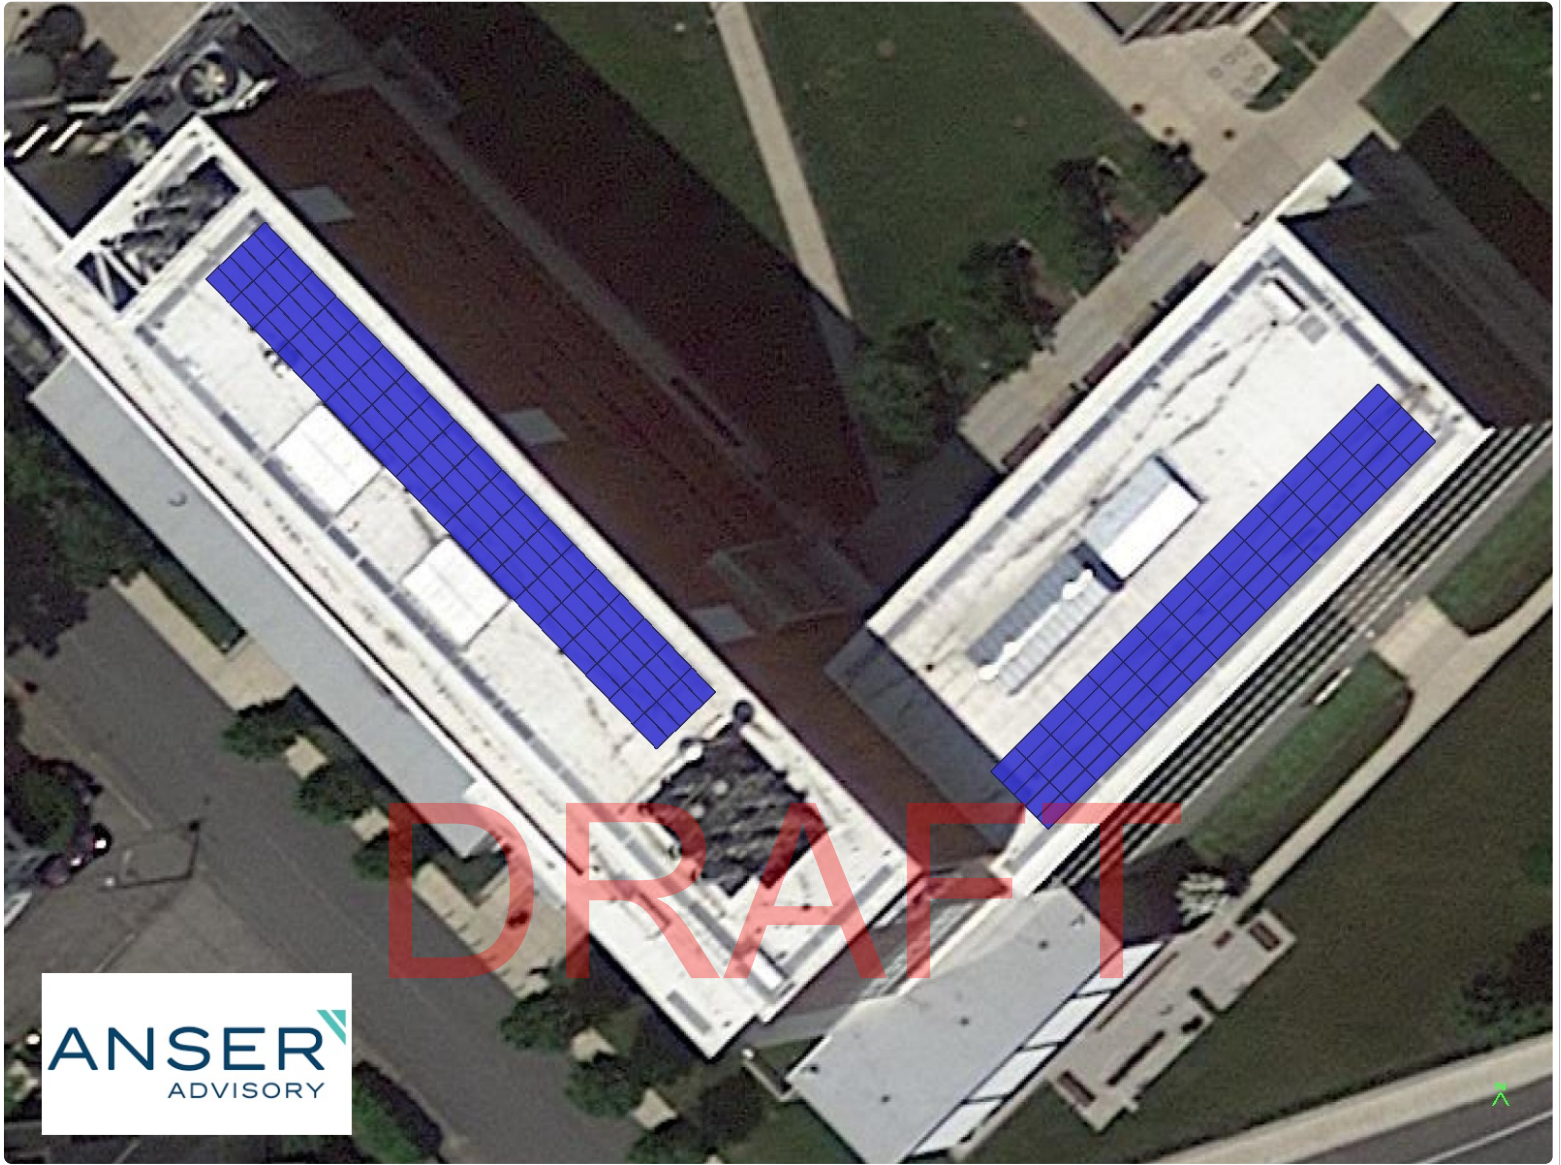




ANSER
ADVISORY

Salem Street/ Admissions Lot UML - Salem Street/ Admissions Lot, 294 Salem St., Lowell, MA

01854

Report	
Project Name	UML - Salem Street/ Admissions Lot
Project Address	294 Salem St., Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Salem Street/ Admissions Lot
Module DC Nameplate	341.9 kW
Inverter AC Nameplate	288.7 kW Load Ratio: 1.18
Annual Production	413.9 MWh
Performance Ratio	82.5%
kWh/kWp	1,210.5
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

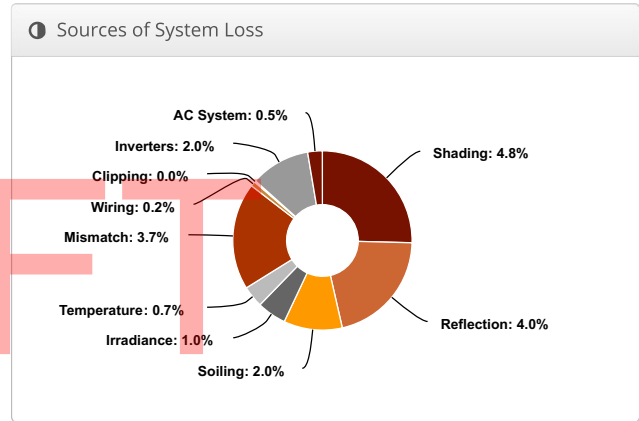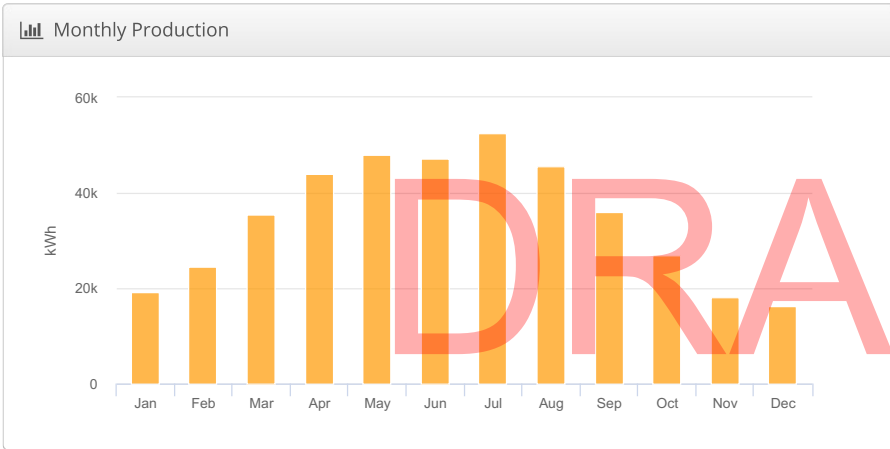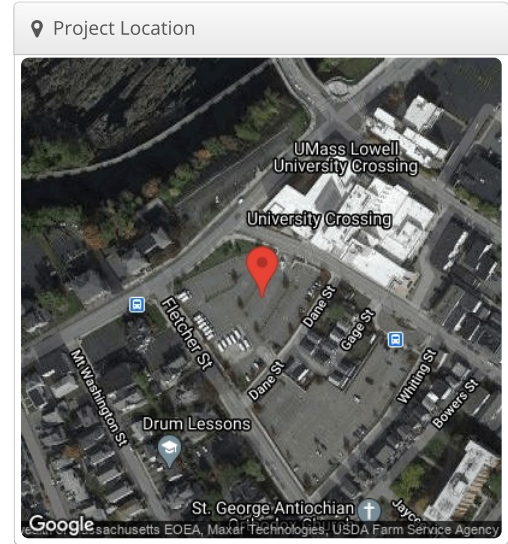


Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,466.7	4.5%
	Shaded Irradiance	1,396.1	-4.8%
	Irradiance after Reflection	1,340.5	-4.0%
	Irradiance after Soiling	1,313.7	-2.0%
	Total Collector Irradiance	1,313.7	0.0%
Energy (kWh)	Nameplate	449,488.3	
	Output at Irradiance Levels	444,997.8	-1.0%
	Output at Cell Temperature Derate	441,743.8	-0.7%
	Output After Mismatch	425,581.2	-3.7%
	Optimal DC Output	424,879.8	-0.2%
	Constrained DC Output	424,676.7	0.0%
	Inverter Output	416,011.3	-2.0%
	Energy to Grid	413,931.2	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.3 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By		Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By		Characterization									
	Sunny Tripower 24000TL-US (SMA)	Folsom Labs		Modified CEC									

Components		
Component	Name	Count
Inverters	Sunny Tripower 24000TL-US (SMA)	12 (288.7 kW)
Strings	10 AWG (Copper)	54 (5,435.1 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	834 (341.9 kW)

Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		4-18		Along Racking					
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Portrait (Vertical)	7°	121.82744657667308°	0.0 ft	1x1	228	228	93.5 kW	
Field Segment 1 (copy)	Fixed Tilt	Portrait (Vertical)	7°	121.827446°	0.0 ft	6x1	25	150	61.5 kW	
Field Segment 3	Carport	Portrait (Vertical)	7°	144.42065255754466°	0.0 ft	1x1	288	288	118.1 kW	
Field Segment 4	Fixed Tilt	Portrait (Vertical)	7°	154.76172558682606°	0.0 ft	1x1	168	168	68.9 kW	

Detailed Layout



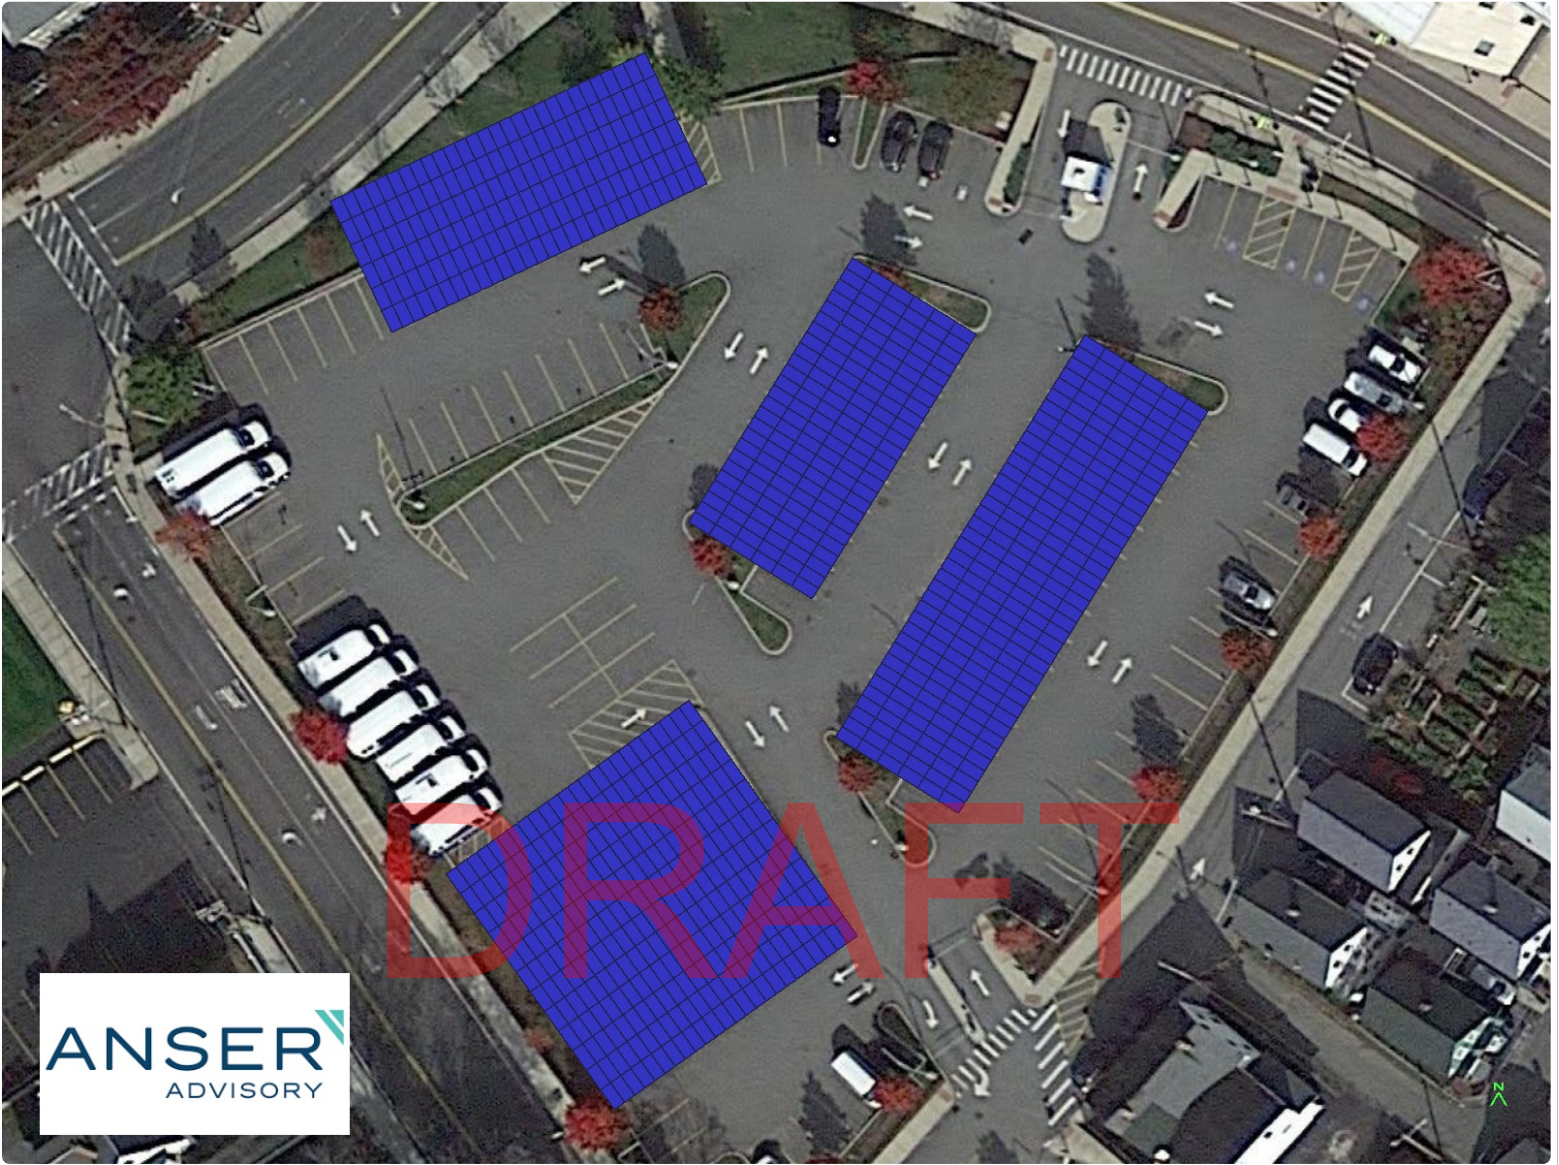


ANSER
ADVISORY

Sheehy Hall UML - Sheehy Hall, 4 Solomont Way, Lowell, MA 01854

Report	
Project Name	UML - Sheehy Hall
Project Address	4 Solomont Way, Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Sheehy Hall
Module DC Nameplate	59.9 kW
Inverter AC Nameplate	66.6 kW Load Ratio: 0.90
Annual Production	80.86 MWh
Performance Ratio	88.5%
kWh/kWp	1,350.9
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	7083ebd0da-eb8d5d50ae-001efefa85-cf86515f29

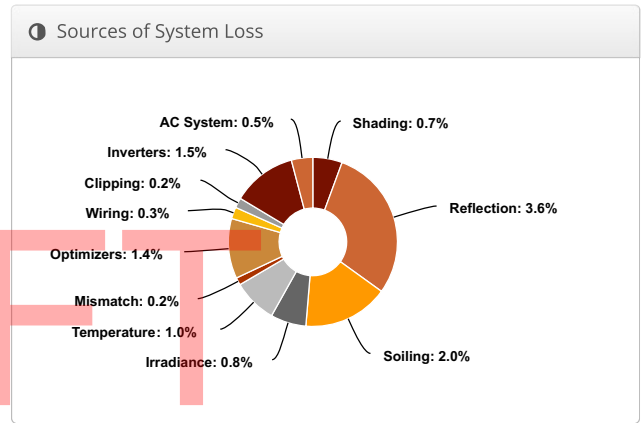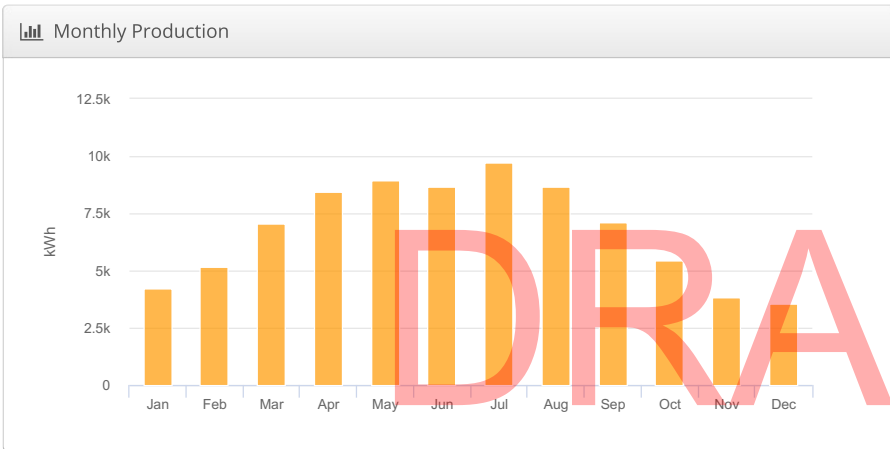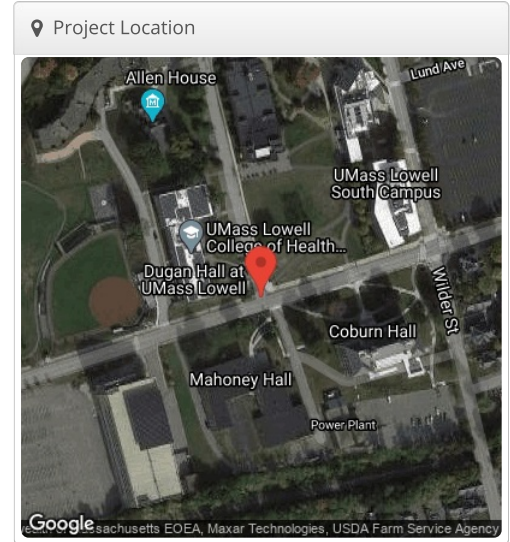

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,516.5	-0.7%
	Irradiance after Reflection	1,462.2	-3.6%
	Irradiance after Soiling	1,433.0	-2.0%
	Total Collector Irradiance	1,433.0	0.0%
Energy (kWh)	Nameplate	85,836.1	
	Output at Irradiance Levels	85,124.9	-0.8%
	Output at Cell Temperature Derate	84,248.1	-1.0%
	Output After Mismatch	84,103.6	-0.2%
	Optimizer Output	82,925.6	-1.4%
	Optimal DC Output	82,699.2	-0.3%
	Constrained DC Output	82,506.7	-0.2%
	Inverter Output	81,269.1	-1.5%
	Energy to Grid	80,862.7	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Strings	10 AWG (Copper)	4 (625.2 ft)
Optimizers	P850 (SolarEdge)	74 (62.9 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	146 (59.9 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	113	103	42.2 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	49	43	17.6 kW	
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	0	0	0	
Field Segment 4	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	0	0	0	




Detailed Layout



Southwick Hall UML - Southwick Hall, 1 University Ave. Lowell, MA 01854

Report	
Project Name	UML - Southwick Hall
Project Address	1 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Southwick Hall
Module DC Nameplate	100.5 kW
Inverter AC Nameplate	100.0 kW Load Ratio: 1.00
Annual Production	134.6 MWh
Performance Ratio	87.8%
kWh/kWp	1,339.9
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

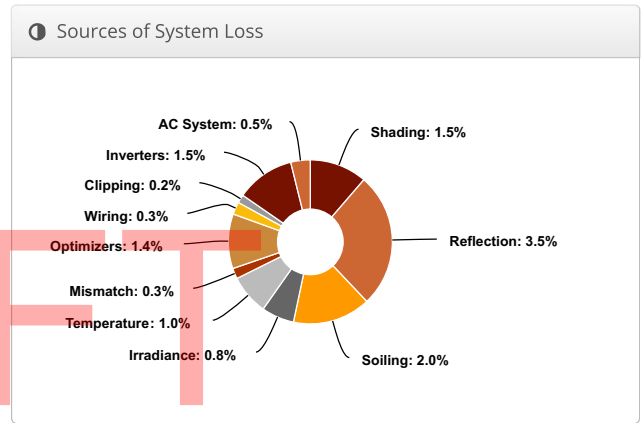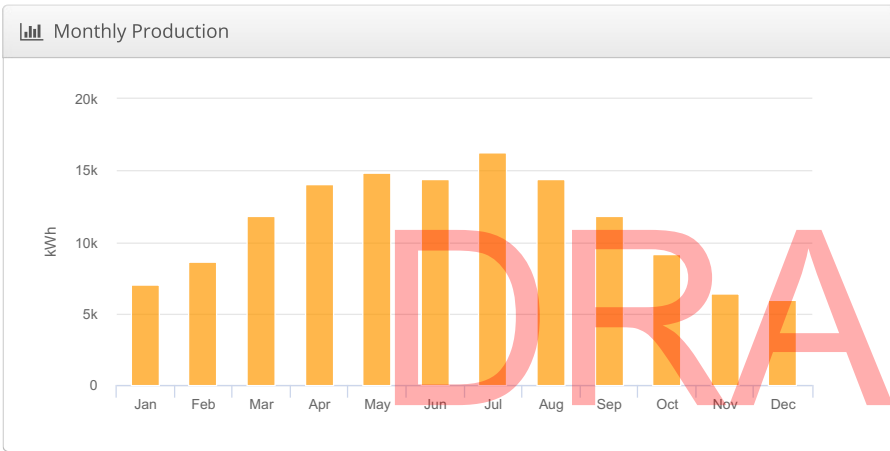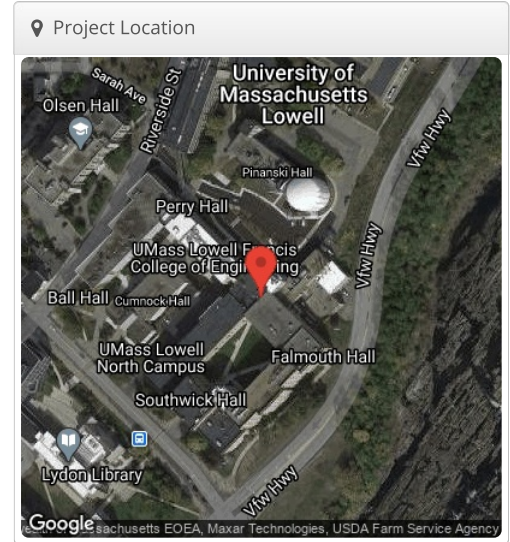

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,504.5	-1.5%
	Irradiance after Reflection	1,452.4	-3.5%
	Irradiance after Soiling	1,423.3	-2.0%
	Total Collector Irradiance	1,423.4	0.0%
Energy (kWh)	Nameplate	143,070.5	
	Output at Irradiance Levels	141,870.4	-0.8%
	Output at Cell Temperature Derate	140,414.6	-1.0%
	Output After Mismatch	140,032.1	-0.3%
	Optimizer Output	138,067.3	-1.4%
	Optimal DC Output	137,626.5	-0.3%
	Constrained DC Output	137,333.7	-0.2%
	Inverter Output	135,273.7	-1.5%
	Energy to Grid	134,597.3	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components		
Component	Name	Count
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
Strings	10 AWG (Copper)	7 (1,379.6 ft)
Optimizers	P850 (2020) (SolarEdge)	126 (107.1 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	245 (100.5 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	117	117	48.0 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	50	50	20.5 kW
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	78	78	32.0 kW






Standish Visitor/ Metered Lot UML - Standish Visitor/ Metered Lot, 84 University Ave. Lowell, MA

01854

Report	
Project Name	UML - Standish Visitor/ Metered Lot
Project Address	84 University Ave. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Standish Visitor/ Metered Lot
Module DC Nameplate	102.5 kW
Inverter AC Nameplate	108.0 kW Load Ratio: 0.95
Annual Production	125.6 MWh
Performance Ratio	83.5%
kWh/kWp	1,225.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	502035f482-cd44865f46-fd709b90f8-9ad17e68c5

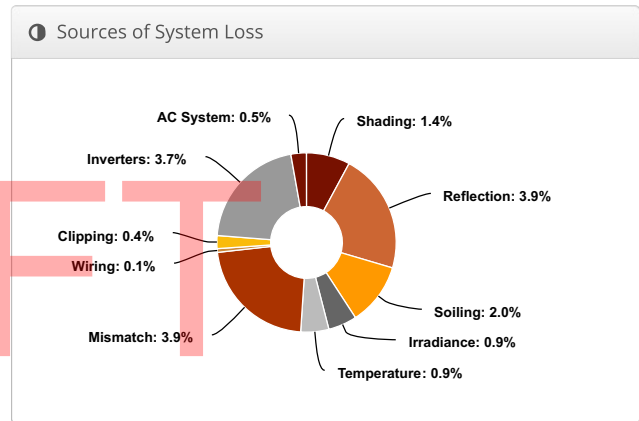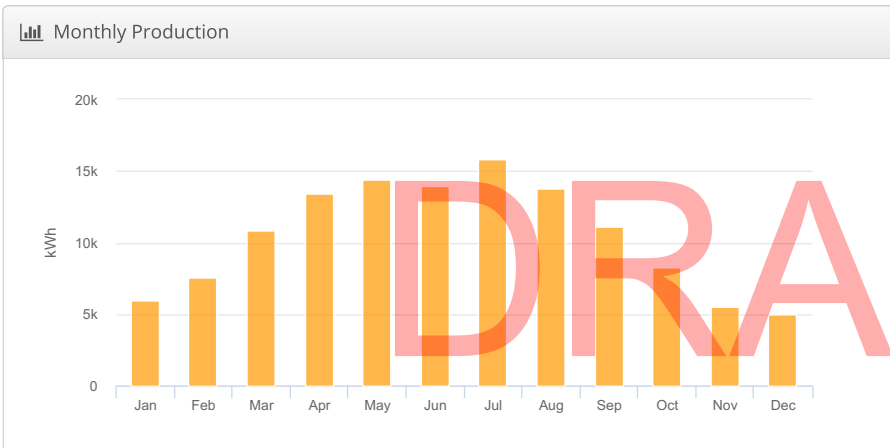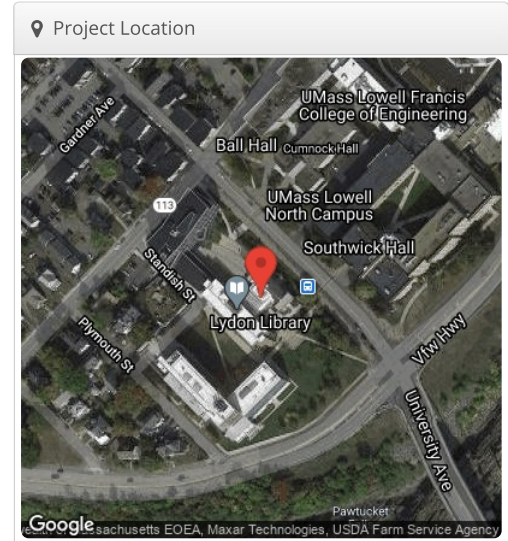

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,467.7	4.6%
	Shaded Irradiance	1,447.1	-1.4%
	Irradiance after Reflection	1,391.2	-3.9%
	Irradiance after Soiling	1,363.4	-2.0%
	Total Collector Irradiance	1,363.4	0.0%
Energy (kWh)	Nameplate	139,830.7	
	Output at Irradiance Levels	138,541.8	-0.9%
	Output at Cell Temperature Derate	137,295.5	-0.9%
	Output After Mismatch	131,874.2	-3.9%
	Optimal DC Output	131,714.6	-0.1%
	Constrained DC Output	131,166.7	-0.4%
	Inverter Output	126,276.7	-3.7%
	Energy to Grid	125,645.3	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By	Characterization										
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN										
Component Characterizations	Device	Uploaded By	Characterization										
	PVI 36TL 480V (Solectria)	Folsom Labs	Manufacturer										

Components		
Component	Name	Count
Inverters	PVI 36TL 480V (Solectria)	3 (108.0 kW)
Strings	10 AWG (Copper)	15 (772.0 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	250 (102.5 kW)

Wiring Zones										
Description	Combiner Poles	String Size	Stringing Strategy							
Wiring Zone	-	14-18	Along Racking							
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Carport	Portrait (Vertical)	7°	135.45114°	0.0 ft	1x1	250	250	102.5 kW	

Detailed Layout



ANSER
ADVISORY

Tremont Lot UML - Tremont Lot, 600 Suffolk St. Lowell, MA 01854


Report

Project Name	UML - Tremont Lot
Project Address	600 Suffolk St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Tremont Lot
Module DC Nameplate	597.8 kW
Inverter AC Nameplate	480.0 kW Load Ratio: 1.25
Annual Production	734.6 MWh
Performance Ratio	84.6%
kWh/kWp	1,228.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

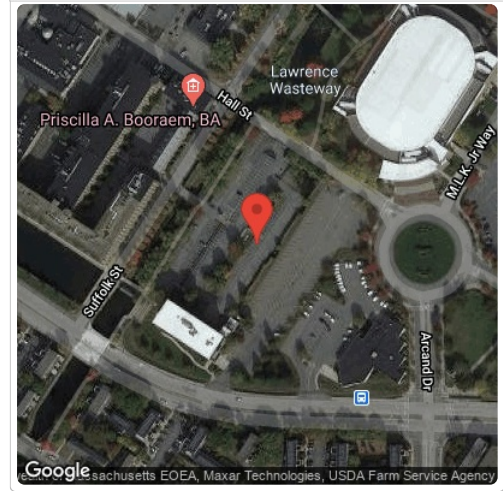

Monthly Production

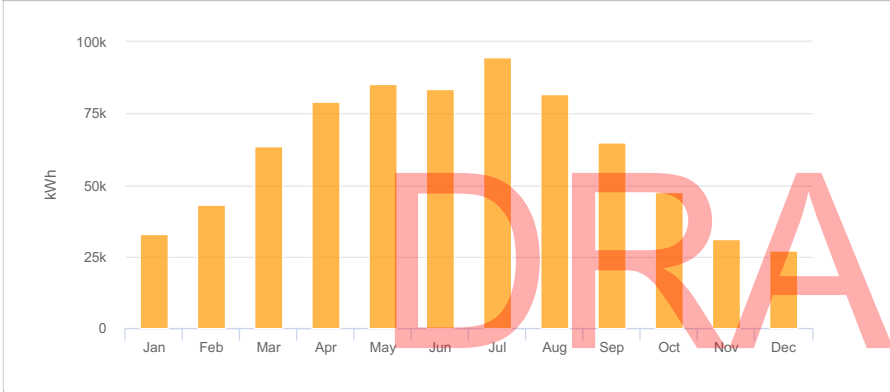

Sources of System Loss

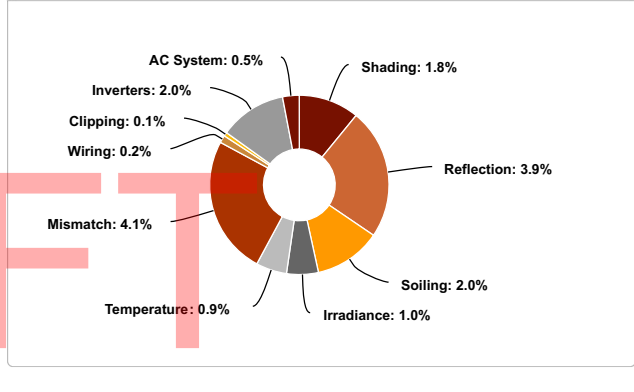

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,452.8	3.5%
	Shaded Irradiance	1,426.6	-1.8%
	Irradiance after Reflection	1,370.8	-3.9%
	Irradiance after Soiling	1,343.4	-2.0%
	Total Collector Irradiance	1,343.3	0.0%
Energy (kWh)	Nameplate	803,537.3	
	Output at Irradiance Levels	795,893.1	-1.0%
	Output at Cell Temperature Derate	788,574.1	-0.9%
	Output After Mismatch	755,894.1	-4.1%
	Optimal DC Output	754,193.5	-0.2%
	Constrained DC Output	753,352.2	-0.1%
	Inverter Output	738,269.6	-2.0%
	Energy to Grid	734,578.3	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.5 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set


Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components		
Component	Name	Count
Inverters	PVI 60TL (Solecristia)	8 (480.0 kW)
Strings	10 AWG (Copper)	88 (17,332.6 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	1,458 (597.8 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carpport	Portrait (Vertical)	7°	123.0519970567342°	0.0 ft	1x1	774	774	317.3 kW
Field Segment 1 (copy)	Carpport	Portrait (Vertical)	7°	123.527549335608°	0.0 ft	1x1	684	684	280.4 kW

Detailed Layout

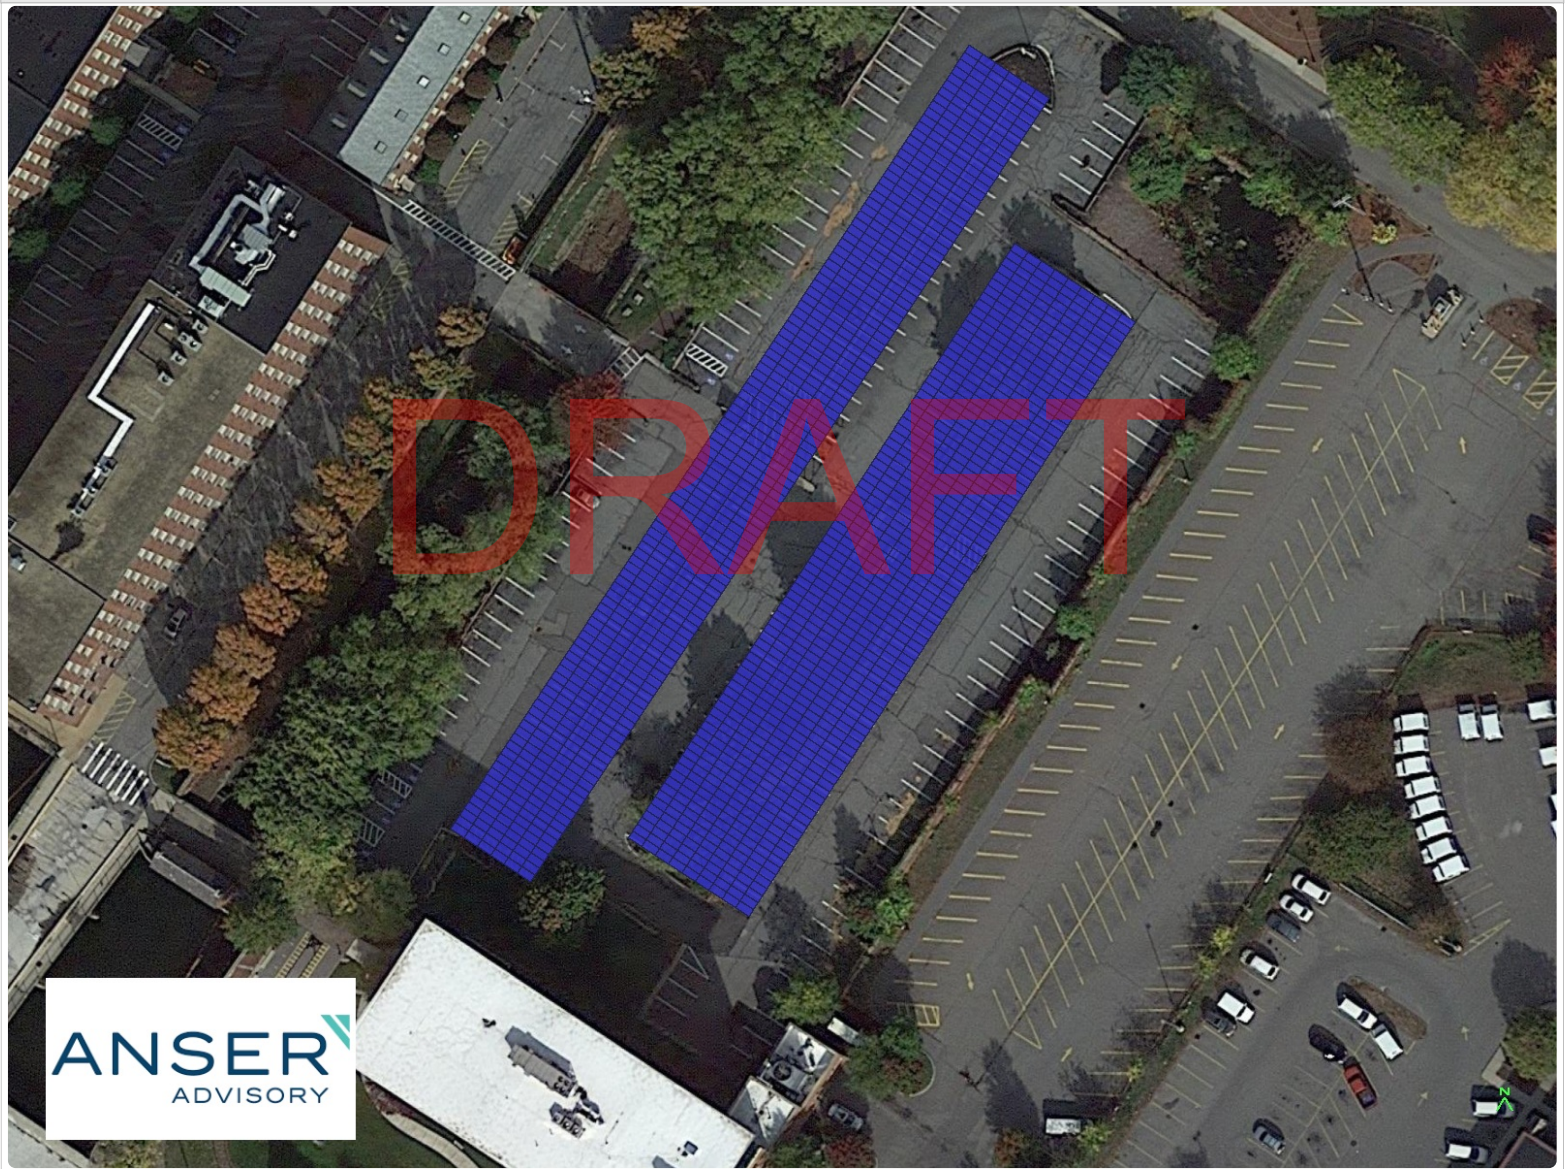

Tsongas Center UML - Tsongas Center, 300 Arcand Dr. Lowell, MA 01852


Report

Project Name	UML - Tsongas Center
Project Address	300 Arcand Dr. Lowell, MA 01852
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com


System Metrics

Design	Tsongas Center
Module DC Nameplate	502.7 kW
Inverter AC Nameplate	500.0 kW Load Ratio: 1.01
Annual Production	678.9 MWh
Performance Ratio	88.5%
kWh/kWp	1,350.7
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45


Project Location

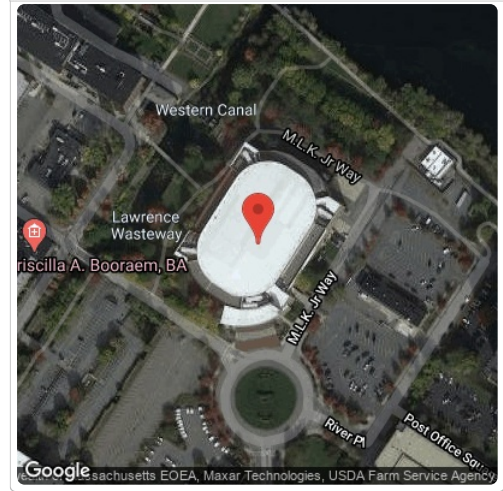

Monthly Production

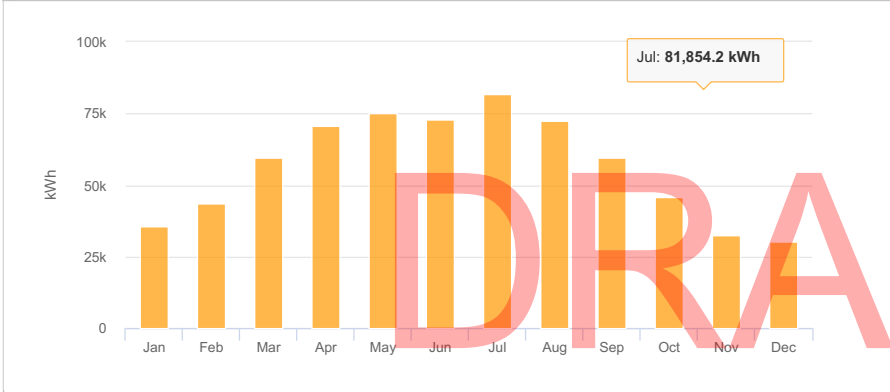

Sources of System Loss

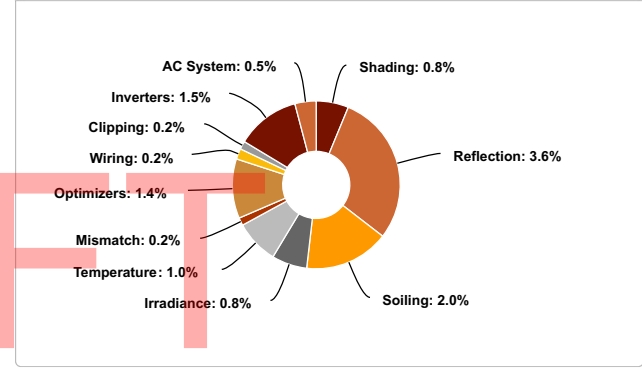

Annual Production

	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,515.3	-0.8%
	Irradiance after Reflection	1,461.2	-3.6%
	Irradiance after Soiling	1,432.0	-2.0%
	Total Collector Irradiance	1,432.0	0.0%
Energy (kWh)	Nameplate	720,293.9	
	Output at Irradiance Levels	714,318.7	-0.8%
	Output at Cell Temperature Derate	706,978.1	-1.0%
	Output After Mismatch	705,675.7	-0.2%
	Optimizer Output	695,789.6	-1.4%
	Optimal DC Output	694,058.2	-0.2%
	Constrained DC Output	692,729.6	-0.2%
	Inverter Output	682,338.6	-1.5%
	Energy to Grid	678,926.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set


Description	Condition Set 1															
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)															
Solar Angle Location	Meteo Lat/Lng															
Transposition Model	Perez Model															
Temperature Model	Sandia Model															
Temperature Model Parameters	Rack Type	a	b	Temperature Delta												
	Fixed Tilt	-3.56	-0.075	3°C												
	Flush Mount	-2.81	-0.0455	0°C												
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D				
	2	2	2	2	2	2	2	2	2	2	2	2				
Irradiation Variance	5%															
Cell Temperature Spread	4° C															
Module Binning Range	-2.5% to 2.5%															
AC System Derate	0.50%															
Module Characterizations	Module	"LG410N2W-A5 (Jan1,17)" (LG Electronics)						Uploaded By	Folsom Labs					Characterization	Spec Sheet Characterization, PAN	
	Component Characterizations	Device	Uploaded By					Characterization								

Components		
Component	Name	Count
Inverters	SE100KUS (SolarEdge)	5 (500.0 kW)
Strings	10 AWG (Copper)	34 (4,081.4 ft)
Optimizers	P850 (2020) (SolarEdge)	614 (521.9 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	1,226 (502.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	1,226	1,226	502.7 kW




Detailed Layout

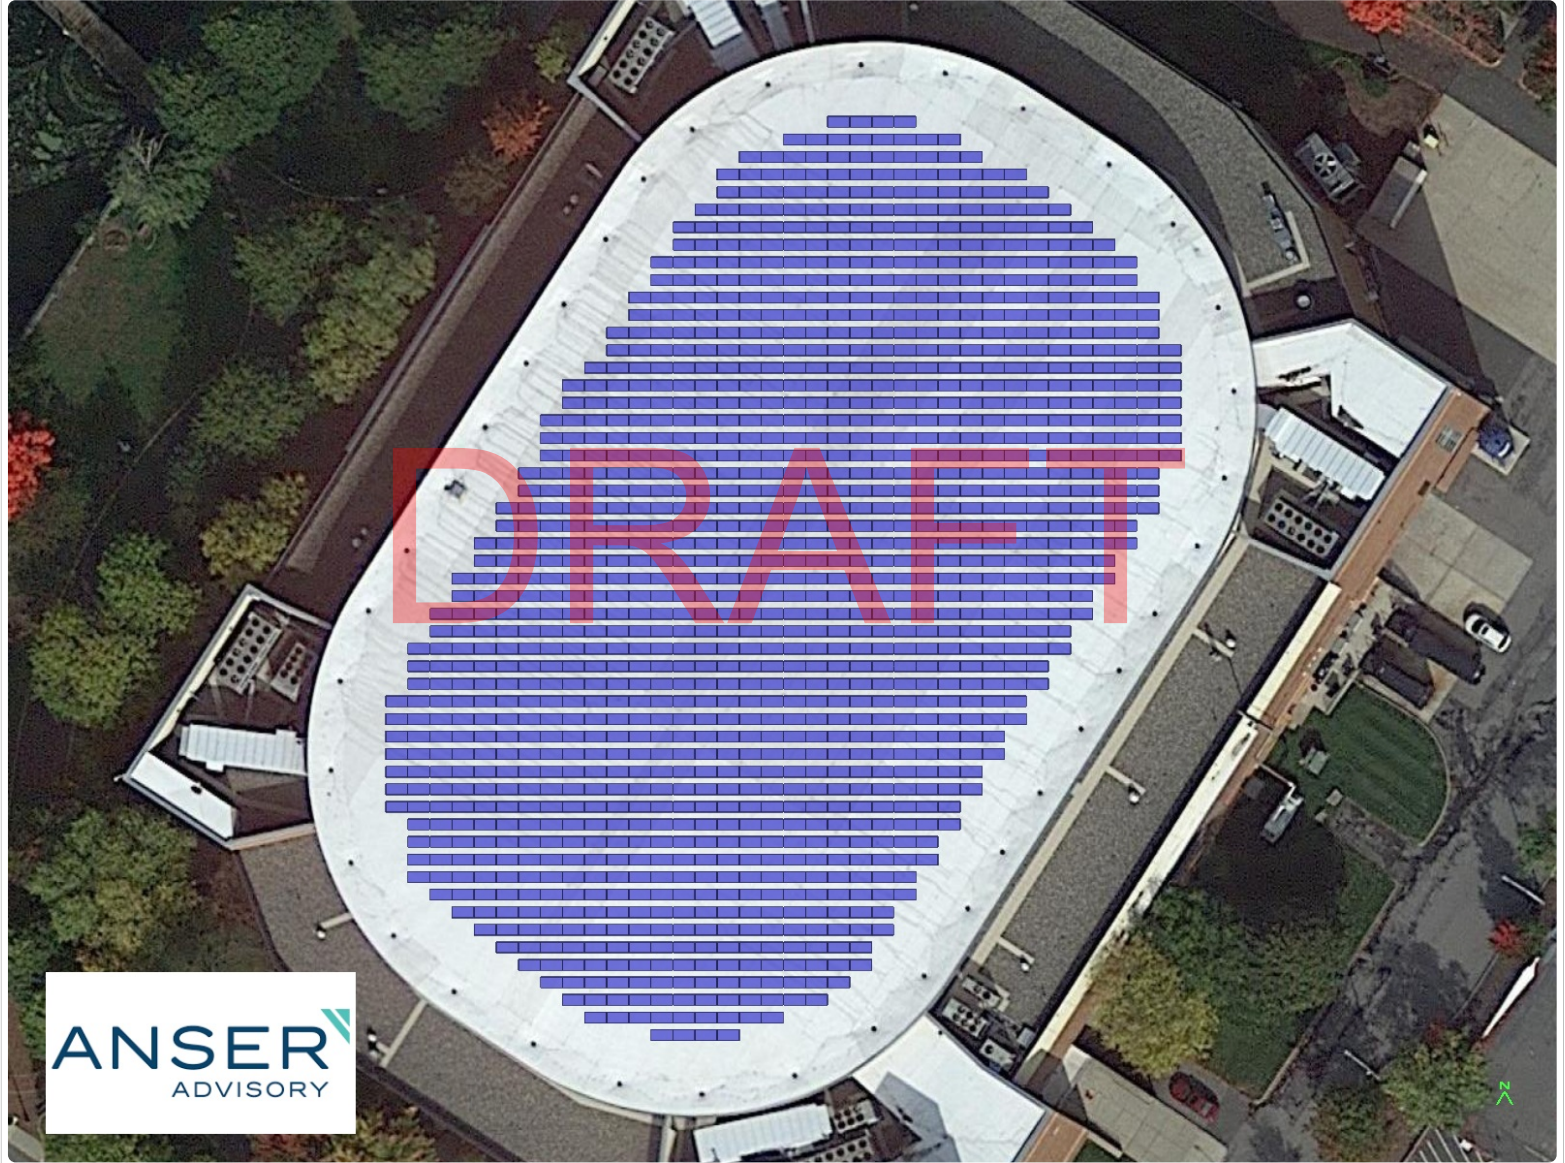

Tsongas Lot B UML - Tsongas Lot B, 300 Martin Luther King Jr. Way Lowell, MA 01854

Report	
Project Name	UML - Tsongas Lot B
Project Address	300 Martin Luther King Jr. Way Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Tsongas Lot B
Module DC Nameplate	294.4 kW
Inverter AC Nameplate	240.0 kW Load Ratio: 1.23
Annual Production	375.2 MWh
Performance Ratio	86.3%
kWh/kWp	1,274.5
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

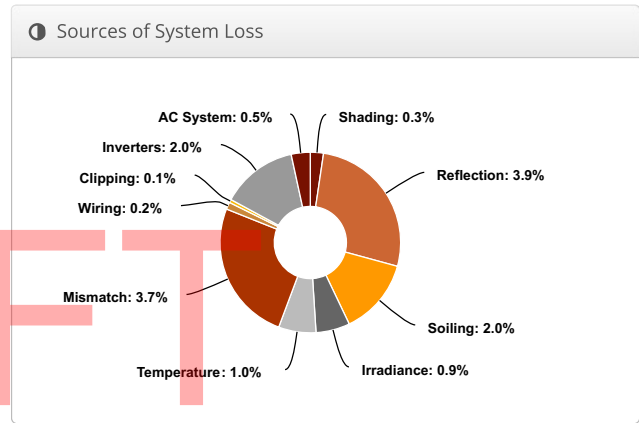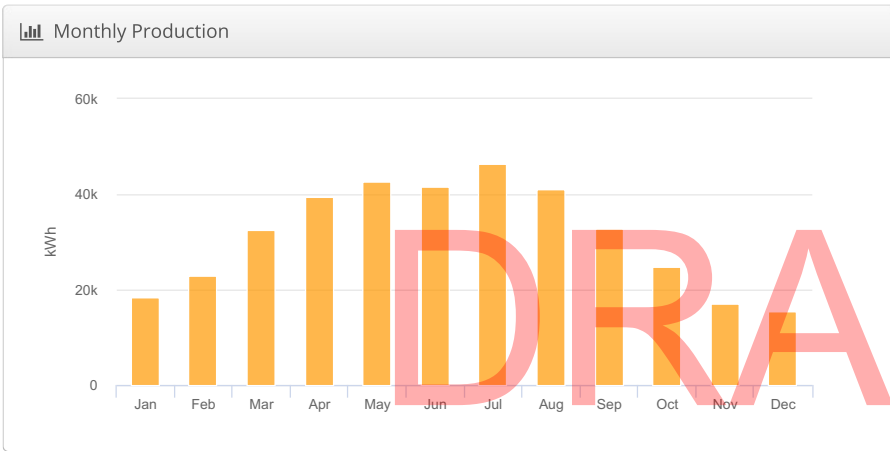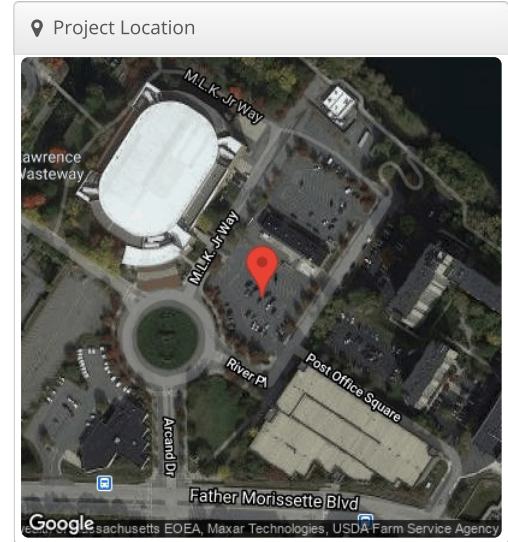

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,477.3	5.3%
	Shaded Irradiance	1,472.2	-0.3%
	Irradiance after Reflection	1,414.3	-3.9%
	Irradiance after Soiling	1,386.0	-2.0%
	Total Collector Irradiance	1,386.0	0.0%
Energy (kWh)	Nameplate	408,296.0	
	Output at Irradiance Levels	404,659.4	-0.9%
	Output at Cell Temperature Derate	400,698.3	-1.0%
	Output After Mismatch	385,832.3	-3.7%
	Optimal DC Output	385,116.9	-0.2%
	Constrained DC Output	384,788.8	-0.1%
	Inverter Output	377,086.9	-2.0%
	Energy to Grid	375,201.5	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b									
	Fixed Tilt	-3.56	-0.075									
	Flush Mount	-2.81	-0.0455									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									
	PVI 60TL (Solectria)	Folsom Labs	Spec Sheet									

Components

Component	Name	Count
Inverters	PVI 60TL (Solectria)	4 (240.0 kW)
Strings	10 AWG (Copper)	42 (5,550.0 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	718 (294.4 kW)


Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	213.14440993256403°	0.0 ft	1x1	210	210	86.1 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	213.14441°	0.0 ft	1x1	210	210	86.1 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	213.14441°	0.0 ft	1x1	90	90	36.9 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	213.14441°	0.0 ft	1x1	208	208	85.3 kW




Detailed Layout

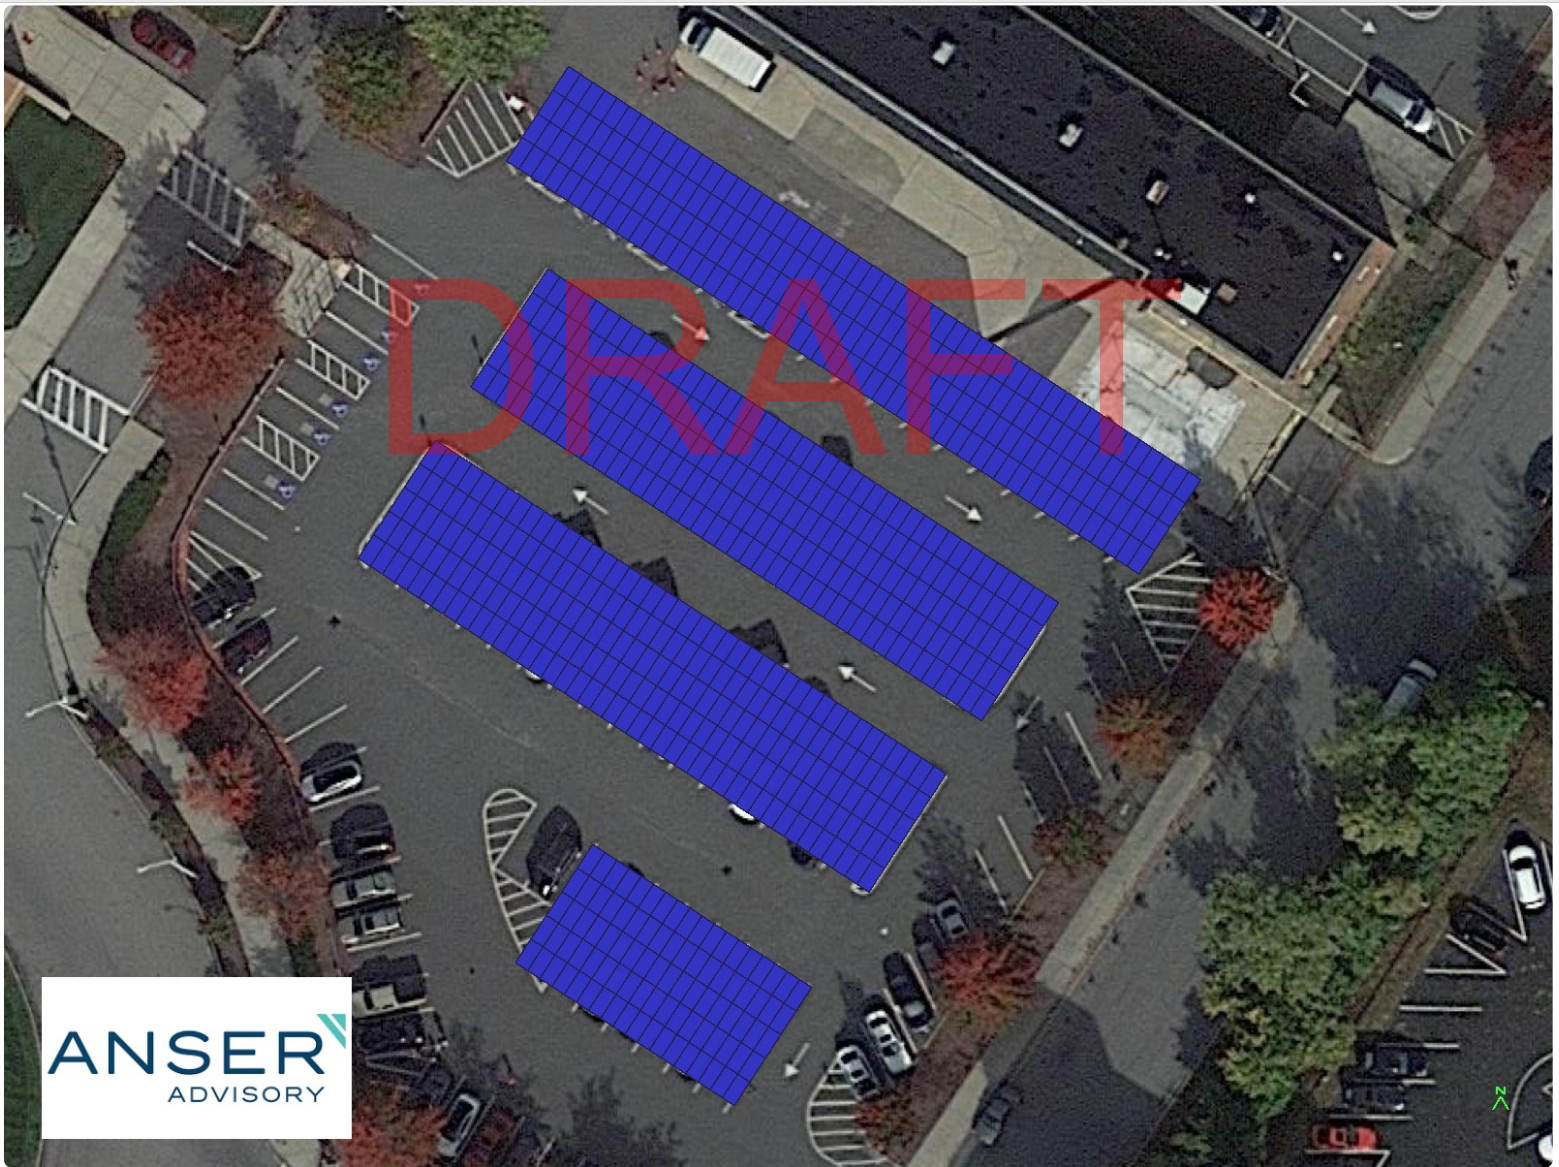

University Crossing UML - University Crossing, 220 Pawtucket St. Lowell, MA 01854

Report	
Project Name	UML - University Crossing
Project Address	220 Pawtucket St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	University Crossing
Module DC Nameplate	109.5 kW
Inverter AC Nameplate	100.0 kW Load Ratio: 1.09
Annual Production	143.3 MWh
Performance Ratio	86.1%
kWh/kWp	1,308.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

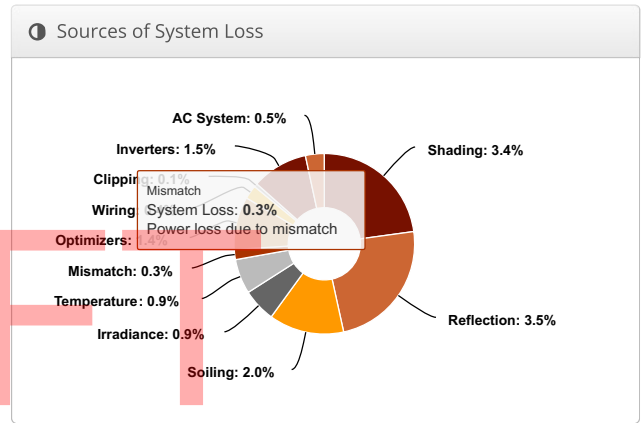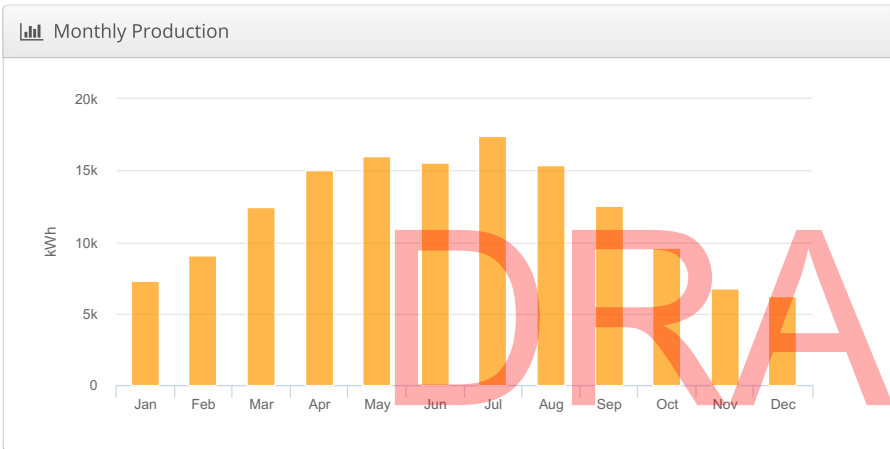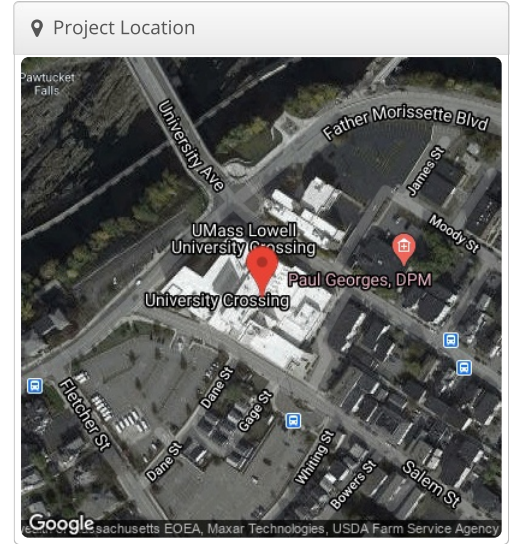

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,520.5	8.4%
	Shaded Irradiance	1,468.9	-3.4%
	Irradiance after Reflection	1,417.0	-3.5%
	Irradiance after Soiling	1,388.7	-2.0%
	Total Collector Irradiance	1,388.6	0.0%
Energy (kWh)	Nameplate	152,096.9	
	Output at Irradiance Levels	150,751.4	-0.9%
	Output at Cell Temperature Derate	149,354.8	-0.9%
	Output After Mismatch	148,951.5	-0.3%
	Optimizer Output	146,854.7	-1.4%
	Optimal DC Output	146,315.8	-0.4%
	Constrained DC Output	146,181.6	-0.1%
	Inverter Output	143,988.9	-1.5%
	Energy to Grid	143,268.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b									
	Fixed Tilt	-3.56	-0.075									
	Flush Mount	-2.81	-0.0455									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By	Characterization									
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs	Spec Sheet Characterization, PAN									
Component Characterizations	Device	Uploaded By	Characterization									

Components

Component	Name	Count
Inverters	SE100KUS (SolarEdge)	1 (100.0 kW)
Strings	10 AWG (Copper)	8 (1,678.0 ft)
Optimizers	P850 (2020) (SolarEdge)	136 (115.6 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	267 (109.5 kW)

Wiring Zones

Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-37	Along Racking

Field Segments

Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	239	217	89.0 kW
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	15°	123.06703°	0.0 ft	1x1	50	50	20.5 kW

Detailed Layout






University Suites Residence Hall UML - University Suites Residence Hall, 327 Aiken St. Lowell, MA

01854

Report	
Project Name	UML - University Suites Residence Hall
Project Address	327 Aiken St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	University Suites Residence Hall
Module DC Nameplate	103.7 kW
Inverter AC Nameplate	99.9 kW Load Ratio: 1.04
Annual Production	133.3 MWh
Performance Ratio	85.8%
kWh/kWp	1,284.8
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89

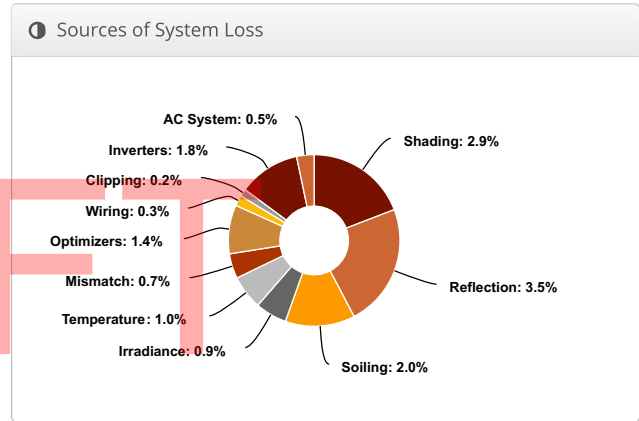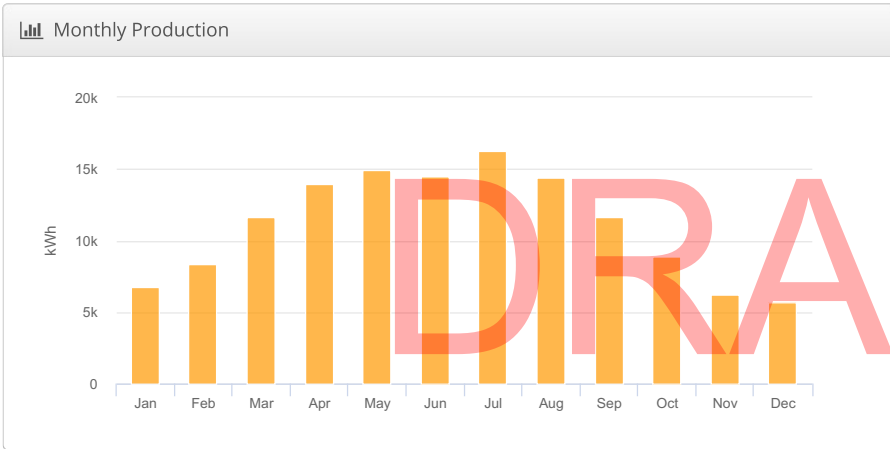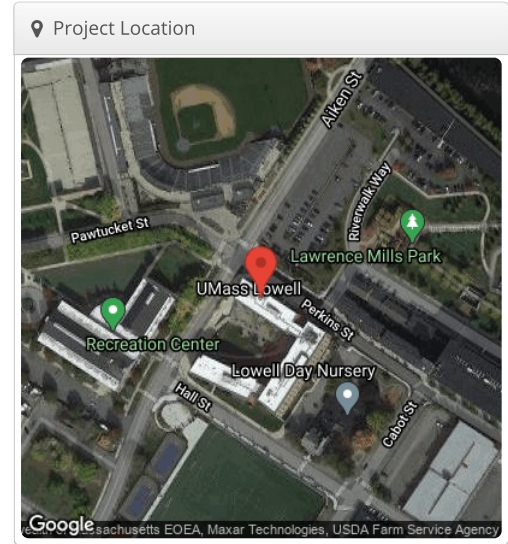

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,497.5	6.7%
	Shaded Irradiance	1,453.8	-2.9%
	Irradiance after Reflection	1,402.6	-3.5%
	Irradiance after Soiling	1,374.5	-2.0%
	Total Collector Irradiance	1,374.6	0.0%
Energy (kWh)	Nameplate	142,677.2	
	Output at Irradiance Levels	141,386.3	-0.9%
	Output at Cell Temperature Derate	140,005.9	-1.0%
	Output After Mismatch	139,004.1	-0.7%
	Optimizer Output	137,056.2	-1.4%
	Optimal DC Output	136,638.4	-0.3%
	Constrained DC Output	136,349.3	-0.2%
	Inverter Output	133,939.5	-1.8%
Energy to Grid	133,269.8	-0.5%	
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.6 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By					Characterization						
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs					Spec Sheet Characterization, PAN						
Component Characterizations	Device	Uploaded By					Characterization						

Components		
Component Name		Count
Inverters	SE66.6KUS (SolarEdge)	1 (66.6 kW)
Inverters	SE33.3K (2020) (SolarEdge)	1 (33.3 kW)
Strings	10 AWG (Copper)	7 (1,202.2 ft)
Optimizers	P850 (2020) (SolarEdge)	129 (109.7 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	253 (103.7 kW)

Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		13-37		Along Racking					
Wiring Zone 2	-		13-37		Along Racking					
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	205.12554888340424°	2.0 ft	1x1	108	108	44.3 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	213.80390005073616°	2.0 ft	1x1	84	68	27.9 kW	
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	122.70865123713338°	2.0 ft	1x1	78	77	31.6 kW	

Detailed Layout






Wannalancit Business Center UML - Wannalancit Business Center, 660 Suffolk St. Lowell, MA

01854

Report	
Project Name	UML - Wannalancit Business Center
Project Address	660 Suffolk St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Wannalancit Business Center
Module DC Nameplate	223.5 kW
Inverter AC Nameplate	200.0 kW Load Ratio: 1.12
Annual Production	300.8 MWh
Performance Ratio	88.2%
kWh/kWp	1,346.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	ee07b2c24f-40774bc534-9c5f92fcd7-e88a1fda89

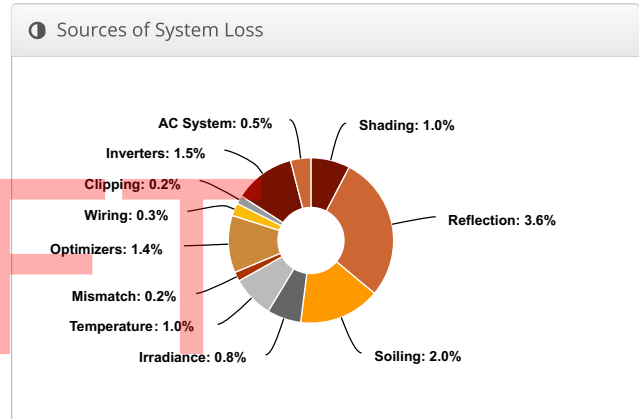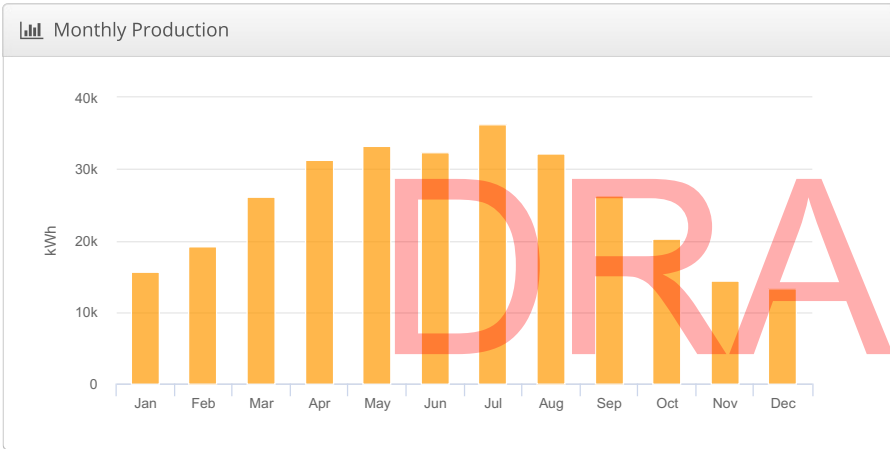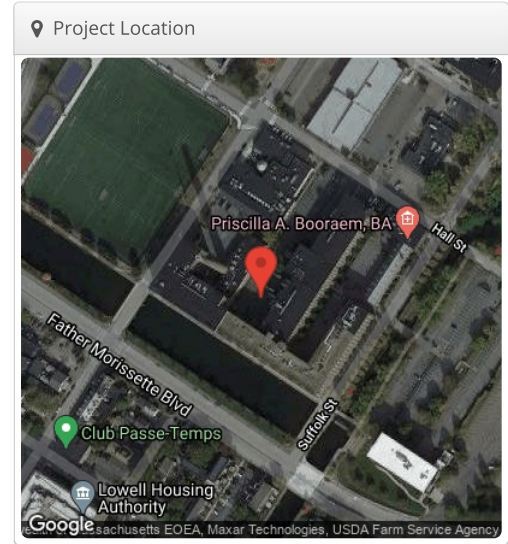


Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,526.9	8.8%
	Shaded Irradiance	1,512.3	-1.0%
	Irradiance after Reflection	1,458.4	-3.6%
	Irradiance after Soiling	1,429.3	-2.0%
	Total Collector Irradiance	1,429.3	0.0%
Energy (kWh)	Nameplate	319,584.2	
	Output at Irradiance Levels	316,920.9	-0.8%
	Output at Cell Temperature Derate	313,656.9	-1.0%
	Output After Mismatch	312,944.1	-0.2%
	Optimizer Output	308,536.2	-1.4%
	Optimal DC Output	307,570.1	-0.3%
	Constrained DC Output	306,941.4	-0.2%
	Inverter Output	302,335.9	-1.5%
Energy to Grid	300,824.2	-0.5%	
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.9 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set													
Description	Condition Set 1												
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)												
Solar Angle Location	Meteo Lat/Lng												
Transposition Model	Perez Model												
Temperature Model	Sandia Model												
Temperature Model Parameters	Rack Type	a	b	Temperature Delta									
	Fixed Tilt	-3.56	-0.075	3°C									
	Flush Mount	-2.81	-0.0455	0°C									
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D	
	2	2	2	2	2	2	2	2	2	2	2	2	
Irradiation Variance	5%												
Cell Temperature Spread	4° C												
Module Binning Range	-2.5% to 2.5%												
AC System Derate	0.50%												
Module Characterizations	Module	Uploaded By					Characterization						
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs					Spec Sheet Characterization, PAN						
Component Characterizations	Device	Uploaded By					Characterization						

Components		
Component Name		Count
Inverters	SE100KUS (SolarEdge)	2 (200.0 kW)
Strings	10 AWG (Copper)	16 (4,024.1 ft)
Optimizers	P850 (2020) (SolarEdge)	277 (235.5 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	545 (223.5 kW)

Wiring Zones										
Description	Combiner Poles		String Size		Stringing Strategy					
Wiring Zone	-		13-37		Along Racking					
Wiring Zone 2	-		13-37		Along Racking					
Field Segments										
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power	
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	298	284	116.4 kW	
Field Segment 2	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	204	199	81.6 kW	
Field Segment 3	Fixed Tilt	Landscape (Horizontal)	10°	180°	2.0 ft	1x1	62	62	25.4 kW	

Detailed Layout



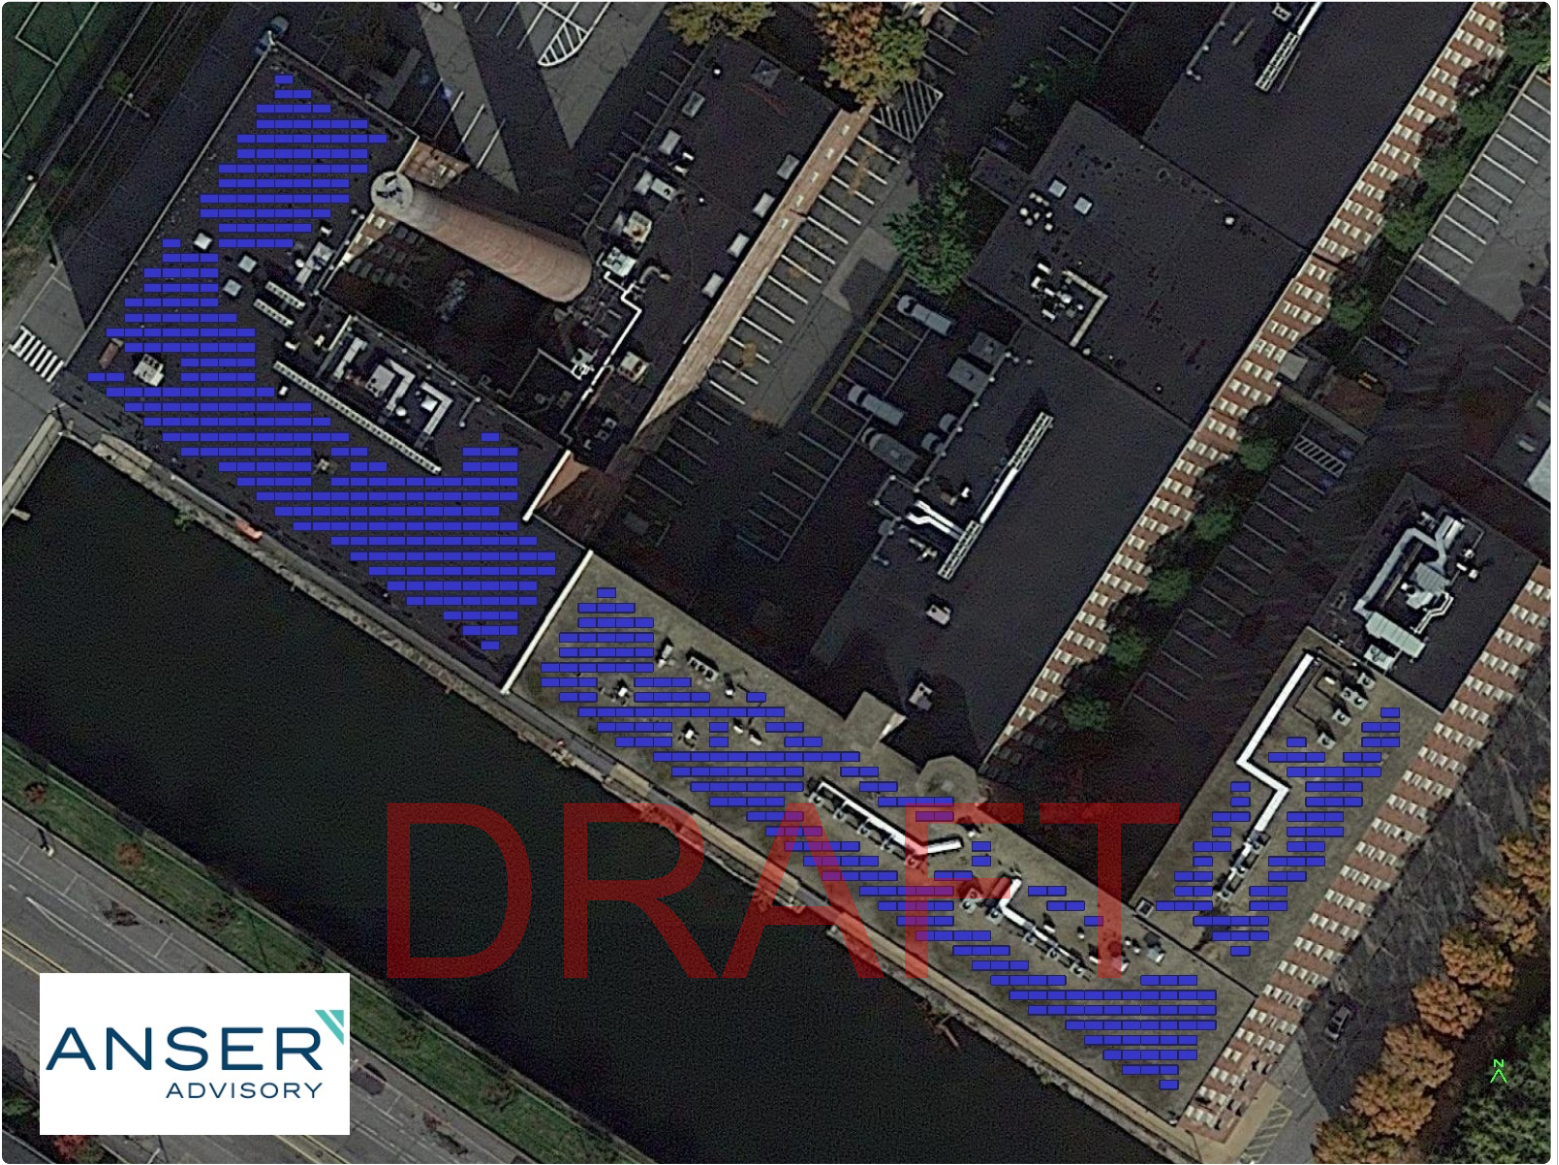


ANSER
ADVISORY

Weed Hall UML - Weed Hall, 3 Solomont Way Lowell, MA 01854

Report	
Project Name	UML - Weed Hall
Project Address	3 Solomont Way Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Weed Hall
Module DC Nameplate	52.9 kW
Inverter AC Nameplate	51.9 kW Load Ratio: 1.02
Annual Production	67.75 MWh
Performance Ratio	84.1%
kWh/kWp	1,281.0
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	5f5cdd1076-3edb84d28b-6bff68b913-0b0d9d60b5

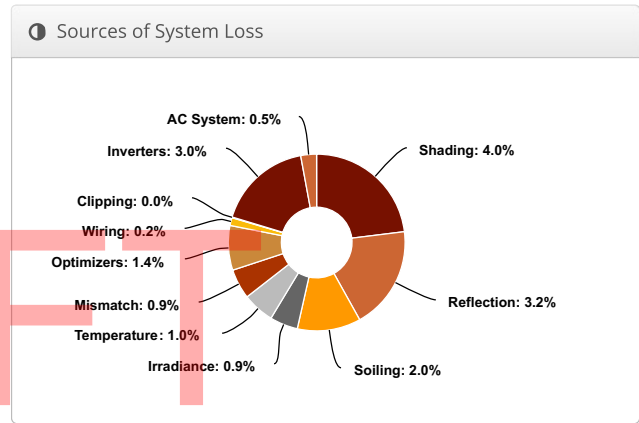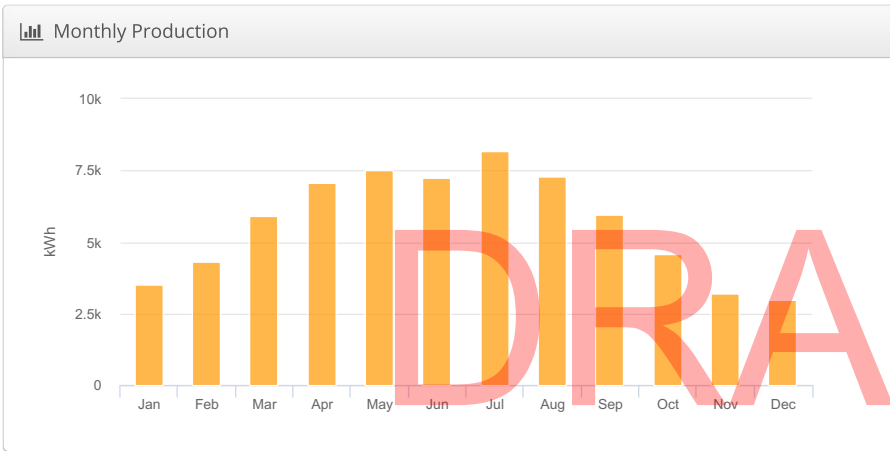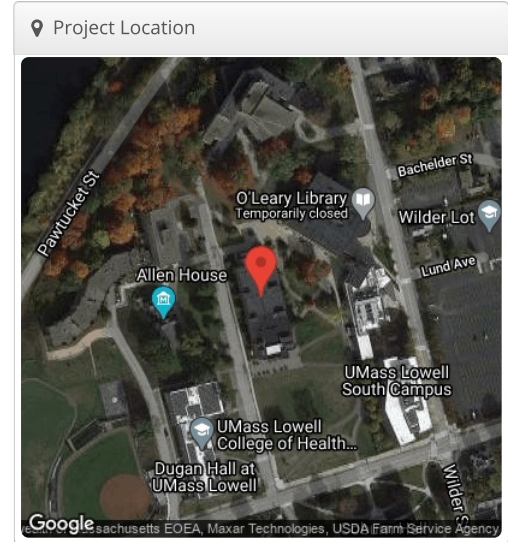

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,524.0	8.6%
	Shaded Irradiance	1,463.5	-4.0%
	Irradiance after Reflection	1,415.9	-3.2%
	Irradiance after Soiling	1,387.6	-2.0%
	Total Collector Irradiance	1,387.8	0.0%
Energy (kWh)	Nameplate	73,446.3	
	Output at Irradiance Levels	72,797.6	-0.9%
	Output at Cell Temperature Derate	72,069.7	-1.0%
	Output After Mismatch	71,389.9	-0.9%
	Optimizer Output	70,386.8	-1.4%
	Optimal DC Output	70,212.1	-0.2%
	Constrained DC Output	70,196.9	0.0%
	Inverter Output	68,090.8	-3.0%
	Energy to Grid	67,750.3	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	


Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								

Components		
Component	Name	Count
Inverters	SE17.3KUS (2020) (SolarEdge)	3 (51.9 kW)
Strings	10 AWG (Copper)	8 (443.7 ft)
Optimizers	P850 (2020) (SolarEdge)	65 (55.3 kW)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	129 (52.9 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	13-17	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Fixed Tilt	Landscape (Horizontal)	10°	166.85406217344416°	2.0 ft	1x1	137	129	52.9 kW




Detailed Layout

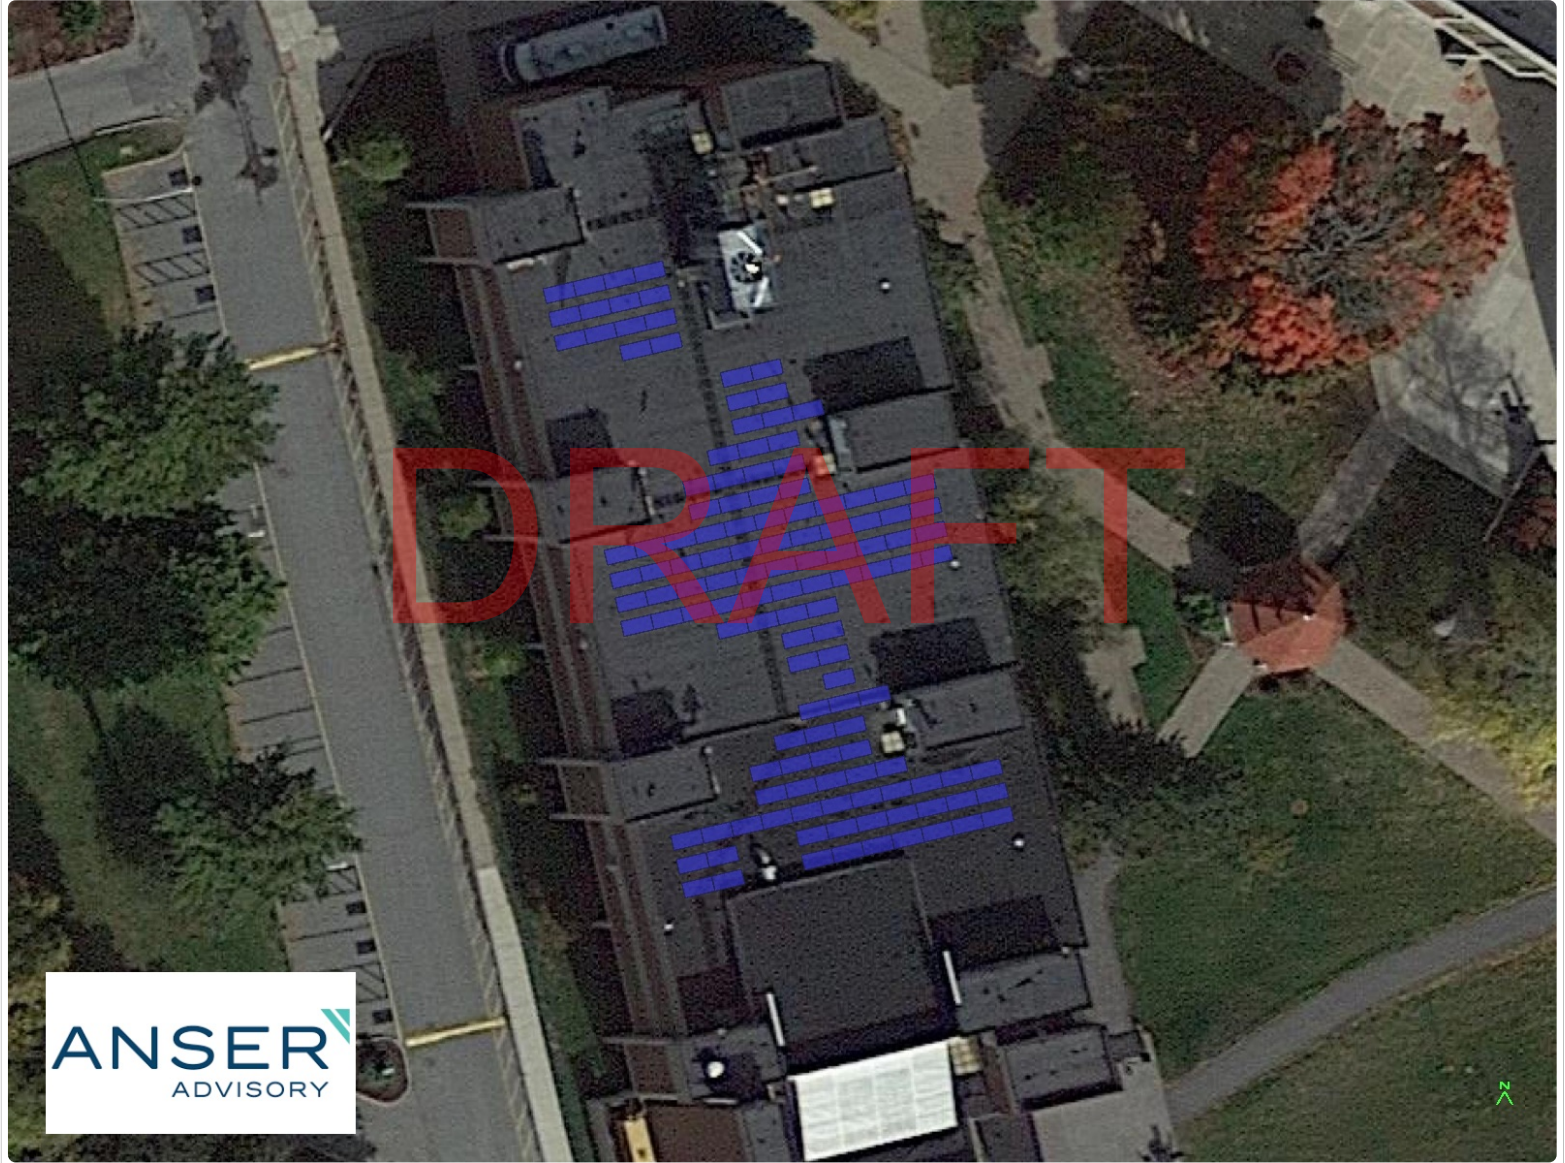

Wilder Faculty/ Staff Lot UML - Wilder Faculty/ Staff Lot, 883 Broadway St. Lowell, MA 01854

Report	
Project Name	UML - Wilder Faculty/ Staff Lot
Project Address	883 Broadway St. Lowell, MA 01854
Prepared By	David Lazerwitz david.lazerwitz@anseradvisory.com

System Metrics	
Design	Wilder Faculty/ Staff Lot
Module DC Nameplate	823.7 kW
Inverter AC Nameplate	660.0 kW Load Ratio: 1.25
Annual Production	1.050 GWh
Performance Ratio	86.0%
kWh/kWp	1,274.3
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)
Simulator Version	863670a94f-c064fa8fd3-2068660a65-c8f42cea45

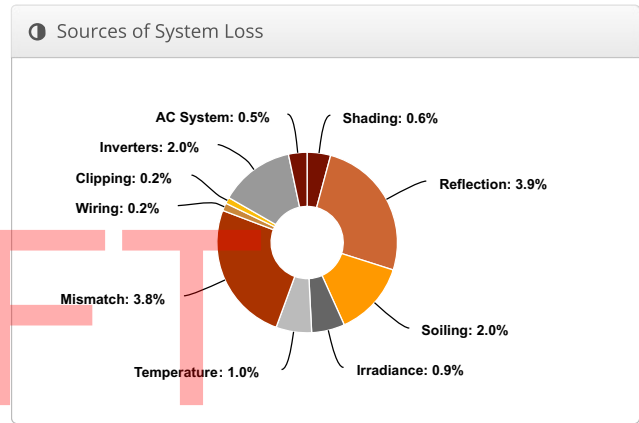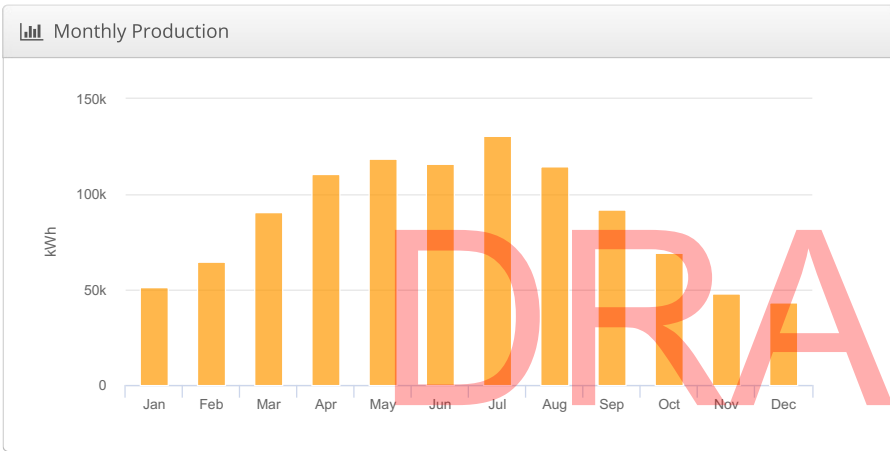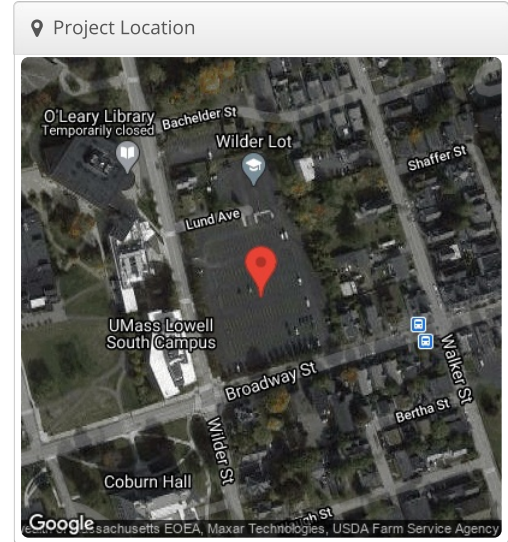

Annual Production			
	Description	Output	% Delta
Irradiance (kWh/m ²)	Annual Global Horizontal Irradiance	1,403.1	
	POA Irradiance	1,482.1	5.6%
	Shaded Irradiance	1,472.8	-0.6%
	Irradiance after Reflection	1,416.1	-3.9%
	Irradiance after Soiling	1,387.8	-2.0%
	Total Collector Irradiance	1,387.7	0.0%
Energy (kWh)	Nameplate	1,143,836.3	
	Output at Irradiance Levels	1,133,683.2	-0.9%
	Output at Cell Temperature Derate	1,122,833.7	-1.0%
	Output After Mismatch	1,080,465.0	-3.8%
	Optimal DC Output	1,078,227.9	-0.2%
	Constrained DC Output	1,076,430.6	-0.2%
	Inverter Output	1,054,867.2	-2.0%
	Energy to Grid	1,049,592.9	-0.5%
Temperature Metrics			
	Avg. Operating Ambient Temp		12.3 °C
	Avg. Operating Cell Temp		19.7 °C
Simulation Metrics			
	Operating Hours	4685	
	Solved Hours	4685	

Condition Set												
Description	Condition Set 1											
Weather Dataset	TMY, 10km grid (42.65,-71.35), NREL (prospector)											
Solar Angle Location	Meteo Lat/Lng											
Transposition Model	Perez Model											
Temperature Model	Sandia Model											
Temperature Model Parameters	Rack Type	a	b	Temperature Delta								
	Fixed Tilt	-3.56	-0.075	3°C								
	Flush Mount	-2.81	-0.0455	0°C								
Soiling (%)	J	F	M	A	M	J	J	A	S	O	N	D
	2	2	2	2	2	2	2	2	2	2	2	2
Irradiation Variance	5%											
Cell Temperature Spread	4° C											
Module Binning Range	-2.5% to 2.5%											
AC System Derate	0.50%											
Module Characterizations	Module	Uploaded By		Characterization								
	"LG410N2W-A5 (Jan1,17)" (LG Electronics)	Folsom Labs		Spec Sheet Characterization, PAN								
Component Characterizations	Device	Uploaded By		Characterization								
	PVI 60TL (Solectria)	Folsom Labs		Spec Sheet								

Components		
Component	Name	Count
Inverters	PVI 60TL (Solectria)	11 (660.0 kW)
Strings	10 AWG (Copper)	121 (19,255.1 ft)
Module	LG Electronics, "LG410N2W-A5 (Jan1,17)" (410W)	2,009 (823.7 kW)

Wiring Zones			
Description	Combiner Poles	String Size	Stringing Strategy
Wiring Zone	-	14-18	Along Racking

Field Segments									
Description	Racking	Orientation	Tilt	Azimuth	Intrarow Spacing	Frame Size	Frames	Modules	Power
Field Segment 1	Carport	Portrait (Vertical)	7°	162.60182°	0.0 ft	1x1	365	365	149.7 kW
Field Segment 1 (copy)	Carport	Portrait (Vertical)	7°	162.60182°	0.0 ft	1x1	360	360	147.6 kW
Field Segment 1 (copy 1)	Carport	Portrait (Vertical)	7°	162.60182°	0.0 ft	1x1	354	354	145.1 kW
Field Segment 1 (copy 2)	Carport	Portrait (Vertical)	7°	162.60182°	0.0 ft	1x1	342	342	140.2 kW
Field Segment 1 (copy 3)	Carport	Portrait (Vertical)	7°	162.60182°	0.0 ft	1x1	378	378	155.0 kW
Field Segment 6	Carport	Portrait (Vertical)	7°	256.7707°	0.0 ft	1x1	210	210	86.1 kW



DRAFT

DRAFT

Table of Contents

UML Ball Hall PV Only	2
UML Ball Hall PV BESS	13
UML Olney Hall PV Only	25
UML Sheehy Hall PV Only	36
UML Tsongas Center PV BESS	47

DRAFT

ENERGY TOOLBASE™

Prepared For

UMass Lowell
(111)111-1111

adam.tobin@anseradvisory.com

UML - Ball Hall (PV Only)

Prepared By

David Lazerwitz
(213) 514-2108

david.lazerwitz@anseradvisory.com

3/30/2021



The Energy Toolbase provides comprehensive cost analysis for commercial, municipal, and residential renewable energy projects. We provide the tools that professionals need to compete in the fast paced renewable energy market by leveraging our first hand experience developing energy projects. Our software developers are NABCEP certified energy professionals and have completed energy analysis for companies including the Mirage Casino Resorts, Boston Scientific, Leviton, Balfour Beatty Construction, and many others.



Table of Contents

- 1 Project Summary 3
- 2 Project Details 4
 - 2.1 Ball Hall 4
 - 2.1.1 PV System Details 4
 - 2.1.2 Rebates and Incentives 5
 - 2.1.3 Utility Rates 6
 - 2.1.4 Current Electric Bill 6
 - 2.1.5 New Electric Bill 7
- 3 Cash Flow Analysis 8
 - 3.1 Generic PPA 8
 - 3.2 Cash Purchase 9
- 4 Detailed Cash Flow Analysis 10
 - 4.1 Generic PPA 10
 - 4.2 Cash Purchase 11

DRAFT


1 Project Summary

Payment Options	Generic PPA	Cash Purchase
PPA Escalation Rate	1%	-
Starting PPA Rate	\$0.12/kWh	-
Upfront Payment	-	\$240,585
Term	20 Years	-
Rebates and Incentives	-	\$274,484
Net Payments	-	\$45,804
25-Year Electric Bill Savings	-	\$847,174
25-Year IRR	-	15.66%
25-Year LCOE PV	-	\$0.012
25-Year NPV	-	\$332,479
Payback Period	-	6.5 Years
Total Payments	\$398,430	\$320,288
20-Year Electric Bill Savings	\$625,322	-
20-Year LCOE PV	\$0.132	-
20-Year NPV	\$127,298	-

Combined Solar PV Rating
 Power Rating: 111,930 W-DC
 Power Rating: 100,072 W-AC-CEC

DRAFT

Cumulative Energy Costs By Payment Option

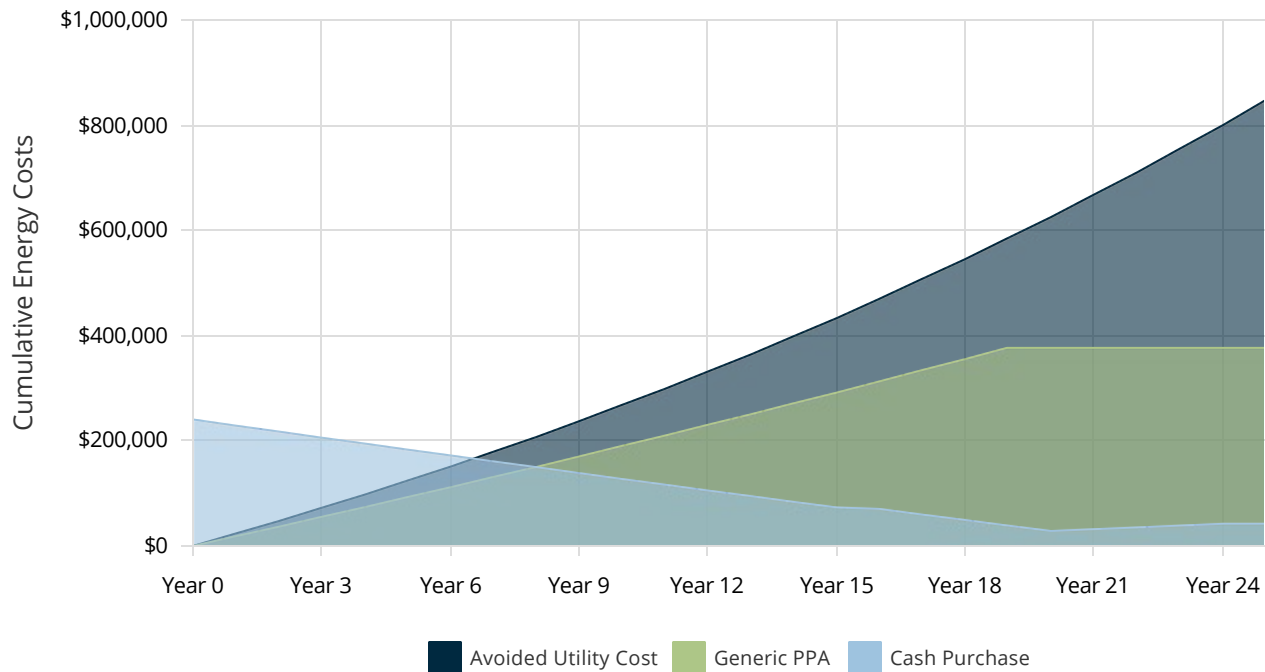

2.1.1 PV System Details

General Information

Facility: Ball Hall
 Address: 185 Riverside St Lowell MA 01854

Solar PV System Rating

Power Rating: 111,930 W-DC
 Power Rating: 100,072 W-AC-CEC

Solar PV Equipment Description

Solar Panels: (273) LG Electronics "LG410N2W-A5 (Jan1,17)"
 Inverters: (1) SolarEdge SE100KUS

Energy Consumption Mix

Annual Energy Use: 906,220 kWh


Solar PV Equipment Typical Lifespan

Solar Panels: Greater than 30 Years
 Inverters: 15 Years

Solar PV System Cost And Incentives


Solar PV System Cost \$240,585
 (SMART) Program - PV **-\$274,484**

Net Solar PV System Cost: **-\$33,899**

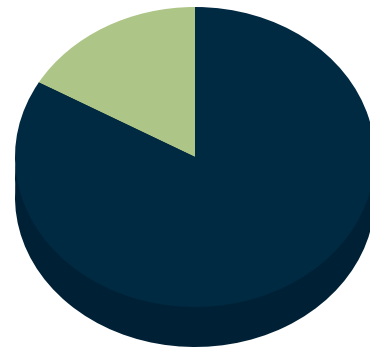

DRAFT

Monthly Energy Use vs Solar Generation

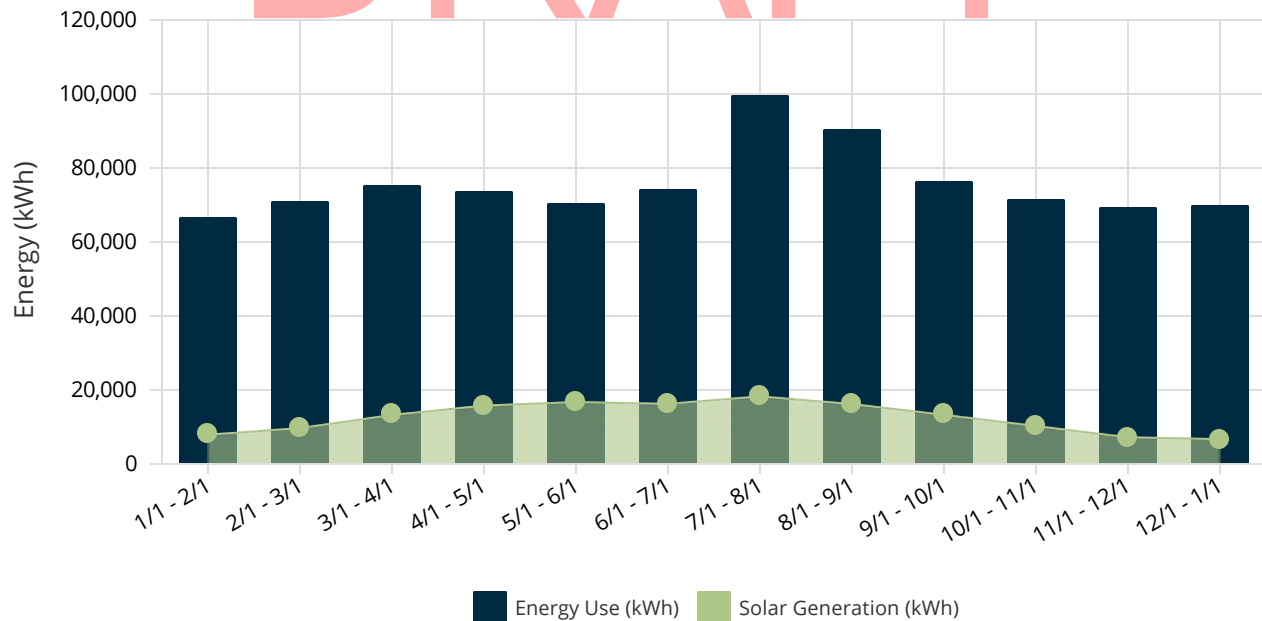

2.1.2 Rebates and Incentives

This section summarizes all incentives available for this project. The actual rebate and incentive amounts for this project are shown in each example.

Solar Massachusetts Renewable Target (SMART) - PV Incentive

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1600MW declining block incentive program. Eligible projects must be interconnected by one of three investor owned utility companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. If adding Energy Storage to the Proposal and claiming the SMART Tariff make sure to enter the Energy Storage Adder on the Excel calculator to include it in the total incentive value.

Total Incentive Value: \$274,484

DRAFT

2.1.3 Utility Rates

The table below shows the rates associated with your current utility rate schedule (G-3). Your estimated electric bills after solar are shown on the following page.

Fixed Charges		Energy Charges		Demand Charges	
Type	G-3	Type	G-3	Type	G-3
S1 Monthly	\$223.00	S1 On Peak	\$0.13176	S1 On Peak	\$8.05
S2 Monthly	\$223.00	S1 Off Peak	\$0.13001	S2 On Peak	\$8.05
S3 Monthly	\$223.00	S2 On Peak	\$0.13294	S3 On Peak	\$8.05
S4 Monthly	\$223.00	S2 Off Peak	\$0.13119	S4 On Peak	\$8.05
		S3 On Peak	\$0.16172		
		S3 Off Peak	\$0.15997		
		S4 On Peak	\$0.14915		
		S4 Off Peak	\$0.14740		

2.1.4 Current Electric Bill

The table below shows your annual electricity costs based on the most current utility rates and your previous 12 months of electrical usage.

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	32,507	34,228	180	\$223	\$10,732	\$1,449	\$12,404
2/1/2019 - 3/1/2019 S4	34,893	35,687	199	\$223	\$10,465	\$1,602	\$12,290
3/1/2019 - 4/1/2019 S4	35,257	39,615	201	\$223	\$11,098	\$1,618	\$12,939
4/1/2019 - 5/1/2019 S4	38,203	35,235	191	\$223	\$10,892	\$1,538	\$12,652
5/1/2019 - 6/1/2019 S1	35,261	35,247	165	\$223	\$9,228	\$1,328	\$10,780
6/1/2019 - 7/1/2019 S1	34,540	39,550	186	\$223	\$9,693	\$1,497	\$11,413
7/1/2019 - 8/1/2019 S1	49,223	50,303	238	\$223	\$13,026	\$1,916	\$15,164
8/1/2019 - 9/1/2019 S2	44,104	45,970	232	\$223	\$11,894	\$1,868	\$13,985
9/1/2019 - 10/1/2019 S2	38,901	37,453	211	\$223	\$10,085	\$1,699	\$12,007
10/1/2019 - 11/1/2019 S2	37,448	33,666	183	\$223	\$9,395	\$1,473	\$11,091
11/1/2019 - 12/1/2019 S3	33,326	36,108	169	\$223	\$11,166	\$1,360	\$12,749
12/1/2019 - 1/1/2020 S3	31,744	37,755	174	\$223	\$11,173	\$1,401	\$12,797
Totals:	445,407	460,817	-	\$2,676	\$128,846	\$18,748	\$150,271

2.1.5 New Electric Bill

Rate Schedule: NGrid-MA - G-3

Time Periods Bill Ranges & Seasons	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	26,684	32,148	160	\$223	\$9,458	\$1,288	\$10,969
2/1/2019 - 3/1/2019 S4	28,026	32,859	175	\$223	\$9,023	\$1,409	\$10,655
3/1/2019 - 4/1/2019 S4	26,475	35,150	188	\$223	\$9,130	\$1,513	\$10,866
4/1/2019 - 5/1/2019 S4	27,578	30,073	174	\$223	\$8,546	\$1,401	\$10,170
5/1/2019 - 6/1/2019 S1	23,204	30,557	139	\$223	\$7,030	\$1,119	\$8,372
6/1/2019 - 7/1/2019 S1	24,383	33,456	173	\$223	\$7,562	\$1,393	\$9,178
7/1/2019 - 8/1/2019 S1	36,487	44,774	214	\$223	\$10,629	\$1,723	\$12,574
8/1/2019 - 9/1/2019 S2	32,646	41,240	182	\$223	\$9,750	\$1,465	\$11,438
9/1/2019 - 10/1/2019 S2	29,313	33,763	186	\$223	\$8,326	\$1,497	\$10,047
10/1/2019 - 11/1/2019 S2	29,658	31,202	158	\$223	\$8,036	\$1,272	\$9,531
11/1/2019 - 12/1/2019 S3	28,185	34,040	160	\$223	\$10,003	\$1,288	\$11,514
12/1/2019 - 1/1/2020 S3	26,927	35,857	155	\$223	\$10,091	\$1,248	\$11,561
Totals:	339,566	415,119	-	\$2,676	\$107,585	\$16,615	\$126,876

Annual Electricity Savings: **\$23,394**

DRAFT

3.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Term	20	Electricity Escalation Rate	3%
PPA Escalation Rate	1%	Total Payments	\$398,430	Federal Income Tax Rate	0%
Starting PPA Rate	\$0.12	PV Degradation Rate	0.05%	State Income Tax Rate	0%
Upfront Payment	\$0				

Years	PPA Payments	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-
1	-\$18,184	\$23,394	\$5,210	\$5,210
2	-\$18,357	\$24,084	\$5,727	\$10,937
3	-\$18,531	\$24,794	\$6,263	\$17,201
4	-\$18,707	\$25,525	\$6,818	\$24,019
5	-\$18,885	\$26,278	\$7,393	\$31,412
6	-\$19,064	\$27,053	\$7,989	\$39,401
7	-\$19,245	\$27,850	\$8,605	\$48,006
8	-\$19,428	\$28,671	\$9,244	\$57,250
9	-\$19,612	\$29,517	\$9,905	\$67,154
10	-\$19,798	\$30,387	\$10,589	\$77,743
11	-\$19,986	\$31,283	\$11,297	\$89,040
12	-\$20,176	\$32,205	\$12,029	\$101,069
13	-\$20,367	\$33,155	\$12,787	\$113,856
14	-\$20,561	\$34,132	\$13,571	\$127,427
15	-\$20,756	\$35,138	\$14,382	\$141,810
16	-\$20,953	\$36,174	\$15,221	\$157,031
17	-\$21,152	\$37,241	\$16,089	\$173,120
18	-\$21,353	\$38,339	\$16,986	\$190,106
19	-\$21,555	\$39,469	\$17,914	\$208,020
20	-\$21,760	\$40,632	\$18,873	\$226,892
Totals:	-\$398,430	\$625,322	\$226,892	-

3.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$240,585	25-Year ROI	333.1%	Electricity Escalation Rate	3%
25-Year IRR	15.66%	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%
25-Year NPV	\$332,479	Discount Rate	5%	State Income Tax Rate	0%
Payback Period	6.5 Years				

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$240,585	-	-	-	-\$240,585	-\$240,585
1	-	-\$2,239	\$13,790	\$23,394	\$34,945	-\$205,640
2	-	-\$2,283	\$13,783	\$24,084	\$35,584	-\$170,056
3	-	-\$2,329	\$13,776	\$24,794	\$36,241	-\$133,815
4	-	-\$2,376	\$13,769	\$25,525	\$36,919	-\$96,896
5	-	-\$2,423	\$13,762	\$26,278	\$37,617	-\$59,279
6	-	-\$2,472	\$13,755	\$27,053	\$38,336	-\$20,943
7	-	-\$2,521	\$13,748	\$27,850	\$39,078	\$18,135
8	-	-\$2,571	\$13,741	\$28,671	\$39,841	\$57,976
9	-	-\$2,623	\$13,735	\$29,517	\$40,628	\$98,604
10	-	-\$2,675	\$13,728	\$30,387	\$41,439	\$140,044
11	-	-\$2,729	\$13,721	\$31,283	\$42,275	\$182,318
12	-	-\$2,783	\$13,714	\$32,205	\$43,136	\$225,454
13	-	-\$2,839	\$13,707	\$33,155	\$44,022	\$269,476
14	-	-\$2,896	\$13,700	\$34,132	\$44,936	\$314,413
15	-	-\$2,954	\$13,693	\$35,138	\$45,878	\$360,290
16	-	-\$11,013	\$13,686	\$36,174	\$38,848	\$399,138
17	-	-\$3,073	\$13,679	\$37,241	\$47,847	\$446,985
18	-	-\$3,135	\$13,672	\$38,339	\$48,877	\$495,862
19	-	-\$3,197	\$13,666	\$39,469	\$49,937	\$545,799
20	-	-\$3,261	\$13,659	\$40,632	\$51,030	\$596,829
21	-	-\$3,326	-	\$41,830	\$38,504	\$635,333
22	-	-\$3,393	-	\$43,063	\$39,670	\$675,003
23	-	-\$3,461	-	\$44,333	\$40,872	\$715,875
24	-	-\$3,530	-	\$45,640	\$42,110	\$757,985
25	-	-\$3,601	-	\$46,985	\$43,385	\$801,370
Totals:	-\$240,585	-\$79,703	\$274,484	\$847,174	\$801,370	-

4.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Upfront Payment	\$0	PV Degradation Rate	0.05%	State Income Tax Rate	0%
PPA Escalation Rate	1%	Term	20	Electricity Escalation Rate	3%		
Starting PPA Rate	\$0.12	Total Payments	\$398,430	Federal Income Tax Rate	0%		

Years	PPA Payments	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-	-
1	-\$18,184	\$23,394	151,535	\$5,210	\$5,210
2	-\$18,357	\$24,084	151,459	\$5,727	\$10,937
3	-\$18,531	\$24,794	151,383	\$6,263	\$17,201
4	-\$18,707	\$25,525	151,308	\$6,818	\$24,019
5	-\$18,885	\$26,278	151,232	\$7,393	\$31,412
6	-\$19,064	\$27,053	151,156	\$7,989	\$39,401
7	-\$19,245	\$27,850	151,080	\$8,605	\$48,006
8	-\$19,428	\$28,671	151,005	\$9,244	\$57,250
9	-\$19,612	\$29,517	150,929	\$9,905	\$67,154
10	-\$19,798	\$30,387	150,853	\$10,589	\$77,743
11	-\$19,986	\$31,283	150,777	\$11,297	\$89,040
12	-\$20,176	\$32,205	150,702	\$12,029	\$101,069
13	-\$20,367	\$33,155	150,626	\$12,787	\$113,856
14	-\$20,561	\$34,132	150,550	\$13,571	\$127,427
15	-\$20,756	\$35,138	150,474	\$14,382	\$141,810
16	-\$20,953	\$36,174	150,398	\$15,221	\$157,031
17	-\$21,152	\$37,241	150,323	\$16,089	\$173,120
18	-\$21,353	\$38,339	150,247	\$16,986	\$190,106
19	-\$21,555	\$39,469	150,171	\$17,914	\$208,020
20	-\$21,760	\$40,632	150,095	\$18,873	\$226,892
Totals:	-\$398,430	\$625,322	3,016,304	\$226,892	-

4.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$240,585	Payback Period	6.5 Years	Discount Rate	5%	State Income Tax Rate	0%
25-Year IRR	15.66%	25-Year ROI	333.1%	Electricity Escalation Rate	3%		
25-Year NPV	\$332,479	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%		

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$240,585	-	-	-	-	-\$240,585	-\$240,585
1	-	-\$2,239	\$13,790	\$23,394	151,535	\$34,945	-\$205,640
2	-	-\$2,283	\$13,783	\$24,084	151,459	\$35,584	-\$170,056
3	-	-\$2,329	\$13,776	\$24,794	151,383	\$36,241	-\$133,815
4	-	-\$2,376	\$13,769	\$25,525	151,308	\$36,919	-\$96,896
5	-	-\$2,423	\$13,762	\$26,278	151,232	\$37,617	-\$59,279
6	-	-\$2,472	\$13,755	\$27,053	151,156	\$38,336	-\$20,943
7	-	-\$2,521	\$13,748	\$27,850	151,080	\$39,078	\$18,135
8	-	-\$2,571	\$13,741	\$28,671	151,005	\$39,841	\$57,976
9	-	-\$2,623	\$13,735	\$29,517	150,929	\$40,628	\$98,604
10	-	-\$2,675	\$13,728	\$30,387	150,853	\$41,439	\$140,044
11	-	-\$2,729	\$13,721	\$31,283	150,777	\$42,275	\$182,318
12	-	-\$2,783	\$13,714	\$32,205	150,702	\$43,136	\$225,454
13	-	-\$2,839	\$13,707	\$33,155	150,626	\$44,022	\$269,476
14	-	-\$2,896	\$13,700	\$34,132	150,550	\$44,936	\$314,413
15	-	-\$2,954	\$13,693	\$35,138	150,474	\$45,878	\$360,290
16	-	-\$11,013	\$13,686	\$36,174	150,398	\$38,848	\$399,138
17	-	-\$3,073	\$13,679	\$37,241	150,323	\$47,847	\$446,985
18	-	-\$3,135	\$13,672	\$38,339	150,247	\$48,877	\$495,862
19	-	-\$3,197	\$13,666	\$39,469	150,171	\$49,937	\$545,799
20	-	-\$3,261	\$13,659	\$40,632	150,095	\$51,030	\$596,829
21	-	-\$3,326	-	\$41,830	150,020	\$38,504	\$635,333
22	-	-\$3,393	-	\$43,063	149,944	\$39,670	\$675,003
23	-	-\$3,461	-	\$44,333	149,868	\$40,872	\$715,875
24	-	-\$3,530	-	\$45,640	149,792	\$42,110	\$757,985
25	-	-\$3,601	-	\$46,985	149,717	\$43,385	\$801,370
Totals:	-\$240,585	-\$79,703	\$274,484	\$847,174	3,765,645	\$801,370	-

ENERGY TOOLBASE™

Prepared For

UMass Lowell
(111)111-1111

adam.tobin@anseradvisory.com

UML - Ball Hall (PV+BESS)

Prepared By

David Lazerwitz
(213) 514-2108

david.lazerwitz@anseradvisory.com

4/2/2021



The Energy Toolbase provides comprehensive cost analysis for commercial, municipal, and residential renewable energy projects. We provide the tools that professionals need to compete in the fast paced renewable energy market by leveraging our first hand experience developing energy projects. Our software developers are NABCEP certified energy professionals and have completed energy analysis for companies including the Mirage Casino Resorts, Boston Scientific, Leviton, Balfour Beatty Construction, and many others.



Table of Contents

- 1 Project Summary 3
- 2 Project Details 4
 - 2.1 Ball Hall 4
 - 2.1.1 PV System Details 4
 - 2.1.2 Energy Storage System (ESS) Details 5
 - 2.1.3 Rebates and Incentives 6
 - 2.1.4 Utility Rates 7
 - 2.1.5 Current Electric Bill 7
 - 2.1.6 New Electric Bill 8
- 3 Cash Flow Analysis 9
 - 3.1 Generic PPA 9
 - 3.2 Cash Purchase 10
- 4 Detailed Cash Flow Analysis 11
 - 4.1 Generic PPA 11
 - 4.2 Cash Purchase 12

DRAFT

1 Project Summary

Payment Options	Generic PPA	Cash Purchase
PPA Escalation Rate	1%	-
Starting PPA Rate	\$0.18/kWh	-
Upfront Payment	-	\$381,848
Term	20 Years	-
Rebates and Incentives	-	\$383,167
Net Payments	-	\$120,956
25-Year Electric Bill Savings	-	\$884,171
25-Year IRR	-	10.91%
25-Year LCOE PV	-	\$0.032
25-Year NPV	-	\$259,310
Payback Period	-	8.6 Years
Total Payments	\$597,645	\$504,124
20-Year Electric Bill Savings	\$653,211	-
20-Year LCOE PV	\$0.198	-
20-Year NPV	\$21,865	-

Combined Solar PV Rating


Power Rating: 111,930 W-DC
 Power Rating: 100,072 W-AC-CEC

Combined ESS Ratings

Energy Capacity: 74.0 kWh
 Power Rating: 37.0 kW

DRAFT

Cumulative Energy Costs By Payment Option

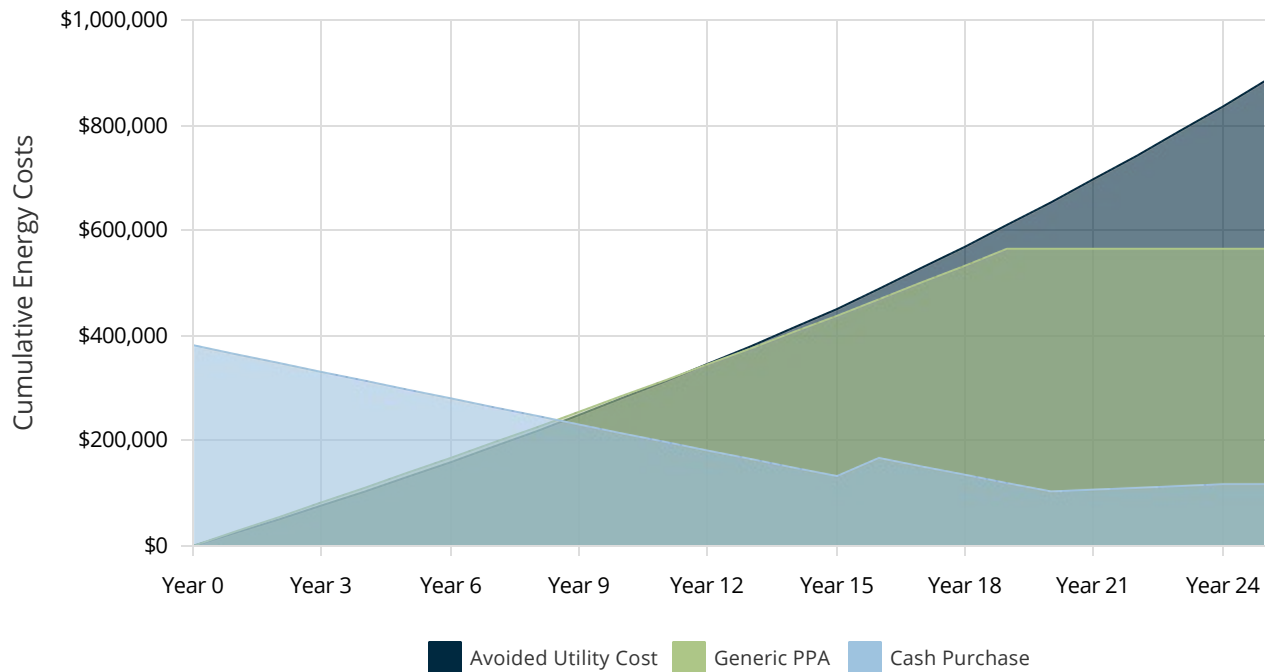

2.1.1 PV System Details

General Information

Facility: Ball Hall
 Address: 185 Riverside St Lowell MA 01854

Solar PV System Rating

Power Rating: 111,930 W-DC
 Power Rating: 100,072 W-AC-CEC

Solar PV Equipment Description

Solar Panels: (273) LG Electronics "LG410N2W-A5 (Jan1,17)"
 Inverters: (1) SolarEdge SE100KUS

Energy Consumption Mix

Annual Energy Use: 906,220 kWh


Solar PV Equipment Typical Lifespan

Solar Panels: Greater than 30 Years
 Inverters: 15 Years

Solar PV System Cost And Incentives


Solar PV System Cost \$307,808
 (SMART) Program - PV **-\$274,484**

Net Solar PV System Cost: \$33,324

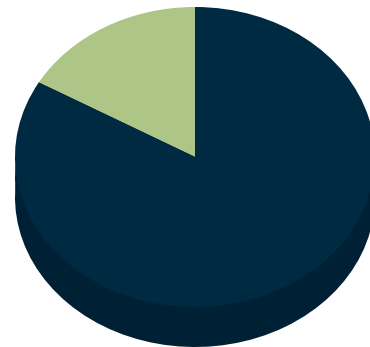

DRAFT

Monthly Energy Use vs Solar Generation

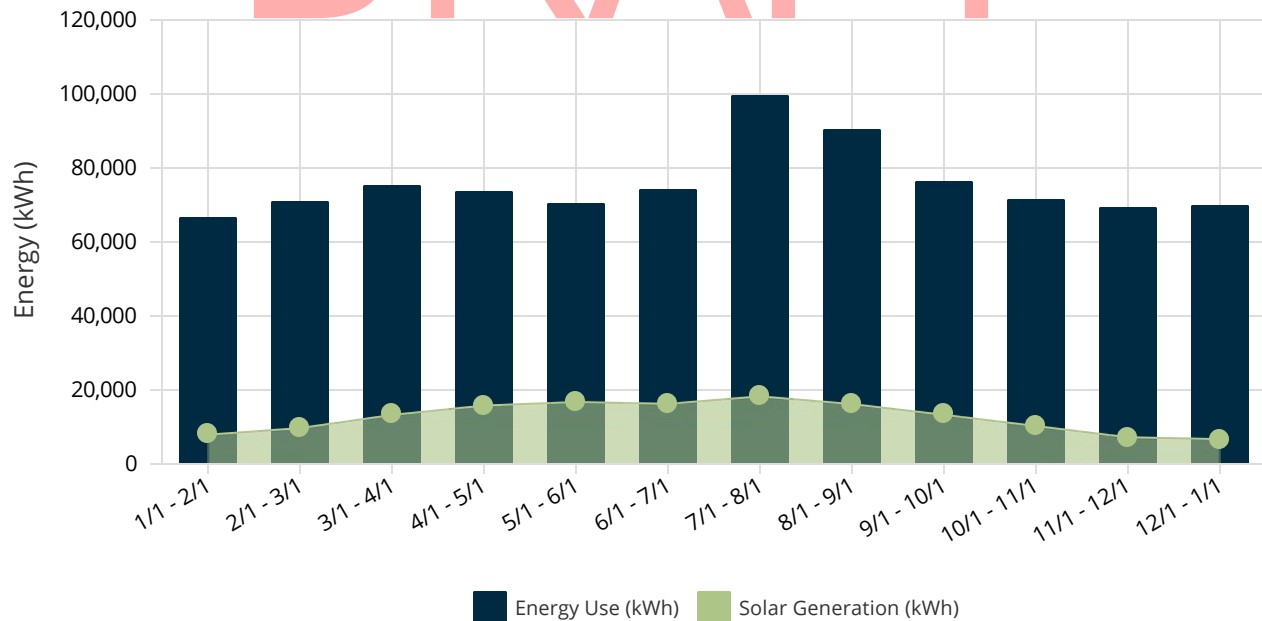

2.1.2 Energy Storage System (ESS) Details

General Information

Facility: Ball Hall
Address: Lowell MA 01854

ESS System Ratings

Energy Capacity: 74.0 kWh
Power Rating: 37.0 kW

ESS Equipment Description

Battery 37.02kw/74.04kWh Energy Storage
Banks: System
Inverters: 37.02kw/74.04kWh Energy Storage System

ESS Equipment Typical Lifespan


Battery Banks: 15 Years
Inverters: 15 Years

ESS Cost And Incentives

ESS System Cost \$74,040
Solar Massachusetts Renewable Target (SMART) - Storage adder - \$108,684

Net ESS System Cost: -\$34,644

Energy Storage Annual Utilization

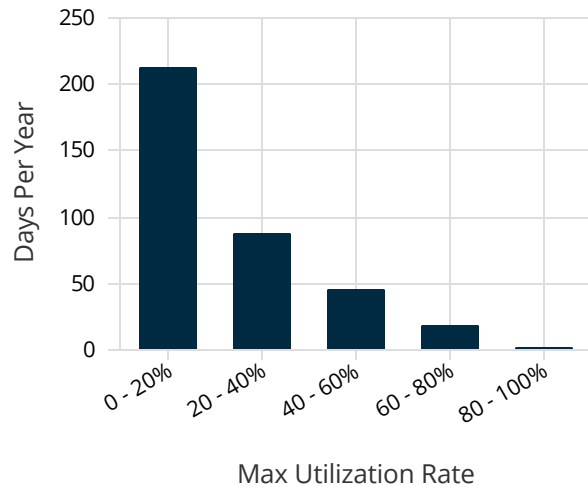

Energy Output and Demand Savings From Solar PV and Energy Storage

Date Range	ESS Energy Discharge	Solar PV Generation	ESS Energy as % of PV Energy	Total Demand Savings
1/1/2019 - 2/1/2019	397	7,903	5.02%	\$346
2/1/2019 - 3/1/2019	395	9,694	4.07%	\$322
3/1/2019 - 4/1/2019	184	13,246	1.39%	\$282
4/1/2019 - 5/1/2019	390	15,787	2.47%	\$290
5/1/2019 - 6/1/2019	671	16,747	4.01%	\$298
6/1/2019 - 7/1/2019	482	16,250	2.97%	\$290
7/1/2019 - 8/1/2019	355	18,266	1.94%	\$378
8/1/2019 - 9/1/2019	537	16,188	3.32%	\$523
9/1/2019 - 10/1/2019	412	13,277	3.10%	\$362
10/1/2019 - 11/1/2019	580	10,254	5.66%	\$338
11/1/2019 - 12/1/2019	482	7,209	6.69%	\$185
12/1/2019 - 1/1/2020	450	6,714	6.70%	\$274
-	5,335	151,535	3.52%	\$3,888

2.1.3 Rebates and Incentives

This section summarizes all incentives available for this project. The actual rebate and incentive amounts for this project are shown in each example.

Solar Massachusetts Renewable Target (SMART) - ESS Incentive

Performance Based ESS Incentive, based on the ratio of Total ESS Max Power Discharge to Total PV DC Power Rating, the ESS Full Discharge Duration, and the production of the system. There is a Minimum Efficiency Requirement, stating that the Energy Storage System paired with the solar photovoltaic Generation Unit must have at least a 65% round trip efficiency in normal operation. There are also Operational Requirements, such as that the Energy Storage System must discharge at least 52 complete cycle equivalents per year and must remain functional and operational in order for the solar photovoltaic Generation Unit to continue to be eligible for the Energy Storage Adder. On top of this, the nominal useful energy capacity of the Energy Storage System paired with the solar photovoltaic Generation Unit must be at least two hours and shall be incentivized for no more than six hours and the nominal rated power capacity of the Energy Storage System paired with a solar photovoltaic Generation Unit must be at least 25 per cent and shall be incentivized for no more than 100 per cent of the rated capacity, as measured in direct current, of the solar photovoltaic Generation Unit.

Total Incentive Value: \$108,684

Solar Massachusetts Renewable Target (SMART) - PV Incentive

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1600MW declining block incentive program. Eligible projects must be interconnected by one of three investor owned utility companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. If adding Energy Storage to the Proposal and claiming the SMART Tariff make sure to enter the Energy Storage Adder on the Excel calculator to include it in the total incentive value.

Total Incentive Value: \$274,484

2.1.4 Utility Rates

The table below shows the rates associated with your current utility rate schedule (G-3). Your estimated electric bills after solar are shown on the following page.

Fixed Charges		Energy Charges		Demand Charges	
Type	G-3	Type	G-3	Type	G-3
S1 Monthly	\$223.00	S1 On Peak	\$0.13176	S1 On Peak	\$8.05
S2 Monthly	\$223.00	S1 Off Peak	\$0.13001	S2 On Peak	\$8.05
S3 Monthly	\$223.00	S2 On Peak	\$0.13294	S3 On Peak	\$8.05
S4 Monthly	\$223.00	S2 Off Peak	\$0.13119	S4 On Peak	\$8.05
		S3 On Peak	\$0.16172		
		S3 Off Peak	\$0.15997		
		S4 On Peak	\$0.14915		
		S4 Off Peak	\$0.14740		

2.1.5 Current Electric Bill

The table below shows your annual electricity costs based on the most current utility rates and your previous 12 months of electrical usage.

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	32,507	34,228	180	\$223	\$10,732	\$1,449	\$12,404
2/1/2019 - 3/1/2019 S4	34,893	35,687	199	\$223	\$10,465	\$1,602	\$12,290
3/1/2019 - 4/1/2019 S4	35,257	39,615	201	\$223	\$11,098	\$1,618	\$12,939
4/1/2019 - 5/1/2019 S4	38,203	35,235	191	\$223	\$10,892	\$1,538	\$12,652
5/1/2019 - 6/1/2019 S1	35,261	35,247	165	\$223	\$9,228	\$1,328	\$10,780
6/1/2019 - 7/1/2019 S1	34,540	39,550	186	\$223	\$9,693	\$1,497	\$11,413
7/1/2019 - 8/1/2019 S1	49,223	50,303	238	\$223	\$13,026	\$1,916	\$15,164
8/1/2019 - 9/1/2019 S2	44,104	45,970	232	\$223	\$11,894	\$1,868	\$13,985
9/1/2019 - 10/1/2019 S2	38,901	37,453	211	\$223	\$10,085	\$1,699	\$12,007
10/1/2019 - 11/1/2019 S2	37,448	33,666	183	\$223	\$9,395	\$1,473	\$11,091
11/1/2019 - 12/1/2019 S3	33,326	36,108	169	\$223	\$11,166	\$1,360	\$12,749
12/1/2019 - 1/1/2020 S3	31,744	37,755	174	\$223	\$11,173	\$1,401	\$12,797
Totals:	445,407	460,817	-	\$2,676	\$128,846	\$18,748	\$150,271

2.1.6 New Electric Bill

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	26,650	32,335	137	\$223	\$9,482	\$1,103	\$10,808
2/1/2019 - 3/1/2019 S4	28,024	33,013	159	\$223	\$9,046	\$1,280	\$10,549
3/1/2019 - 4/1/2019 S4	26,485	35,211	166	\$223	\$9,140	\$1,336	\$10,700
4/1/2019 - 5/1/2019 S4	27,545	30,255	155	\$223	\$8,568	\$1,248	\$10,039
5/1/2019 - 6/1/2019 S1	22,944	31,074	128	\$223	\$7,063	\$1,030	\$8,316
6/1/2019 - 7/1/2019 S1	24,190	33,835	150	\$223	\$7,586	\$1,208	\$9,017
7/1/2019 - 8/1/2019 S1	36,512	44,885	191	\$223	\$10,646	\$1,538	\$12,407
8/1/2019 - 9/1/2019 S2	32,467	41,624	167	\$223	\$9,777	\$1,344	\$11,344
9/1/2019 - 10/1/2019 S2	29,276	33,958	166	\$223	\$8,347	\$1,336	\$9,906
10/1/2019 - 11/1/2019 S2	29,529	31,553	141	\$223	\$8,065	\$1,135	\$9,423
11/1/2019 - 12/1/2019 S3	28,135	34,275	146	\$223	\$10,033	\$1,175	\$11,431
12/1/2019 - 1/1/2020 S3	26,832	36,125	140	\$223	\$10,118	\$1,127	\$11,468
Totals:	338,589	418,143	-	\$2,676	\$107,872	\$14,860	\$125,408

Annual Electricity Savings: \$24,862

DRAFT

3.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Term	20	Electricity Escalation Rate	3%
PPA Escalation Rate	1%	Total Payments	\$597,645	Federal Income Tax Rate	0%
Starting PPA Rate	\$0.18	PV Degradation Rate	0.05%	State Income Tax Rate	0%
Upfront Payment	\$0				

Years	PPA Payments	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-
1	-\$27,276	\$24,862	-\$2,414	-\$2,414
2	-\$27,535	\$25,521	-\$2,015	-\$4,429
3	-\$27,797	\$26,196	-\$1,601	-\$6,029
4	-\$28,061	\$26,889	-\$1,172	-\$7,201
5	-\$28,327	\$27,600	-\$727	-\$7,929
6	-\$28,596	\$28,329	-\$267	-\$8,196
7	-\$28,867	\$29,077	\$210	-\$7,986
8	-\$29,142	\$29,845	\$703	-\$7,282
9	-\$29,418	\$30,633	\$1,214	-\$6,068
10	-\$29,697	\$31,440	\$1,743	-\$4,325
11	-\$29,979	\$32,269	\$2,290	-\$2,035
12	-\$30,264	\$33,120	\$2,856	\$821
13	-\$30,551	\$33,992	\$3,441	\$4,261
14	-\$30,841	\$34,887	\$4,045	\$8,307
15	-\$31,134	\$35,805	\$4,671	\$12,977
16	-\$31,429	\$38,461	\$7,032	\$20,009
17	-\$31,728	\$39,479	\$7,751	\$27,760
18	-\$32,029	\$40,522	\$8,494	\$36,254
19	-\$32,333	\$41,593	\$9,260	\$45,514
20	-\$32,640	\$42,692	\$10,052	\$55,566
Totals:	-\$597,645	\$653,211	\$55,566	-

3.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$381,848	25-Year ROI	199.9%	Electricity Escalation Rate	3%
25-Year IRR	10.91%	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%
25-Year NPV	\$259,310	Discount Rate	5%	State Income Tax Rate	0%
Payback Period	8.6 Years				

Years	Project Costs	O&M Plan	Solar Massachusetts Renewable Target (SMART) - Storage adder	(SMART) Program - PV	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$381,847	-	-	-	-	-\$381,847	-\$381,847
1	-	-\$2,239	\$5,460	\$13,790	\$24,862	\$41,874	-\$339,974
2	-	-\$2,283	\$5,457	\$13,783	\$25,521	\$42,477	-\$297,497
3	-	-\$2,329	\$5,455	\$13,776	\$26,196	\$43,097	-\$254,399
4	-	-\$2,376	\$5,452	\$13,769	\$26,889	\$43,734	-\$210,665
5	-	-\$2,423	\$5,449	\$13,762	\$27,600	\$44,388	-\$166,277
6	-	-\$2,472	\$5,446	\$13,755	\$28,329	\$45,059	-\$121,218
7	-	-\$2,521	\$5,444	\$13,748	\$29,077	\$45,748	-\$75,470
8	-	-\$2,571	\$5,441	\$13,741	\$29,845	\$46,456	-\$29,014
9	-	-\$2,623	\$5,438	\$13,735	\$30,633	\$47,182	\$18,169
10	-	-\$2,675	\$5,436	\$13,728	\$31,440	\$47,928	\$66,097
11	-	-\$2,729	\$5,433	\$13,721	\$32,269	\$48,694	\$114,791
12	-	-\$2,783	\$5,430	\$13,714	\$33,120	\$49,480	\$164,271
13	-	-\$2,839	\$5,427	\$13,707	\$33,992	\$50,287	\$214,558
14	-	-\$2,896	\$5,425	\$13,700	\$34,887	\$51,115	\$265,674
15	-	-\$2,954	\$5,422	\$13,693	\$35,805	\$51,966	\$317,640
16	-	-\$53,586	\$5,419	\$13,686	\$38,461	\$3,981	\$321,621
17	-	-\$3,073	\$5,416	\$13,679	\$39,479	\$55,501	\$377,122
18	-	-\$3,135	\$5,414	\$13,672	\$40,522	\$56,474	\$433,596
19	-	-\$3,197	\$5,411	\$13,666	\$41,593	\$57,472	\$491,068
20	-	-\$3,261	\$5,408	\$13,659	\$42,692	\$58,497	\$549,566
21	-	-\$3,326	-	-	\$43,819	\$40,492	\$590,058
22	-	-\$3,393	-	-	\$44,975	\$41,582	\$631,640
23	-	-\$3,461	-	-	\$46,161	\$42,700	\$674,341
24	-	-\$3,530	-	-	\$47,378	\$43,848	\$718,189
25	-	-\$3,601	-	-	\$48,627	\$45,026	\$763,215
Totals:	-\$381,847	-\$122,276	\$108,684	\$274,484	\$884,171	\$763,215	-

4.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Upfront Payment	\$0	PV Degradation Rate	0.05%	State Income Tax Rate	0%
PPA Escalation Rate	1%	Term	20	Electricity Escalation Rate	3%		
Starting PPA Rate	\$0.18	Total Payments	\$597,645	Federal Income Tax Rate	0%		

Years	PPA Payments	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-	-
1	-\$27,276	\$24,862	151,535	-\$2,414	-\$2,414
2	-\$27,535	\$25,521	151,459	-\$2,015	-\$4,429
3	-\$27,797	\$26,196	151,383	-\$1,601	-\$6,029
4	-\$28,061	\$26,889	151,308	-\$1,172	-\$7,201
5	-\$28,327	\$27,600	151,232	-\$727	-\$7,929
6	-\$28,596	\$28,329	151,156	-\$267	-\$8,196
7	-\$28,867	\$29,077	151,080	\$210	-\$7,986
8	-\$29,142	\$29,845	151,005	\$703	-\$7,282
9	-\$29,418	\$30,633	150,929	\$1,214	-\$6,068
10	-\$29,697	\$31,440	150,853	\$1,743	-\$4,325
11	-\$29,979	\$32,269	150,777	\$2,290	-\$2,035
12	-\$30,264	\$33,120	150,702	\$2,856	\$821
13	-\$30,551	\$33,992	150,626	\$3,441	\$4,261
14	-\$30,841	\$34,887	150,550	\$4,045	\$8,307
15	-\$31,134	\$35,805	150,474	\$4,671	\$12,977
16	-\$31,429	\$38,461	150,398	\$7,032	\$20,009
17	-\$31,728	\$39,479	150,323	\$7,751	\$27,760
18	-\$32,029	\$40,522	150,247	\$8,494	\$36,254
19	-\$32,333	\$41,593	150,171	\$9,260	\$45,514
20	-\$32,640	\$42,692	150,095	\$10,052	\$55,566
Totals:	-\$597,645	\$653,211	3,016,304	\$55,566	-

4.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$381,848	Payback Period	8.6 Years	Discount Rate	5%	State Income Tax Rate	0%
25-Year IRR	10.91%	25-Year ROI	199.9%	Electricity Escalation Rate	3%		
25-Year NPV	\$259,310	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%		

Years	Project Costs	O&M Plan	Solar Massachusetts Renewable Target (SMART) - Storage adder	(SMART) Program - PV	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$381,847	-	-	-	-	-	-\$381,847	-\$381,847
1	-	-\$2,239	\$5,460	\$13,790	\$24,862	151,535	\$41,874	-\$339,974
2	-	-\$2,283	\$5,457	\$13,783	\$25,521	151,459	\$42,477	-\$297,497
3	-	-\$2,329	\$5,455	\$13,776	\$26,196	151,383	\$43,097	-\$254,399
4	-	-\$2,376	\$5,452	\$13,769	\$26,889	151,308	\$43,734	-\$210,665
5	-	-\$2,423	\$5,449	\$13,762	\$27,600	151,232	\$44,388	-\$166,277
6	-	-\$2,472	\$5,446	\$13,755	\$28,329	151,156	\$45,059	-\$121,218
7	-	-\$2,521	\$5,444	\$13,748	\$29,077	151,080	\$45,748	-\$75,470
8	-	-\$2,571	\$5,441	\$13,741	\$29,845	151,005	\$46,456	-\$29,014
9	-	-\$2,623	\$5,438	\$13,735	\$30,633	150,929	\$47,182	\$18,169
10	-	-\$2,675	\$5,436	\$13,728	\$31,440	150,853	\$47,928	\$66,097
11	-	-\$2,729	\$5,433	\$13,721	\$32,269	150,777	\$48,694	\$114,791
12	-	-\$2,783	\$5,430	\$13,714	\$33,120	150,702	\$49,480	\$164,271
13	-	-\$2,839	\$5,427	\$13,707	\$33,992	150,626	\$50,287	\$214,558
14	-	-\$2,896	\$5,425	\$13,700	\$34,887	150,550	\$51,115	\$265,674
15	-	-\$2,954	\$5,422	\$13,693	\$35,805	150,474	\$51,966	\$317,640
16	-	-\$53,586	\$5,419	\$13,686	\$38,461	150,398	\$3,981	\$321,621
17	-	-\$3,073	\$5,416	\$13,679	\$39,479	150,323	\$55,501	\$377,122
18	-	-\$3,135	\$5,414	\$13,672	\$40,522	150,247	\$56,474	\$433,596
19	-	-\$3,197	\$5,411	\$13,666	\$41,593	150,171	\$57,472	\$491,068
20	-	-\$3,261	\$5,408	\$13,659	\$42,692	150,095	\$58,497	\$549,566
21	-	-\$3,326	-	-	\$43,819	150,020	\$40,492	\$590,058
22	-	-\$3,393	-	-	\$44,975	149,944	\$41,582	\$631,640
23	-	-\$3,461	-	-	\$46,161	149,868	\$42,700	\$674,341
24	-	-\$3,530	-	-	\$47,378	149,792	\$43,848	\$718,189
25	-	-\$3,601	-	-	\$48,627	149,717	\$45,026	\$763,215
Totals:	-\$381,847	-\$122,276	\$108,684	\$274,484	\$884,171	3,765,645	\$763,215	-

ENERGY TOOLBASE™

Prepared For

UMass Lowell
(111)111-1111

adam.tobin@anseradvisory.com

UML - Olney Hall (PV Only)

Prepared By

David Lazerwitz
(213) 514-2108

david.lazerwitz@anseradvisory.com

4/2/2021



The Energy Toolbase provides comprehensive cost analysis for commercial, municipal, and residential renewable energy projects. We provide the tools that professionals need to compete in the fast paced renewable energy market by leveraging our first hand experience developing energy projects. Our software developers are NABCEP certified energy professionals and have completed energy analysis for companies including the Mirage Casino Resorts, Boston Scientific, Leviton, Balfour Beatty Construction, and many others.



Table of Contents

- 1 Project Summary 3
- 2 Project Details 4
 - 2.1 Olney Hall 4
 - 2.1.1 PV System Details 4
 - 2.1.2 Rebates and Incentives 5
 - 2.1.3 Utility Rates 6
 - 2.1.4 Current Electric Bill 6
 - 2.1.5 New Electric Bill 7
- 3 Cash Flow Analysis 8
 - 3.1 PPA 8
 - 3.2 Cash Purchase 9
- 4 Detailed Cash Flow Analysis 10
 - 4.1 PPA 10
 - 4.2 Cash Purchase 11

DRAFT


1 Project Summary

Payment Options	PPA	Cash Purchase
PPA Escalation Rate	1%	-
Starting PPA Rate	\$0.13/kWh	-
Upfront Payment	-	\$238,005
Term	20 Years	-
Rebates and Incentives	-	\$256,357
Net Payments	-	\$60,563
25-Year Electric Bill Savings	-	\$824,778
25-Year IRR	-	15.16%
25-Year LCOE PV	-	\$0.017
25-Year NPV	-	\$312,440
Payback Period	-	6.7 Years
Total Payments	\$403,128	\$316,920
20-Year Electric Bill Savings	\$608,791	-
20-Year LCOE PV	\$0.143	-
20-Year NPV	\$114,584	-

Combined Solar PV Rating
 Power Rating: 110,700 W-DC
 Power Rating: 98,972 W-AC-CEC

DRAFT

Cumulative Energy Costs By Payment Option

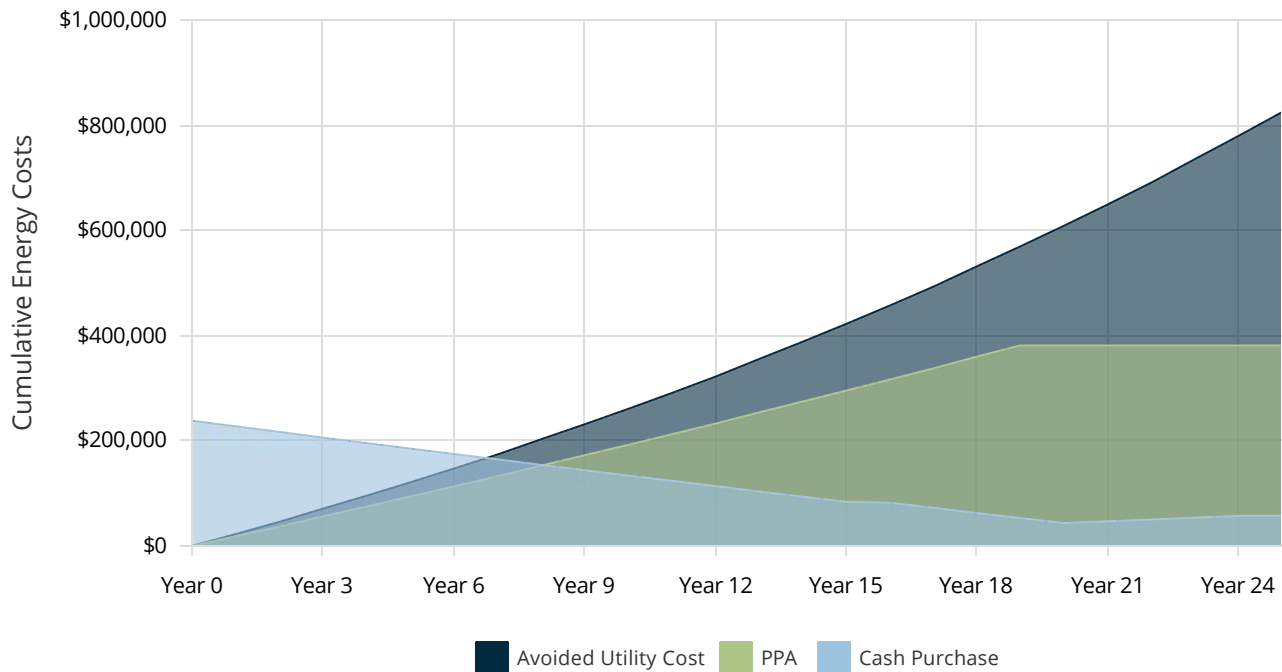

2.1.1 PV System Details

General Information

Facility: Olney Hall
 Address: 91 Pawtucket St Lowell MA 01854

Solar PV System Rating

Power Rating: 110,700 W-DC
 Power Rating: 98,972 W-AC-CEC

Solar PV Equipment Description

Solar Panels: (270) LG Electronics "LG410N2W-A5 (Jan1,17)"
 Inverters: (1) SolarEdge SE100KUS

Energy Consumption Mix

Annual Energy Use: 4,167,152 kWh


Solar PV Equipment Typical Lifespan

Solar Panels: Greater than 30 Years
 Inverters: 15 Years

Solar PV System Cost And Incentives


Solar PV System Cost \$238,005
 (SMART) Program - PV **-\$256,357**

Net Solar PV System Cost: -\$18,352

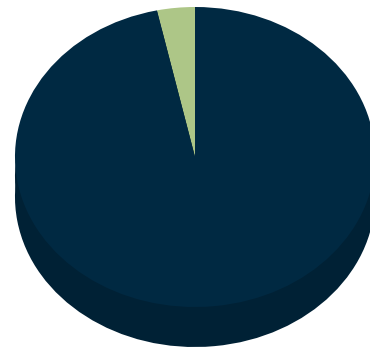

DRAFT

Monthly Energy Use vs Solar Generation

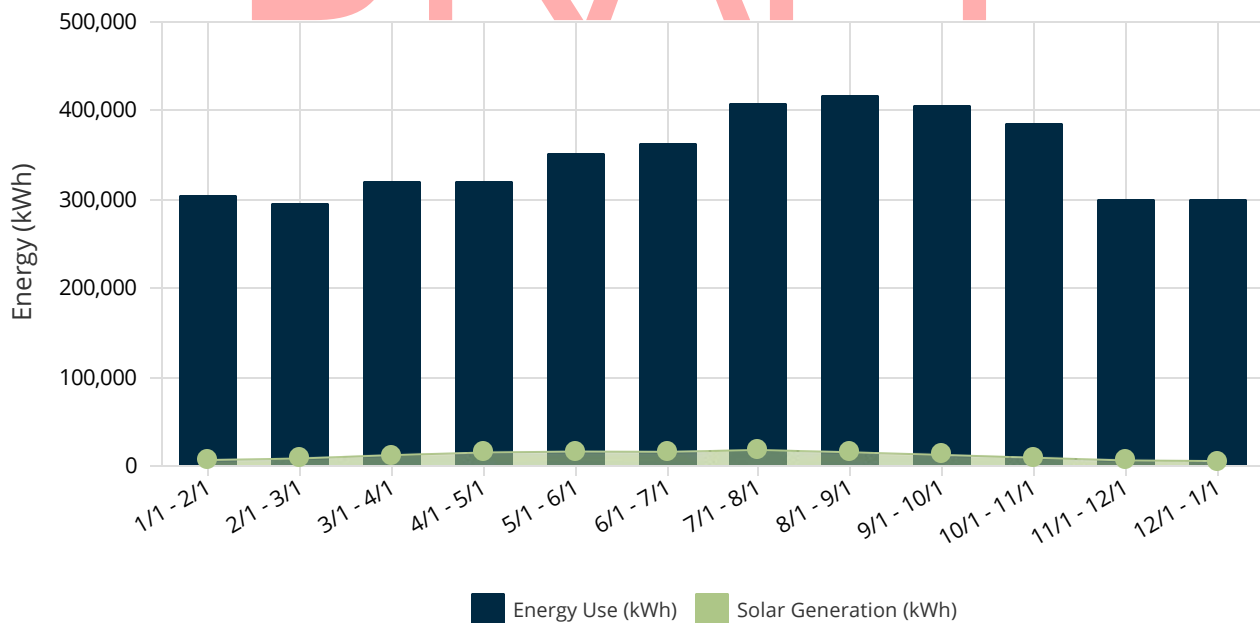

2.1.2 Rebates and Incentives

This section summarizes all incentives available for this project. The actual rebate and incentive amounts for this project are shown in each example.

Solar Massachusetts Renewable Target (SMART) - PV Incentive

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1600MW declining block incentive program. Eligible projects must be interconnected by one of three investor owned utility companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. If adding Energy Storage to the Proposal and claiming the SMART Tariff make sure to enter the Energy Storage Adder on the Excel calculator to include it in the total incentive value.

Total Incentive Value: \$256,357

DRAFT

2.1.3 Utility Rates

The table below shows the rates associated with your current utility rate schedule (G-3). Your estimated electric bills after solar are shown on the following page.

Fixed Charges		Energy Charges		Demand Charges	
Type	G-3	Type	G-3	Type	G-3
S1 Monthly	\$223.00	S1 On Peak	\$0.13176	S1 On Peak	\$8.05
S2 Monthly	\$223.00	S1 Off Peak	\$0.13001	S2 On Peak	\$8.05
S3 Monthly	\$223.00	S2 On Peak	\$0.13294	S3 On Peak	\$8.05
S4 Monthly	\$223.00	S2 Off Peak	\$0.13119	S4 On Peak	\$8.05
		S3 On Peak	\$0.16172		
		S3 Off Peak	\$0.15997		
		S4 On Peak	\$0.14915		
		S4 Off Peak	\$0.14740		

2.1.4 Current Electric Bill

The table below shows your annual electricity costs based on the most current utility rates and your previous 12 months of electrical usage.

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	141,247	163,719	580	\$223	\$49,033	\$4,669	\$53,925
2/1/2019 - 3/1/2019 S4	134,919	159,460	584	\$223	\$43,628	\$4,701	\$48,552
3/1/2019 - 4/1/2019 S4	138,731	180,274	584	\$223	\$47,264	\$4,701	\$52,188
4/1/2019 - 5/1/2019 S4	152,838	167,222	728	\$223	\$47,444	\$5,860	\$53,528
5/1/2019 - 6/1/2019 S1	171,233	180,977	716	\$223	\$46,090	\$5,764	\$52,077
6/1/2019 - 7/1/2019 S1	163,516	198,422	756	\$223	\$47,342	\$6,086	\$53,651
7/1/2019 - 8/1/2019 S1	200,328	208,003	832	\$223	\$53,438	\$6,698	\$60,358
8/1/2019 - 9/1/2019 S2	190,664	226,264	776	\$223	\$55,030	\$6,247	\$61,500
9/1/2019 - 10/1/2019 S2	182,419	222,755	808	\$223	\$53,474	\$6,504	\$60,201
10/1/2019 - 11/1/2019 S2	185,491	199,212	784	\$223	\$50,794	\$6,311	\$57,328
11/1/2019 - 12/1/2019 S3	133,161	166,288	684	\$223	\$48,136	\$5,506	\$53,865
12/1/2019 - 1/1/2020 S3	130,748	169,261	564	\$223	\$48,221	\$4,540	\$52,984
Totals:	1,925,295	2,241,857	-	\$2,676	\$589,894	\$67,588	\$660,158

2.1.5 New Electric Bill

Rate Schedule: NGrid-MA - G-3

Time Periods Bill Ranges & Seasons	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	136,406	161,914	565	\$223	\$47,961	\$4,548	\$52,732
2/1/2019 - 3/1/2019 S4	128,987	156,934	574	\$223	\$42,370	\$4,621	\$47,214
3/1/2019 - 4/1/2019 S4	130,748	176,040	549	\$223	\$45,449	\$4,419	\$50,092
4/1/2019 - 5/1/2019 S4	142,782	162,096	678	\$223	\$45,189	\$5,458	\$50,870
5/1/2019 - 6/1/2019 S1	159,703	176,271	685	\$223	\$43,959	\$5,514	\$49,697
6/1/2019 - 7/1/2019 S1	153,706	192,332	744	\$223	\$45,257	\$5,989	\$51,470
7/1/2019 - 8/1/2019 S1	187,972	202,379	800	\$223	\$51,078	\$6,440	\$57,741
8/1/2019 - 9/1/2019 S2	179,861	221,635	729	\$223	\$52,987	\$5,868	\$59,078
9/1/2019 - 10/1/2019 S2	173,562	219,189	768	\$223	\$51,829	\$6,182	\$58,234
10/1/2019 - 11/1/2019 S2	178,463	196,957	732	\$223	\$49,564	\$5,893	\$55,679
11/1/2019 - 12/1/2019 S3	128,827	164,420	643	\$223	\$47,136	\$5,176	\$52,535
12/1/2019 - 1/1/2020 S3	126,782	167,661	558	\$223	\$47,324	\$4,492	\$52,039
Totals:	1,827,799	2,197,828	-	\$2,676	\$570,105	\$64,601	\$637,382

Annual Electricity Savings: \$22,776

DRAFT

3.1 PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Term	20	Electricity Escalation Rate	3%
PPA Escalation Rate	1%	Total Payments	\$403,128	Federal Income Tax Rate	0%
Starting PPA Rate	\$0.13	PV Degradation Rate	0.05%	State Income Tax Rate	0%
Upfront Payment	\$0				

Years	PPA Payments	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-
1	-\$18,399	\$22,776	\$4,377	\$4,377
2	-\$18,573	\$23,447	\$4,874	\$9,251
3	-\$18,750	\$24,139	\$5,389	\$14,640
4	-\$18,928	\$24,851	\$5,923	\$20,563
5	-\$19,107	\$25,583	\$6,476	\$27,039
6	-\$19,289	\$26,337	\$7,049	\$34,088
7	-\$19,472	\$27,114	\$7,642	\$41,730
8	-\$19,657	\$27,913	\$8,257	\$49,986
9	-\$19,843	\$28,736	\$8,893	\$58,879
10	-\$20,032	\$29,584	\$9,552	\$68,431
11	-\$20,222	\$30,456	\$10,234	\$78,665
12	-\$20,414	\$31,354	\$10,940	\$89,605
13	-\$20,608	\$32,278	\$11,670	\$101,276
14	-\$20,803	\$33,230	\$12,426	\$113,702
15	-\$21,001	\$34,209	\$13,209	\$126,911
16	-\$21,200	\$35,218	\$14,018	\$140,929
17	-\$21,401	\$36,256	\$14,855	\$155,784
18	-\$21,604	\$37,325	\$15,721	\$171,504
19	-\$21,809	\$38,425	\$16,616	\$188,120
20	-\$22,016	\$39,558	\$17,542	\$205,662
Totals:	-\$403,128	\$608,791	\$205,662	-

3.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$238,005	25-Year ROI	321.1%	Electricity Escalation Rate	3%
25-Year IRR	15.16%	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%
25-Year NPV	\$312,440	Discount Rate	5%	State Income Tax Rate	0%
Payback Period	6.7 Years				

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$238,005	-	-	-	-\$238,005	-\$238,005
1	-	-\$2,214	\$12,879	\$22,776	\$33,441	-\$204,564
2	-	-\$2,258	\$12,873	\$23,447	\$34,062	-\$170,502
3	-	-\$2,303	\$12,866	\$24,139	\$34,702	-\$135,801
4	-	-\$2,350	\$12,860	\$24,851	\$35,361	-\$100,440
5	-	-\$2,397	\$12,853	\$25,583	\$36,040	-\$64,400
6	-	-\$2,444	\$12,847	\$26,337	\$36,740	-\$27,660
7	-	-\$2,493	\$12,840	\$27,114	\$37,461	\$9,801
8	-	-\$2,543	\$12,834	\$27,913	\$38,204	\$48,005
9	-	-\$2,594	\$12,828	\$28,736	\$38,970	\$86,975
10	-	-\$2,646	\$12,821	\$29,584	\$39,759	\$126,734
11	-	-\$2,699	\$12,815	\$30,456	\$40,572	\$167,305
12	-	-\$2,753	\$12,808	\$31,354	\$41,409	\$208,715
13	-	-\$2,808	\$12,802	\$32,278	\$42,272	\$250,987
14	-	-\$2,864	\$12,795	\$33,230	\$43,161	\$294,148
15	-	-\$2,921	\$12,789	\$34,209	\$44,077	\$338,225
16	-	-\$10,980	\$12,782	\$35,218	\$37,021	\$375,245
17	-	-\$3,039	\$12,776	\$36,256	\$45,993	\$421,238
18	-	-\$3,100	\$12,770	\$37,325	\$46,995	\$468,233
19	-	-\$3,162	\$12,763	\$38,425	\$48,026	\$516,259
20	-	-\$3,225	\$12,757	\$39,558	\$49,090	\$565,349
21	-	-\$3,290	-	\$40,724	\$37,435	\$602,783
22	-	-\$3,356	-	\$41,925	\$38,569	\$641,353
23	-	-\$3,423	-	\$43,161	\$39,738	\$681,091
24	-	-\$3,491	-	\$44,433	\$40,942	\$722,033
25	-	-\$3,561	-	\$45,743	\$42,182	\$764,215
Totals:	-\$238,005	-\$78,915	\$256,357	\$824,778	\$764,215	-

4.1 PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Upfront Payment	\$0	PV Degradation Rate	0.05%	State Income Tax Rate	0%
PPA Escalation Rate	1%	Term	20	Electricity Escalation Rate	3%		
Starting PPA Rate	\$0.13	Total Payments	\$403,128	Federal Income Tax Rate	0%		

Years	PPA Payments	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-	-
1	-\$18,399	\$22,776	141,528	\$4,377	\$4,377
2	-\$18,573	\$23,447	141,457	\$4,874	\$9,251
3	-\$18,750	\$24,139	141,386	\$5,389	\$14,640
4	-\$18,928	\$24,851	141,316	\$5,923	\$20,563
5	-\$19,107	\$25,583	141,245	\$6,476	\$27,039
6	-\$19,289	\$26,337	141,174	\$7,049	\$34,088
7	-\$19,472	\$27,114	141,103	\$7,642	\$41,730
8	-\$19,657	\$27,913	141,033	\$8,257	\$49,986
9	-\$19,843	\$28,736	140,962	\$8,893	\$58,879
10	-\$20,032	\$29,584	140,891	\$9,552	\$68,431
11	-\$20,222	\$30,456	140,820	\$10,234	\$78,665
12	-\$20,414	\$31,354	140,750	\$10,940	\$89,605
13	-\$20,608	\$32,278	140,679	\$11,670	\$101,276
14	-\$20,803	\$33,230	140,608	\$12,426	\$113,702
15	-\$21,001	\$34,209	140,537	\$13,209	\$126,911
16	-\$21,200	\$35,218	140,467	\$14,018	\$140,929
17	-\$21,401	\$36,256	140,396	\$14,855	\$155,784
18	-\$21,604	\$37,325	140,325	\$15,721	\$171,504
19	-\$21,809	\$38,425	140,254	\$16,616	\$188,120
20	-\$22,016	\$39,558	140,183	\$17,542	\$205,662
Totals:	-\$403,128	\$608,791	2,817,115	\$205,662	-

4.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$238,005	Payback Period	6.7 Years	Discount Rate	5%	State Income Tax Rate	0%
25-Year IRR	15.16%	25-Year ROI	321.1%	Electricity Escalation Rate	3%		
25-Year NPV	\$312,440	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%		

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$238,005	-	-	-	-	-\$238,005	-\$238,005
1	-	-\$2,214	\$12,879	\$22,776	141,528	\$33,441	-\$204,564
2	-	-\$2,258	\$12,873	\$23,447	141,457	\$34,062	-\$170,502
3	-	-\$2,303	\$12,866	\$24,139	141,386	\$34,702	-\$135,801
4	-	-\$2,350	\$12,860	\$24,851	141,316	\$35,361	-\$100,440
5	-	-\$2,397	\$12,853	\$25,583	141,245	\$36,040	-\$64,400
6	-	-\$2,444	\$12,847	\$26,337	141,174	\$36,740	-\$27,660
7	-	-\$2,493	\$12,840	\$27,114	141,103	\$37,461	\$9,801
8	-	-\$2,543	\$12,834	\$27,913	141,033	\$38,204	\$48,005
9	-	-\$2,594	\$12,828	\$28,736	140,962	\$38,970	\$86,975
10	-	-\$2,646	\$12,821	\$29,584	140,891	\$39,759	\$126,734
11	-	-\$2,699	\$12,815	\$30,456	140,820	\$40,572	\$167,305
12	-	-\$2,753	\$12,808	\$31,354	140,750	\$41,409	\$208,715
13	-	-\$2,808	\$12,802	\$32,278	140,679	\$42,272	\$250,987
14	-	-\$2,864	\$12,795	\$33,230	140,608	\$43,161	\$294,148
15	-	-\$2,921	\$12,789	\$34,209	140,537	\$44,077	\$338,225
16	-	-\$10,980	\$12,782	\$35,218	140,467	\$37,021	\$375,245
17	-	-\$3,039	\$12,776	\$36,256	140,396	\$45,993	\$421,238
18	-	-\$3,100	\$12,770	\$37,325	140,325	\$46,995	\$468,233
19	-	-\$3,162	\$12,763	\$38,425	140,254	\$48,026	\$516,259
20	-	-\$3,225	\$12,757	\$39,558	140,183	\$49,090	\$565,349
21	-	-\$3,290	-	\$40,724	140,113	\$37,435	\$602,783
22	-	-\$3,356	-	\$41,925	140,042	\$38,569	\$641,353
23	-	-\$3,423	-	\$43,161	139,971	\$39,738	\$681,091
24	-	-\$3,491	-	\$44,433	139,900	\$40,942	\$722,033
25	-	-\$3,561	-	\$45,743	139,830	\$42,182	\$764,215
Totals:	-\$238,005	-\$78,915	\$256,357	\$824,778	3,516,971	\$764,215	-

ENERGY TOOLBASE™

Prepared For

UMass Lowell
(111)111-1111

adam.tobin@anseradvisory.com

UML - Sheehy Hall (PV Only)

Prepared By

David Lazerwitz
(213) 514-2108

david.lazerwitz@anseradvisory.com

4/2/2021



The Energy Toolbase provides comprehensive cost analysis for commercial, municipal, and residential renewable energy projects. We provide the tools that professionals need to compete in the fast paced renewable energy market by leveraging our first hand experience developing energy projects. Our software developers are NABCEP certified energy professionals and have completed energy analysis for companies including the Mirage Casino Resorts, Boston Scientific, Leviton, Balfour Beatty Construction, and many others.



Table of Contents

- 1 Project Summary 3
- 2 Project Details 4
 - 2.1 Sheehy Hall 4
 - 2.1.1 PV System Details 4
 - 2.1.2 Rebates and Incentives 5
 - 2.1.3 Utility Rates 6
 - 2.1.4 Current Electric Bill 6
 - 2.1.5 New Electric Bill 7
- 3 Cash Flow Analysis 8
 - 3.1 PPA 8
 - 3.2 Cash Purchase 9
- 4 Detailed Cash Flow Analysis 10
 - 4.1 PPA 10
 - 4.2 Cash Purchase 11

DRAFT

1 Project Summary

Payment Options	PPA	Cash Purchase
PPA Escalation Rate	1%	-
Starting PPA Rate	\$0.18/kWh	-
Upfront Payment	-	\$173,594
Term	20 Years	-
Rebates and Incentives	-	\$146,472
Net Payments	-	\$65,469
25-Year Electric Bill Savings	-	\$426,862
25-Year IRR	-	10.8%
25-Year LCOE PV	-	\$0.033
25-Year NPV	-	\$120,904
Payback Period	-	9 Years
Total Payments	\$318,919	\$211,941
20-Year Electric Bill Savings	\$315,079	-
20-Year LCOE PV	\$0.198	-
20-Year NPV	(\$8,381)	-


Combined Solar PV Rating

Power Rating: 59,860 W-DC

Power Rating: 53,518 W-AC-CEC

DRAFT

Cumulative Energy Costs By Payment Option

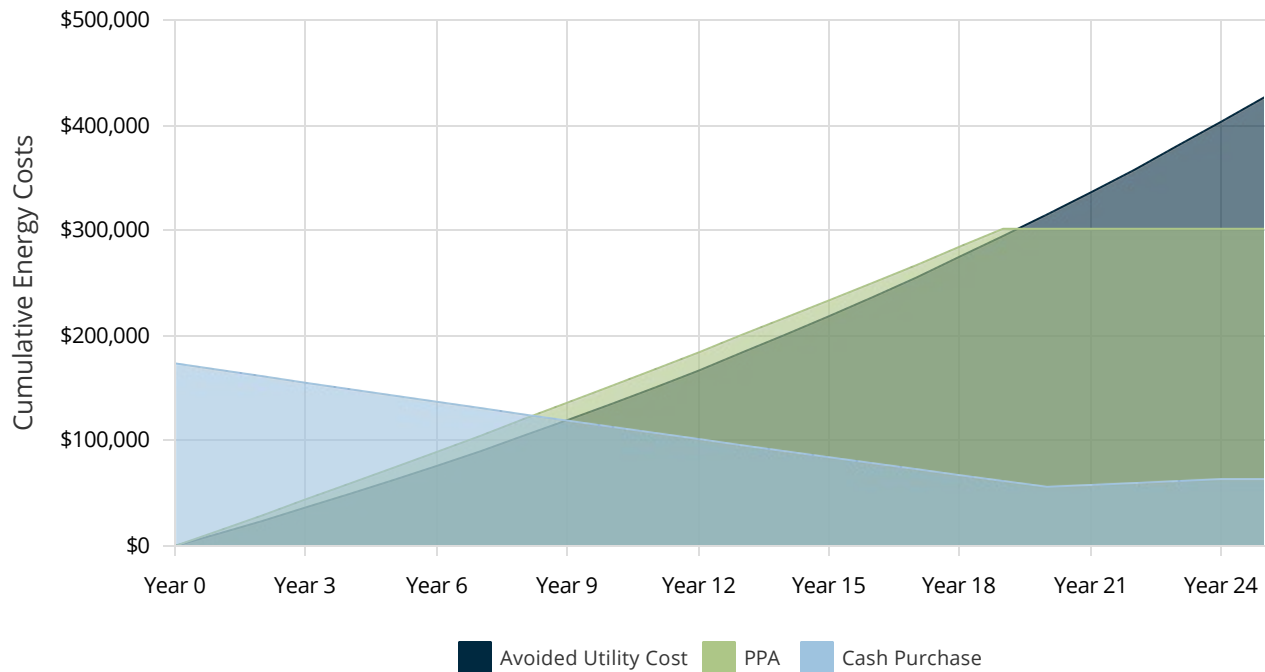

2.1.1 PV System Details

General Information

Facility: Sheehy Hall
 Address: 91 Pawtucket St Lowell MA 01854

Solar PV System Rating

Power Rating: 59,860 W-DC
 Power Rating: 53,518 W-AC-CEC

Solar PV Equipment Description

Solar Panels: (146) LG Electronics "LG410N2W-A5 (Jan1,17)"
 Inverters: (0) SolarEdge SE66.6KUS

Energy Consumption Mix

Annual Energy Use: 334,033 kWh


Solar PV Equipment Typical Lifespan

Solar Panels: Greater than 30 Years
 Inverters: 15 Years

Solar PV System Cost And Incentives

Solar PV System Cost \$173,594
 (SMART) Program - PV **-\$146,472**


Net Solar PV System Cost: \$27,122

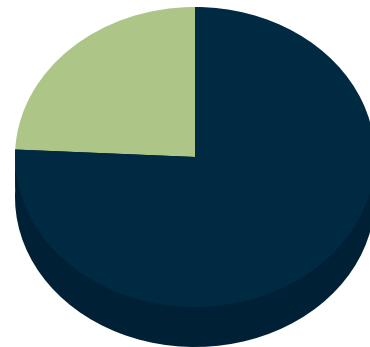

Utility 253,170 kWh (75.79%)
 Solar PV 80,863 kWh (24.21%)

DRAFT

Monthly Energy Use vs Solar Generation

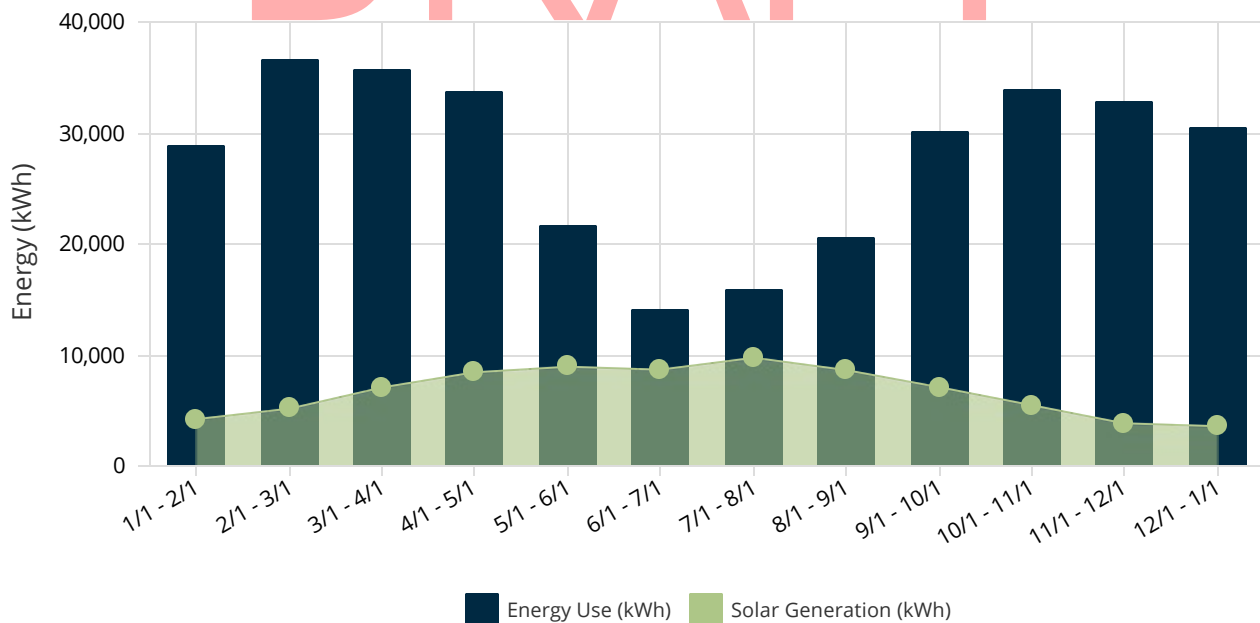

2.1.2 Rebates and Incentives

This section summarizes all incentives available for this project. The actual rebate and incentive amounts for this project are shown in each example.

Solar Massachusetts Renewable Target (SMART) - PV Incentive

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1600MW declining block incentive program. Eligible projects must be interconnected by one of three investor owned utility companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. If adding Energy Storage to the Proposal and claiming the SMART Tariff make sure to enter the Energy Storage Adder on the Excel calculator to include it in the total incentive value.

Total Incentive Value: \$146,472

DRAFT

2.1.3 Utility Rates

The table below shows the rates associated with your current utility rate schedule (G-3). Your estimated electric bills after solar are shown on the following page.

Fixed Charges		Energy Charges		Demand Charges	
Type	G-3	Type	G-3	Type	G-3
S1 Monthly	\$223.00	S1 On Peak	\$0.13176	S1 On Peak	\$8.05
S2 Monthly	\$223.00	S1 Off Peak	\$0.13001	S2 On Peak	\$8.05
S3 Monthly	\$223.00	S2 On Peak	\$0.13294	S3 On Peak	\$8.05
S4 Monthly	\$223.00	S2 Off Peak	\$0.13119	S4 On Peak	\$8.05
		S3 On Peak	\$0.16172		
		S3 Off Peak	\$0.15997		
		S4 On Peak	\$0.14915		
		S4 Off Peak	\$0.14740		

2.1.4 Current Electric Bill

The table below shows your annual electricity costs based on the most current utility rates and your previous 12 months of electrical usage.

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak		On Peak	Other	Energy	Demand
1/1/2019 - 2/1/2019 S3	11,690	17,073	102	\$223	\$4,622	\$821	\$5,666
2/1/2019 - 3/1/2019 S4	14,457	22,127	123	\$223	\$5,418	\$990	\$6,631
3/1/2019 - 4/1/2019 S4	13,560	22,190	123	\$223	\$5,293	\$990	\$6,506
4/1/2019 - 5/1/2019 S4	13,899	19,712	102	\$223	\$4,979	\$821	\$6,023
5/1/2019 - 6/1/2019 S1	8,558	13,052	93	\$223	\$2,824	\$749	\$3,796
6/1/2019 - 7/1/2019 S1	5,227	8,880	27	\$223	\$1,843	\$217	\$2,284
7/1/2019 - 8/1/2019 S1	6,603	9,328	72	\$223	\$2,083	\$580	\$2,885
8/1/2019 - 9/1/2019 S2	7,888	12,723	75	\$223	\$2,718	\$604	\$3,545
9/1/2019 - 10/1/2019 S2	11,509	18,548	93	\$223	\$3,963	\$749	\$4,935
10/1/2019 - 11/1/2019 S2	13,411	20,390	90	\$223	\$4,458	\$725	\$5,405
11/1/2019 - 12/1/2019 S3	12,512	20,199	81	\$223	\$5,255	\$652	\$6,130
12/1/2019 - 1/1/2020 S3	11,982	18,515	87	\$223	\$4,900	\$700	\$5,823
Totals:	131,296	202,737	-	\$2,676	\$48,355	\$8,597	\$59,628

2.1.5 New Electric Bill

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	8,587	15,964	95	\$223	\$3,942	\$765	\$4,930
2/1/2019 - 3/1/2019 S4	10,795	20,620	108	\$223	\$4,649	\$869	\$5,742
3/1/2019 - 4/1/2019 S4	8,873	19,807	123	\$223	\$4,243	\$990	\$5,456
4/1/2019 - 5/1/2019 S4	8,225	16,954	91	\$223	\$3,726	\$733	\$4,681
5/1/2019 - 6/1/2019 S1	2,120	10,549	86	\$223	\$1,651	\$692	\$2,566
6/1/2019 - 7/1/2019 S1	-194	5,628	24	\$223	\$706	\$193	\$1,122
7/1/2019 - 8/1/2019 S1	-195	6,377	71	\$223	\$803	\$572	\$1,598
8/1/2019 - 9/1/2019 S2	1,772	10,199	72	\$223	\$1,574	\$580	\$2,376
9/1/2019 - 10/1/2019 S2	6,392	16,580	90	\$223	\$3,025	\$725	\$3,972
10/1/2019 - 11/1/2019 S2	9,255	19,076	85	\$223	\$3,733	\$684	\$4,640
11/1/2019 - 12/1/2019 S3	9,771	19,097	81	\$223	\$4,635	\$652	\$5,510
12/1/2019 - 1/1/2020 S3	9,415	17,503	87	\$223	\$4,323	\$700	\$5,246
Totals:	74,816	178,354	-	\$2,676	\$37,010	\$8,155	\$47,841

Annual Electricity Savings: \$11,788

DRAFT

3.1 PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Term	20	Electricity Escalation Rate	3%
PPA Escalation Rate	1%	Total Payments	\$318,919	Federal Income Tax Rate	0%
Starting PPA Rate	\$0.18	PV Degradation Rate	0.05%	State Income Tax Rate	0%
Upfront Payment	\$0				

Years	PPA Payments	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-
1	-\$14,555	\$11,788	-\$2,768	-\$2,768
2	-\$14,694	\$12,135	-\$2,558	-\$5,326
3	-\$14,833	\$12,493	-\$2,340	-\$7,666
4	-\$14,974	\$12,861	-\$2,113	-\$9,779
5	-\$15,116	\$13,241	-\$1,876	-\$11,654
6	-\$15,260	\$13,631	-\$1,629	-\$13,283
7	-\$15,404	\$14,033	-\$1,372	-\$14,654
8	-\$15,551	\$14,447	-\$1,104	-\$15,759
9	-\$15,698	\$14,872	-\$826	-\$16,584
10	-\$15,847	\$15,311	-\$536	-\$17,121
11	-\$15,998	\$15,762	-\$235	-\$17,356
12	-\$16,150	\$16,227	\$77	-\$17,279
13	-\$16,303	\$16,705	\$403	-\$16,876
14	-\$16,458	\$17,198	\$740	-\$16,136
15	-\$16,614	\$17,705	\$1,091	-\$15,045
16	-\$16,772	\$18,227	\$1,455	-\$13,589
17	-\$16,931	\$18,764	\$1,834	-\$11,756
18	-\$17,091	\$19,318	\$2,226	-\$9,530
19	-\$17,254	\$19,887	\$2,633	-\$6,896
20	-\$17,417	\$20,473	\$3,056	-\$3,840
Totals:	-\$318,919	\$315,079	-\$3,840	-

3.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$173,594	25-Year ROI	208.2%	Electricity Escalation Rate	3%
25-Year IRR	10.8%	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%
25-Year NPV	\$120,904	Discount Rate	5%	State Income Tax Rate	0%
Payback Period	9 Years				

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$173,594	-	-	-	-\$173,594	-\$173,594
1	-	-\$1,197	\$7,359	\$11,788	\$17,949	-\$155,645
2	-	-\$1,221	\$7,355	\$12,135	\$18,269	-\$137,376
3	-	-\$1,246	\$7,351	\$12,493	\$18,599	-\$118,778
4	-	-\$1,270	\$7,347	\$12,861	\$18,938	-\$99,839
5	-	-\$1,296	\$7,344	\$13,241	\$19,288	-\$80,551
6	-	-\$1,322	\$7,340	\$13,631	\$19,649	-\$60,901
7	-	-\$1,348	\$7,336	\$14,033	\$20,021	-\$40,880
8	-	-\$1,375	\$7,333	\$14,447	\$20,404	-\$20,476
9	-	-\$1,403	\$7,329	\$14,872	\$20,799	\$323
10	-	-\$1,431	\$7,325	\$15,311	\$21,206	\$21,528
11	-	-\$1,459	\$7,322	\$15,762	\$21,625	\$43,153
12	-	-\$1,489	\$7,318	\$16,227	\$22,057	\$65,209
13	-	-\$1,518	\$7,314	\$16,705	\$22,502	\$87,711
14	-	-\$1,549	\$7,311	\$17,198	\$22,960	\$110,671
15	-	-\$1,580	\$7,307	\$17,705	\$23,432	\$134,103
16	-	-\$1,611	\$7,303	\$18,227	\$23,919	\$158,022
17	-	-\$1,643	\$7,300	\$18,764	\$24,421	\$182,443
18	-	-\$1,676	\$7,296	\$19,318	\$24,937	\$207,380
19	-	-\$1,710	\$7,292	\$19,887	\$25,469	\$232,850
20	-	-\$1,744	\$7,289	\$20,473	\$26,018	\$258,867
21	-	-\$1,779	-	\$21,077	\$19,298	\$278,165
22	-	-\$1,815	-	\$21,698	\$19,884	\$298,049
23	-	-\$1,851	-	\$22,338	\$20,487	\$318,536
24	-	-\$1,888	-	\$22,996	\$21,108	\$339,644
25	-	-\$1,926	-	\$23,674	\$21,749	\$361,393
Totals:	-\$173,594	-\$38,347	\$146,472	\$426,862	\$361,393	-

4.1 PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Upfront Payment	\$0	PV Degradation Rate	0.05%	State Income Tax Rate	0%
PPA Escalation Rate	1%	Term	20	Electricity Escalation Rate	3%		
Starting PPA Rate	\$0.18	Total Payments	\$318,919	Federal Income Tax Rate	0%		

Years	PPA Payments	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-	-
1	-\$14,555	\$11,788	80,863	-\$2,768	-\$2,768
2	-\$14,694	\$12,135	80,823	-\$2,558	-\$5,326
3	-\$14,833	\$12,493	80,782	-\$2,340	-\$7,666
4	-\$14,974	\$12,861	80,742	-\$2,113	-\$9,779
5	-\$15,116	\$13,241	80,701	-\$1,876	-\$11,654
6	-\$15,260	\$13,631	80,661	-\$1,629	-\$13,283
7	-\$15,404	\$14,033	80,620	-\$1,372	-\$14,654
8	-\$15,551	\$14,447	80,580	-\$1,104	-\$15,759
9	-\$15,698	\$14,872	80,540	-\$826	-\$16,584
10	-\$15,847	\$15,311	80,499	-\$536	-\$17,121
11	-\$15,998	\$15,762	80,459	-\$235	-\$17,356
12	-\$16,150	\$16,227	80,418	\$77	-\$17,279
13	-\$16,303	\$16,705	80,378	\$403	-\$16,876
14	-\$16,458	\$17,198	80,337	\$740	-\$16,136
15	-\$16,614	\$17,705	80,297	\$1,091	-\$15,045
16	-\$16,772	\$18,227	80,257	\$1,455	-\$13,589
17	-\$16,931	\$18,764	80,216	\$1,834	-\$11,756
18	-\$17,091	\$19,318	80,176	\$2,226	-\$9,530
19	-\$17,254	\$19,887	80,135	\$2,633	-\$6,896
20	-\$17,417	\$20,473	80,095	\$3,056	-\$3,840
Totals:	-\$318,919	\$315,079	1,609,578	-\$3,840	-

4.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$173,594	Payback Period	9 Years	Discount Rate	5%	State Income Tax Rate	0%
25-Year IRR	10.8%	25-Year ROI	208.2%	Electricity Escalation Rate	3%		
25-Year NPV	\$120,904	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%		

Years	Project Costs	O&M Plan	(SMART) Program - PV	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$173,594	-	-	-	-	-\$173,594	-\$173,594
1	-	-\$1,197	\$7,359	\$11,788	80,863	\$17,949	-\$155,645
2	-	-\$1,221	\$7,355	\$12,135	80,823	\$18,269	-\$137,376
3	-	-\$1,246	\$7,351	\$12,493	80,782	\$18,599	-\$118,778
4	-	-\$1,270	\$7,347	\$12,861	80,742	\$18,938	-\$99,839
5	-	-\$1,296	\$7,344	\$13,241	80,701	\$19,288	-\$80,551
6	-	-\$1,322	\$7,340	\$13,631	80,661	\$19,649	-\$60,901
7	-	-\$1,348	\$7,336	\$14,033	80,620	\$20,021	-\$40,880
8	-	-\$1,375	\$7,333	\$14,447	80,580	\$20,404	-\$20,476
9	-	-\$1,403	\$7,329	\$14,872	80,540	\$20,799	\$323
10	-	-\$1,431	\$7,325	\$15,311	80,499	\$21,206	\$21,528
11	-	-\$1,459	\$7,322	\$15,762	80,459	\$21,625	\$43,153
12	-	-\$1,489	\$7,318	\$16,227	80,418	\$22,057	\$65,209
13	-	-\$1,518	\$7,314	\$16,705	80,378	\$22,502	\$87,711
14	-	-\$1,549	\$7,311	\$17,198	80,337	\$22,960	\$110,671
15	-	-\$1,580	\$7,307	\$17,705	80,297	\$23,432	\$134,103
16	-	-\$1,611	\$7,303	\$18,227	80,257	\$23,919	\$158,022
17	-	-\$1,643	\$7,300	\$18,764	80,216	\$24,421	\$182,443
18	-	-\$1,676	\$7,296	\$19,318	80,176	\$24,937	\$207,380
19	-	-\$1,710	\$7,292	\$19,887	80,135	\$25,469	\$232,850
20	-	-\$1,744	\$7,289	\$20,473	80,095	\$26,018	\$258,867
21	-	-\$1,779	-	\$21,077	80,054	\$19,298	\$278,165
22	-	-\$1,815	-	\$21,698	80,014	\$19,884	\$298,049
23	-	-\$1,851	-	\$22,338	79,974	\$20,487	\$318,536
24	-	-\$1,888	-	\$22,996	79,933	\$21,108	\$339,644
25	-	-\$1,926	-	\$23,674	79,893	\$21,749	\$361,393
Totals:	-\$173,594	-\$38,347	\$146,472	\$426,862	2,009,446	\$361,393	-

ENERGY TOOLBASE™

Prepared For

UMass Lowell
(111)111-1111

adam.tobin@anseradvisory.com

UML - Tsongas Center (PV+BESS)

Prepared By

David Lazerwitz
(213) 514-2108

david.lazerwitz@anseradvisory.com

4/27/2021



The Energy Toolbase provides comprehensive cost analysis for commercial, municipal, and residential renewable energy projects. We provide the tools that professionals need to compete in the fast paced renewable energy market by leveraging our first hand experience developing energy projects. Our software developers are NABCEP certified energy professionals and have completed energy analysis for companies including the Mirage Casino Resorts, Boston Scientific, Leviton, Balfour Beatty Construction, and many others.



Table of Contents

- 1 Project Summary 3
- 2 Project Details 4
 - 2.1 Tsongas Center 4
 - 2.1.1 PV System Details 4
 - 2.1.2 Energy Storage System (ESS) Details 5
 - 2.1.3 Rebates and Incentives 6
 - 2.1.4 Utility Rates 7
 - 2.1.5 Current Electric Bill 7
 - 2.1.6 New Electric Bill 8
- 3 Cash Flow Analysis 9
 - 3.1 Generic PPA 9
 - 3.2 Cash Purchase 10
- 4 Detailed Cash Flow Analysis 11
 - 4.1 Generic PPA 11
 - 4.2 Cash Purchase 12

DRAFT

1 Project Summary

Payment Options	Generic PPA	Cash Purchase
PPA Escalation Rate	1%	-
Starting PPA Rate	\$0.17/kWh	-
Upfront Payment	-	\$1,233,729
Term	20 Years	-
Rebates and Incentives	-	\$1,040,162
Net Payments	-	\$724,440
25-Year Electric Bill Savings	-	\$3,861,836
25-Year IRR	-	12.76%
25-Year LCOE PV	-	\$0.043
25-Year NPV	-	\$1,172,537
Payback Period	-	7.7 Years
Total Payments	\$2,528,889	\$1,764,602
20-Year Electric Bill Savings	\$2,853,174	-
20-Year LCOE PV	\$0.187	-
20-Year NPV	\$145,619	-

Combined Solar PV Rating


Power Rating: 502,660 W-DC
 Power Rating: 449,406 W-AC-CEC

Combined ESS Ratings

Energy Capacity: 293.7 kWh
 Power Rating: 146.8 kW

DRAFT

Cumulative Energy Costs By Payment Option

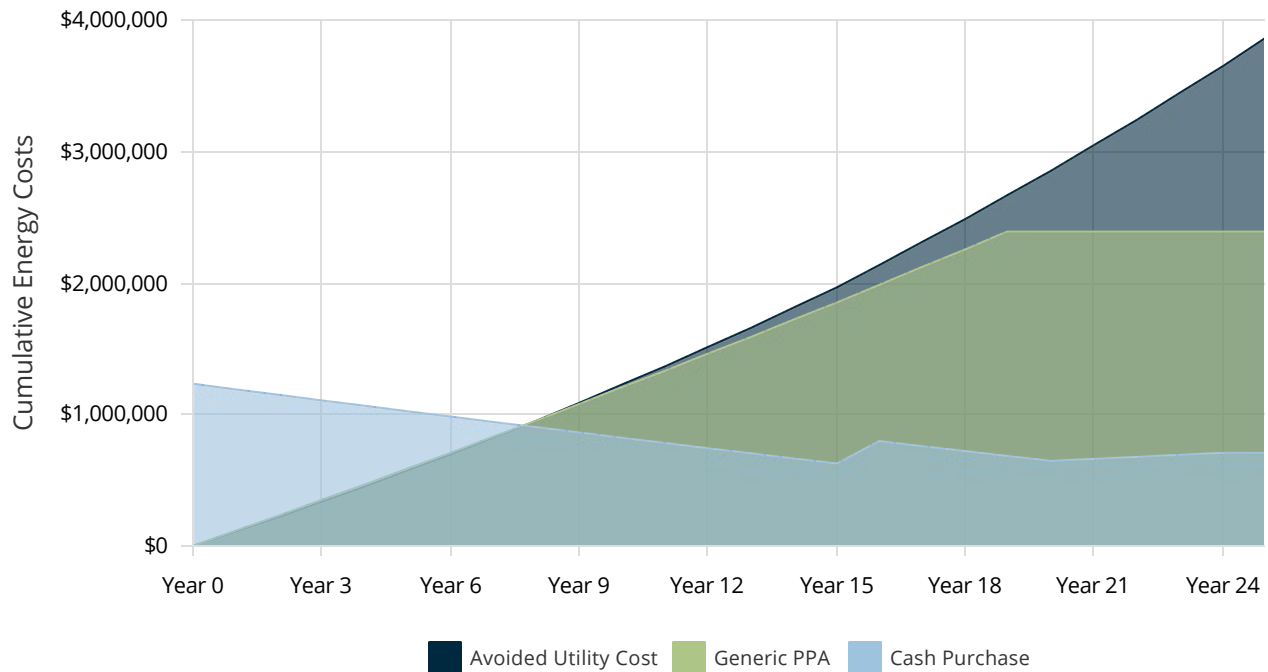

2.1.1 PV System Details

General Information

Facility: Tsongas Center
 Address: 300 Arcand Dr Lowell MA 01852

Solar PV System Rating

Power Rating: 502,660 W-DC
 Power Rating: 449,406 W-AC-CEC

Solar PV Equipment Description

Solar Panels: (1226) LG Electronics "LG410N2W-A5 (Jan1,17)"
 Inverters: (5) SolarEdge SE100KUS

Energy Consumption Mix

Annual Energy Use: 3,618,733 kWh


Solar PV Equipment Typical Lifespan

Solar Panels: Greater than 30 Years
 Inverters: 15 Years

Solar PV System Cost And Incentives

Solar PV System Cost \$940,049
 (SMART) Program - PV **-\$621,646**


Net Solar PV System Cost: \$318,403

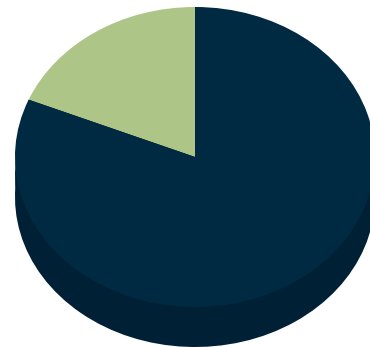

Utility 2,939,806 kWh (81.24%)
 Solar PV 678,927 kWh (18.76%)

DRAFT

Monthly Energy Use vs Solar Generation

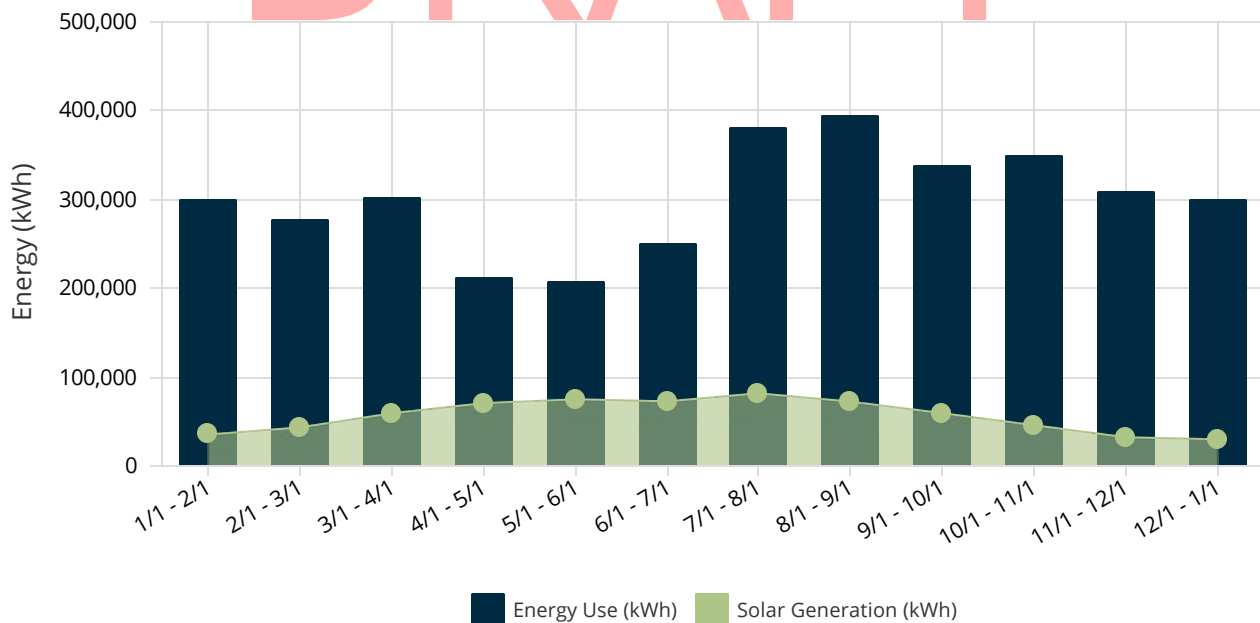

2.1.2 Energy Storage System (ESS) Details

General Information

Facility: Tsongas Center
Address: Lowell MA 01852

ESS System Ratings

Energy Capacity: 293.7 kWh
Power Rating: 146.8 kW

ESS Equipment Description

Battery 146.84kw/293.68kWh Energy Storage
Banks: System
Inverters: 146.84kw/293.68kWh Energy Storage System

ESS Equipment Typical Lifespan

Battery Banks: 15 Years
Inverters: 15 Years


ESS Cost And Incentives

ESS System Cost \$293,680
Solar Massachusetts Renewable Target (SMART) - Storage adder - \$418,517

Net ESS System Cost:

- \$124,837

Energy Storage Annual Utilization

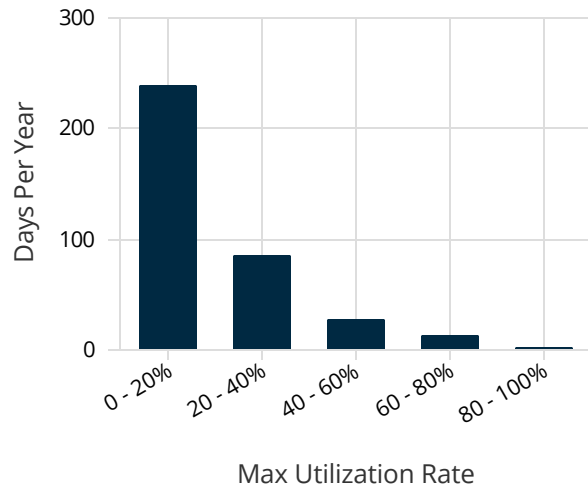

Energy Output and Demand Savings From Solar PV and Energy Storage

Date Range	ESS Energy Discharge	Solar PV Generation	ESS Energy as % of PV Energy	Total Demand Savings
1/1/2019 - 2/1/2019	1,935	35,369	5.47%	\$620
2/1/2019 - 3/1/2019	1,766	43,422	4.07%	\$805
3/1/2019 - 4/1/2019	1,218	59,361	2.05%	\$555
4/1/2019 - 5/1/2019	3,149	70,799	4.45%	\$1,385
5/1/2019 - 6/1/2019	3,397	75,063	4.53%	\$1,755
6/1/2019 - 7/1/2019	1,299	72,804	1.78%	\$2,029
7/1/2019 - 8/1/2019	1,166	81,854	1.42%	\$1,369
8/1/2019 - 9/1/2019	2,327	72,540	3.21%	\$1,924
9/1/2019 - 10/1/2019	2,816	59,488	4.73%	\$2,085
10/1/2019 - 11/1/2019	1,366	45,927	2.97%	\$757
11/1/2019 - 12/1/2019	1,701	32,263	5.27%	\$765
12/1/2019 - 1/1/2020	3,311	30,037	11.02%	\$773
-	25,451	678,927	3.75%	\$14,820

2.1.3 Rebates and Incentives

This section summarizes all incentives available for this project. The actual rebate and incentive amounts for this project are shown in each example.

Solar Massachusetts Renewable Target (SMART) - PV Incentive

Massachusetts SMART Tariff for those considering installing a Behind-the-Meter System (Tariff Generation Unit under the SMART Program.) The Solar Massachusetts Renewable Target (SMART) Program is the newest program established to support the development of solar in Massachusetts. The DOER regulation in 225 CMR 20.00 sets the regulatory framework for the program. The tariff based incentive is paid directly by the utility company to the system owner, following the approval of the application by the Solar Program Administrator. The SMART Program is a 1600MW declining block incentive program. Eligible projects must be interconnected by one of three investor owned utility companies in Massachusetts: Eversource, National Grid, and Unitil. Each utility has established blocks that decline in incentive rates between each block. If adding Energy Storage to the Proposal and claiming the SMART Tariff make sure to enter the Energy Storage Adder on the Excel calculator to include it in the total incentive value.

Total Incentive Value: \$621,646

Solar Massachusetts Renewable Target (SMART) - ESS Incentive

Performance Based ESS Incentive, based on the ratio of Total ESS Max Power Discharge to Total PV DC Power Rating, the ESS Full Discharge Duration, and the production of the system. There is a Minimum Efficiency Requirement, stating that the Energy Storage System paired with the solar photovoltaic Generation Unit must have at least a 65% round trip efficiency in normal operation. There are also Operational Requirements, such as that the Energy Storage System must discharge at least 52 complete cycle equivalents per year and must remain functional and operational in order for the solar photovoltaic Generation Unit to continue to be eligible for the Energy Storage Adder. On top of this, the nominal useful energy capacity of the Energy Storage System paired with the solar photovoltaic Generation Unit must be at least two hours and shall be incentivized for no more than six hours and the nominal rated power capacity of the Energy Storage System paired with a solar photovoltaic Generation Unit must be at least 25 per cent and shall be incentivized for no more than 100 per cent of the rated capacity, as measured in direct current, of the solar photovoltaic Generation Unit.

Total Incentive Value: \$418,517

2.1.4 Utility Rates

The table below shows the rates associated with your current utility rate schedule (G-3). Your estimated electric bills after solar are shown on the following page.

Fixed Charges		Energy Charges		Demand Charges	
Type	G-3	Type	G-3	Type	G-3
S1 Monthly	\$223.00	S1 On Peak	\$0.13176	S1 On Peak	\$8.05
S2 Monthly	\$223.00	S1 Off Peak	\$0.13001	S2 On Peak	\$8.05
S3 Monthly	\$223.00	S2 On Peak	\$0.13294	S3 On Peak	\$8.05
S4 Monthly	\$223.00	S2 Off Peak	\$0.13119	S4 On Peak	\$8.05
		S3 On Peak	\$0.16172		
		S3 Off Peak	\$0.15997		
		S4 On Peak	\$0.14915		
		S4 Off Peak	\$0.14740		

2.1.5 Current Electric Bill

The table below shows your annual electricity costs based on the most current utility rates and your previous 12 months of electrical usage.

Rate Schedule: NGrid-MA - G-3

Time Periods	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	126,310	173,032	670	\$223	\$48,107	\$5,394	\$53,723
2/1/2019 - 3/1/2019 S4	117,250	159,133	712	\$223	\$40,944	\$5,732	\$46,899
3/1/2019 - 4/1/2019 S4	119,614	183,049	748	\$223	\$44,822	\$6,021	\$51,066
4/1/2019 - 5/1/2019 S4	91,248	120,946	538	\$223	\$31,437	\$4,331	\$35,991
5/1/2019 - 6/1/2019 S1	93,713	112,519	551	\$223	\$26,976	\$4,436	\$31,635
6/1/2019 - 7/1/2019 S1	106,331	144,116	803	\$223	\$32,747	\$6,464	\$39,434
7/1/2019 - 8/1/2019 S1	169,217	212,171	944	\$223	\$49,880	\$7,599	\$57,703
8/1/2019 - 9/1/2019 S2	173,019	220,079	919	\$223	\$51,873	\$7,398	\$59,494
9/1/2019 - 10/1/2019 S2	150,454	188,223	892	\$223	\$44,694	\$7,181	\$52,098
10/1/2019 - 11/1/2019 S2	156,095	193,980	845	\$223	\$46,200	\$6,802	\$53,225
11/1/2019 - 12/1/2019 S3	126,728	182,271	782	\$223	\$49,652	\$6,295	\$56,170
12/1/2019 - 1/1/2020 S3	125,816	173,419	657	\$223	\$48,089	\$5,289	\$53,601
Totals:	1,555,795	2,062,938	-	\$2,676	\$515,421	\$72,941	\$591,038

2.1.6 New Electric Bill

Rate Schedule: NGrid-MA - G-3

Time Periods Bill Ranges & Seasons	Energy Use (kWh)		Max Demand (kW)	Charges			
	On Peak	Off Peak	On Peak	Other	Energy	Demand	Total
1/1/2019 - 2/1/2019 S3	100,344	164,372	593	\$223	\$42,522	\$4,774	\$47,519
2/1/2019 - 3/1/2019 S4	85,954	147,686	612	\$223	\$34,589	\$4,927	\$39,739
3/1/2019 - 4/1/2019 S4	79,974	163,796	679	\$223	\$36,072	\$5,466	\$41,761
4/1/2019 - 5/1/2019 S4	42,968	99,637	366	\$223	\$21,095	\$2,946	\$24,264
5/1/2019 - 6/1/2019 S1	38,856	93,618	333	\$223	\$17,291	\$2,681	\$20,195
6/1/2019 - 7/1/2019 S1	60,372	117,770	551	\$223	\$23,266	\$4,436	\$27,924
7/1/2019 - 8/1/2019 S1	112,106	187,875	774	\$223	\$39,197	\$6,231	\$45,650
8/1/2019 - 9/1/2019 S2	122,360	199,091	680	\$223	\$42,385	\$5,474	\$48,082
9/1/2019 - 10/1/2019 S2	107,395	172,875	633	\$223	\$36,957	\$5,096	\$42,275
10/1/2019 - 11/1/2019 S2	121,508	183,164	751	\$223	\$40,183	\$6,046	\$46,451
11/1/2019 - 12/1/2019 S3	104,104	173,285	687	\$223	\$44,556	\$5,530	\$50,309
12/1/2019 - 1/1/2020 S3	104,454	166,016	561	\$223	\$43,450	\$4,516	\$48,189
Totals:	1,080,395	1,869,185	-	\$2,676	\$421,562	\$58,121	\$482,359

Annual Electricity Savings: \$108,679

DRAFT

3.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Term	20	Electricity Escalation Rate	3%
PPA Escalation Rate	1%	Total Payments	\$2,528,889	Federal Income Tax Rate	0%
Starting PPA Rate	\$0.17	PV Degradation Rate	0.05%	State Income Tax Rate	0%
Upfront Payment	\$0				

Years	PPA Payments	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-
1	-\$115,418	\$108,679	-\$6,738	-\$6,738
2	-\$116,513	\$111,542	-\$4,971	-\$11,709
3	-\$117,620	\$114,479	-\$3,140	-\$14,850
4	-\$118,736	\$117,492	-\$1,244	-\$16,094
5	-\$119,864	\$120,582	\$719	-\$15,375
6	-\$121,002	\$123,753	\$2,751	-\$12,625
7	-\$122,151	\$127,004	\$4,854	-\$7,771
8	-\$123,310	\$130,340	\$7,030	-\$741
9	-\$124,481	\$133,761	\$9,281	\$8,540
10	-\$125,662	\$137,271	\$11,608	\$20,148
11	-\$126,855	\$140,870	\$14,015	\$34,163
12	-\$128,060	\$144,562	\$16,503	\$50,666
13	-\$129,275	\$148,349	\$19,074	\$69,739
14	-\$130,502	\$152,233	\$21,731	\$91,470
15	-\$131,741	\$156,216	\$24,475	\$115,945
16	-\$132,991	\$168,127	\$35,136	\$151,081
17	-\$134,254	\$172,552	\$38,299	\$189,380
18	-\$135,528	\$177,091	\$41,563	\$230,943
19	-\$136,814	\$181,747	\$44,933	\$275,876
20	-\$138,112	\$186,522	\$48,410	\$324,286
Totals:	-\$2,528,889	\$2,853,174	\$324,286	-

3.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$1,233,729	25-Year ROI	254.3%	Electricity Escalation Rate	3%
25-Year IRR	12.76%	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%
25-Year NPV	\$1,172,537	Discount Rate	5%	State Income Tax Rate	0%
Payback Period	7.7 Years				

Years	Project Costs	O&M Plan	(SMART) Program - PV	Solar Massachusetts Renewable Target (SMART) - Storage adder	Electric Bill Savings	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$1,233,729	-	-	-	-	-\$1,233,729	-\$1,233,729
1	-	-\$10,053	\$31,231	\$21,026	\$108,679	\$150,883	-\$1,082,846
2	-	-\$10,254	\$31,215	\$21,015	\$111,542	\$153,518	-\$929,328
3	-	-\$10,459	\$31,199	\$21,005	\$114,479	\$156,224	-\$773,104
4	-	-\$10,669	\$31,184	\$20,994	\$117,492	\$159,001	-\$614,103
5	-	-\$10,882	\$31,168	\$20,984	\$120,582	\$161,852	-\$452,250
6	-	-\$11,100	\$31,153	\$20,973	\$123,753	\$164,779	-\$287,471
7	-	-\$11,322	\$31,137	\$20,963	\$127,004	\$167,782	-\$119,689
8	-	-\$11,548	\$31,121	\$20,952	\$130,340	\$170,865	\$51,176
9	-	-\$11,779	\$31,106	\$20,942	\$133,761	\$174,030	\$225,206
10	-	-\$12,015	\$31,090	\$20,931	\$137,271	\$177,277	\$402,484
11	-	-\$12,255	\$31,074	\$20,921	\$140,870	\$180,611	\$583,094
12	-	-\$12,500	\$31,059	\$20,910	\$144,562	\$184,031	\$767,126
13	-	-\$12,750	\$31,043	\$20,900	\$148,349	\$187,542	\$954,667
14	-	-\$13,005	\$31,028	\$20,889	\$152,233	\$191,145	\$1,145,812
15	-	-\$13,265	\$31,012	\$20,879	\$156,216	\$194,842	\$1,340,654
16	-	-\$222,396	\$30,996	\$20,868	\$168,127	-\$2,404	\$1,338,249
17	-	-\$13,801	\$30,981	\$20,857	\$172,552	\$210,589	\$1,548,839
18	-	-\$14,077	\$30,965	\$20,847	\$177,091	\$214,826	\$1,763,665
19	-	-\$14,358	\$30,950	\$20,836	\$181,747	\$219,174	\$1,982,839
20	-	-\$14,646	\$30,934	\$20,826	\$186,522	\$223,637	\$2,206,475
21	-	-\$14,939	-	-	\$191,421	\$176,483	\$2,382,958
22	-	-\$15,237	-	-	\$196,446	\$181,209	\$2,564,167
23	-	-\$15,542	-	-	\$201,600	\$186,058	\$2,750,225
24	-	-\$15,853	-	-	\$206,886	\$191,033	\$2,941,258
25	-	-\$16,170	-	-	\$212,309	\$196,139	\$3,137,397
Totals:	-\$1,233,729	-\$530,873	\$621,646	\$418,517	\$3,861,836	\$3,137,397	-

4.1 Generic PPA

Inputs and Key Financial Metrics

End of Term Buyout Payment	\$0	Upfront Payment	\$0	PV Degradation Rate	0.05%	State Income Tax Rate	0%
PPA Escalation Rate	1%	Term	20	Electricity Escalation Rate	3%		
Starting PPA Rate	\$0.17	Total Payments	\$2,528,889	Federal Income Tax Rate	0%		

Years	PPA Payments	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-	-	-	-	-
1	-\$115,418	\$108,679	678,927	-\$6,738	-\$6,738
2	-\$116,513	\$111,542	678,588	-\$4,971	-\$11,709
3	-\$117,620	\$114,479	678,248	-\$3,140	-\$14,850
4	-\$118,736	\$117,492	677,909	-\$1,244	-\$16,094
5	-\$119,864	\$120,582	677,569	\$719	-\$15,375
6	-\$121,002	\$123,753	677,230	\$2,751	-\$12,625
7	-\$122,151	\$127,004	676,890	\$4,854	-\$7,771
8	-\$123,310	\$130,340	676,551	\$7,030	-\$741
9	-\$124,481	\$133,761	676,211	\$9,281	\$8,540
10	-\$125,662	\$137,271	675,872	\$11,608	\$20,148
11	-\$126,855	\$140,870	675,532	\$14,015	\$34,163
12	-\$128,060	\$144,562	675,193	\$16,503	\$50,666
13	-\$129,275	\$148,349	674,853	\$19,074	\$69,739
14	-\$130,502	\$152,233	674,514	\$21,731	\$91,470
15	-\$131,741	\$156,216	674,175	\$24,475	\$115,945
16	-\$132,991	\$168,127	673,835	\$35,136	\$151,081
17	-\$134,254	\$172,552	673,496	\$38,299	\$189,380
18	-\$135,528	\$177,091	673,156	\$41,563	\$230,943
19	-\$136,814	\$181,747	672,817	\$44,933	\$275,876
20	-\$138,112	\$186,522	672,477	\$48,410	\$324,286
Totals:	-\$2,528,889	\$2,853,174	13,514,042	\$324,286	-

4.2 Cash Purchase

Inputs and Key Financial Metrics

Total Project Costs	\$1,233,729	Payback Period	7.7 Years	Discount Rate	5%	State Income Tax Rate	0%
25-Year IRR	12.76%	25-Year ROI	254.3%	Electricity Escalation Rate	3%		
25-Year NPV	\$1,172,537	PV Degradation Rate	0.05%	Federal Income Tax Rate	0%		

Years	Project Costs	O&M Plan	(SMART) Program - PV	Solar Massachusetts Renewable Target (SMART) - Storage adder	Electric Bill Savings	PV Generation (kWh)	Total Cash Flow	Cumulative Cash Flow
Upfront	-\$1,233,729	-	-	-	-	-	-\$1,233,729	-\$1,233,729
1	-	-\$10,053	\$31,231	\$21,026	\$108,679	678,927	\$150,883	-\$1,082,846
2	-	-\$10,254	\$31,215	\$21,015	\$111,542	678,588	\$153,518	-\$929,328
3	-	-\$10,459	\$31,199	\$21,005	\$114,479	678,248	\$156,224	-\$773,104
4	-	-\$10,669	\$31,184	\$20,994	\$117,492	677,909	\$159,001	-\$614,103
5	-	-\$10,882	\$31,168	\$20,984	\$120,582	677,569	\$161,852	-\$452,250
6	-	-\$11,100	\$31,153	\$20,973	\$123,753	677,230	\$164,779	-\$287,471
7	-	-\$11,322	\$31,137	\$20,963	\$127,004	676,890	\$167,782	-\$119,689
8	-	-\$11,548	\$31,121	\$20,952	\$130,340	676,551	\$170,865	\$51,176
9	-	-\$11,779	\$31,106	\$20,942	\$133,761	676,211	\$174,030	\$225,206
10	-	-\$12,015	\$31,090	\$20,931	\$137,271	675,872	\$177,277	\$402,484
11	-	-\$12,255	\$31,074	\$20,921	\$140,870	675,532	\$180,611	\$583,094
12	-	-\$12,500	\$31,059	\$20,910	\$144,562	675,193	\$184,031	\$767,126
13	-	-\$12,750	\$31,043	\$20,900	\$148,349	674,853	\$187,542	\$954,667
14	-	-\$13,005	\$31,028	\$20,889	\$152,233	674,514	\$191,145	\$1,145,812
15	-	-\$13,265	\$31,012	\$20,879	\$156,216	674,175	\$194,842	\$1,340,654
16	-	-\$222,396	\$30,996	\$20,868	\$168,127	673,835	-\$2,404	\$1,338,249
17	-	-\$13,801	\$30,981	\$20,857	\$172,552	673,496	\$210,589	\$1,548,839
18	-	-\$14,077	\$30,965	\$20,847	\$177,091	673,156	\$214,826	\$1,763,665
19	-	-\$14,358	\$30,950	\$20,836	\$181,747	672,817	\$219,174	\$1,982,839
20	-	-\$14,646	\$30,934	\$20,826	\$186,522	672,477	\$223,637	\$2,206,475
21	-	-\$14,939	-	-	\$191,421	672,138	\$176,483	\$2,382,958
22	-	-\$15,237	-	-	\$196,446	671,798	\$181,209	\$2,564,167
23	-	-\$15,542	-	-	\$201,600	671,459	\$186,058	\$2,750,225
24	-	-\$15,853	-	-	\$206,886	671,119	\$191,033	\$2,941,258
25	-	-\$16,170	-	-	\$212,309	670,780	\$196,139	\$3,137,397
Totals:	-\$1,233,729	-\$530,873	\$621,646	\$418,517	\$3,861,836	16,871,336	\$3,137,397	-

Appendix Q – Building Timeline

Building Name	Campus	Targeted Renovation	Recommended Upgrade Bundle
150 Wilder - Desmarais House	South Campus	2045-2050	BAU
820 Broadway	South Campus	2045-2050	BAU
Allen House	South Campus	2045-2050	BAU
Ames Textile	East Campus	2045-2050	Good*
Ball Hall	North Campus	2020-2025	Best
Bourgeois Hall	East Campus	2040-2045	BAU
Campus Recreation Center	East Campus	2040-2045	BAU
Charles Hoff Alumni Scholarship Center	East Campus	2045-2050	BAU
Coburn Hall	South Campus	2040-2045	BAU
Concordia Hall	South Campus	2035-2040	Best
Costello Athletic Center	North Campus	2020-2025	Best
Cumnock Hall	North Campus	2025-2030	Good
Dandeneau Hall	North Campus	2030-2035	Good
Donahue Hall	East Campus	2035-2040	BAU
Dugan Hall	South Campus	2040-2045	Good
Durgin Hall	South Campus	2040-2045	Good
Falmouth Hall	North Campus	2025-2030	Good
Fox Hall	East Campus	2045-2050	Good
Graduate and Professional Studies Center	East Campus	2045-2050	Good*
Health & Social Sciences Building	South Campus	2040-2045	Good*
Kitson Hall	North Campus	2025-2030	Good
Leitch Hall	East Campus	2040-2045	BAU
Lydon Library	North Campus	2025-2030	Good
Mahoney Hall	South Campus	2035-2040	Best
McGauvran Center	South Campus	2040-2045	Good*
O'Leary Library	South Campus	2040-2045	Good
Olney Hall	North Campus	2020-2025	Best
Olsen Hall	North Campus	2020-2025	Good
Perry Hall	North Campus	2030-2035	BAU
Pinanski Hall	North Campus	2030-2035	Good*
Pulichino Tong Business Center	North Campus	2030-2035	BAU
River Hawk Village	East Campus	2035-2040	BAU
Saab Emerging Technologies-Innovation Center	North Campus	2030-2035	BAU
Sheehy Hall	South Campus	2035-2040	Best
South Maintenance Facility	South Campus	2040-2045	BAU
Southwick Hall	North Campus	2025-2030	Good
Tsongas Center at UMass Lowell	East Campus	2035-2040	Best
UMass Lowell Bellegarde Boathouse	North Campus	2045-2050	BAU
UMass Lowell Inn & Conference Center	East Campus	2045-2050	Good*
University Crossing	East Campus	2035-2040	BAU
University Suites Residence Hall	East Campus	2040-2045	BAU
Wannalancit Business Center	East Campus	2045-2050	Good*
Weed Hall	South Campus	2035-2040	Best

*These bundles vary from those Good options defined in the Default-Alternative report. Buildings are recommended for increased air-side recovery (reflective of the "Best" upgrade option - ECM 6b and 6d - in lieu of wall insulation upgrades.

Appendix R – Soft Cost Factors

Cost	Percentage Increase
General conditions	12%
Contractor OH&P	8%
Insurance	4%
Design Contingency	20%
Change Order Contingency	10%
Owner Construction Contingency	10%
Design Services	10%
Construction Mgmt	3%
Escalation	3.5%
Discount Rate	5%

DRAFT